




PLAN
1:50

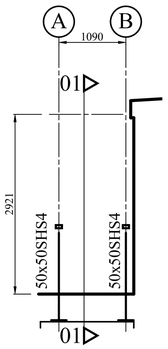


ELEVATION
(GRIDLINE 01)
1:50

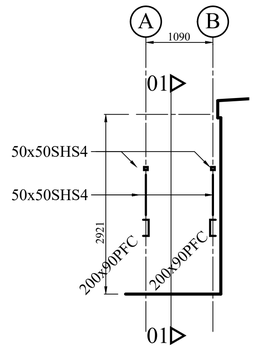


ELEVATION
(GRIDLINE 02)
1:50

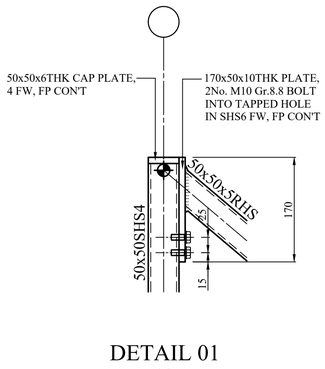


DETAIL 01
1:5




DETAIL 03
1:5




DETAIL 03
1:5

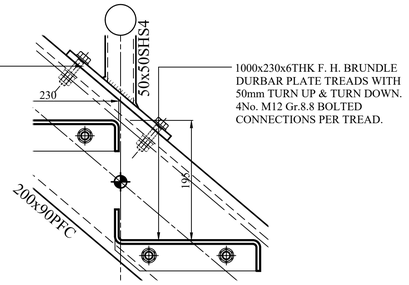


DETAIL 04
1:5

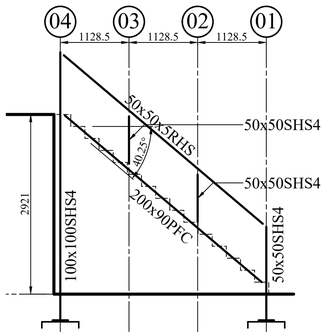


ELEVATION
(GRIDLINE A & B)
1:50

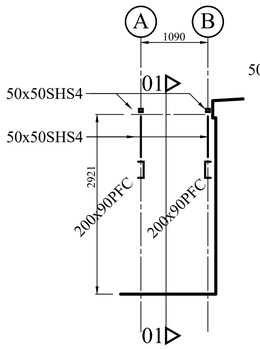


ELEVATION
(GRIDLINE 03)
1:50

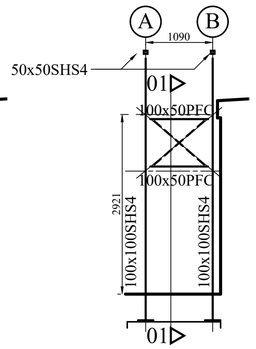


ELEVATION
(GRIDLINE 04)
1:50

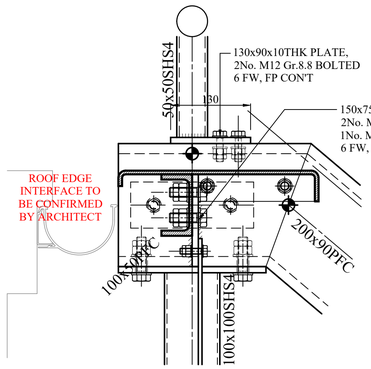


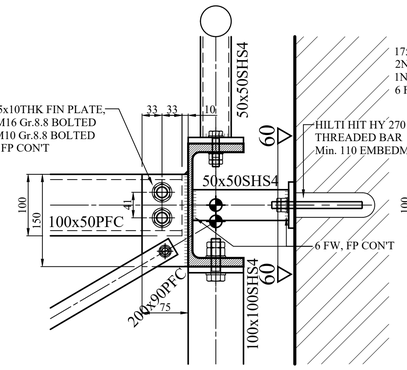


DETAIL 05
1:5

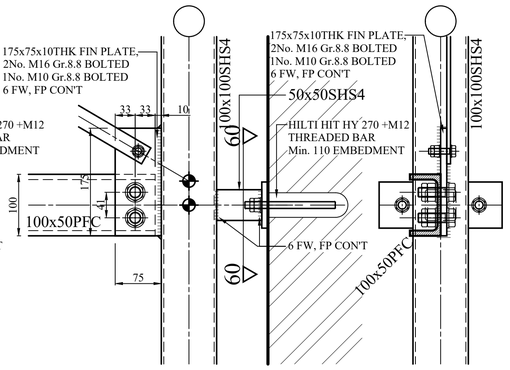


DETAIL 06
1:5

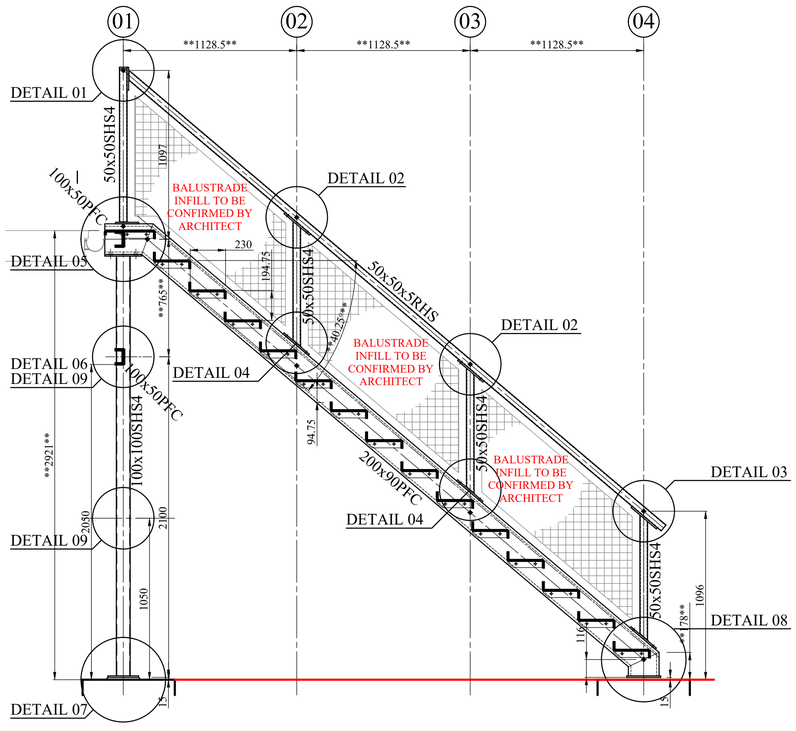


SECTION 01
1:20

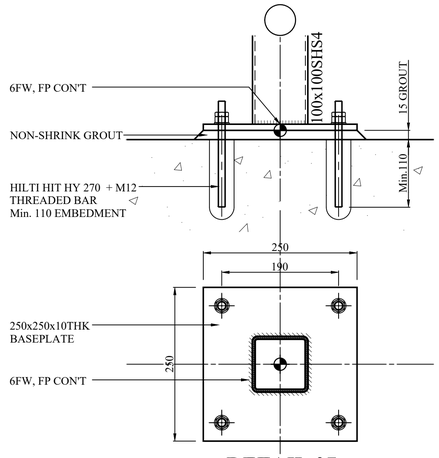

DETAIL 07
1:5

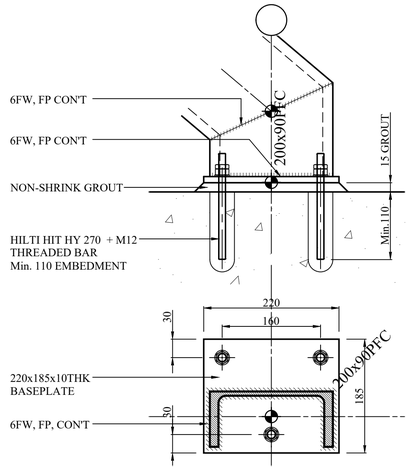


DETAIL 08
1:5



DETAIL 09
1:5

RESIDUAL RISKS

ALL TEMPORARY WORKS ARE THE RESPONSIBILITY OF THE CONTRACTOR. ALL TEMPORARY WORKS TO BE DESIGNED & DETAILED BY THE CONTRACTOR. SHORING/PROPPING ARRANGEMENTS TO BE ADEQUATE TO SUPPORT ALL APPLIED LOADS AND CONSIDERATION GIVEN TO THE ADJACENT STRUCTURE IN THE TEMPORARY CONDITION.

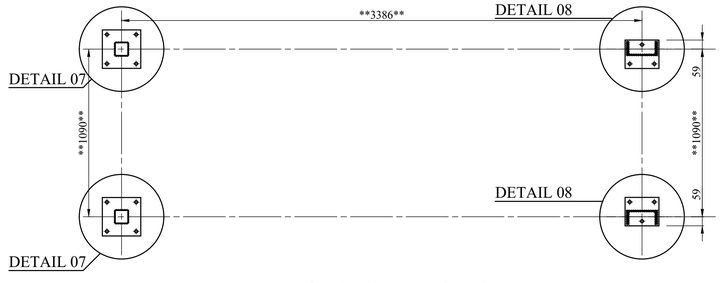

BASEPLATE PLAN
1:20

NOTES

DO NOT SCALE FROM THIS DRAWING.

ALL LEVELS IN METRES UNLESS NOTED OTHERWISE ON DRAWING.

1. ALL DIMENSIONS AND LEVELS TO BE CHECKED ON SITE. PRIOR TO UNDERTAKING ANY WORKS, ORDERING MATERIALS OR FABRICATING ANY COMPONENTS.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT ENGINEER'S AND ARCHITECT'S DRAWINGS AND RELEVANT SPECIFICATION CLAUSES.
3. ALL STRUCTURAL STEEL WORK IS TO BE IN ACCORDANCE WITH THE RELEVANT BS CODES OF PRACTICE, IN PARTICULAR BS 5950, BS EN 10025 OR BS EN 10210 AS APPROPRIATE & THE NBS ISSUED. STEEL TO BE GRADE S275 UNLESS NOTED OTHERWISE. SERIAL SIZE OF BEAMS AND STANCHIONS ARE SHOWN BUT THEY DO NOT TAKE INTO ACCOUNT ANY ROLLING TOLERANCES.
4. THE PARTICULAR QUALITY FOR EACH ELEMENT SHALL BE AS FOLLOWS:

   QUALITY JR FOR MATERIALS OF THICKNESS < 20MM
   QUALITY JR FOR MATERIALS OF THICKNESS > 20MM < 40MM
   QUALITY JO FOR ROLLED HOLLOW SECTIONS
5. ALL STEELWORK/CONTACT SURFACES TO BE PAINTED AS SPECIFICATION.
6. ALL SHOP AND SITE BOLTS ARE TO BE SHERADISED TO BS4921:CLASS 1 HOLDING DOWN BOLTS AND WASHER PLATES ARE TO BE SUPPLIED SELF COLOUR, BY STEELWORK CONTRACTOR. THE BOLTS ARE TO BE SET LOOSELY IN SQUARE OR ROUND SLEEVES AND ACCURATELY SET OUT AND LEVELLED BY THE GENERAL CONTRACTOR. NUTS SHALL BE KEPT WELL GREASED AND THE GENERAL CONTRACTOR WILL ENSURE THAT THE BOLTS REMAIN LOOSE AND THAT NO FOREIGN MATTER ENTERS THE SLEEVES TO IMPAIR THE FREE PLAY OF THE BOLTS.
7. AFTER ALL STEELWORK HAS BEEN LINED LEVELLED AND PLUMBED BY THE STEELWORK CONTRACTOR AND ACCEPTED BY THE GENERAL CONTRACTOR, THE GENERAL CONTRACTOR WILL GROUT UP IN ACCORDANCE WITH BS5950.

NOT FOR CONSTRUCTION

SUITABILITY	REV	DATE	DESCRIPTION	Org	Chk'd	App'd	Auth.
S2	P01	18.10.24	FIRST ISSUE				

PROJECT TITLE:
THE MINER'S RESCUE STATION

DRAWING TITLE:
EXTERNAL STAIRCASE

DRAWING REF:
00024W-BRP-XX-XX-DR-C-0019

ORIGINATOR:	DATE:	SCALE @ A1:	SUITABILITY:	REVISION:
D.P.	18.10.24	1:50	S2	P01

Bingham Rawlings Partnership Limited
Consulting Civil & Structural Engineers
Jones Suite
2 Grosvenor Road,
Wrexham, LL11 1BU
Telephone:(01978) 353522
e-mail : consult@brp2000.co.uk

BRP BINGHAM RAWLINGS PARTNERSHIP

© BINGHAM RAWLINGS PARTNERSHIP LTD 2024