
Design Plan - 11Kv NCD @ 5 Ridley Woods Court, Wrexham, LL13 9UW

11KV NCD @
5 Ridley Woods Court
Ridley Wood,
Wrexham
LL13 9UW

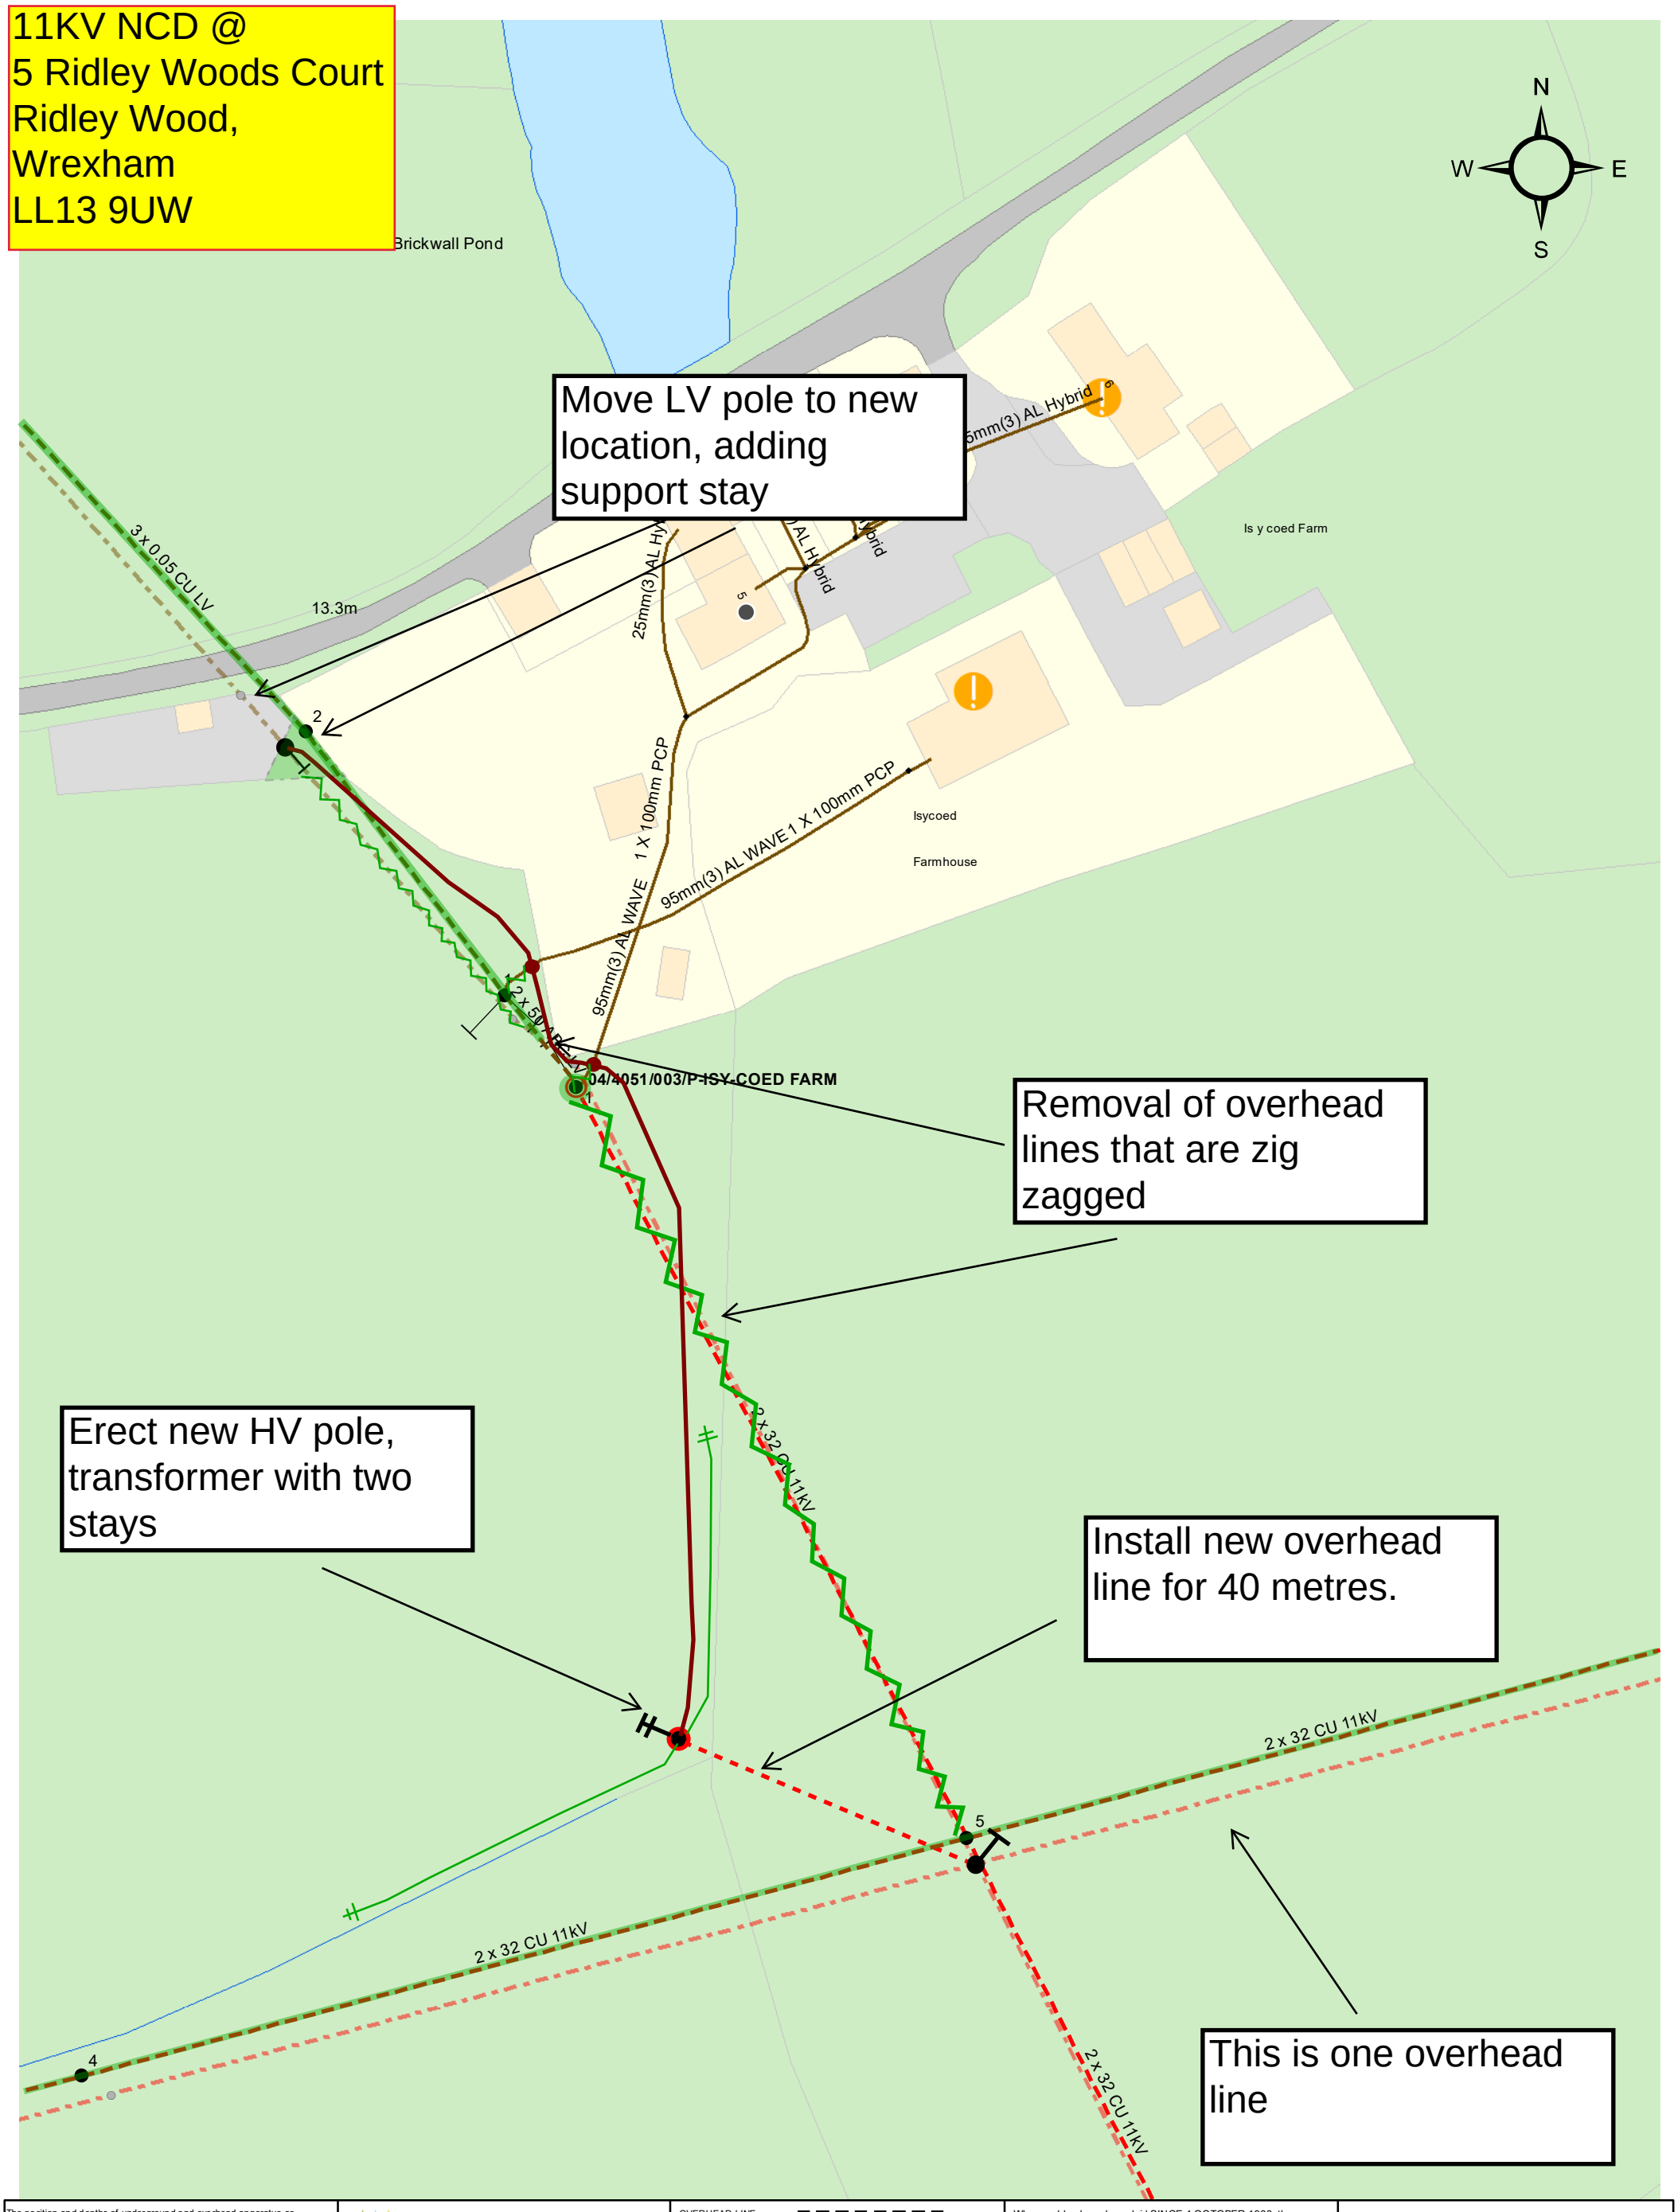

The position and depths of underground and overhead apparatus as indicated on this plan are approximate and are intended for guidance only. The depths may have changed if the land surface levels have altered. You are also informed that the plan may not show, or may inaccurately show, individual property services and services to street lighting installations. The onus of locating the apparatus precisely before commencing any excavations or other works in the immediate vicinity therefore rests entirely upon the person undertaking or responsible for those works. Before any such works are undertaken the precise location of the apparatus and cables should therefore be ascertained by suitable means. In the event of an emergency or for further assistance please contact 0800-092-9290 (ScottishPower area) or 0800-001-5400 (SP Manweb area).

Reproduced from (or based upon) Ordnance Survey maps by PowerSystems with the permission of Ordnance Survey on behalf of the controller of HMSO. (c) Crown Copyright Power Systems 100019036.

SP ENERGY NETWORKS
On behalf of SP Manweb plc

SP Manweb plc
Registered Office: c/o PowerSystems
3 Prenton Way, Prenton, CH43 3ET
Registered in England and Wales No 2366937

OVERHEAD LINE

UNDERGROUND CABLES
In Use
Out of Use
Assumed route

VOLTAGE COLOUR KEY
EHV 132kV BLUE
33kV GREEN
HV RED
LV BROWN

Where cables have been laid SINCE 1 OCTOBER 1988, the following depths in mm apply (to the tops of cables or ducts) UNLESS OTHERWISE SHOWN, but see comments. (TO TOP OF CABLE, ADD 75mm FOR BOTTOM OF TRENCH)

	EHV	HV	LV
IN FOOTPATHS :	775	600	450
ACROSS ROADS :	775	700	600
ALONG ROADS :	775	700	600
AGRICULTURAL :	910	910	910

Your attention is drawn to the Health and Safety Executive Booklet HSG47, available from HSE.

DATE	12/03/2024
SCALE	1 : 750
MAP REFERENCE	340452,351435

0 2.25 4.5 9 13.5 18 Metres