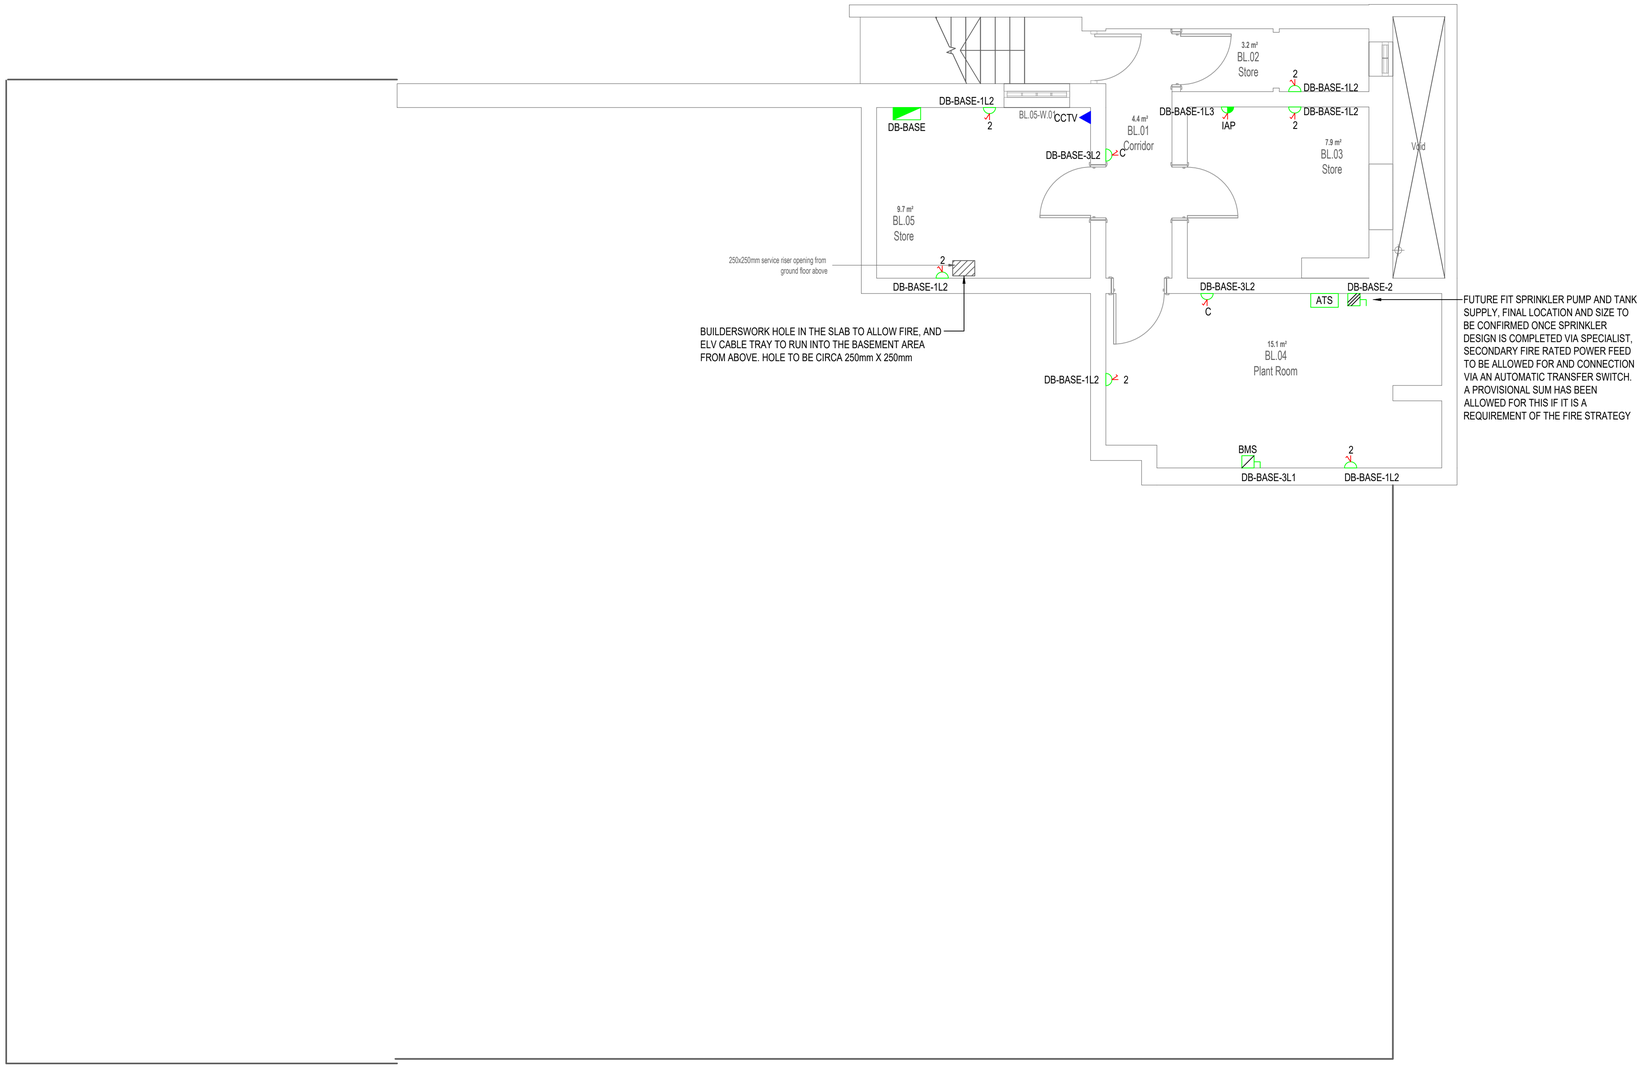


POWER AND DATA LEGEND	
SYMBOL	DESCRIPTION
2	13A TWIN SWITCHED SOCKET OUTLET USB DENOTES WITH USB SOCKET
	13A SWITCHED FUSED CONNECTION UNIT
	13A UNSWITCHED FUSED CONNECTION UNIT
	3-PIN SPN COMMANDO SOCKET
	ISOLATING SWITCH SP&N
	ISOLATING SWITCH TP&N
	THREE PHASE (TPN) DISTRIBUTION BOARD
	THREE PHASE (TPN) SECTION BOARD
M	METER
	2-COMPARTMENT UPVC HIGH IMPACT DADO TRUNKING
	DADO TRUNKING DROP SECTION
	SINGLE DATA RJ45 OUTLET ("2" DENOTES TWIN)

ABBREVIATIONS	
ACO	ACCESS CONTROL SUPPLY
AD	AUTO DOOR SUPPLY
C	CLEANERS SOCKET
DRAP	DISABLED REFUGE ALARM PANEL
DA	DISABLED ALARM SUPPLY
EF	EXTRACT FAN SUPPLY
EPH	ELECTRIC PANEL HEATER SUPPLY
FAP	FIRE ALARM PANEL
IND	INDUCTION LOOP SUPPLY
MSB	MAIN SWITCH BOARD
MVHR	MECHANICAL VENTILATION HEAT RECOVERY
ODH	OVER DOOR HEATER
LCM	LIGHTING CONTROL MODULE
WH	WATER HEATER
WIFI	WIFI HUB SUPPLY
HB	HEATER BATTERY
ACT	ACTUATOR SUPPLY
WC	WATER COOLER SUPPLY
DW	DISHWASHER SUPPLY
CCTV	CCTV CAMERA SUPPLY
IAP	INTRUDER ALARM PANEL
HD	HAND DRYER

This document and its contents are the property of the Purchaser/Employer and Crookes Walker Consulting. They may not be copied or reproduced in any way, in part or whole, without prior written approval of both parties. Violations will result in legal action.
This drawing shall be read in conjunction with the CWC Mechanical and / or Electrical Specification(s).
DO NOT SCALE FROM THIS DRAWING

DESIGNERS RISK ASSESSMENT

REFER TO APPENDIX 1 OF M&E SPECIFICATION FOR DESIGNERS RISK ASSESSMENT SCHEDULE

DRAWING BACKGROUND(S):

NOTES:

1. DO NOT SCALE OFF THIS DRAWING.
2. ALL DRAWINGS TO BE READ IN CONJUNCTION WITH THE RELEVANT MECHANICAL AND / OR ELECTRICAL SPECIFICATION(S).
3. ALL DIMENSIONS SHOWN ARE IN mm UNLESS SHOWN OTHERWISE.

SMALL POWER NOTES:

1. ELECTRICAL INSTALLATION TO BE INSTALLED IN ACCORDANCE WITH BS 7671
2. THE CONTRACTOR SHALL UNDERTAKE A DETAILED WIFI ANALYSIS AND OMIT OR SUPPLEMENT WIFI POINTS WHERE REQUIRED PRIOR TO TENDER.
3. DATA SERVICES SHALL BE CABLED TO THE CLOSEST DATA CABINET.
4. DATA CABINETS SHALL BE SERVED VIA XLPE/SWA/LSF CABLING AND TERMINATE INTO AN ADEQUATELY SIZED COMMANDO SOCKED. THIS CIRCUIT SHALL NOT BE PROTECTED BY AN RCD WHERE POSSIBLE. THERE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING A RISK ASSESSMENT FOR THIS OMISSION AS PER THE REQUIREMENTS OF BS7671.
5. CLEAN EARTHS SHALL BE PRESENTED TO ALL DATA RACKS.
6. A DEDICATED EARTH BAR SHALL BE INSTALLED AT SOURCE. THIS SHALL INCLUDE A REMOVABLE TEST LINK - THE EARTH BARD SHALL BE A FURESE 8 WAY COOPER EARTH BAR (EQUAL AND APPROVED).
7. CONTRACTOR TO PROVIDE 32A SUPPLY TO LOCAL COMMANDO SOCKET TO SUPPLY COMMS CABINET. THE SUPPLY SHALL BE INSTALLED AT HIGH LEVEL AS NOT TO BE TAMPERED WITH. SUPPLY CIRCUIT TO BE PROVIDED WITH CLEAN EARTH
8. CONTRACTOR TO PROVIDE COMMS CABINET AS PER THE CLIENTS REQUIREMENTS
9. DADO TRUNKING IN GL.01 AND GL.04 TO BE AGREED INLINE WITH HERITAGE AND CADW IN TERMS OF FIXING AND LOCATION TO FURNITURE
10. FINAL KITCHEN EQUIPMENT LAYOUT AWAITED. FINAL LOADS AND LOCATIONS OF ELECTRICAL ITEMS TO BE REVIEWED ONCE KITCHEN DESIGN IS IN PLACE
11. ALL POWER SUPPLIES AND SOCKETS IN THE BASEMENT ARE TO BE MOUNTED AT HIGH LEVEL CIRCA 2200mm AFFL

Rev	Date	Description	Eng	Chk
C1	17.03.25	CONSTRUCTION ISSUE	SB	GR
T4	19.11.24	UPDATED WITH CIRCUIT REFERENCES	TN	SB
T3	08.11.24	UPDATED INLINE WITH UPDATED XREF	SB	GR
T2	16.10.24	UPDATED INLINE WITH LATEST XREF	SB	GR
T1	27.09.24	TENDER ISSUE	SB	GR

CWC crookes walker consulting
Suite 9a, Bloc, 17 Marble Street
Manchester M2 3AW
Tel: 0161 834 9999
The Plaza, Old Hall Street,
Liverpool L3 9QJ
Tel: 0151 600 5409
E-mail: admin@cwcon.co.uk
Website: www.cwcon.co.uk

Client: wrexham COUNTY BOROUGH COUNCIL / CYNGOR BWRDEISTREF SIROL wrecsam

Project: WREXHAM OLD LIBRARY REFURBISHMENT

Drawing Title: PROPOSED BASEMENT POWER AND DATA LAYOUT

Status: CONSTRUCTION

Project No.	Drawn	Scale / Paper Size
3327	BW	1:50 @ A1

Drawing No.: 3327-CWC-XX-B1-DR-E-6201 Rev: C1