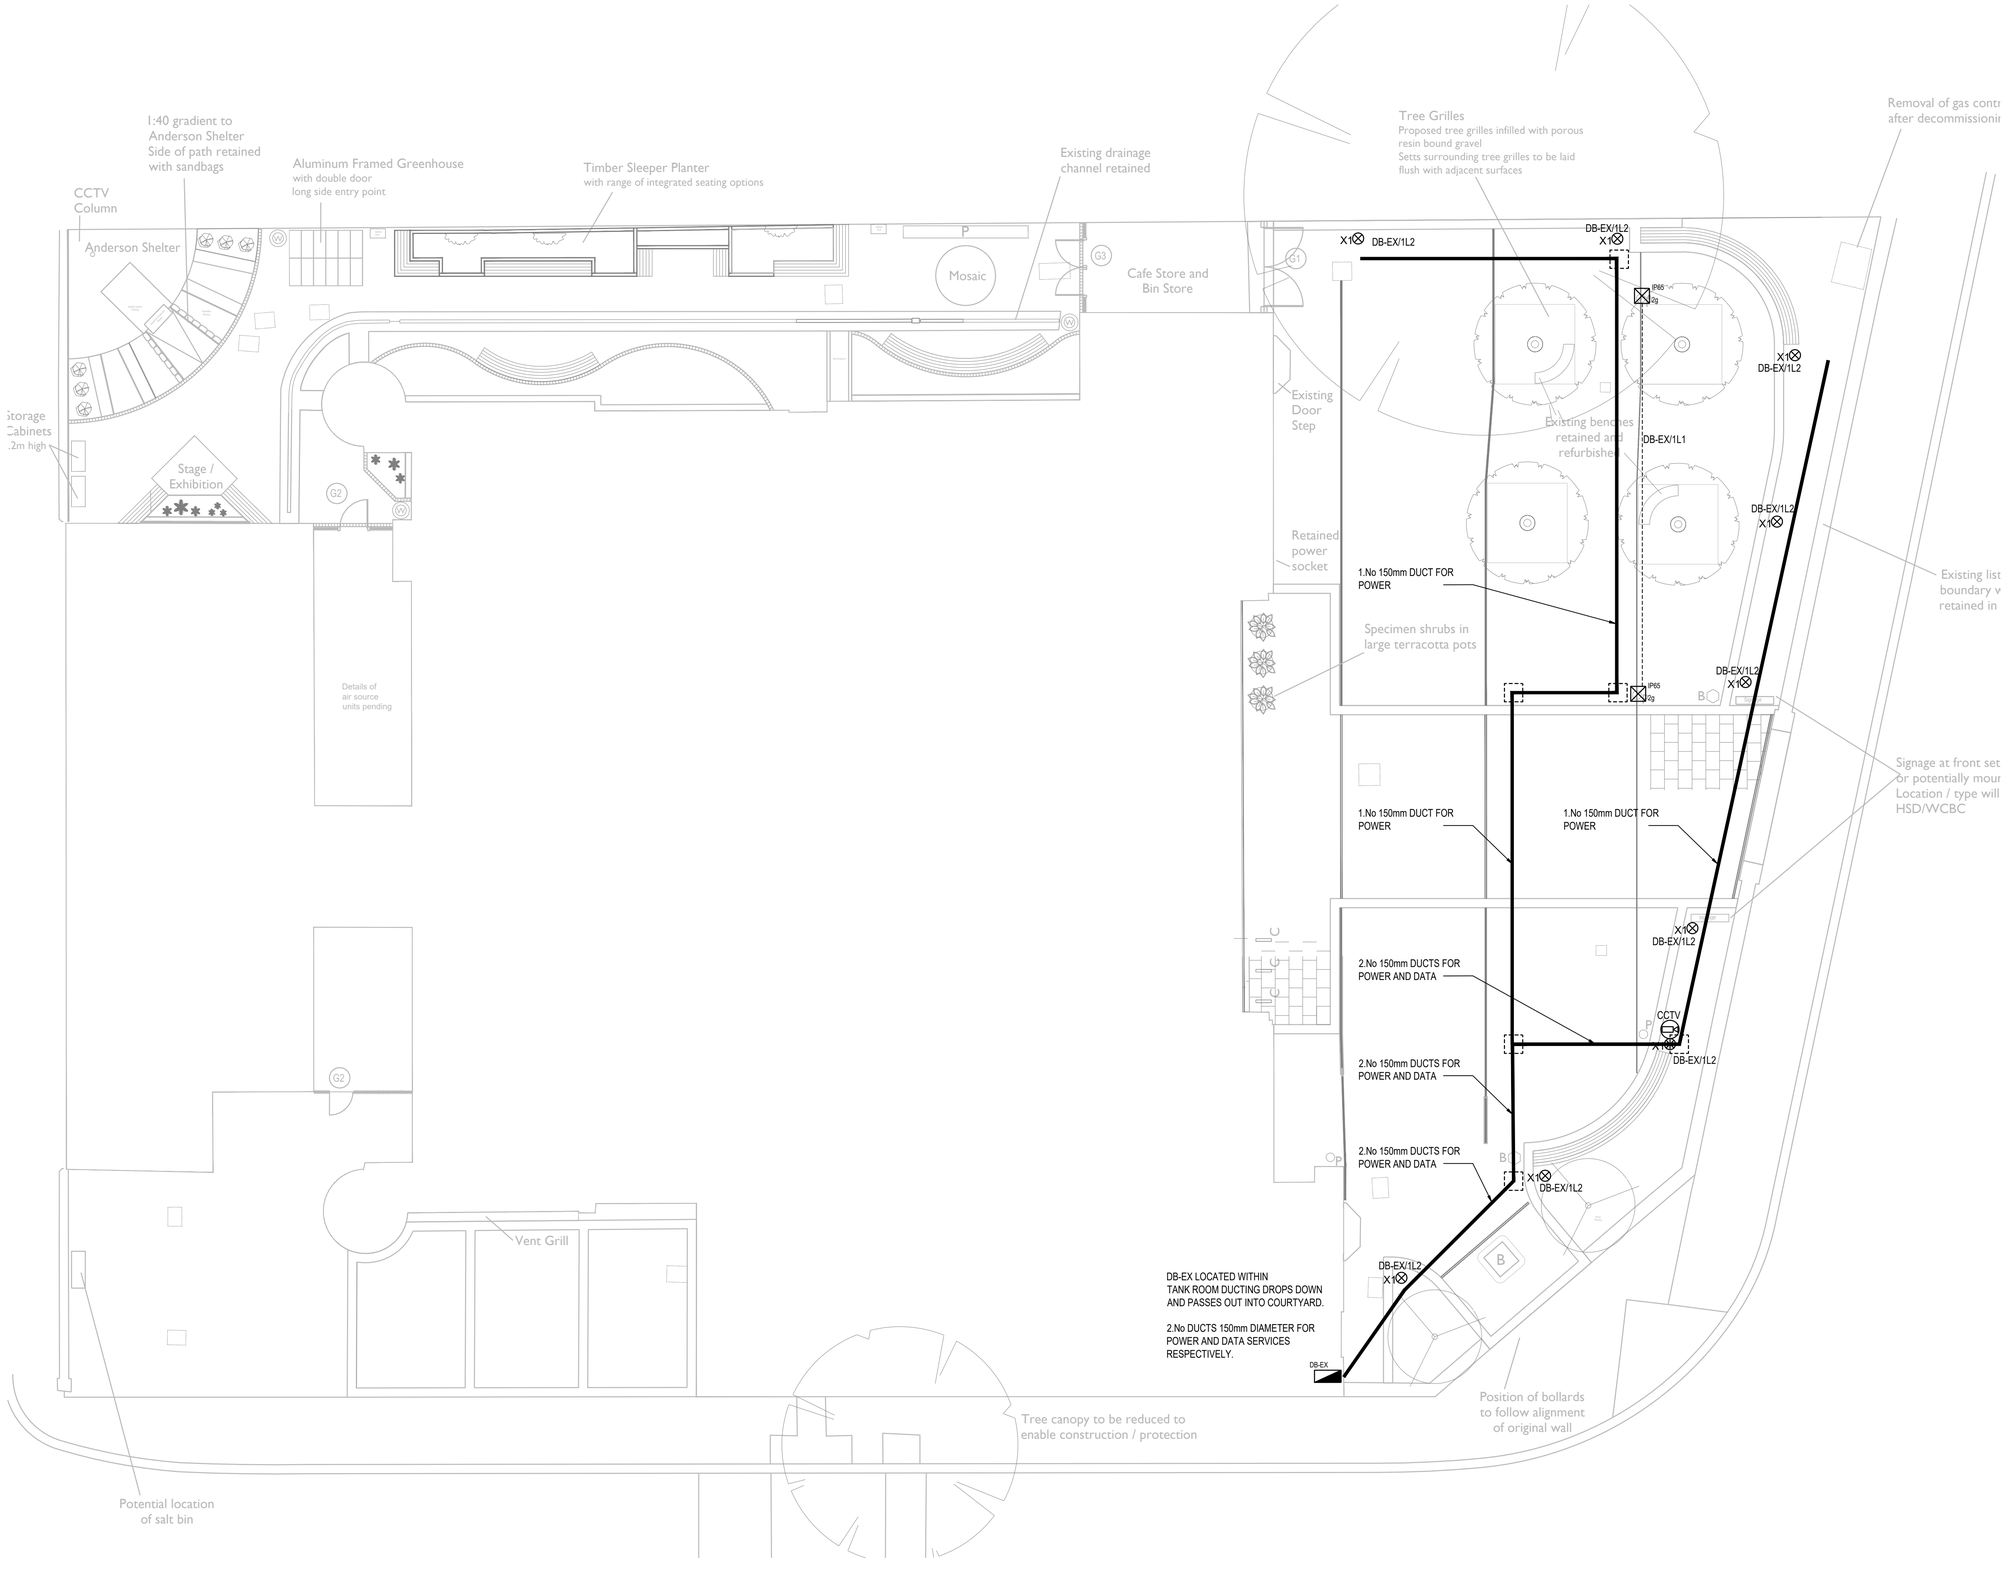


NOTES

1. ALL SERVICE ROUTES DETAILED ARE APPROXIMATE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT ROUTES AND POSITIONS OF ALL INSTALLED SERVICES AND EQUIPMENT.

2. THE EXACT POSITION OF ALL SERVICES AND EQUIPMENT SHALL BE AGREED BY THE CONTRACT ADMINISTRATOR.

3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FULLY CO-ORDINATING ANY SERVICES INSTALLED WITH THE BUILDING FABRIC AND SERVICES INSTALLED BY OTHERS.

4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL MECHANICAL, ELECTRICAL, ARCHITECTURAL AND STRUCTURAL DRAWINGS, CONTRACT DOCUMENTATION AND SPECIFICATION FOR THE WORKS.

5. THIS DRAWING FORMS PART OF THE SPECIFICATION FOR THE WORKS.

6. ALL DIMENSIONS SHOWN ARE IN MILLIMETRES.

7. DO NOT SCALE FROM THIS DRAWING.

8. EXISTING SERVICES SHOWN FAINT.

LEGEND

- 150mm DUCTING
- X1 — DW WINDSOR SILKA LIGHT COLUMN
- CCTV — PAN TILT ZOOM CCTV
- DB — DISTRIBUTION BOARD
- IP65 2g — IP65 RATED IN GROUND FLOOR BOX WITH 1.No DOUBLE SOCKET OUTLET
- 600 x 600 DRAW PIT

REV	DATE	REVISION DESCRIPTION
A	19-06-24	CONSTRUCTION ISSUE
T1	27-11-23	STAGE 4 TENDER ISSUE
P1	13-10-23	PRETENDER ISSUE

CLIENT
WREXHAM MUSEUM

PROJECT
WREXHAM MUSEUM

TITLE
ELECTRICAL SERVICES -
PROPOSED EXTERNAL SERVICES

Parker Wilson Consulting

Burnham House, 373 Bury New Road,
Manchester. M25 1AW.
T: 0161 773 1177 F: 0161 773 9977
manchester@parker-wilson.co.uk

6th Floor, 72 ,Cannon Street.
London EC4N 6AE.
T: 0207 251 4500
london@parker-wilson.co.uk

www.parker-wilson.co.uk

DRAWN BY	CHECKED	APPROVED BY
AL	BP	GW
SCALE	SIZE	DATE
1:100	A1	October 2023
DRAWING No		REV
4114-0-E308		A

CONSTRUCTION