
SEE DRAWING No. 4114-G-E303-S1

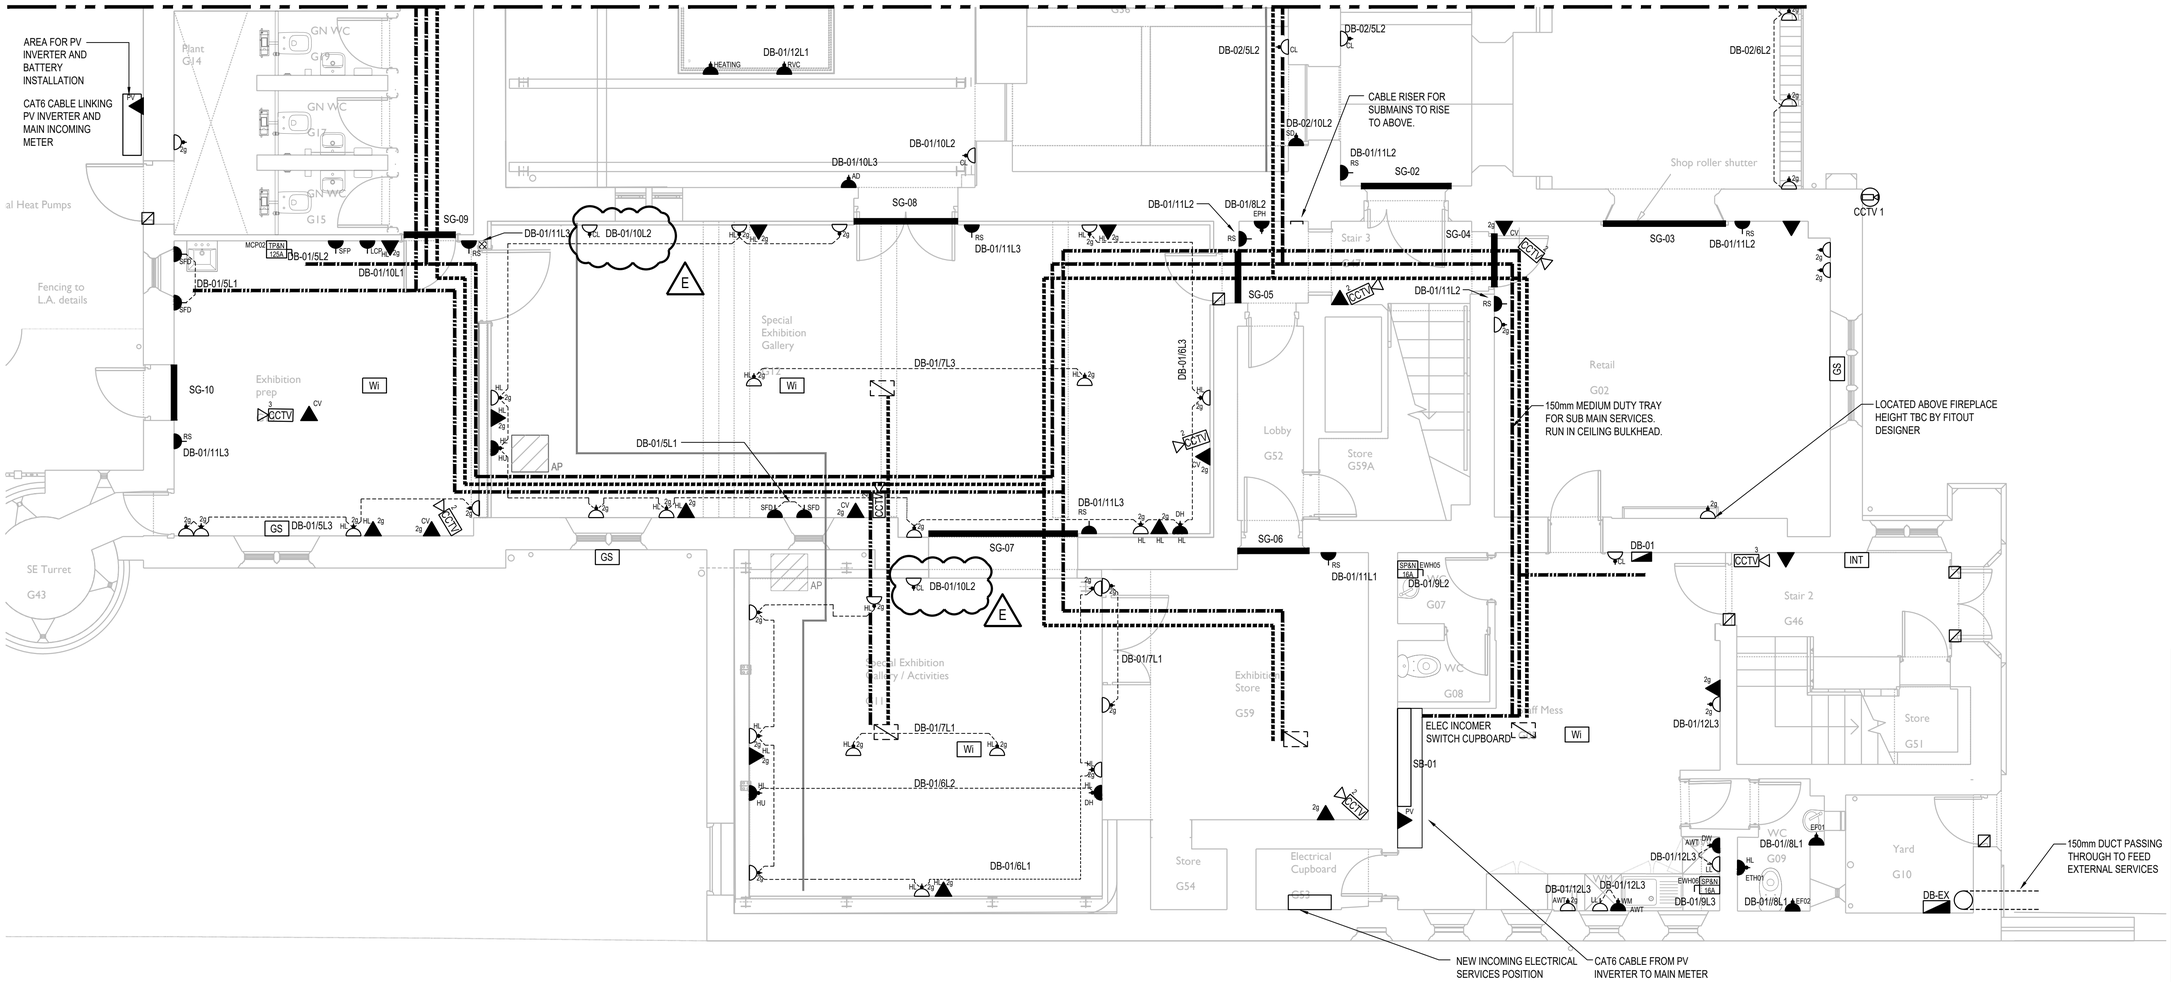

NOTES

1. ALL SERVICE ROUTES DETAILED ARE APPROXIMATE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE EXACT ROUTES AND POSITIONS OF ALL INSTALLED SERVICES AND EQUIPMENT.

2. THE EXACT POSITION OF ALL SERVICES AND EQUIPMENT SHALL BE AGREED BY THE CONTRACT ADMINISTRATOR.

3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR FULLY CO-ORDINATING ANY SERVICES INSTALLED WITH THE BUILDING FABRIC AND SERVICES INSTALLED BY OTHERS.

4. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL MECHANICAL, ELECTRICAL, ARCHITECTURAL AND STRUCTURAL DRAWINGS, CONTRACT DOCUMENTATION AND SPECIFICATION FOR THE WORKS.

5. THIS DRAWING FORMS PART OF THE SPECIFICATION FOR THE WORKS.

6. ALL DIMENSIONS SHOWN ARE IN MILLIMETRES.


7. DO NOT SCALE FROM THIS DRAWING.

8. EXISTING SERVICES SHOWN FAINT.

LEGEND

- DISTRIBUTION BOARD.
- 150mm CABLE BASKET FOR LIGHTING AND POWER WIRING
- MEDIUM DUTY GALVANISED CABLE TRAY FOR LV SUBMAINS
- 300mm CABLE BASKET FOR ELV SERVICES
- 2 COMPARTMENT SURFACE GALVANISED TRUNKING.
- 3 COMPARTMENT DADO TRUNKING.
- DADO SERVICE DROPPER.
- FB1 FLOOR BOX TO TILL. SERVICES TBC.
- FB2 FLOOR BOX WITH 2 No. SWITCHED SOCKET OUTLETS.
- FB3 FLOOR BOX WITH 2 No. SWITCHED SOCKET OUTLETS & 2 No. DATA OUTLET.
- FB4 FLOOR BOX WITH 4 No. SWITCHED SOCKET OUTLETS & 2.No DATA OUTLETS.
- FB5 FLOOR BOX WITH 6 No. SWITCHED SOCKET OUTLETS & 2 No. DATA OUTLETS.
- FB6 FLOOR BOX WITH 4 No. SWITCHED SOCKET OUTLETS
- FB7 FLOOR BOX WITH 3 No. SWITCHED SOCKET OUTLETS & 1 No. DATA OUTLET.
- FB8 FLOOR BOX WITH 4 No. SWITCHED SOCKET OUTLETS.
- FBEX EXISTING FLOOR BOX.
- Xg 13A SWITCHED SOCKET OUTLET. Xg = No. OF GANGS.
- CL CLEANERS SOCKET (LOW LEVEL).
- 13A SWITCHED FUSED SPUR.
- AV COMMANDO SOCKET OUTLET.
- XXA / XXA ISOLATOR. XX&N = TP OR SP&N XXA = RATING AMPS.
- Xg RJ45 DATA OUTLET Xg = No. OF GANGS.
- Wi WIRELESS ACCESS POINT.
- BG BREAK GLASS.
- PB PUSH BUTTON.
- RS NURSE CALL - RESET SWITCH FOR DISABLED CALL.
- NURSE CALL - OVERDOOR UNIT.
- NURSE CALL - PULLCORD UNIT WITH REASSURANCE.
- PIR INTRUDER ALARM MOTION SENSOR.
- CCTV OBSERVATION SPEC.
- CCTV RECOGNITION SPEC.
- CCTV IDENTIFICATION SPEC.
- DOOR CONTACTOR.
- GS BREAK GLASS SENSOR.
- MAG MAGNETIC LOCK
- INT INTRUDER ALARM KEYPAD
- SEC SECURITY PANEL
- MVHR XX MECHANICAL VENTILATION HEAT RECOVERY UNIT.
- AP EX EXISTING ACCESS PANEL.
- AV AUDIO VISUAL.

DSB	DISABLED CALL SYSTEM.
FAP	FIRE ALARM PANEL.
CV	CEILING VOID.
HL	HIGH LEVEL.
AD	AUTOMATIC DOOR
SD	SLIDING DOOR
RS	ROLLER SHUTTER
RVC	ROOF VENTILATOR CONTROLLER

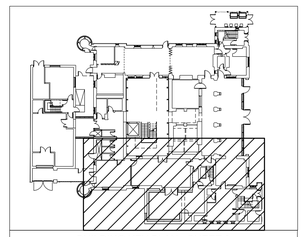

BUILDING KEY PLAN - SHEET 3

CONSTRUCTION

REV	DATE	REVISION DESCRIPTION
E	11-04-25	CONSTRUCTION ISSUE
D	01-04-25	CONSTRUCTION ISSUE
C	20-02-25	ROLLER SHUTTER SUPPLIES ADDED AND CONTAINMENT ROUTE UPDATED
B	11-11-24	CONSTRUCTION ISSUE
A	19-06-24	CONSTRUCTION ISSUE
T2	05-03-24	STAGE 4 TENDER ISSUE
T1	27-11-23	STAGE 4 TENDER ISSUE
P2	29-09-23	PRETENDER ISSUE
P1	21-08-23	ISSUED FOR INFORMATION

CLIENT
WREXHAM MUSEUM

PROJECT
WREXHAM MUSEUM

TITLE
ELECTRICAL SERVICES -
PROPOSED SMALL POWER, DATA LAYOUT
GROUND FLOOR - SHEET 3 OF 3

Parker Wilson Consulting

Burnham House, 373 Bury New Road,
Manchester. M25 1AW.
T: 0161 773 1177 F: 0161 773 9977
manchester@parker-wilson.co.uk

6th Floor, 72 ,Cannon Street.
London EC4N 6AE.
T: 0207 251 4500
london@parker-wilson.co.uk

www.parker-wilson.co.uk

DRAWN BY	CHECKED	APPROVED BY
BRP	AL	GW
SCALE	SIZE	DATE
1:50	A1	July 2023
DRAWING No		REV
4114-G-E303-S3		E