


DOOR SCHEDULE - TYPE M					WALL TYPES	
REF	TYPE	HEIGHT	WIDTH	COMMENTS		
ALL GLAZING BETWEEN FFL AND ROOMS IN WALLS AND PARTITIONS AND BETWEEN FFL AND 1500MM IN A DOOR OR IN A SIDE PANEL CLOSE TO EITHER EDGE OF THE DOOR SHALL BE LAMINATED (NOT TOUCHED) GLASS AS DEFINED IN BS6206:1981. SAFETY GLAZING TO BE PERMANENTLY MARKED TO COMPLY WITH BS 6206:1981.						
WINDOW SCHEDULE - TYPE M						
REF	TYPE	WIDTH	HEIGHT	COMMENTS		
00 - GROUND FLOOR						
D4	INT SINGLE	2110	912			
D5	INT SINGLE	2110	912			
D6	INT DOUBLE	2110	1348			
D7	INT SINGLE	2110	684			
D8	INT SINGLE	2110	836			
D9	INT SINGLE	2110	836			
XD1	ExtSgl IG XD63	2110	1023			
XD2	DoorExtDGL Glazed with reveals	2110	1585			
XD3	DoorExtDGL Glazed with reveals	2110	1585			
01 - FIRST FLOOR						
D10	INT SINGLE	2110	760			
D11	INT SINGLE	2110	836			
D12	INT SINGLE	2110	836			
D13	INT SINGLE	2110	836			
D14	INT SINGLE	2110	836			
D15	INT SINGLE	2110	836			
D16	INT SINGLE	2110	836			
D17	INT SINGLE	2110	836			
NOTE: BACKGROUND VENTILATION TO BE 8000 SQ MM TO HABITABLE ROOMS, 4000 SQ MM TO BATHROOMS AND UTILITIES, WHICH IS TO BE PROVIDED BY THE WINDOW AND EXTERNAL DOOR. TICKLE VENTS, GROUND FLOOR DOORS TO HABITABLE ROOMS AND ROOMS CONTAINING A WC, TO HAVE A MINIMUM CLEAR OPENING OF ROOM WHEN NOT APPROACHED HEAD ON AND 750MM FINISHED GAP AT THE BOTTOM TO PROVIDE REQUIRED BACKGROUND VENTILATION (PROVIDE A 20MM UNFINISHED GAP WHERE FINISHES ARE NOT LAID). ALL CYLINDER DOORS TO BE VENTED EQUIVALENT TO 600MMG.						
EXTERNAL WALL						
BRICK OR RENDER ON LAY-LITE BLOCK OUTER LEAF, 125MM CAVITY FILLED WITH SUPABEAD INSULATION (K=0.018), 100MM THERMAULITE TURBO BLOCK PLASTERBOARD ON DABS, U-VALUE = 0.20 W/M²K. IF USING THERMAULITE TN BLOCK THEN U-VALUE IS 0.21 W/M²K.						
PARTY WALL						
125MM FLEECED CAVITY WITH EACH SIDE 100MM BLOCKWORK & 12.5MM PLASTERBOARD ON DABS WITH SKIM FINISH.						
INTERNAL LOADBEARING WALL (REFER TO ENGINEERS' DETAILS)						
100MM BLOCKWORK & 12.5MM PLASTERBOARD ON DABS WITH SKIM FINISH TO BOTH SIDES.						
INTERNAL NON-LOADBEARING WALL (REFER TO ENGINEERS' DETAILS)						
TRAMER STUDS (75X38 @ 600CTRS INDICATED), 75MM COVER ACOUSTIC PARTITION ROLL (ONLY WHERE INDICATED).						
WALL FINISHED BOTH SIDES WITH 1ND LAYERS OF 12.5MM PLASTERBOARD AND SKIM FINISH UNLESS TILED.						

PRINTED:	12/10/2022 16:58:30
REV. DESCRIPTION:	DATE BY CHK.
P1 FIRST ISSUE	06/10/2022 ME DP




01 FIRST FLOOR STRUCTURAL
SCALE: 1 : 50

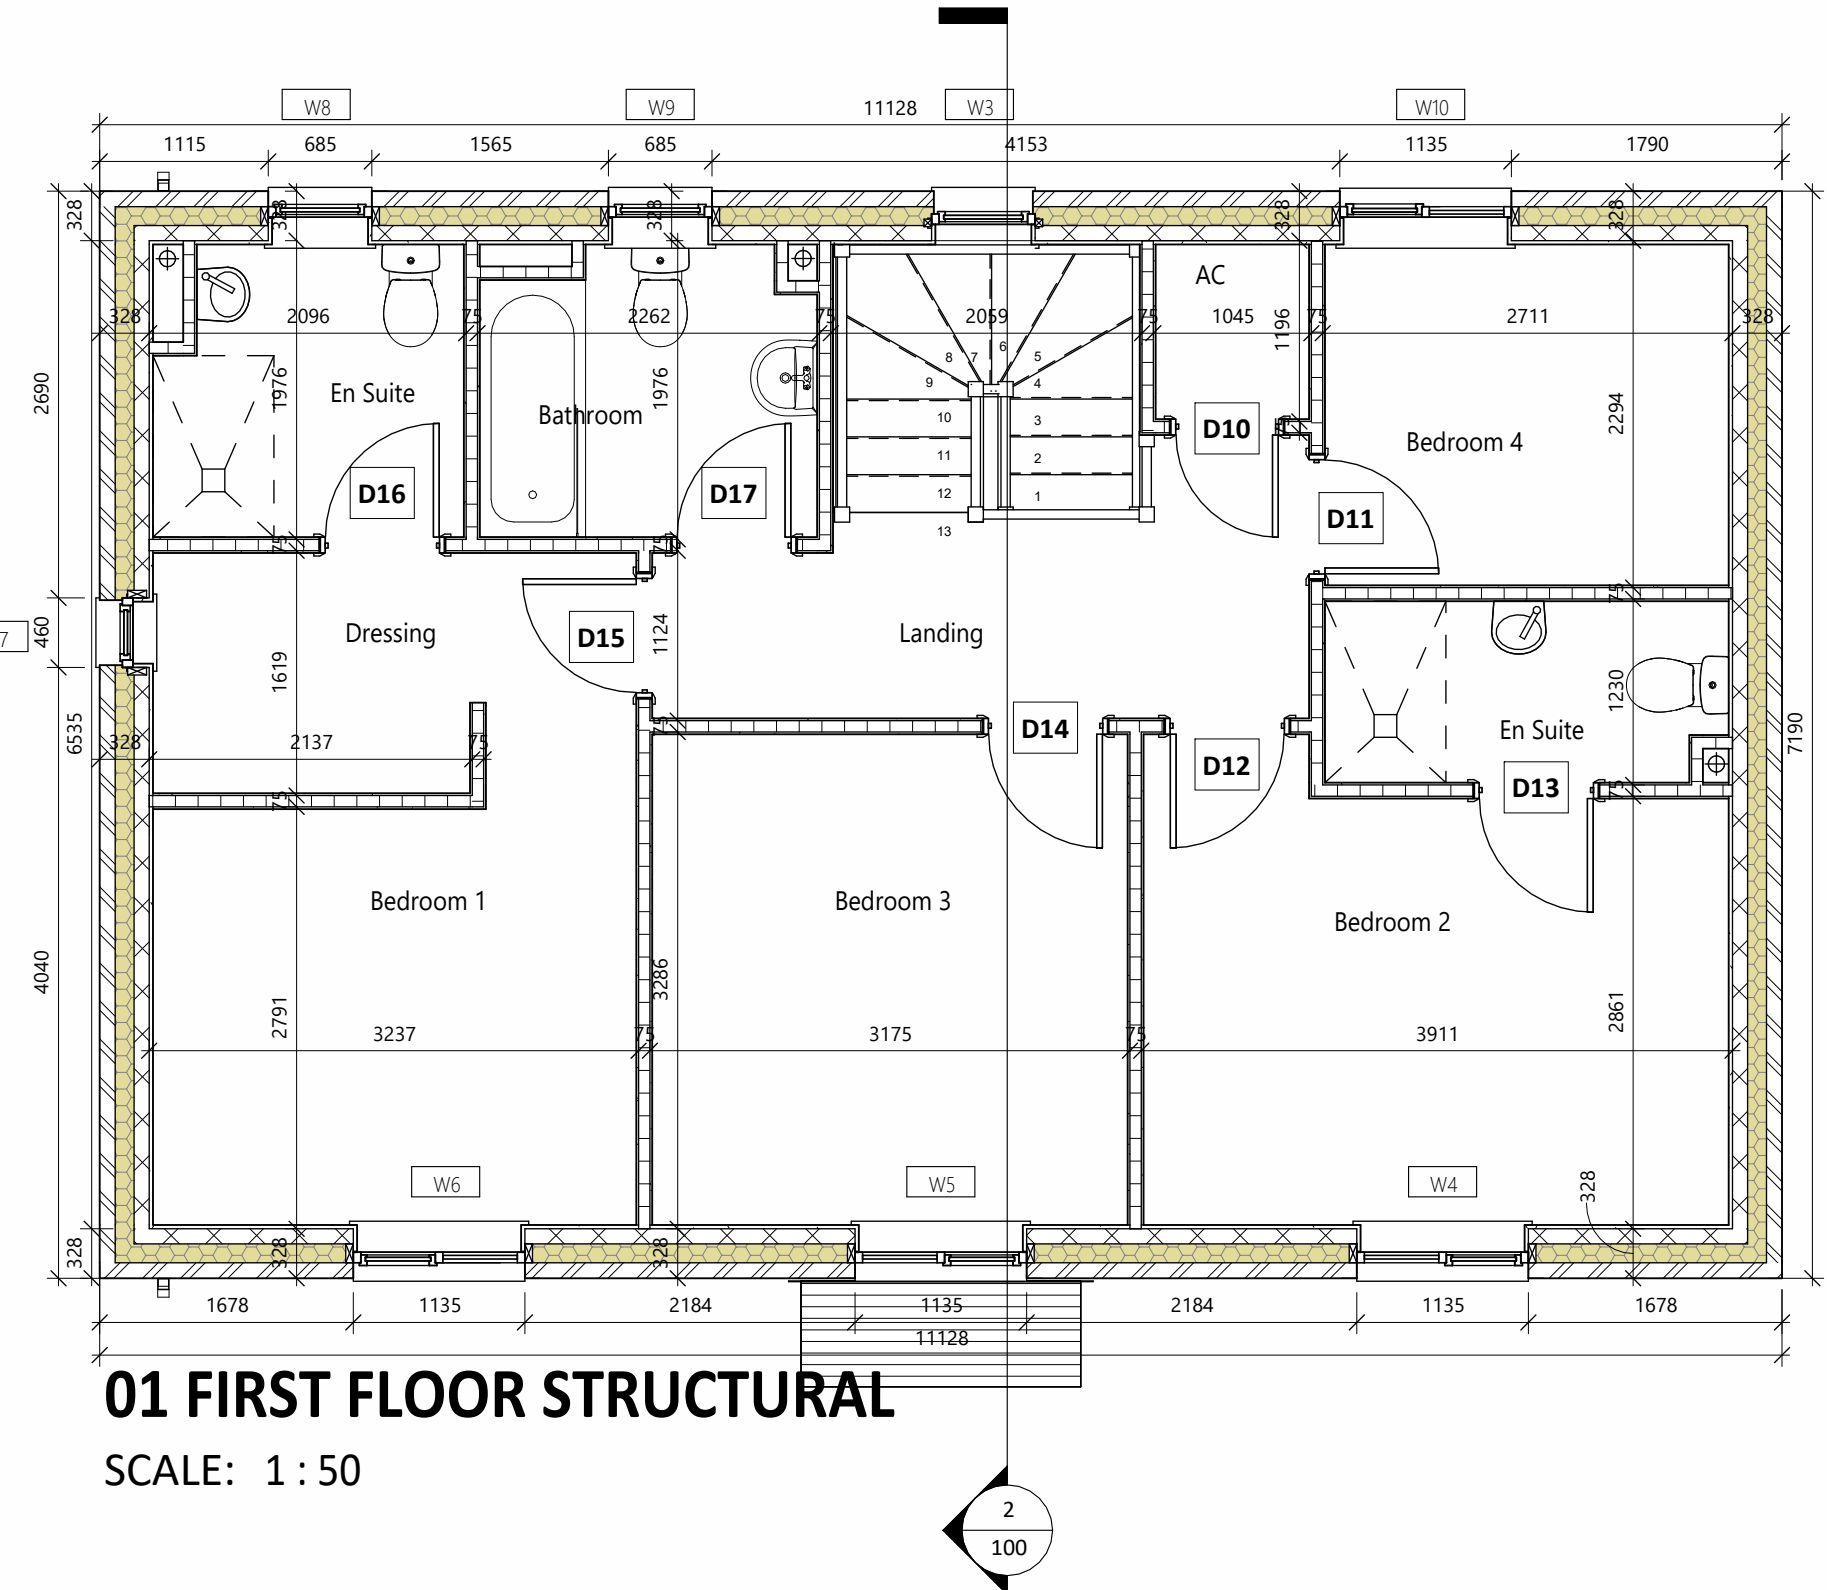


FRONT ELEVATION
SCALE: 1 : 50




REAR ELEVATION
SCALE: 1 : 50

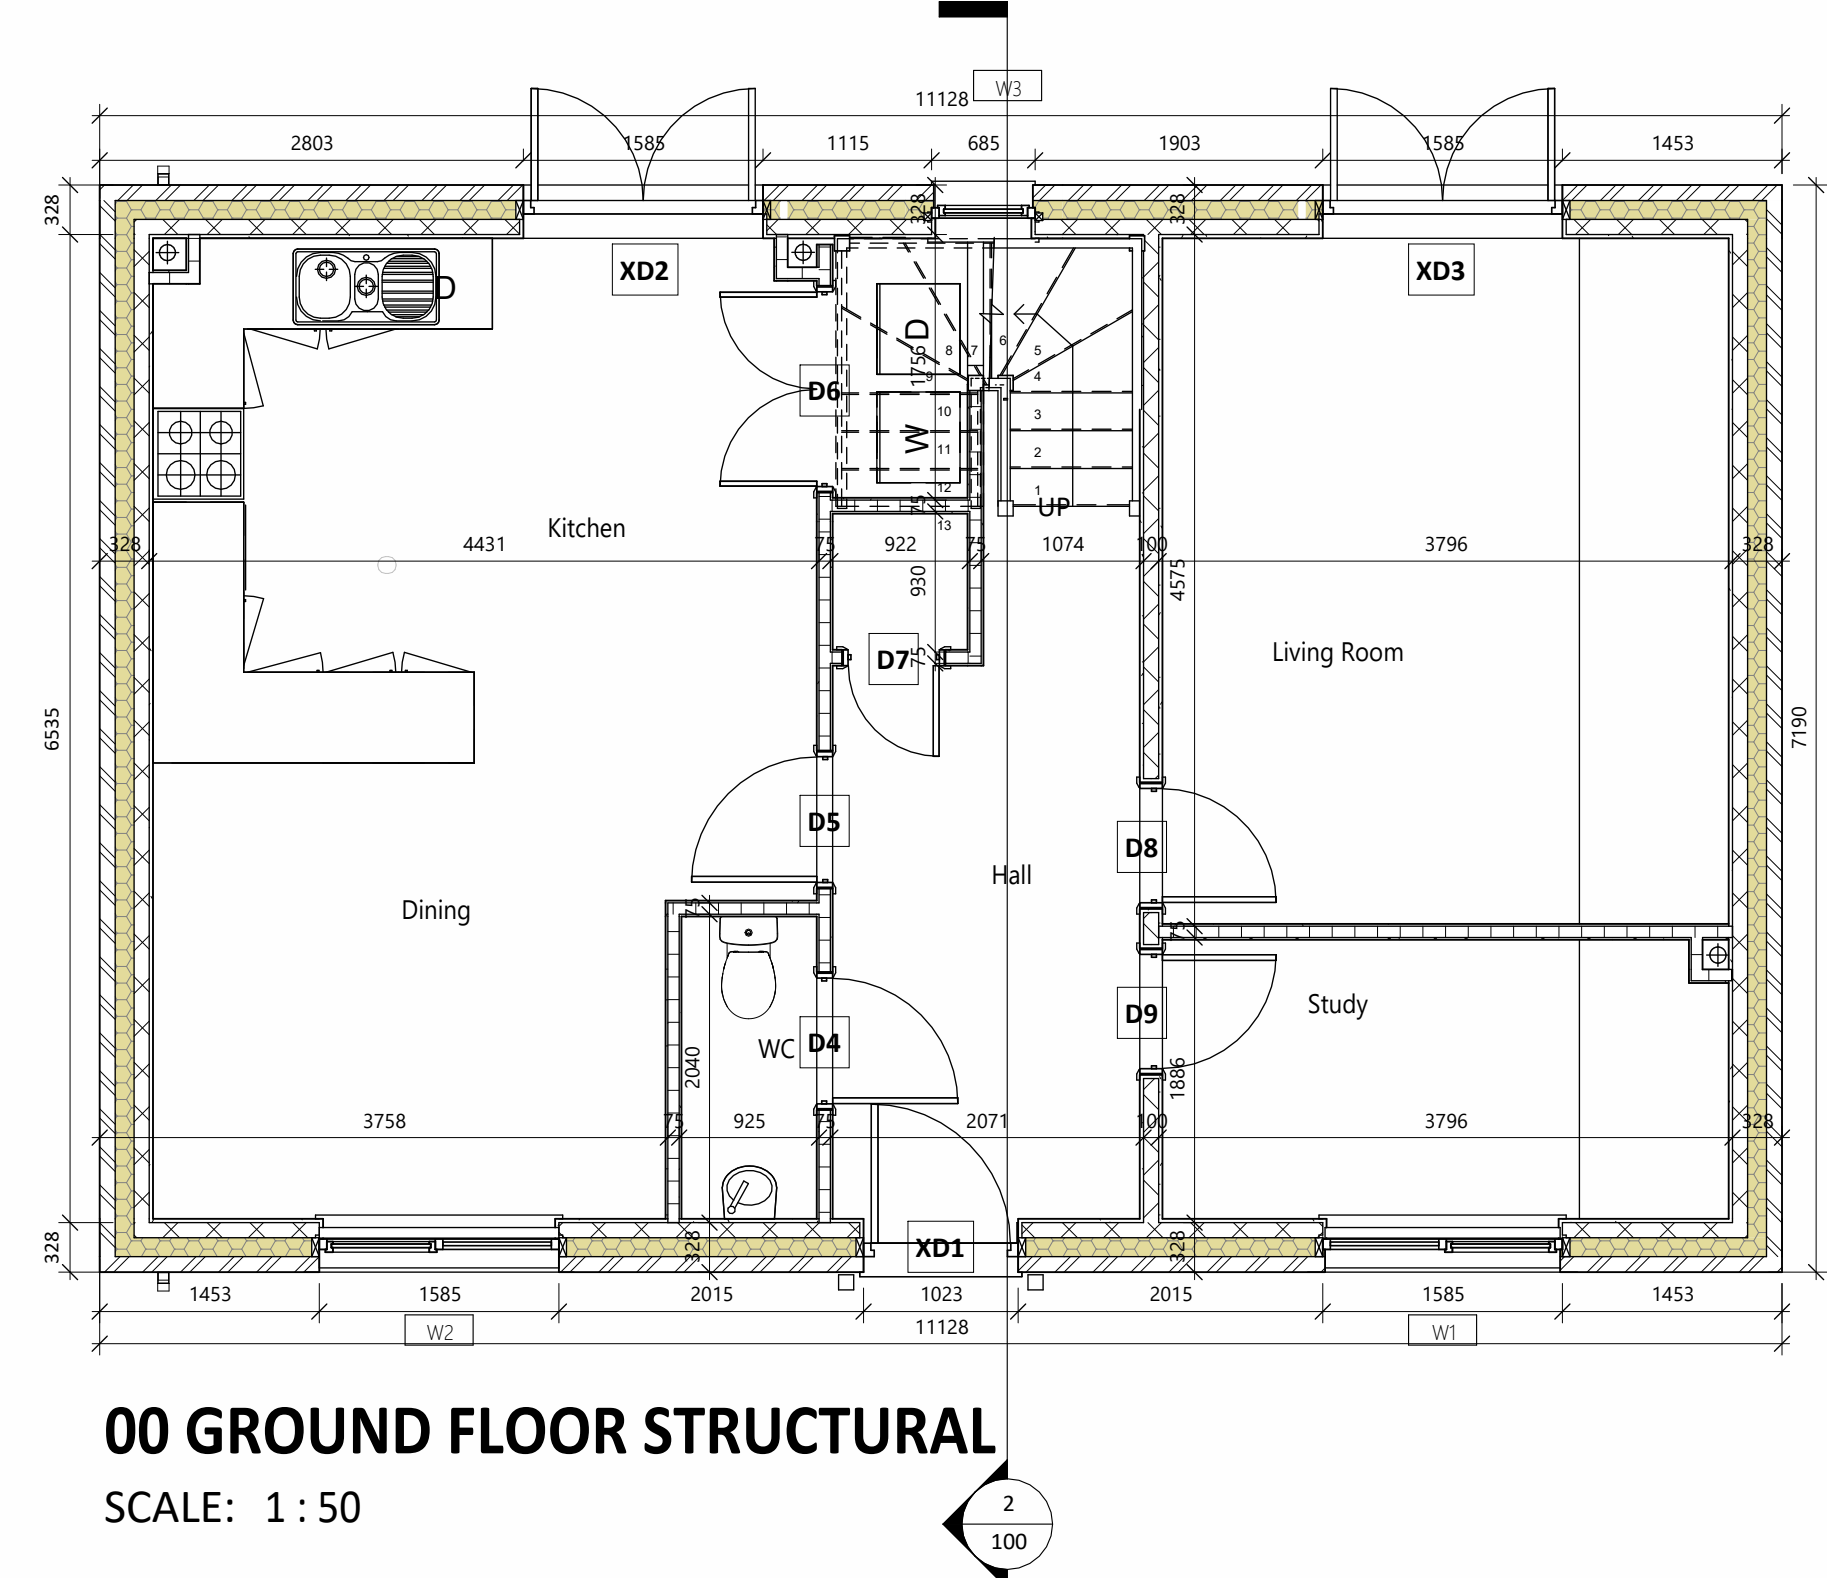


00 GROUND FLOOR STRUCTURAL
SCALE: 1 : 50

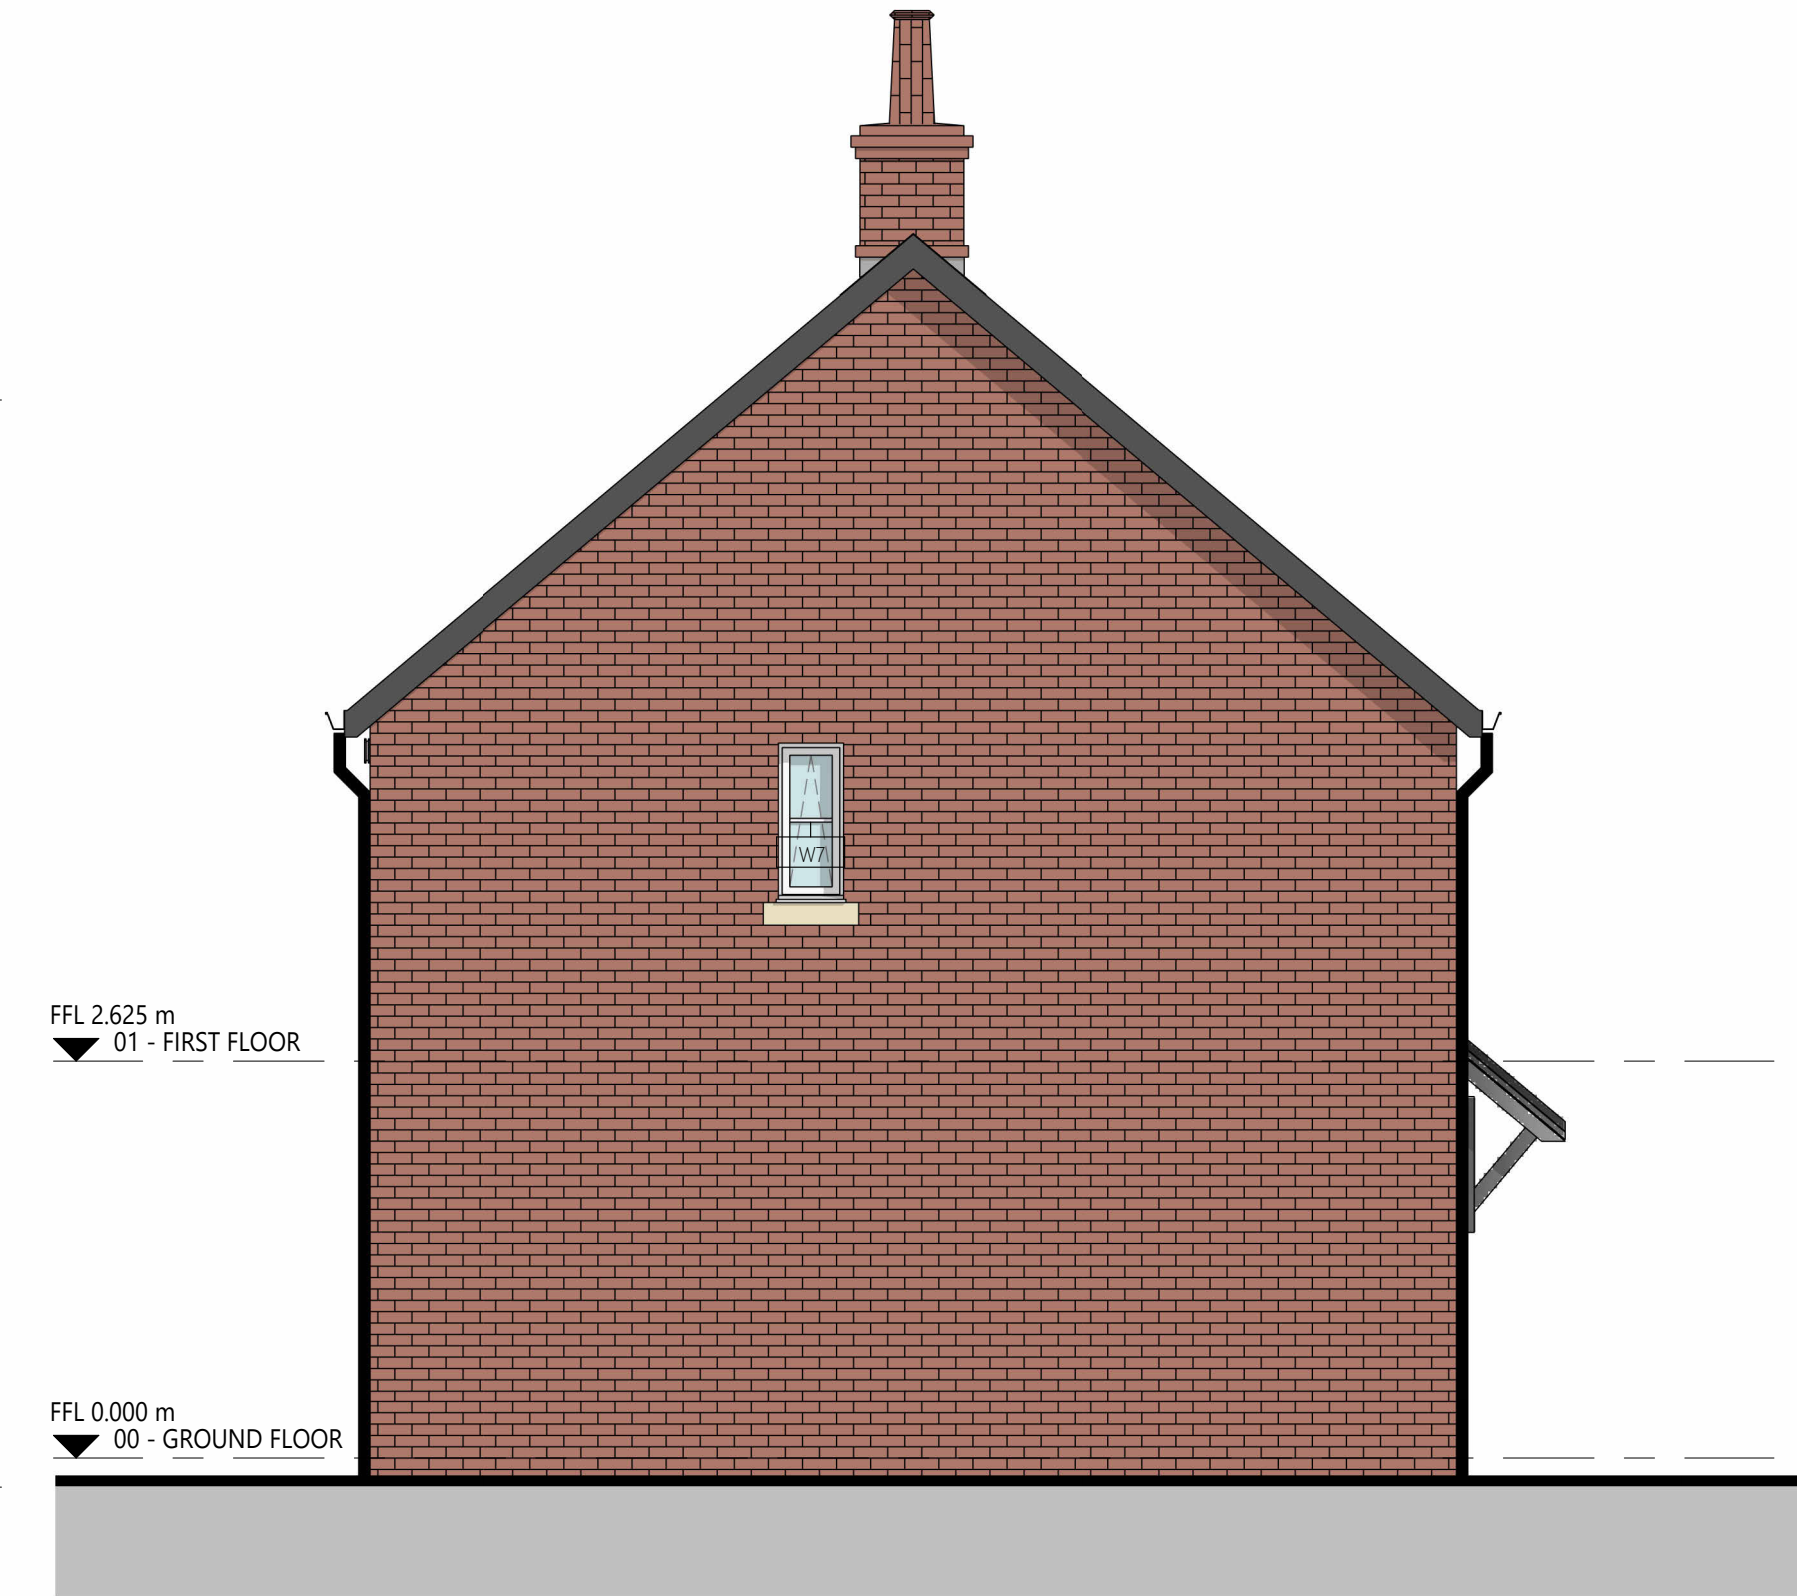

LH GABLE ELEVATION
SCALE: 1 : 50

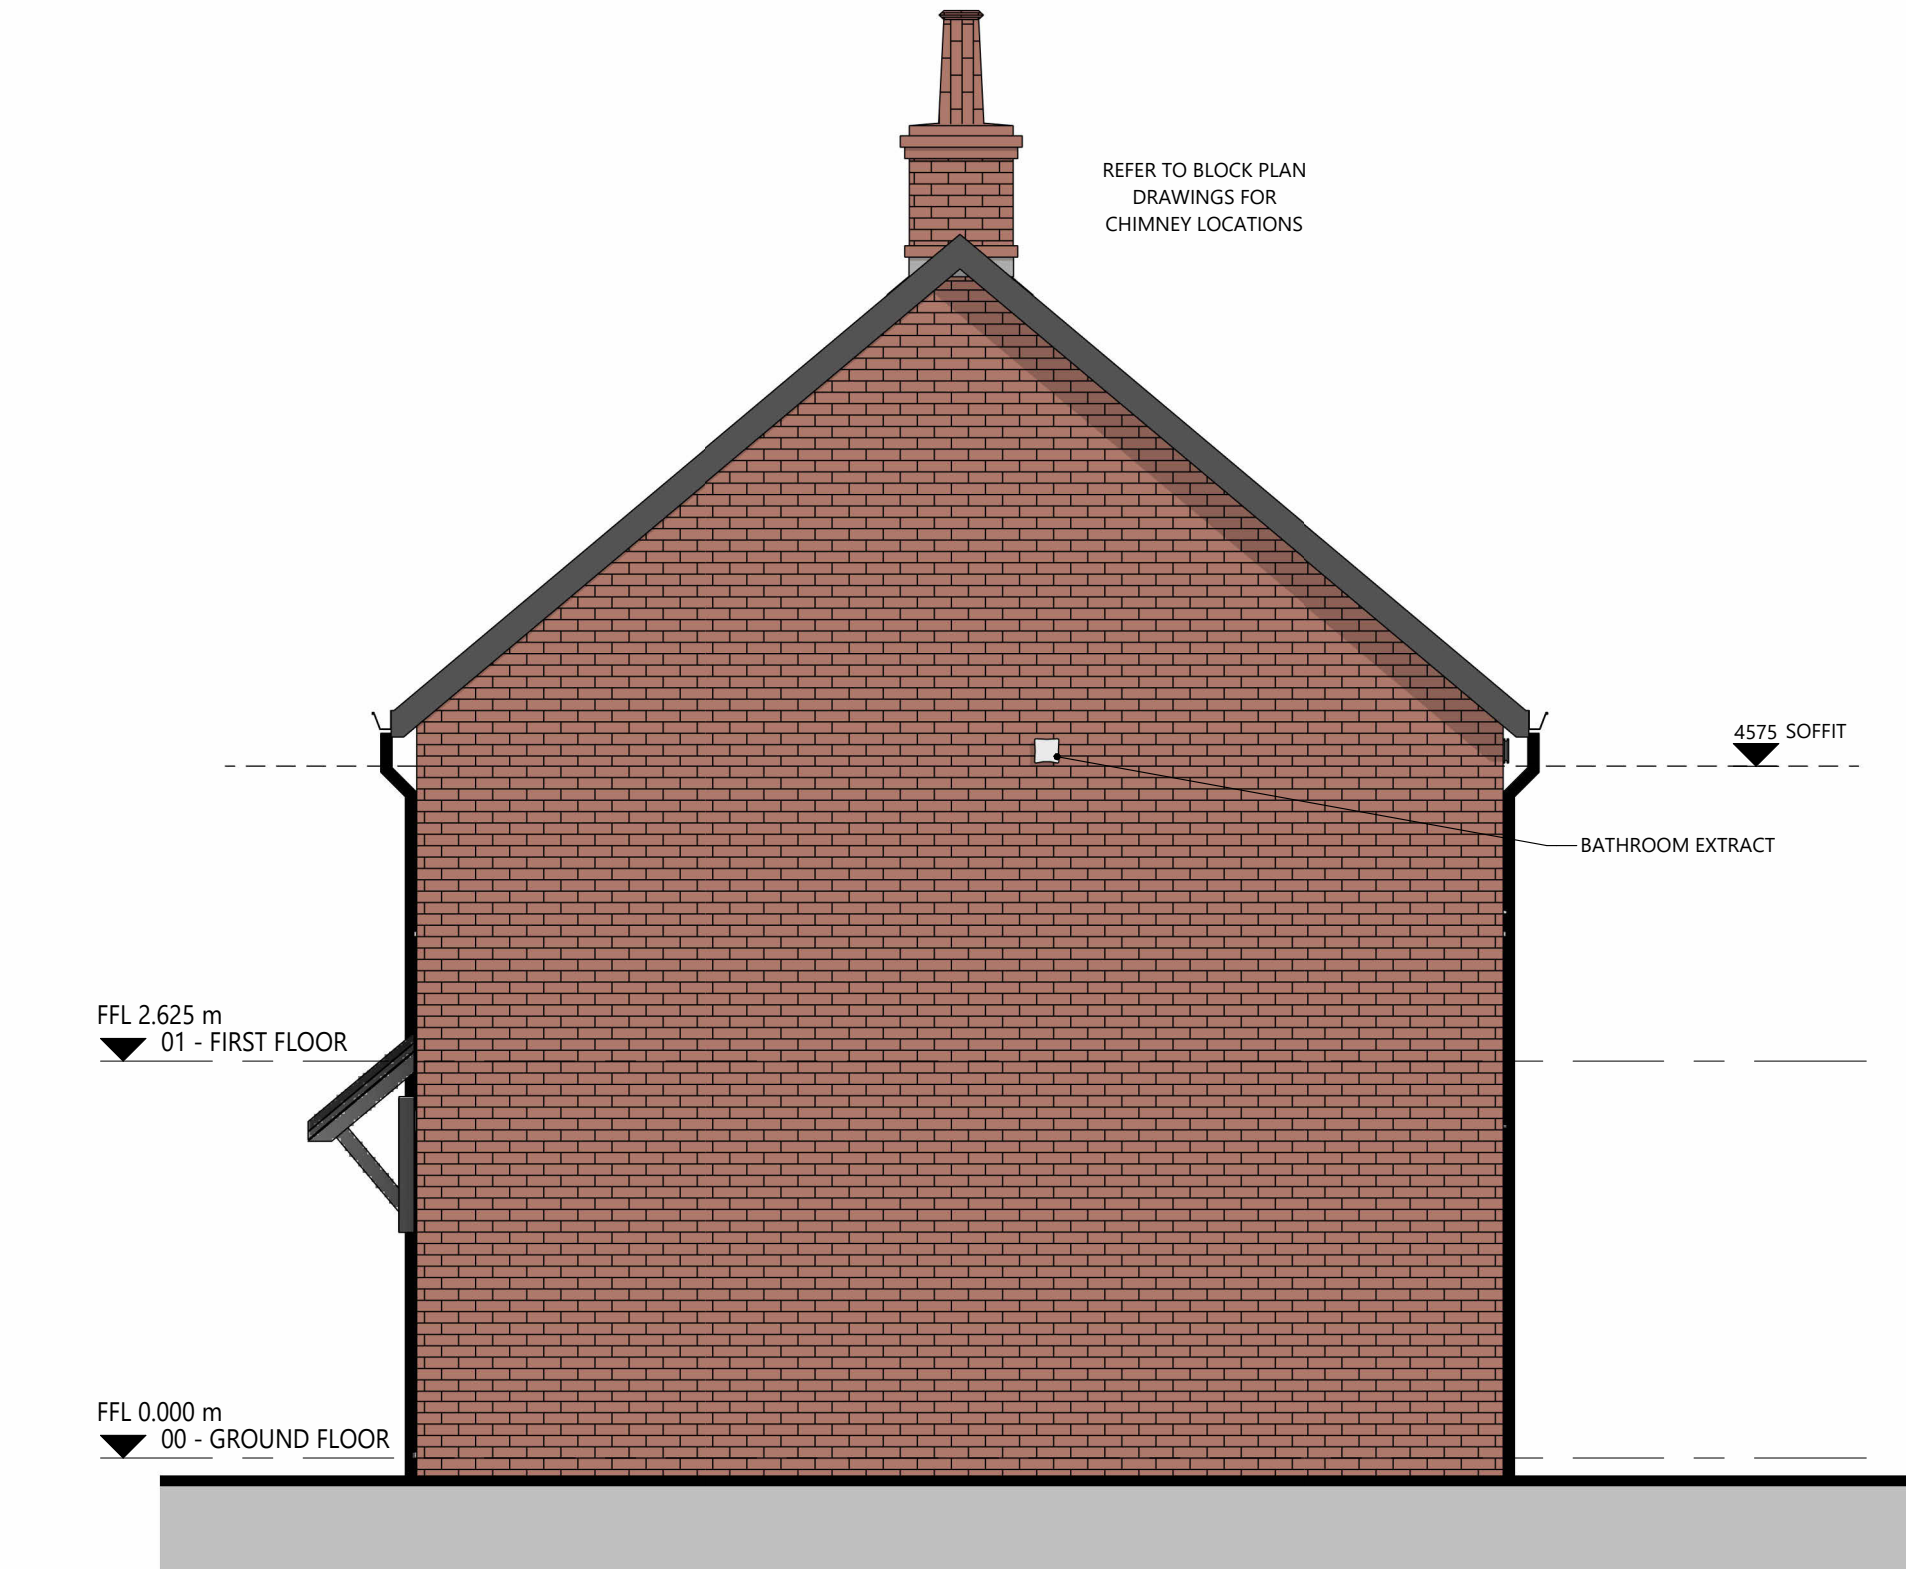

RH GABLE ELEVATION
SCALE: 1 : 50

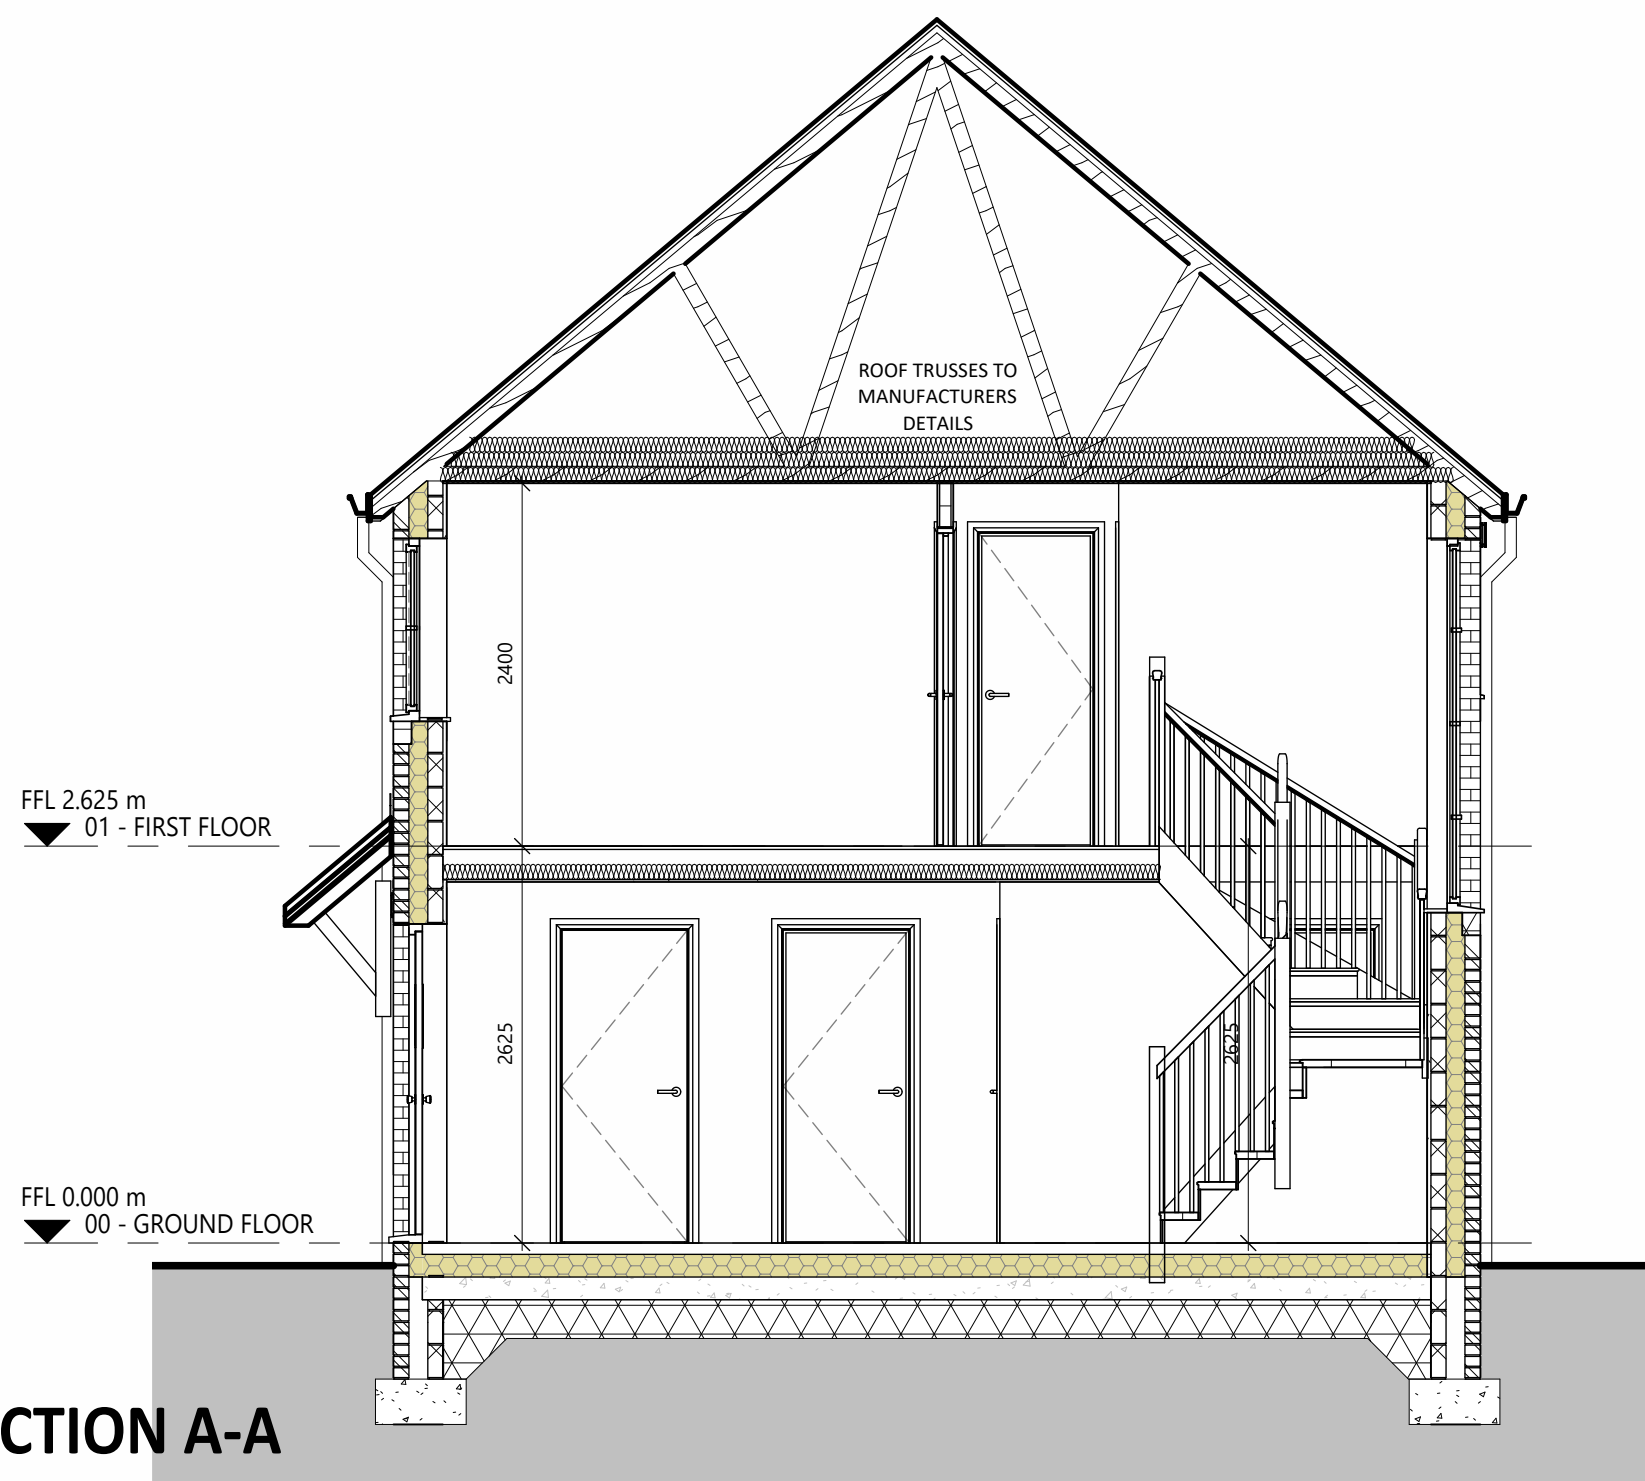

SECTION A-A
SCALE: 1 : 50