

Heat Pump System Performance Estimate

Installer Project Reference Paul-1111 5uy
Client Name paul
Installation Address Line 1 FRON HEULOG FARM
Installation Address Line 2 WESLEY ROAD
Installation Address Line 3 CLWYD
Installation Postcode LL11 5UY



Energy Performance Certificate (EPC) Information

Does this estimate relate to a new build or proposal for extension or reduction in size of an existing building? No

Estimate based on draft EPC

Energy required to heat property 38,953 kWh

Energy required for hot water 5,094 kWh

New Renewable System Information

Type of System	Air Source Heat Pump	* This calculator is not designed to be used for Solar Assisted Heat Pumps
Manufacturer Name	samsung	
Manufacturer Model	AE120RXYDEG/EU&AE200RNWMEG/EU	
MCS Certification Number	011-1W0446(1)	* Available from the MCS Product Directory
Flow Temperature	55 °C	* Determined by the temp. of the water leaving the HP when supplying space heating at the external design temp.
MCS SCOP Heating	3.4	* SCoP - Seasonal Coefficient of Performance. This value is based on the MCS HP SCoP Table below
MCS SCOP Hot Water	1.75	* If providing space heating and DHW, default value from SAP2012. IF DHW only see methodology in MIS3005
Renewable System Provides	Heating and Hot Water	
Hot Water Immersion Use	Once per week	* based on 50°C up to 60°C, 3kW
Size of Hot Water Cylinder	170 ltr	

Existing Heating System

Existing heating system fuel	LPG	* If new build model the most likely alternative fuel.
Hot Water heated by	LPG	* If new build model the most likely alternative fuel.
Age of existing system	Pre-1994	
Efficiency of existing system	82 %	

Estimated System Performance / Comparison

Energy Requirement for the building

	Heating	Hot water	Total	
Net Energy required to heat property	38,953	5,094	44,047	kWh
Existing System Consumption	47,504	6,902	54,406	kWh

New HP System Estimated Consumption

Full Heat Pump System (if selected above)


HP System Electricity Consumption	11,457	3,014	14,471	kWh
-----------------------------------	--------	-------	--------	-----

Hybrid System (if selected above)

HP System Electricity Consumption	0	0	0	kWh
Hybrid system other Consumption	0	0	0	kWh
Hybrid Total Consumption			0	kWh

Note: There are different types of hybrid system. This calculation presumes a hybrid where both sources of heat supply the same hydraulic circuits (heating and hot water) according to the proportion selected above.

Electricity Consumption of Proposed Heat Pump for Space Heating versus Flow Temperature

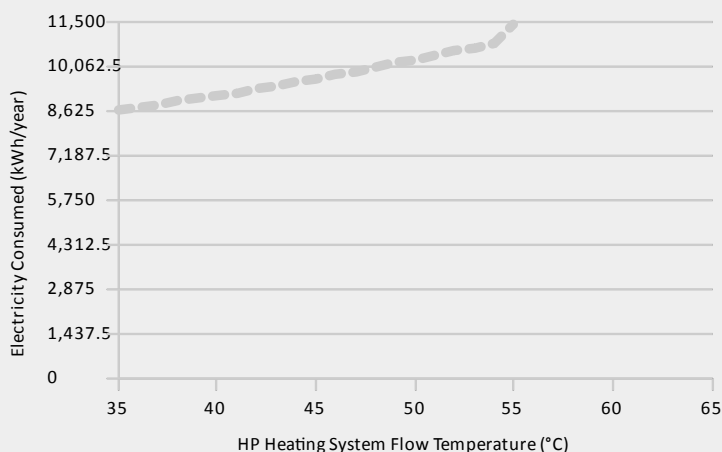

Flow temperature	SCoP
35°C	4.48
36°C	4.43
37°C	4.39
38°C	4.34
39°C	4.29
40°C	4.24
41°C	4.2
42°C	4.15
43°C	4.1
44°C	4.05
45°C	4.01
46°C	3.96
47°C	3.91
48°C	3.86
49°C	3.82
50°C	3.77
51°C	3.72
52°C	3.67
53°C	3.63
54°C	3.58
55°C	3.4
56°C	0
57°C	0
58°C	0
59°C	0
60°C	0
61°C	0
62°C	0
63°C	0
64°C	0
65°C	0

SCoP Definition

SCoP = Seasonal Coefficient of Performance:

MCS SCoP is a theoretical indication of the anticipated efficiency of a heat pump aggregated over a year using standard climate data across Europe. It indicates the units of total heat energy generated (output) for each unit of energy (electricity) consumed (input). It is slightly different to ErP SCoP as it contains efficiency losses due to controls and brine pumps (for a GSHP). As a guide a heat pump with a MCS SCoP of 3 generates 3 kWh of heat energy for every 1 kWh of electrical energy it consumes.

This also means that 2/3rds of the heat output could be eligible for RHI payments. MCS SCoP is based on stringent factory based tests for equipment but does not specifically include the energy consumption of heating circulating pump(s) nor does it model the transient conditions typically experienced in practice in the consumers home and hence the overall final system efficiency is likely to be different from the MCS SCoP.

Important Information

This performance estimate should be accompanied by the Key Facts which explain the factors that can affect the performance of a heat pump.

Any technical variation to the specification could affect the performance of the Heat Pump System in which case the MCS Contractor MUST update and re-issue this document and advise the customer of their Consumer Rights.