
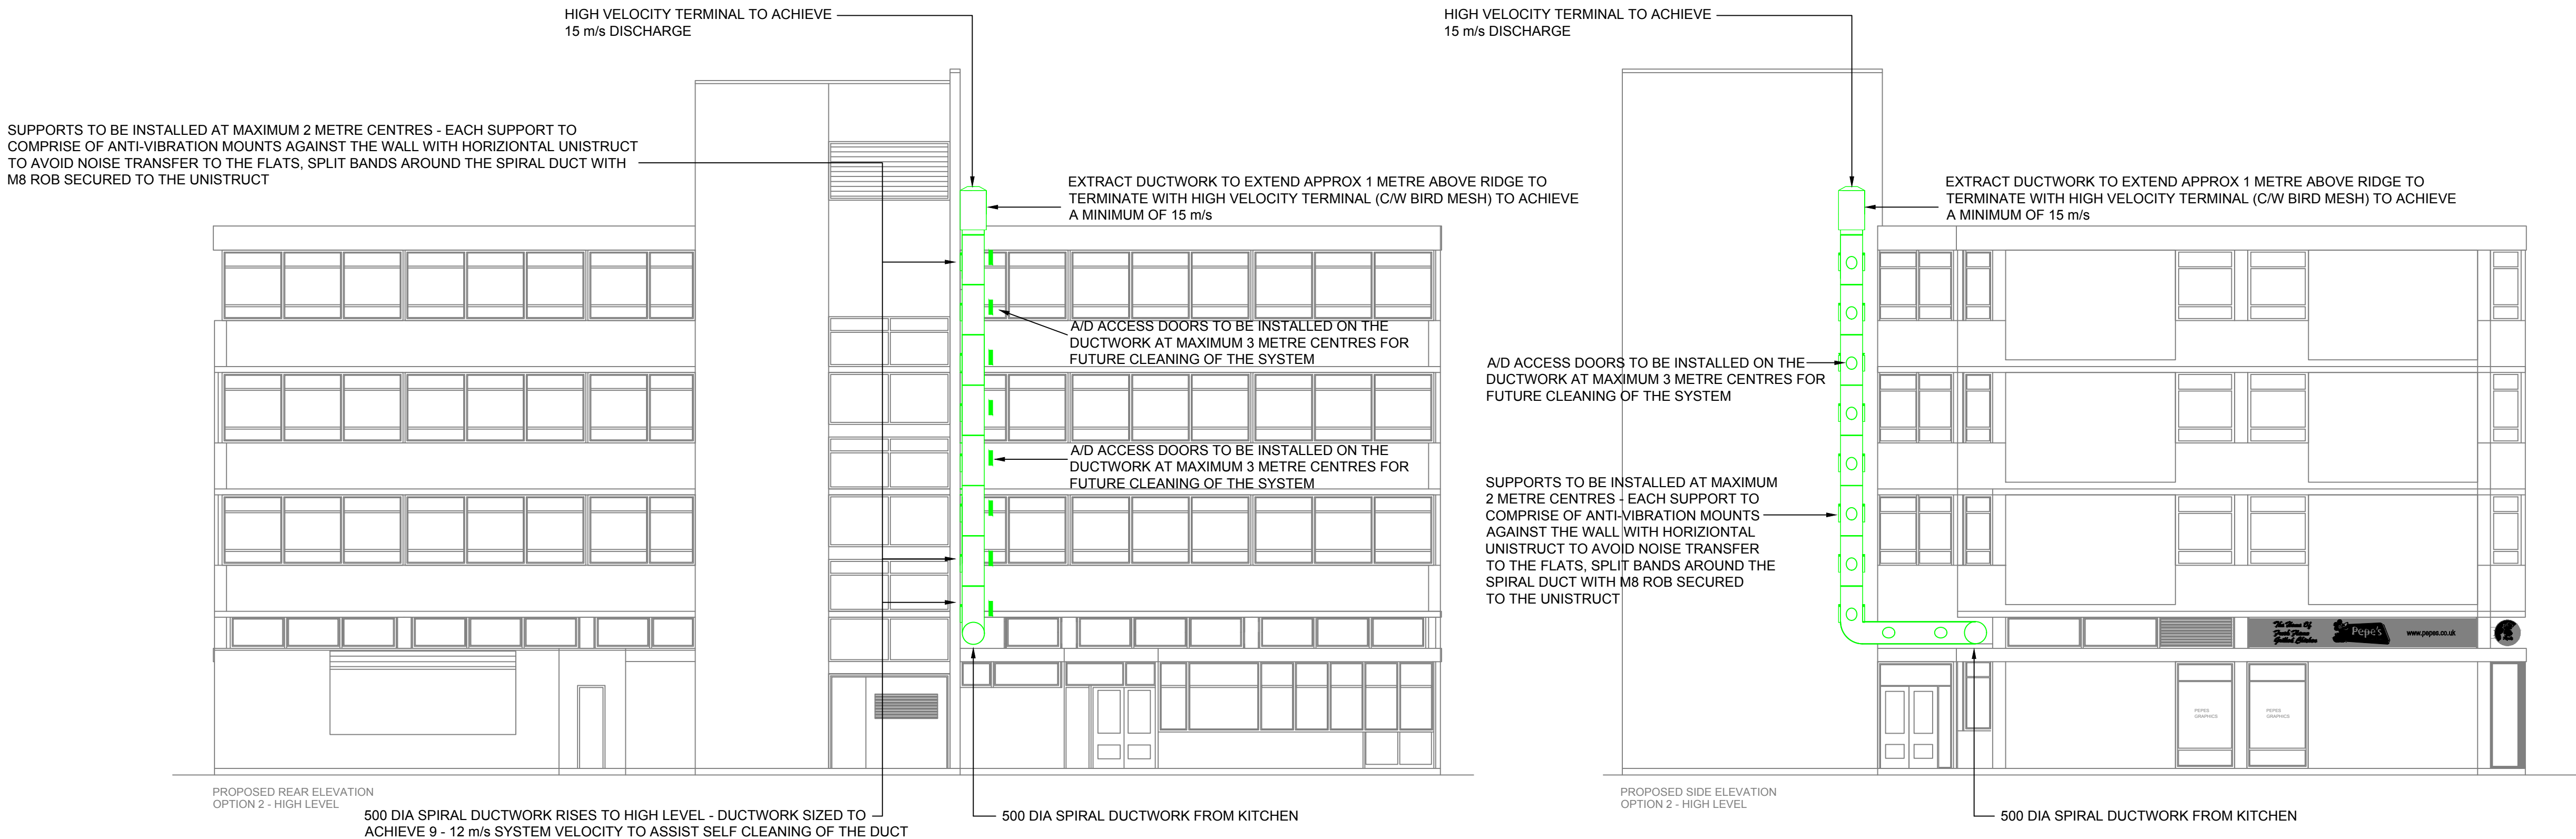


NOTES

- a) SYSTEM CLEANING TO BE CARRIED OUT BY A BESA APPROVED CLEANING CONTRACTOR WHO SHOULD BE APPOINTED WITHIN 6 WEEKS OF THE STORE OPENING TO CARRY OUT RISK ASSESSMENT FOR THE SYSTEM - SEE SPECIFICATION FOR RECOMMENDED MAINTENANCE INTERVALS, SEE ACCOMPANYING SPECIFICATION
- b) A/D ACCESS DOORS TO BE INSTALLED ON THE DUCTWORK AT MAXIMUM 3 METRE CENTRES FOR FUTURE CLEANING OF THE SYSTEM
- c) ANTI-VIBRATION MOUNTS ON ALL SUPPORTS & PLANT TO AVOID NOISE TRANSFER THROUGH THE STRUCTURE

NOTES
ALL DIMENSIONS MUST BE CHECKED ON SITE
AND NOT SCALED FROM THIS DRAWING

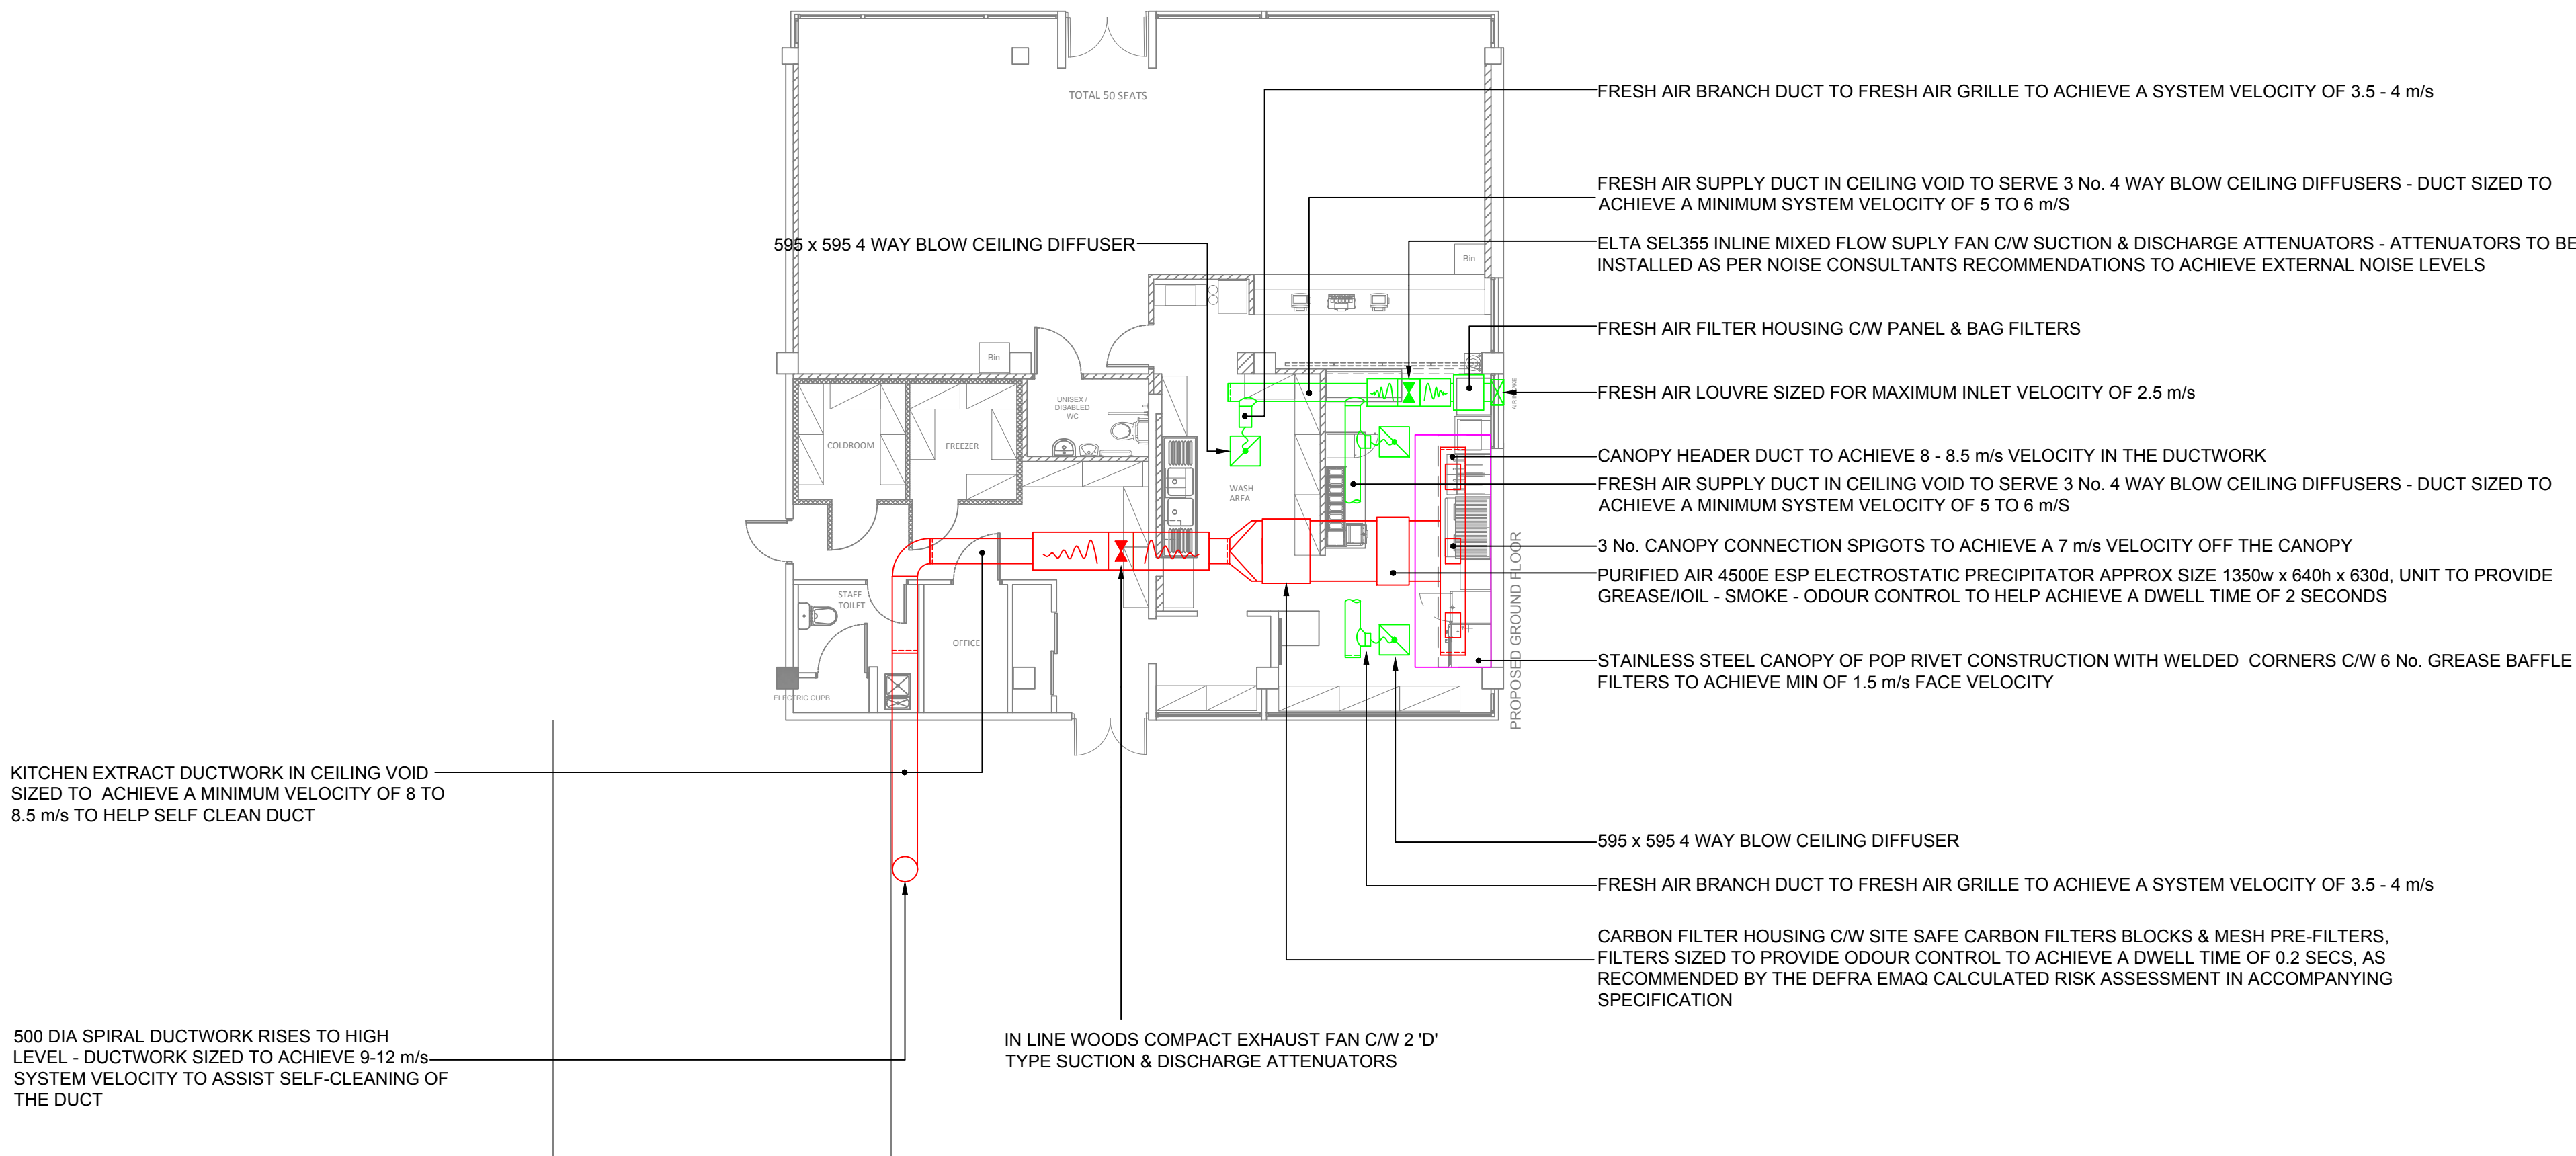

PLEASE NOTE THAT THIS DESIGN & ACCOMPANYING
DESIGN DRAWING ARE THE COPYRIGHT OF KRS LTD
AND MUST NOT BE COPIED IN PART OR IN FULL
WITHOUT THE WRITTEN CONSENT OF KRS LTD. NOR
MUST THEY BE PASSED ON TO A THIRD PARTY IN
ANY FORM UNDER ANY CIRCUMSTANCES.

DATE	REVISION
KRS STEEL SERVICES LTD UNIT 6, MEADWAY TRADING ESTATE 429 THE MEADWAY KITTS GREEN BIRMINGHAM B33 0DZ Tel: 0121 783 7404 Fax: 0121 786 6803	
CLIENT	HSZ FOODS LTD
JOB TITLE	PEPE'S PIRI PIRI UNIT 2 REGENT HOUSE REGENT STREET WREXHAM LL11 1PR
DRAWING TITLE	PROPOSED CANOPY EXTRACT & FRESH AIR SUPPLY VENTILATION LAYOUT
SCALE 1:100 @A1	DATE JUN'23
DRAWN BY CAD	REV
DRAWING NO C2739/M01	