

DOOR SCHEDULE - TYPE A

REF	TYPE	HEIGHT	WIDTH	COMMENTS
00 - GROUND FLOOR				
D3	NBS_DrsetSym_Interior-Double_Blank	2110	850	
D4	INT SINGLE	2110	912	
D5	INT SINGLE	2110	912	
D6	INT SINGLE	2110	912	
XD1	ExtSgl IG XD63	2110	1023	
XD2	DoorExtDbl_Glazed with reveals	2110	1585	
01 - FIRST FLOOR				
D7	INT SINGLE	2110	531	
D8	INT SINGLE	2110	836	
D9	INT SINGLE	2110	836	
D10	INT DOUBLE	2110	1142	
D11	INT SINGLE	2110	836	
D12	INT DOUBLE	2110	1310	

ALL GLAZING BETWEEN FFL AND 800MM IN WALLS AND PARTITIONS AND BETWEEN FFL AND 1500MM IN A DOOR OR IN A SIDE PANEL CLOSE TO EITHER EDGE OF THE DOOR SHALL BE LAMINATED (NOT TOUGHENED) GLASS AS DEFINED IN BS6206:1981. SAFETY GLAZING TO BE PERMANENTLY MARKED TO COMPLY WITH BS 6206:1981.


WINDOW SCHEDULE - TYPE A

REF	TYPE	WIDTH	HEIGHT	COMMENTS
00 - GROUND FLOOR				
W1	1585 x 1510	1585	1510	
W2	460 x 1060	460	1060	OBSOLETE
01 - FIRST FLOOR				
W3	910 x 1210	910	1210	
W4	910 x 1360	910	1210	
W5	460 x 1060	460	1060	OBSOLETE
W6	1200 x 1210	1200	1210	


NOTE: BACKGROUND VENTILATION TO BE 8000 SQ MM TO HABITABLE ROOMS, 4000 SQMM TO BATHROOMS AND UTILITIES WHICH IS TO BE PROVIDED BY THE WINDOW AND EXTERNAL DOOR TRICKLE VENTS. GROUND FLOOR DOORS TO HABITABLE ROOMS AND ROOMS CONTAINING A WC TO HAVE A MINIMUM CLEAR OPENING OF 800MM WHEN NOT APPROACHED HEAD ON AND 750MM FINISHED GAP AT THE BOTTOM TO PROVIDE REQUIRED BACKGROUND VENTILATION (PROVIDE A 20MM UNFINISHED GAP WHERE FINISHES ARE NOT LAID). ALL CYLINDER DOORS TO BE VENTED EQUIVALENT TO 600MM².

WALL TYPES

EXTERNAL WALL BRICK OR RENDER ON LAY-LITE BLOCK OUTER LEAF, 125MM CAVITY FILLED WITH SUPABEAD INSULATION (K-0.033), 100MM THERMALITE TURBO BLOCK, PLASTERBOARD ON DABS, U-VALUE = 0.20 W/M ² K. IF USING THERMALITE 7N BLOCK THEN U-VALUE IS 0.21 W/M ² K		353	
PARTY WALL 125MM FILLED/CLEAR CAVITY WITH EACH SIDE: 100MM BLOCKWORK 12.5MM PLASTERBOARD ON DABS WITH SKIM FINISH		375	
INTERNAL LOADBEARING WALL (REFER TO ENGINEERS DETAILS) 100MM BLOCKWORK & 12.5MM PLASTERBOARD ON DABS WITH SKIM FINISH TO BOTH SIDES		150	
INTERNAL NON-LOADBEARING WALL TIMBER STUDS (75X38 @ 600TRS INDICATED) 75MM ISOVER ACOUSTIC PARTITION ROLL (ONLY WHERE INDICATED) WALL FINISHED BOTH SIDES WITH 1NO. LAYERS OF 12.5MM PLASTERBOARD AND SKIM FINISH UNLESS TILED.		105	

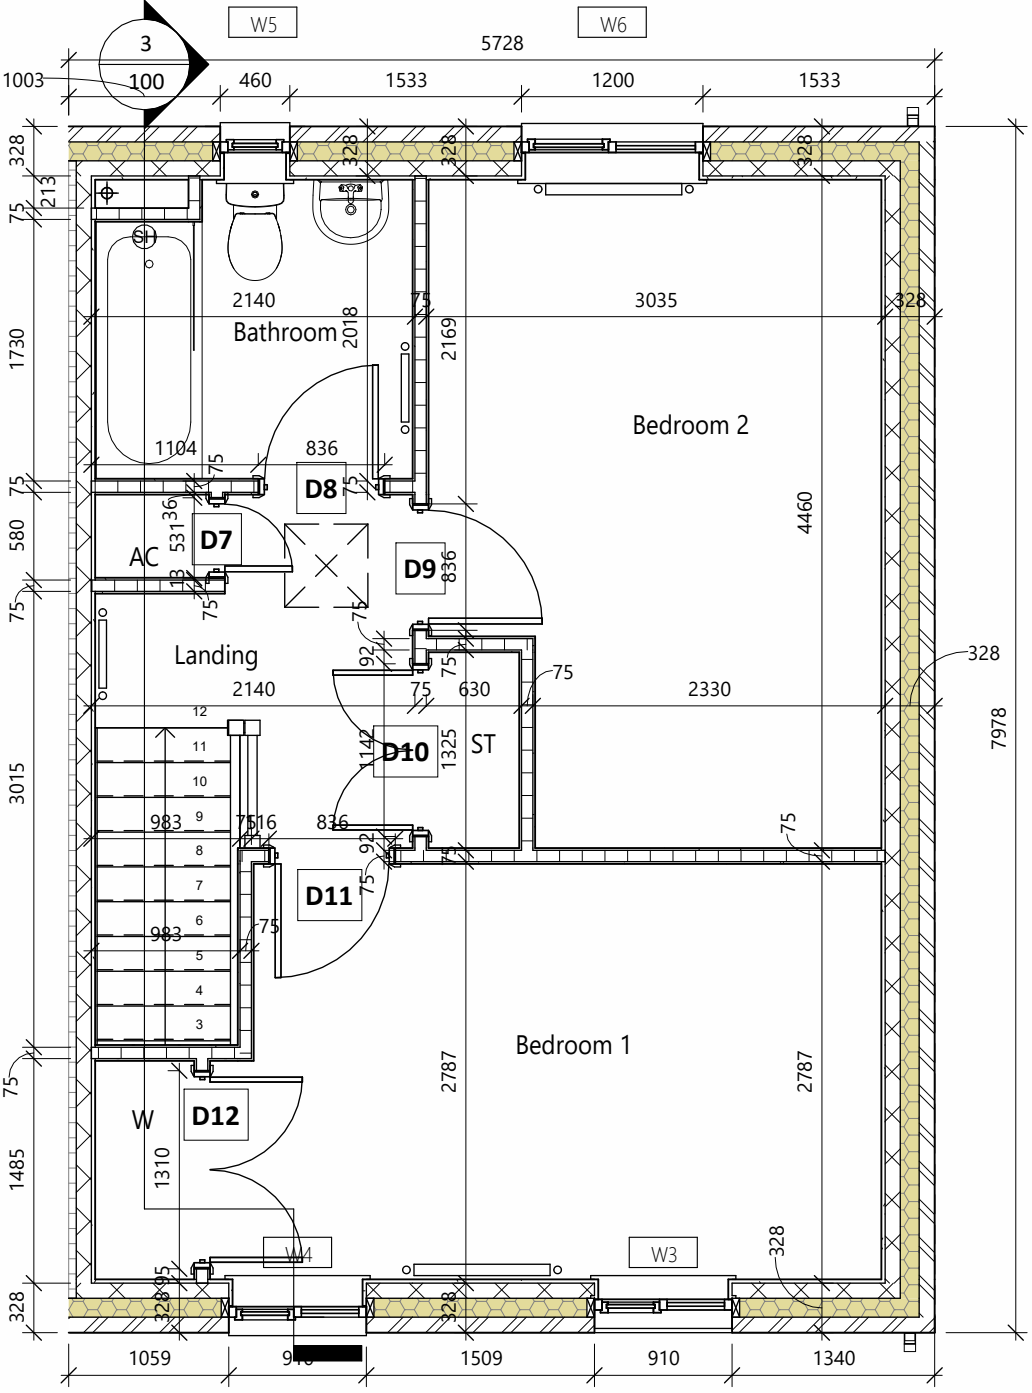


01 FIRST FLOOR STRUCTURAL
SCALE: 1 : 50

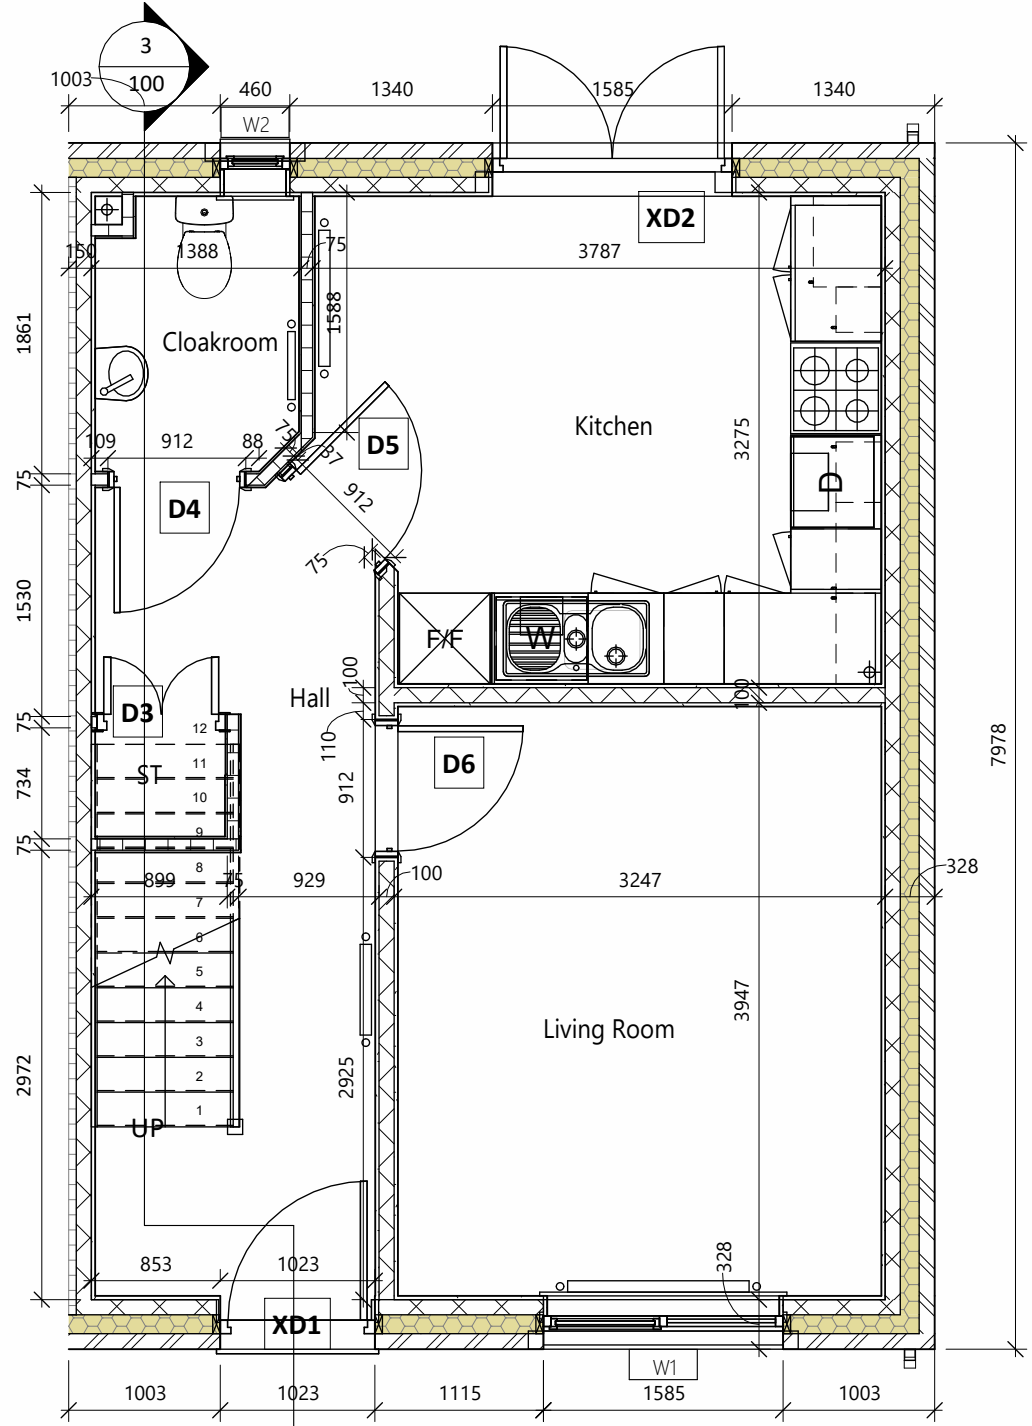


00 GROUND FLOOR STRUCTURAL
SCALE: 1 : 50




FRONT ELEVATION
SCALE: 1 : 50

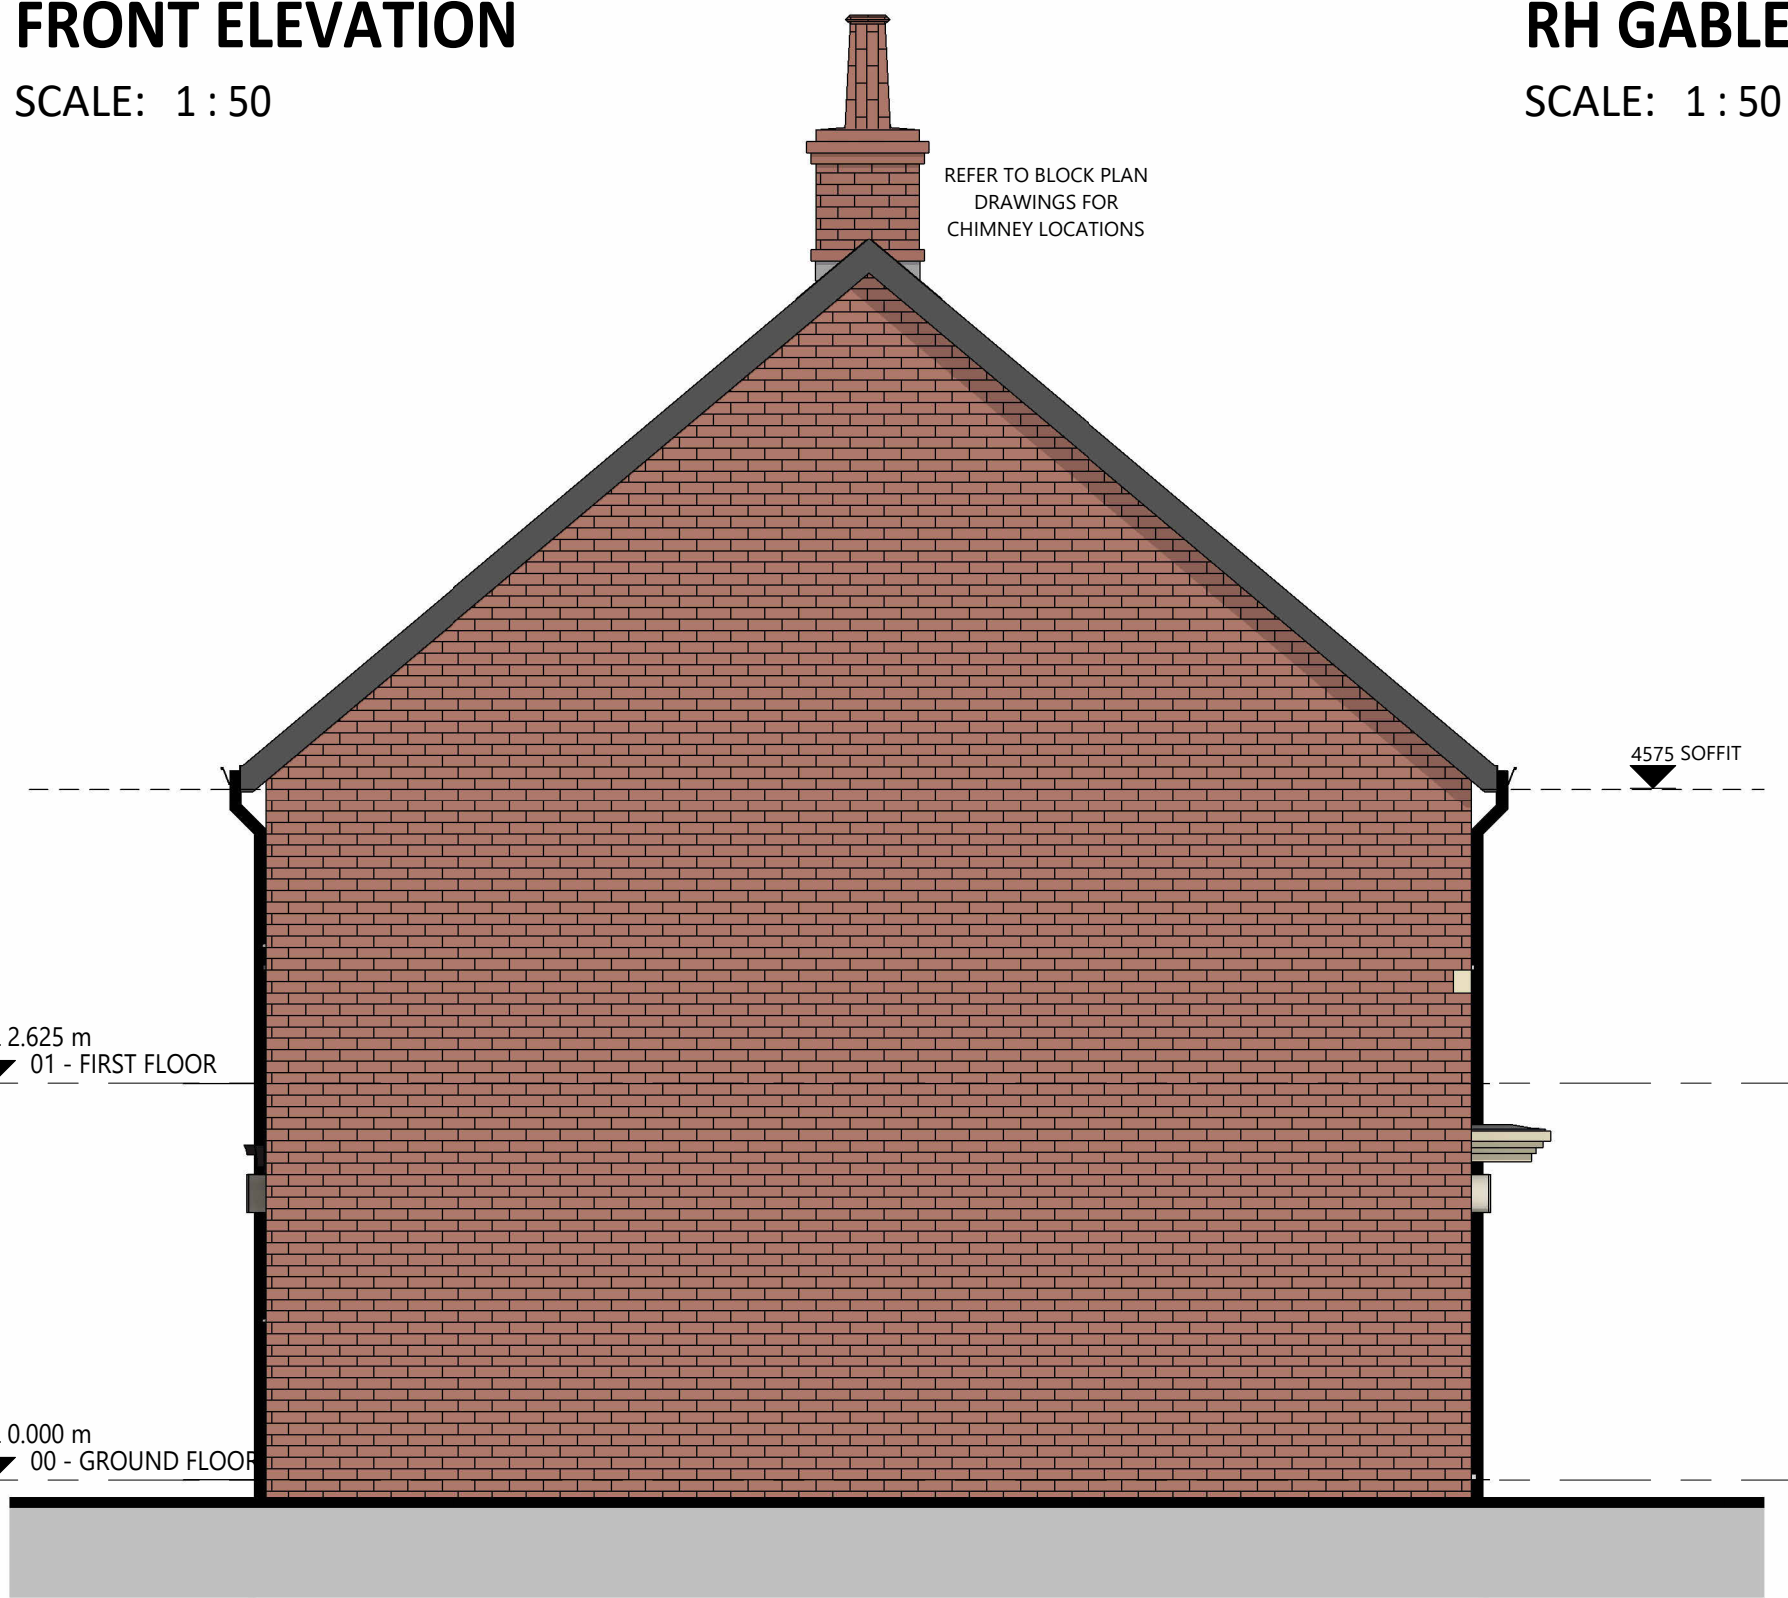


LH GABLE ELEVATION
SCALE: 1 : 50

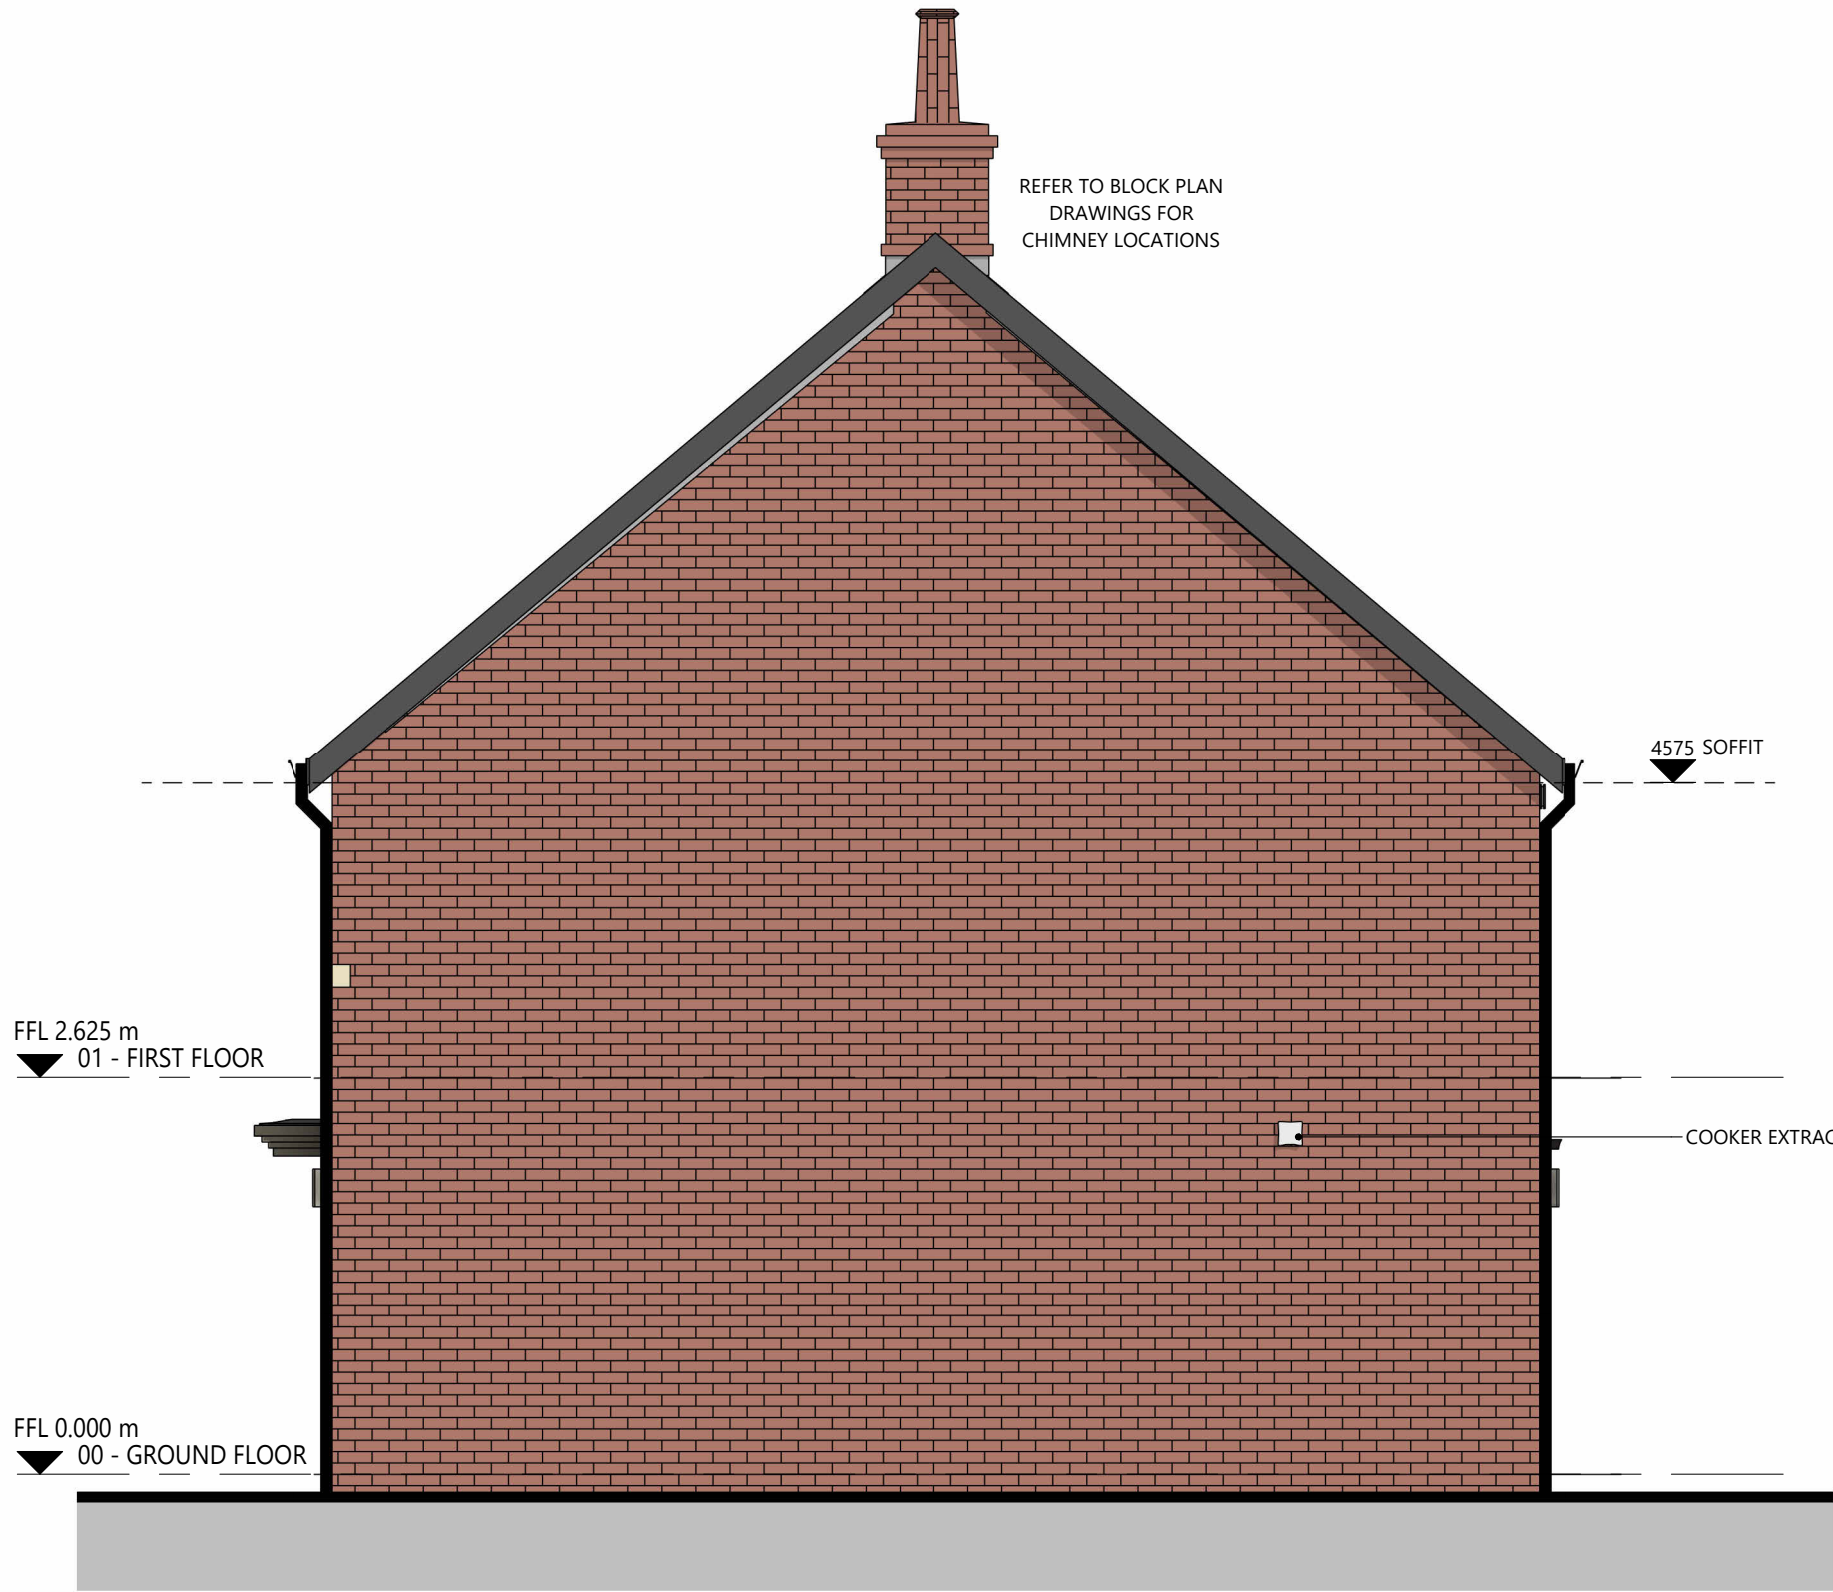

RH GABLE ELEVATION
SCALE: 1 : 50

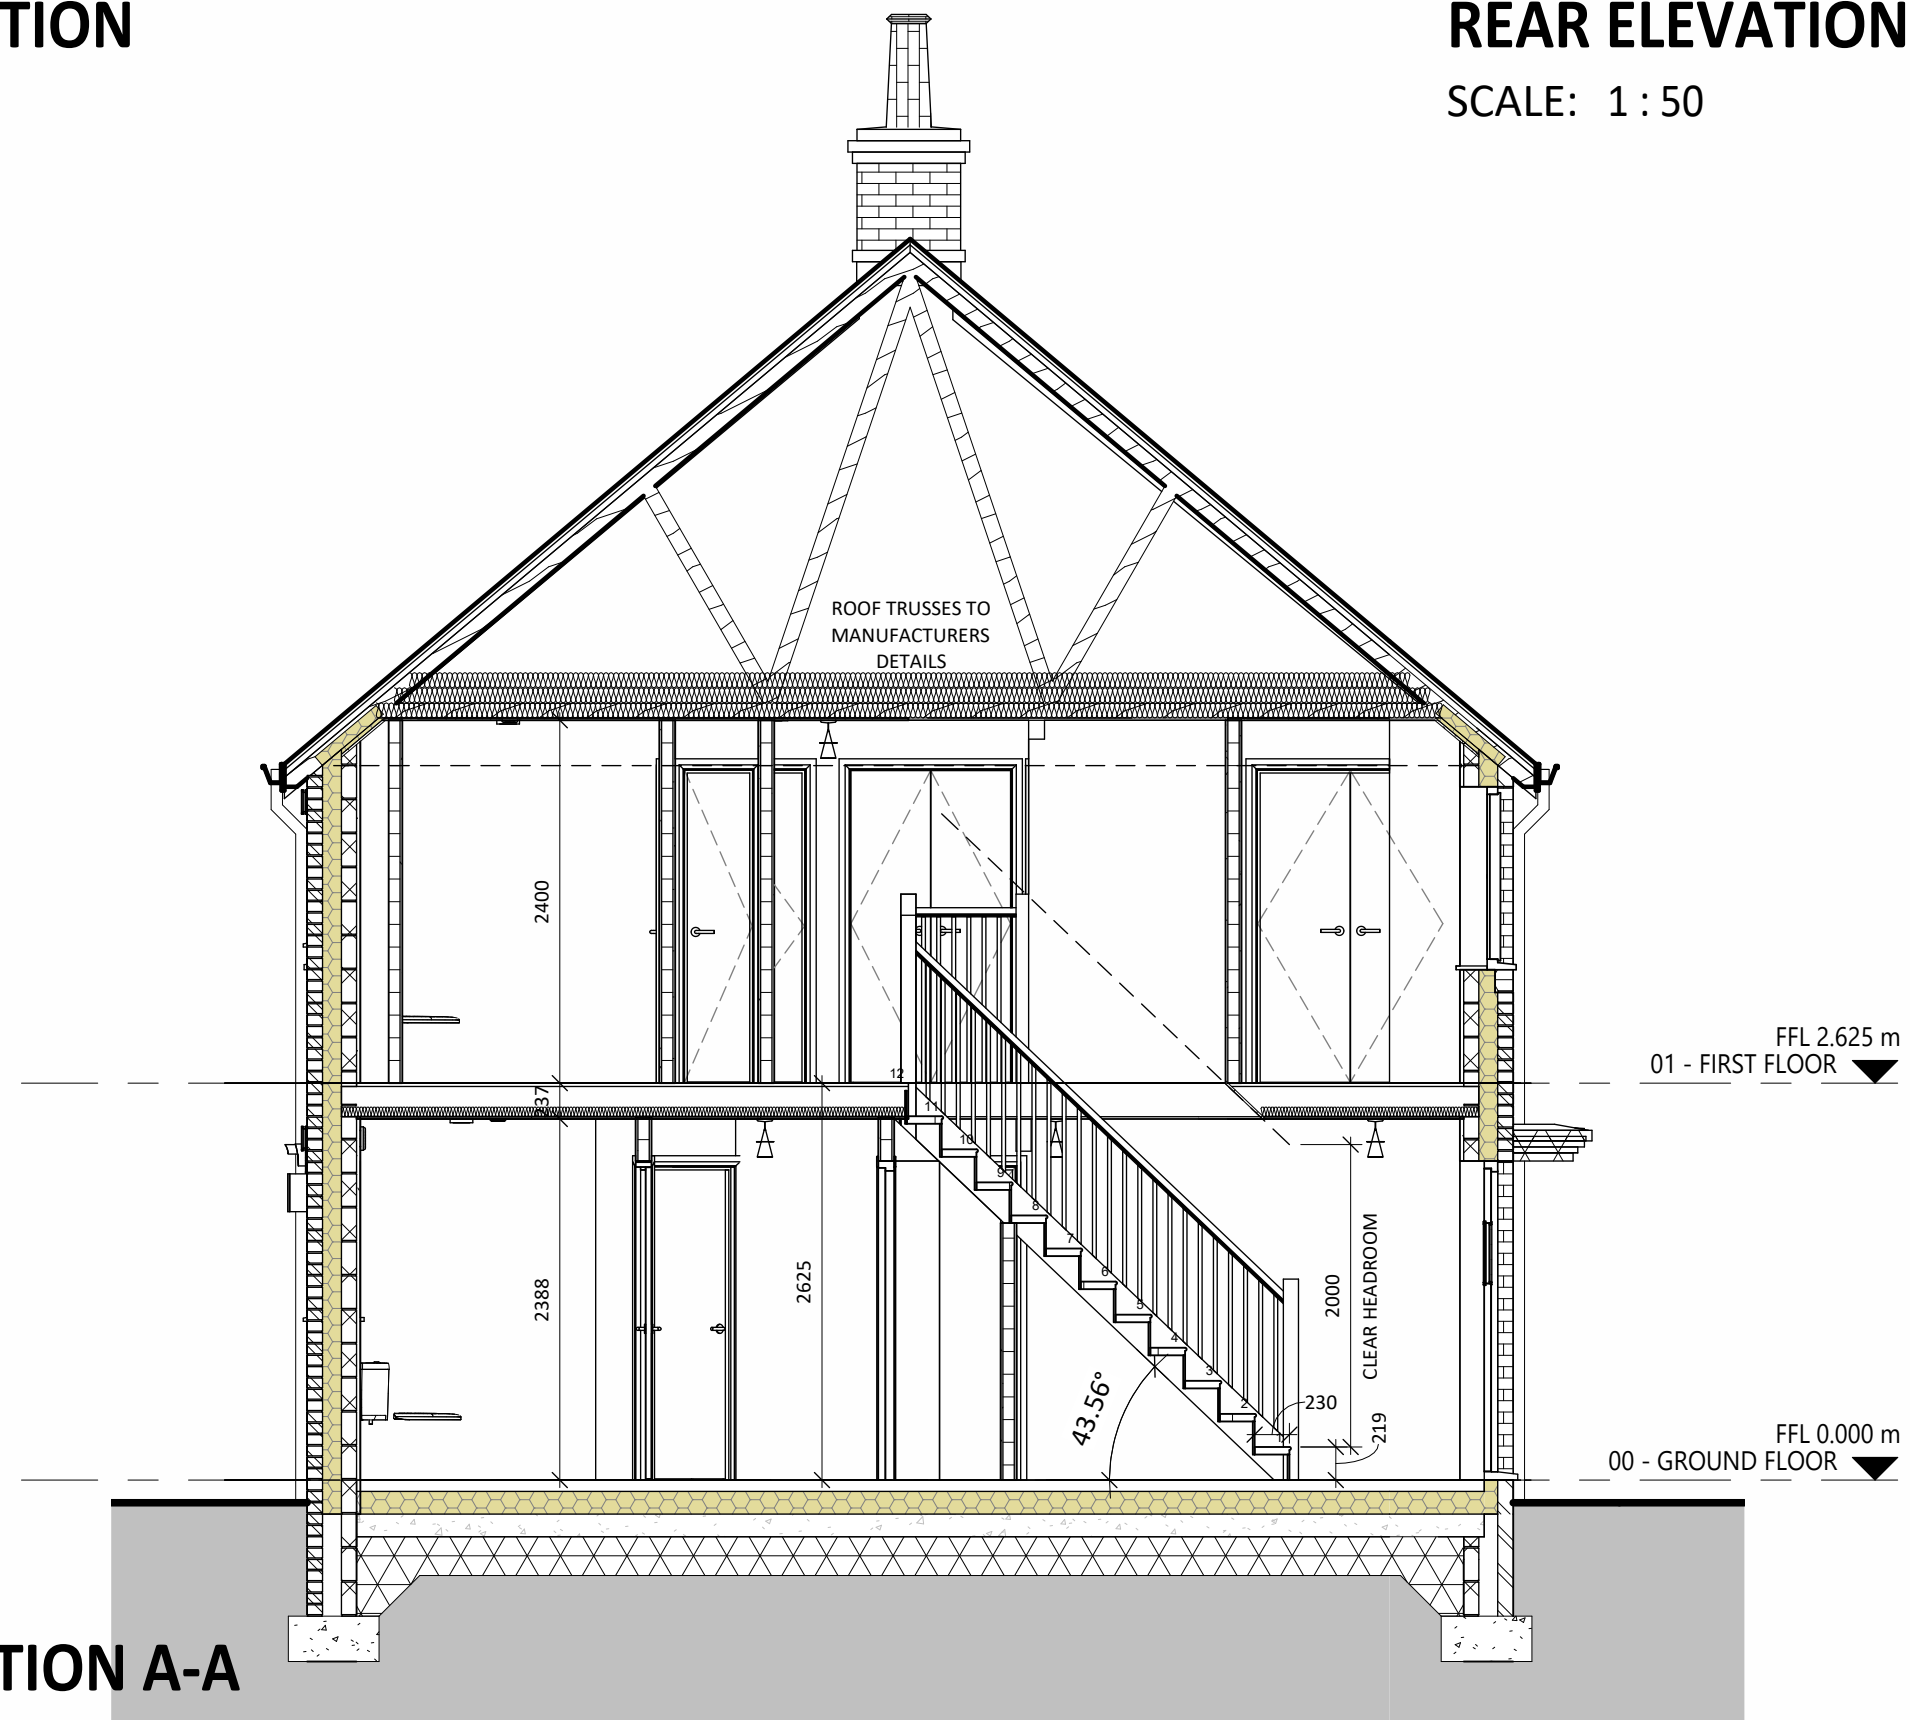

SECTION A-A
SCALE: 1 : 50

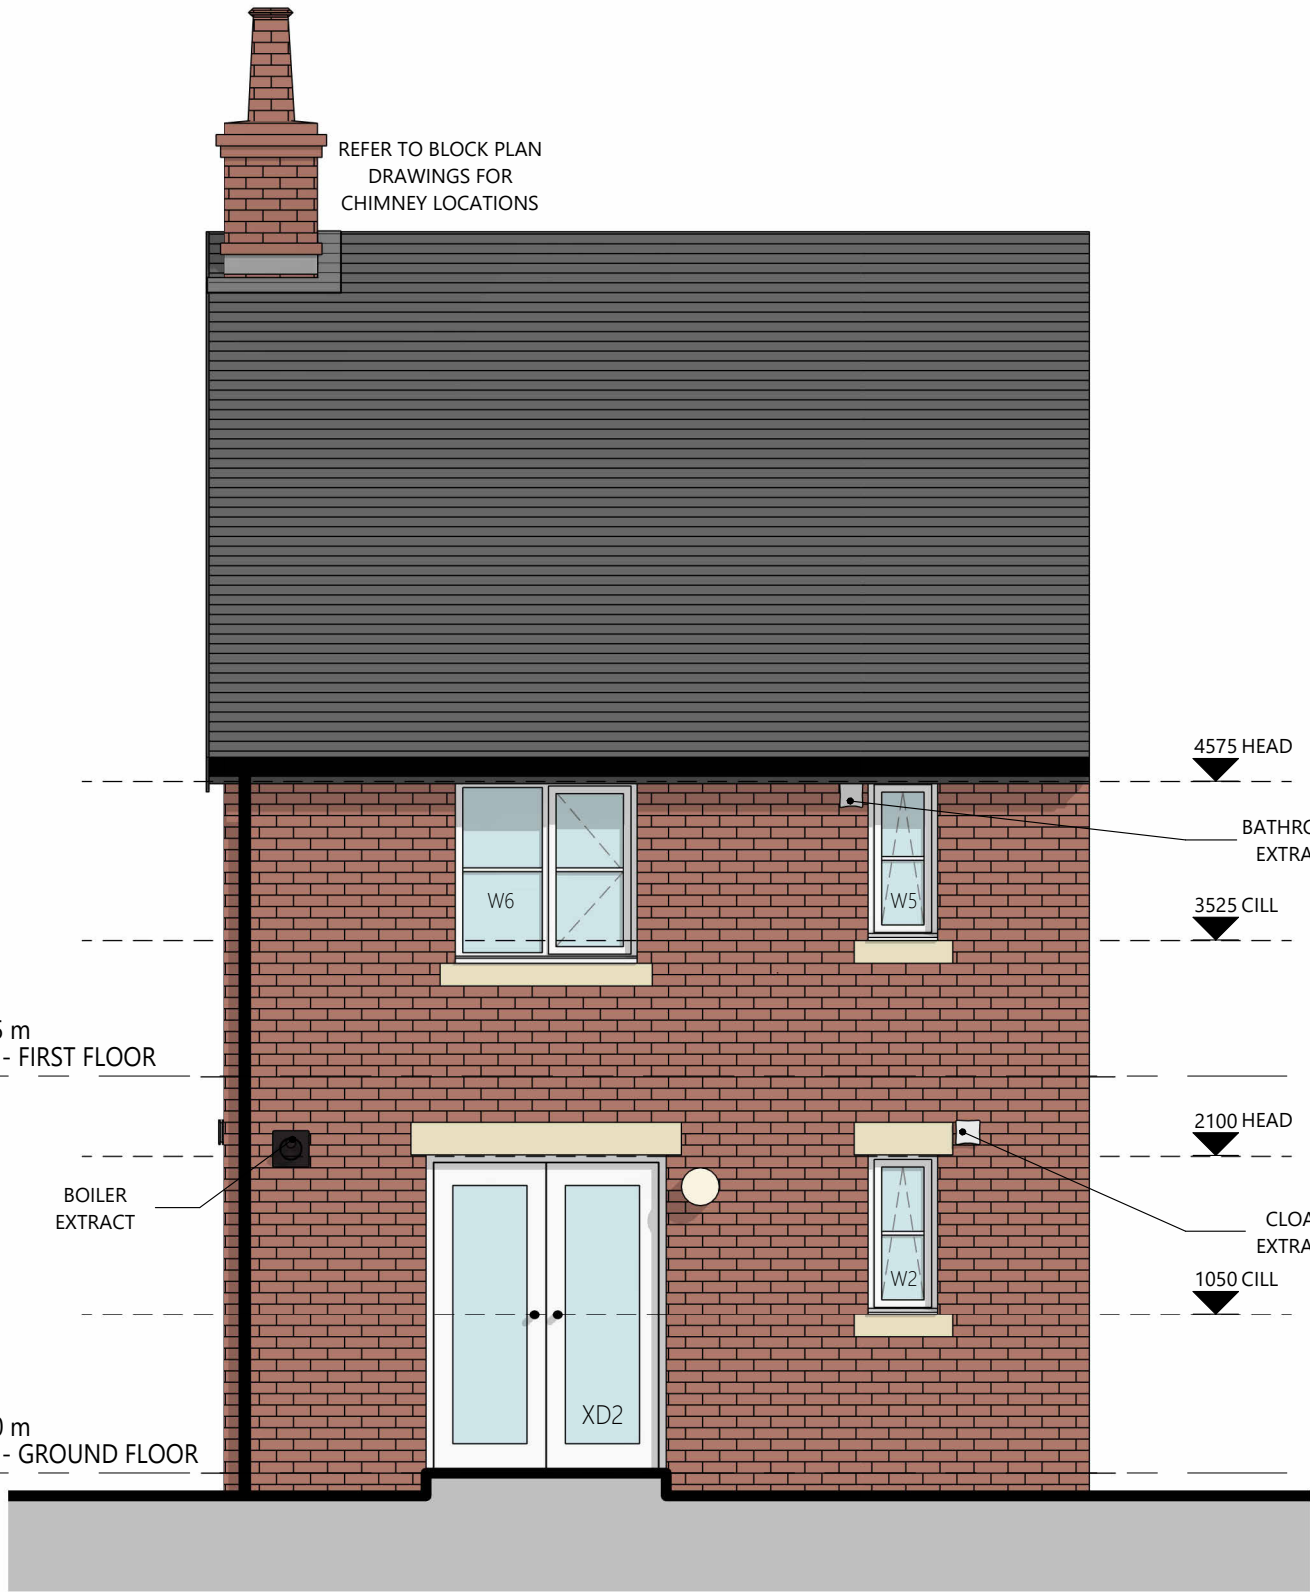

REAR ELEVATION
SCALE: 1 : 50

PRINTED:		25/08/2022 15:54:43		
REV:	DESCRIPTION:	DATE:	BY:	CHK:
P1	FIRST ISSUE	15/08/2022	DP	GJ
P2	REVISED ISSUE	25/08/2022	ME	DP