

DOOR SCHEDULE - TYPE C

REF	TYPE	HEIGHT	WIDTH	COMMENTS
00 - GROUND FLOOR				
D3	INT SINGLE	2110	836	
D4	NBS_DrsetSym_Interior-Double_Blank	2110	1510	
D5	INT SINGLE	2110	836	
D6	INT SINGLE	2110	684	
D7	INT SINGLE	2110	912	
XD1	ExtSgl IG XD63	2110	1023	
XD2	DoorExtDbl_Glazed with reveals	2110	1585	
01 - FIRST FLOOR				
D8	INT SINGLE	2110	836	
D9	INT SINGLE	2110	684	
D10	INT SINGLE	2110	836	
D11	INT SINGLE	2110	836	
D12	INT SINGLE	2110	836	
D13	INT SINGLE	2110	836	





ALL GLAZING BETWEEN FFL AND 800MM IN WALLS AND PARTITIONS AND BETWEEN FFL AND 1500MM IN A DOOR OR IN A SIDE PANEL CLOSE TO EITHER EDGE OF THE DOOR SHALL BE LAMINATED (NOT TOUGHENED) GLASS AS DEFINED IN BS6206:1981. SAFETY GLAZING TO BE PERMANENTLY MARKED TO COMPLY WITH BS 6206:1981.


WINDOW SCHEDULE - TYPE C

REF	TYPE	WIDTH	HEIGHT	COMMENTS
00 - GROUND FLOOR				
W1	460 x 1060	460	1060	OBSCUR
W2	1585 x 1510	1585	1510	
W3	1810 x 1060	1810	1060	
01 - FIRST FLOOR				
W4	460 x 975	460	975	OBSCUR
W5	460 x 975	460	975	OBSCUR
W6	1247.5 X 1211	1248	1210	
W7	1247.5 X 1211	1248	1210	
W8	1247.5 X 1211	1248	1210	

NOTE: BACKGROUND VENTILATION TO BE 8000 SQ MM TO HABITABLE ROOMS, 4000 SQMM TO BATHROOMS AND UTILITIES WHICH IS TO BE PROVIDED BY THE WINDOW AND EXTERNAL DOOR TRICKLE VENTS. GROUND FLOOR DOORS TO HABITABLE ROOMS AND ROOMS CONTAINING A WC TO HAVE A MINIMUM CLEAR OPENING OF 800MM WHEN NOT APPROACHED HEAD ON AND 750MM FINISHED GAP AT THE BOTTOM TO PROVIDE REQUIRED BACKGROUND VENTILATION (PROVIDE A 20MM UNFINISHED GAP WHERE FINISHES ARE NOT LAID). ALL CYLINDER DOORS TO BE VENTED EQUIVALENT TO 600MM².


WALL TYPES

EXTERNAL WALL		
BRICK OR RENDER ON LAY-LITE BLOCK OUTER LEAF, 125MM CAVITY FILLED WITH SUPABEAD INSULATION (K-0.033), 100MM THERMALITE TURBO BLOCK, PLASTERBOARD ON DABS, U-VALUE = 0.20 W/M ² K. IF USING THERMALITE 7N BLOCK THEN U-VALUE IS 0.21 W/M ² K		
PARTY WALL		
125MM FILLED/CLEAR CAVITY WITH EACH SIDE: - 100MM BLOCKWORK - 12.5MM PLASTERBOARD ON DABS WITH SKIM FINISH		
INTERNAL LOADBEARING WALL (REFER TO ENGINEERS DETAILS)		
- 100MM BLOCKWORK & 12.5MM PLASTERBOARD ON DABS WITH SKIM FINISH TO BOTH SIDES		
INTERNAL NON-LOADBEARING WALL		
- TIMBER STUDS (75X38 @ 600CENTS INDICATED) - 75MM ISOVER ACOUSTIC PARTITION ROLL (ONLY WHERE INDICATED) - WALL FINISHED BOTH SIDES WITH 1NO. LAYERS OF 12.5MM PLASTERBOARD AND SKIM FINISH UNLESS TILED.		

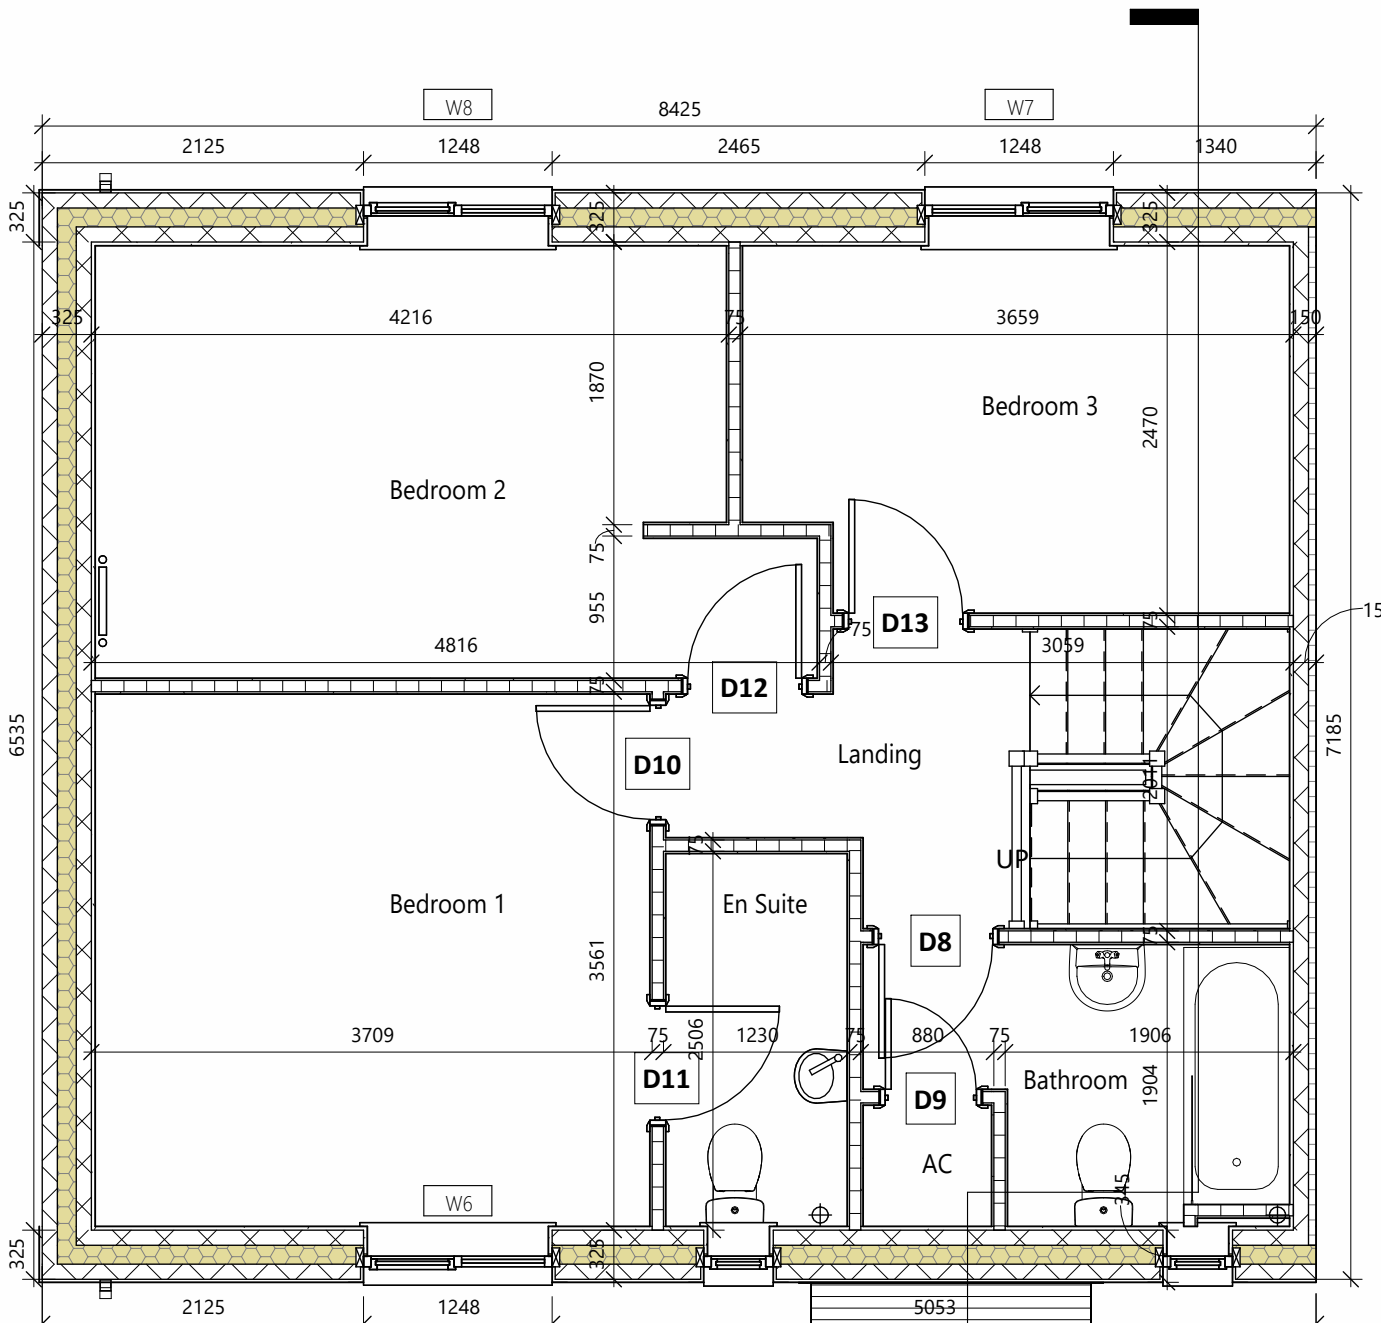


01 FIRST FLOOR STRUCTURAL

SCALE: 1 : 50

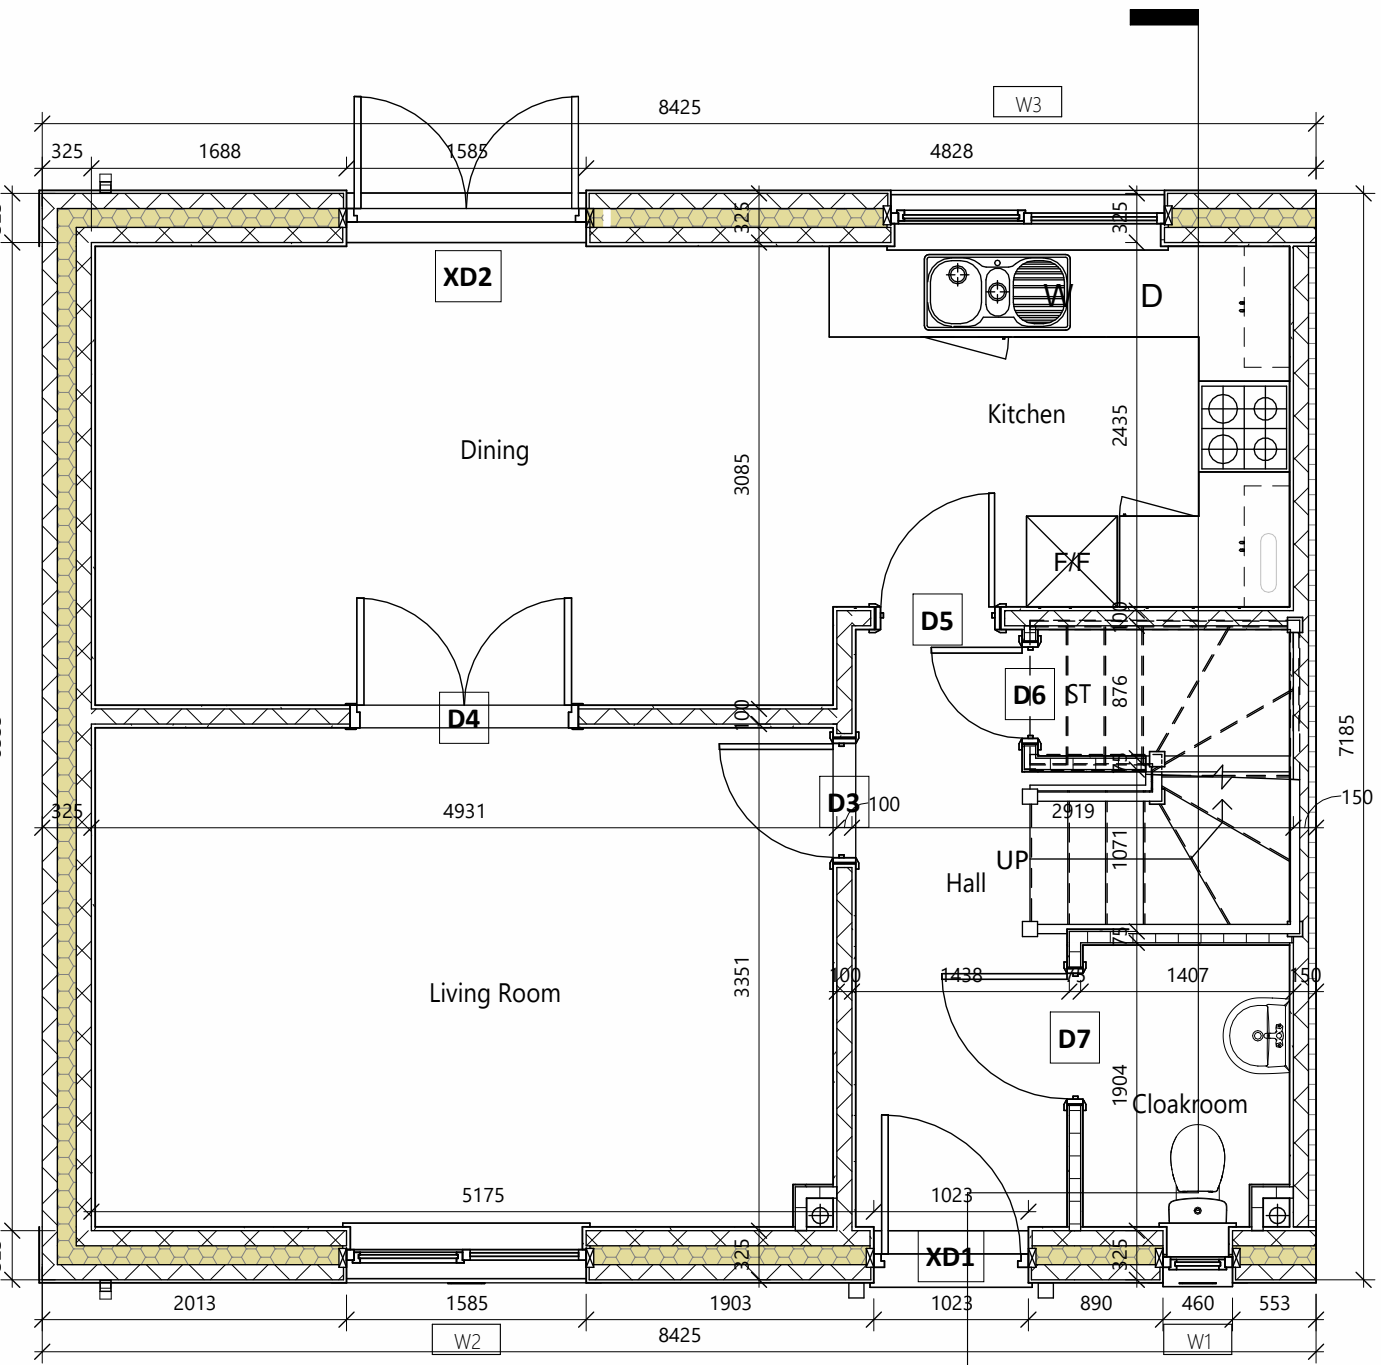


00 GROUND FLOOR STRUCTURAL

SCALE: 1 : 50

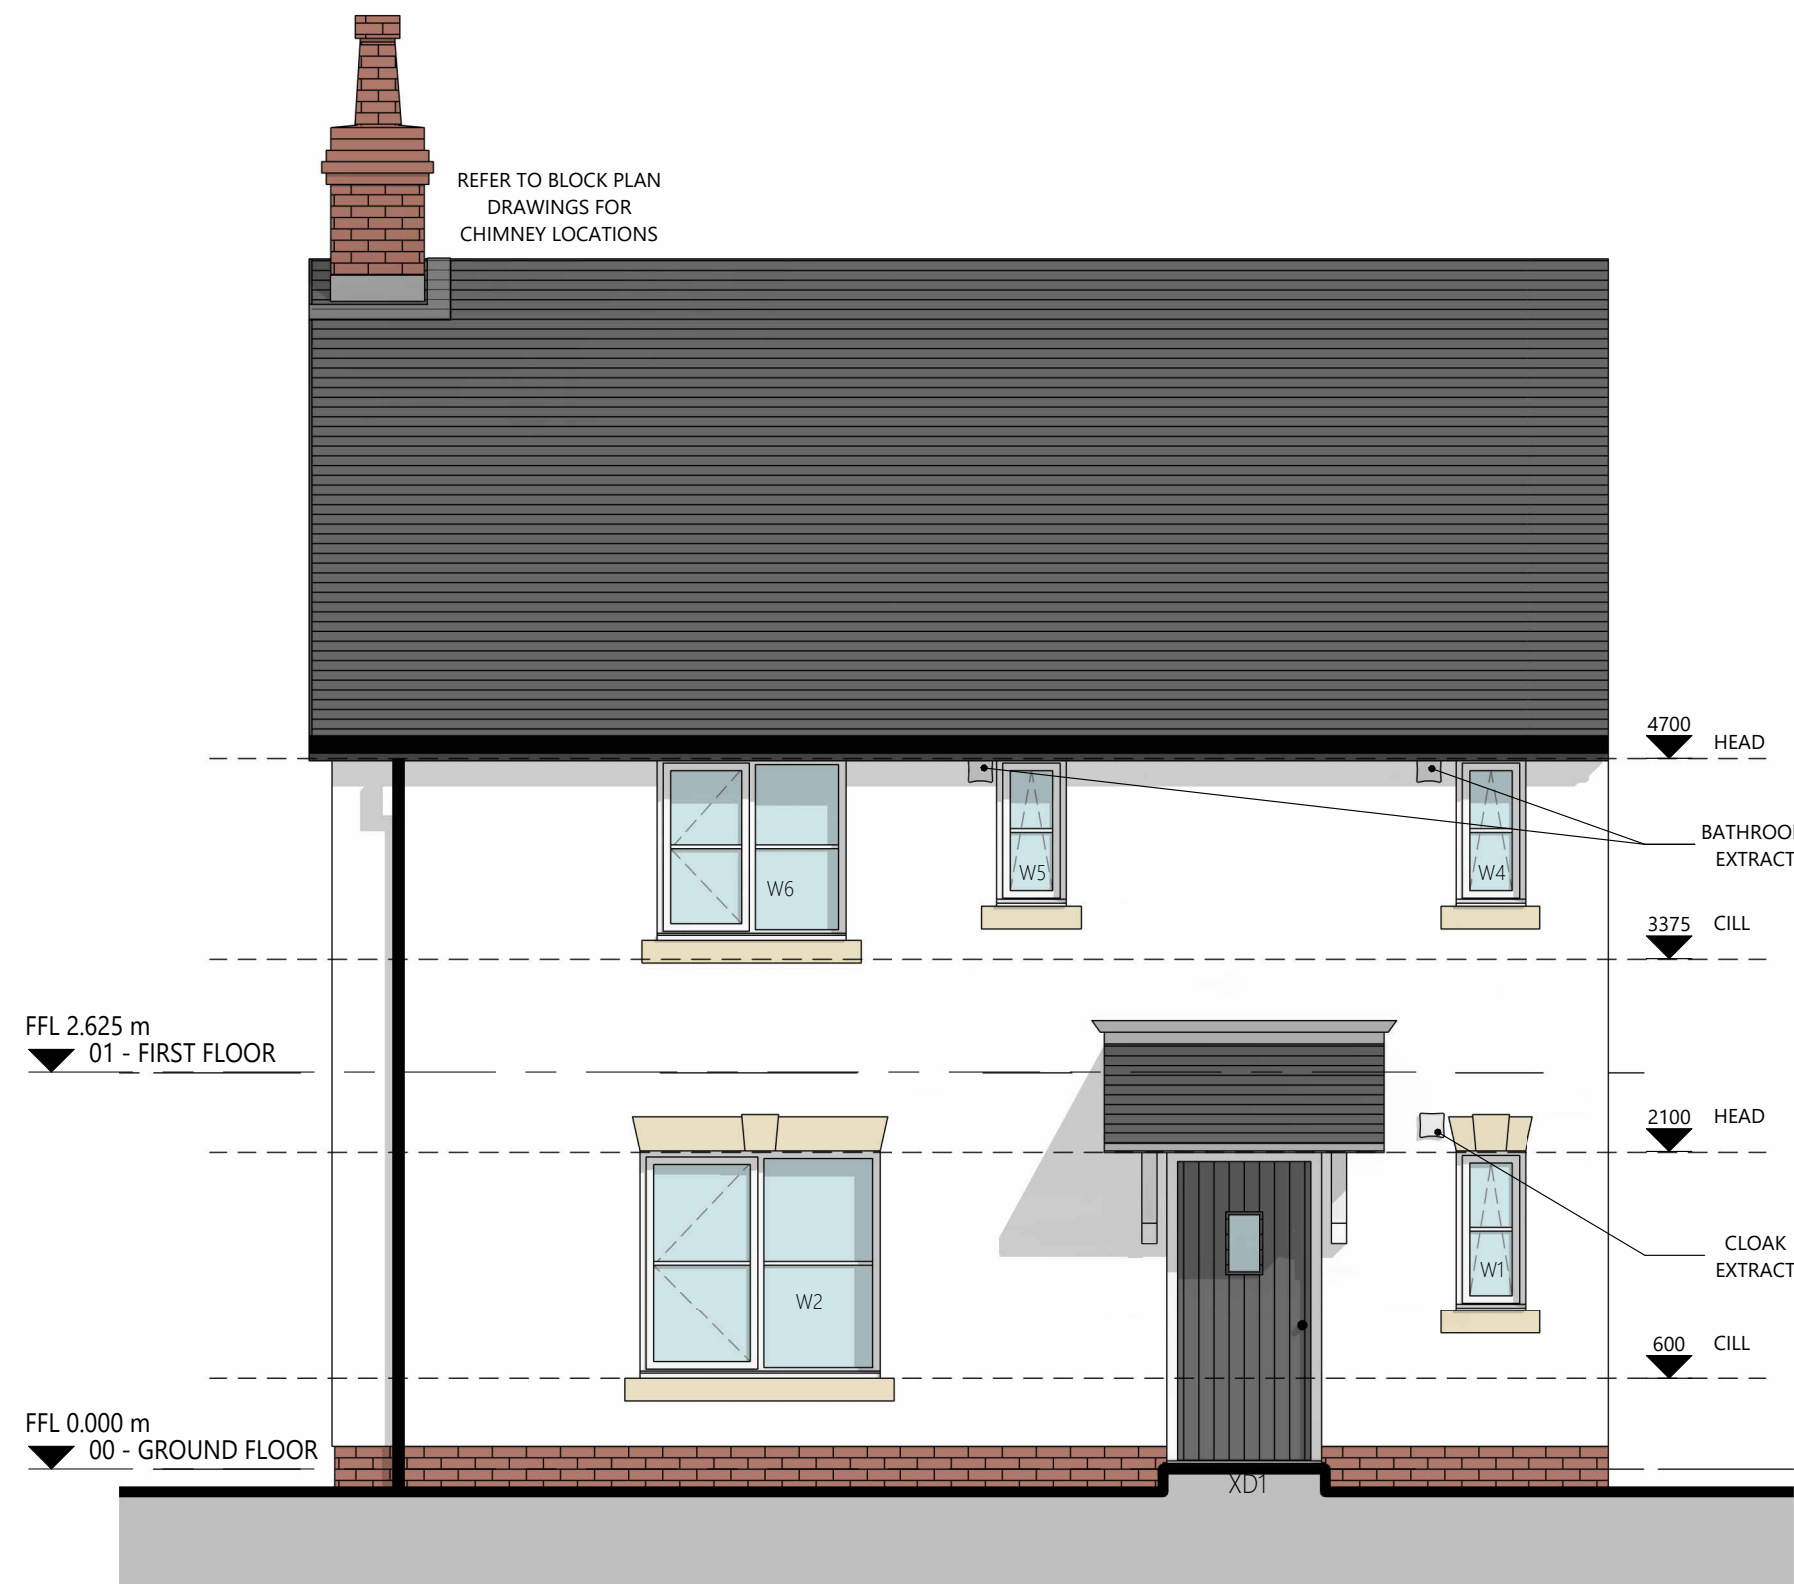

FRONT ELEVATION

SCALE: 1 : 50

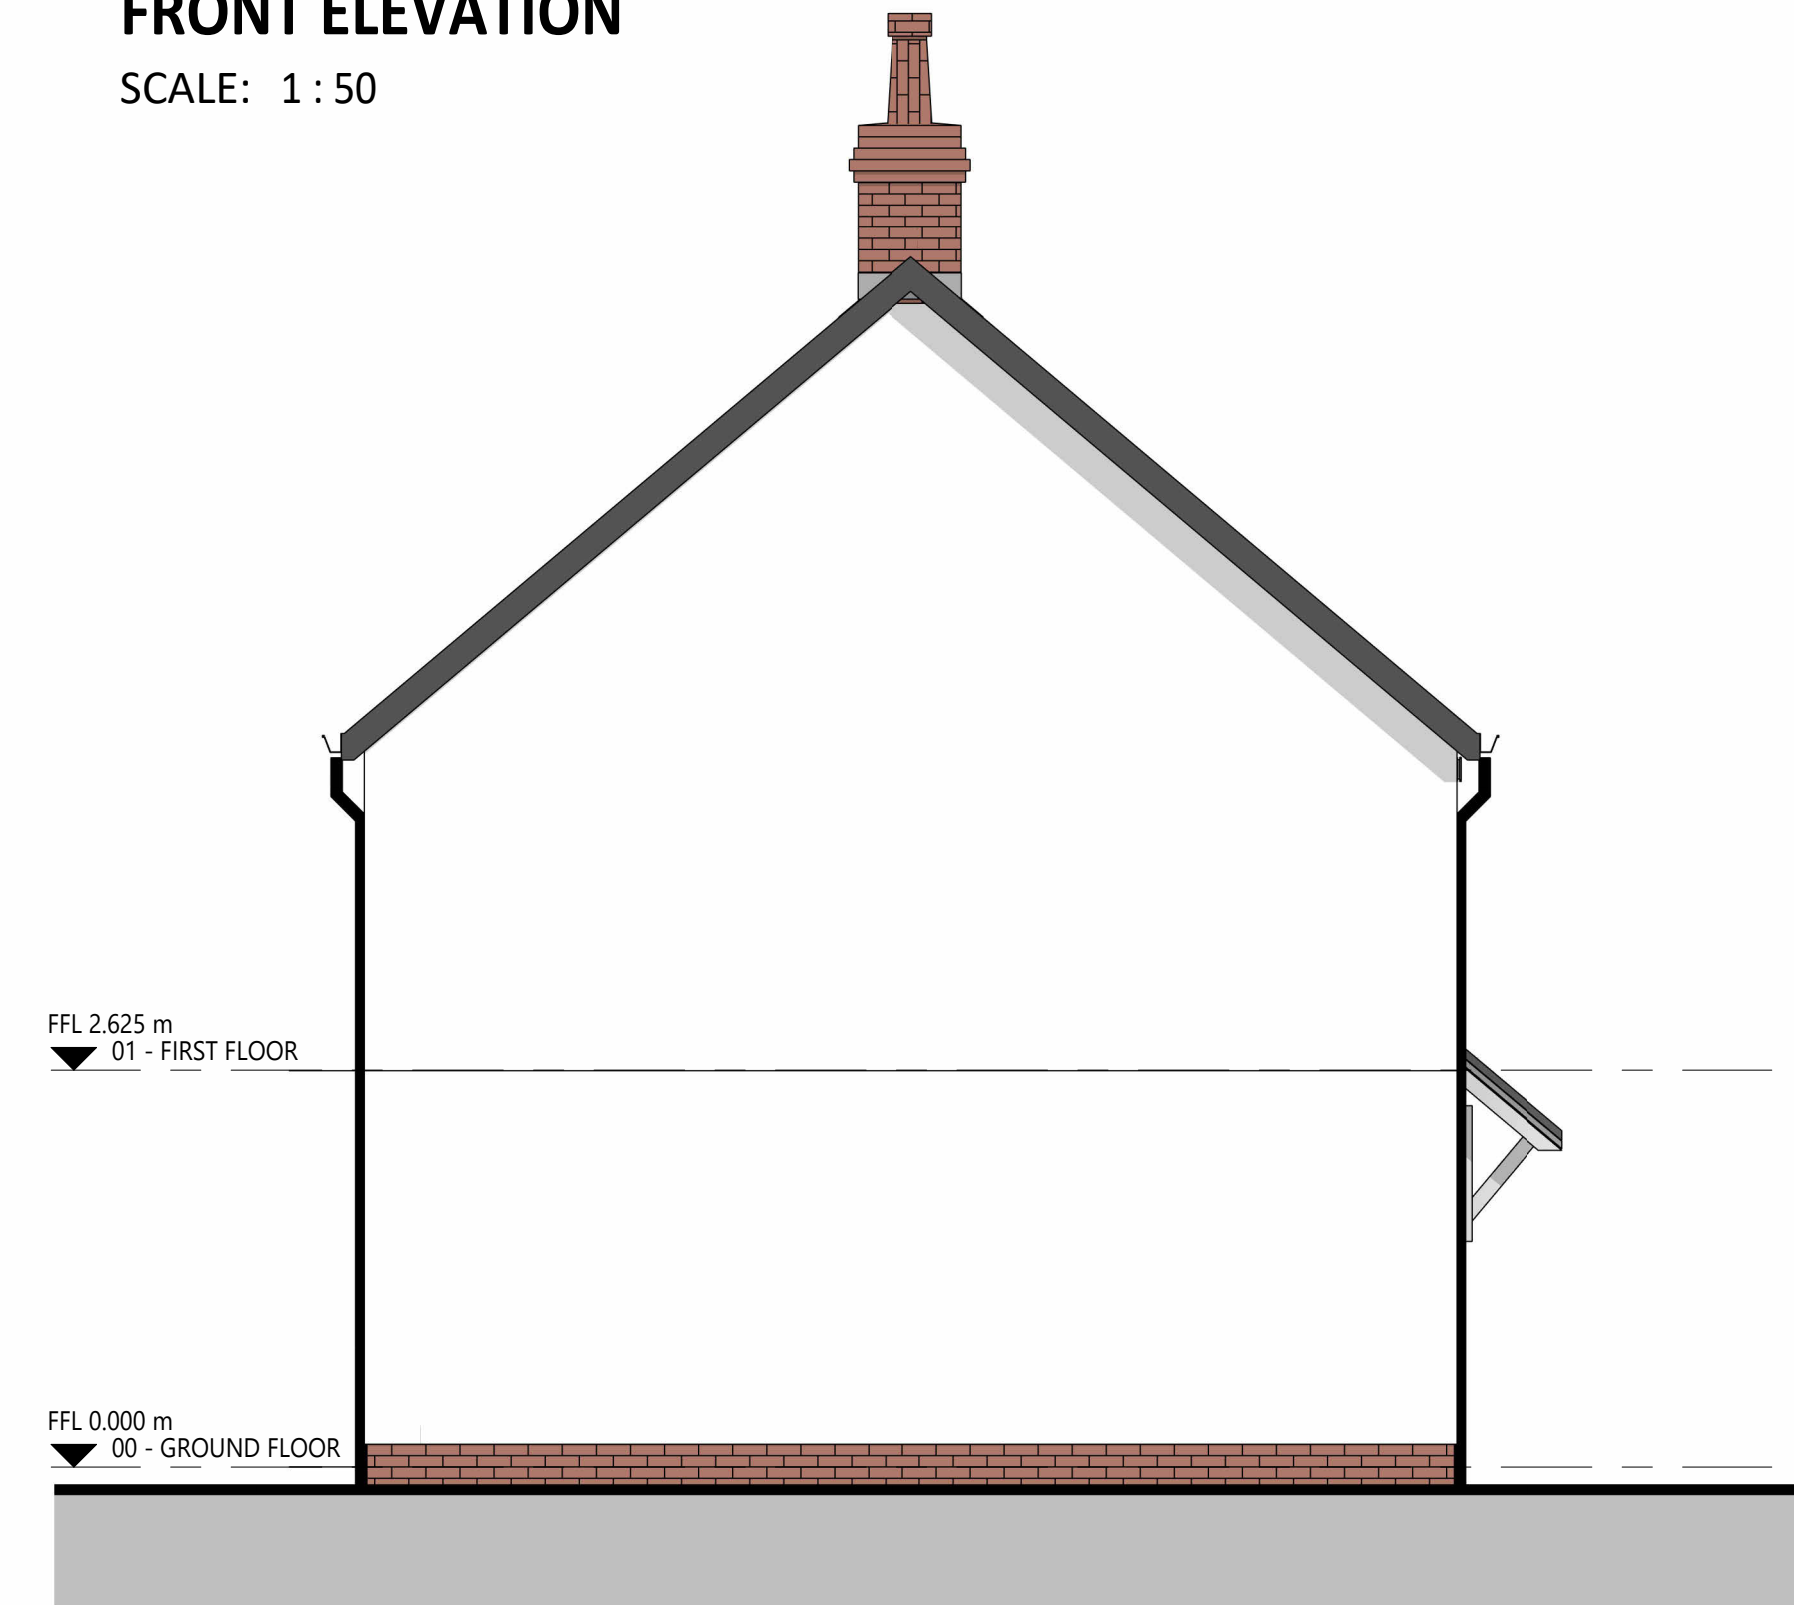


LH GABLE ELEVATION

SCALE: 1 : 50



REAR ELEVATION

SCALE: 1 : 50

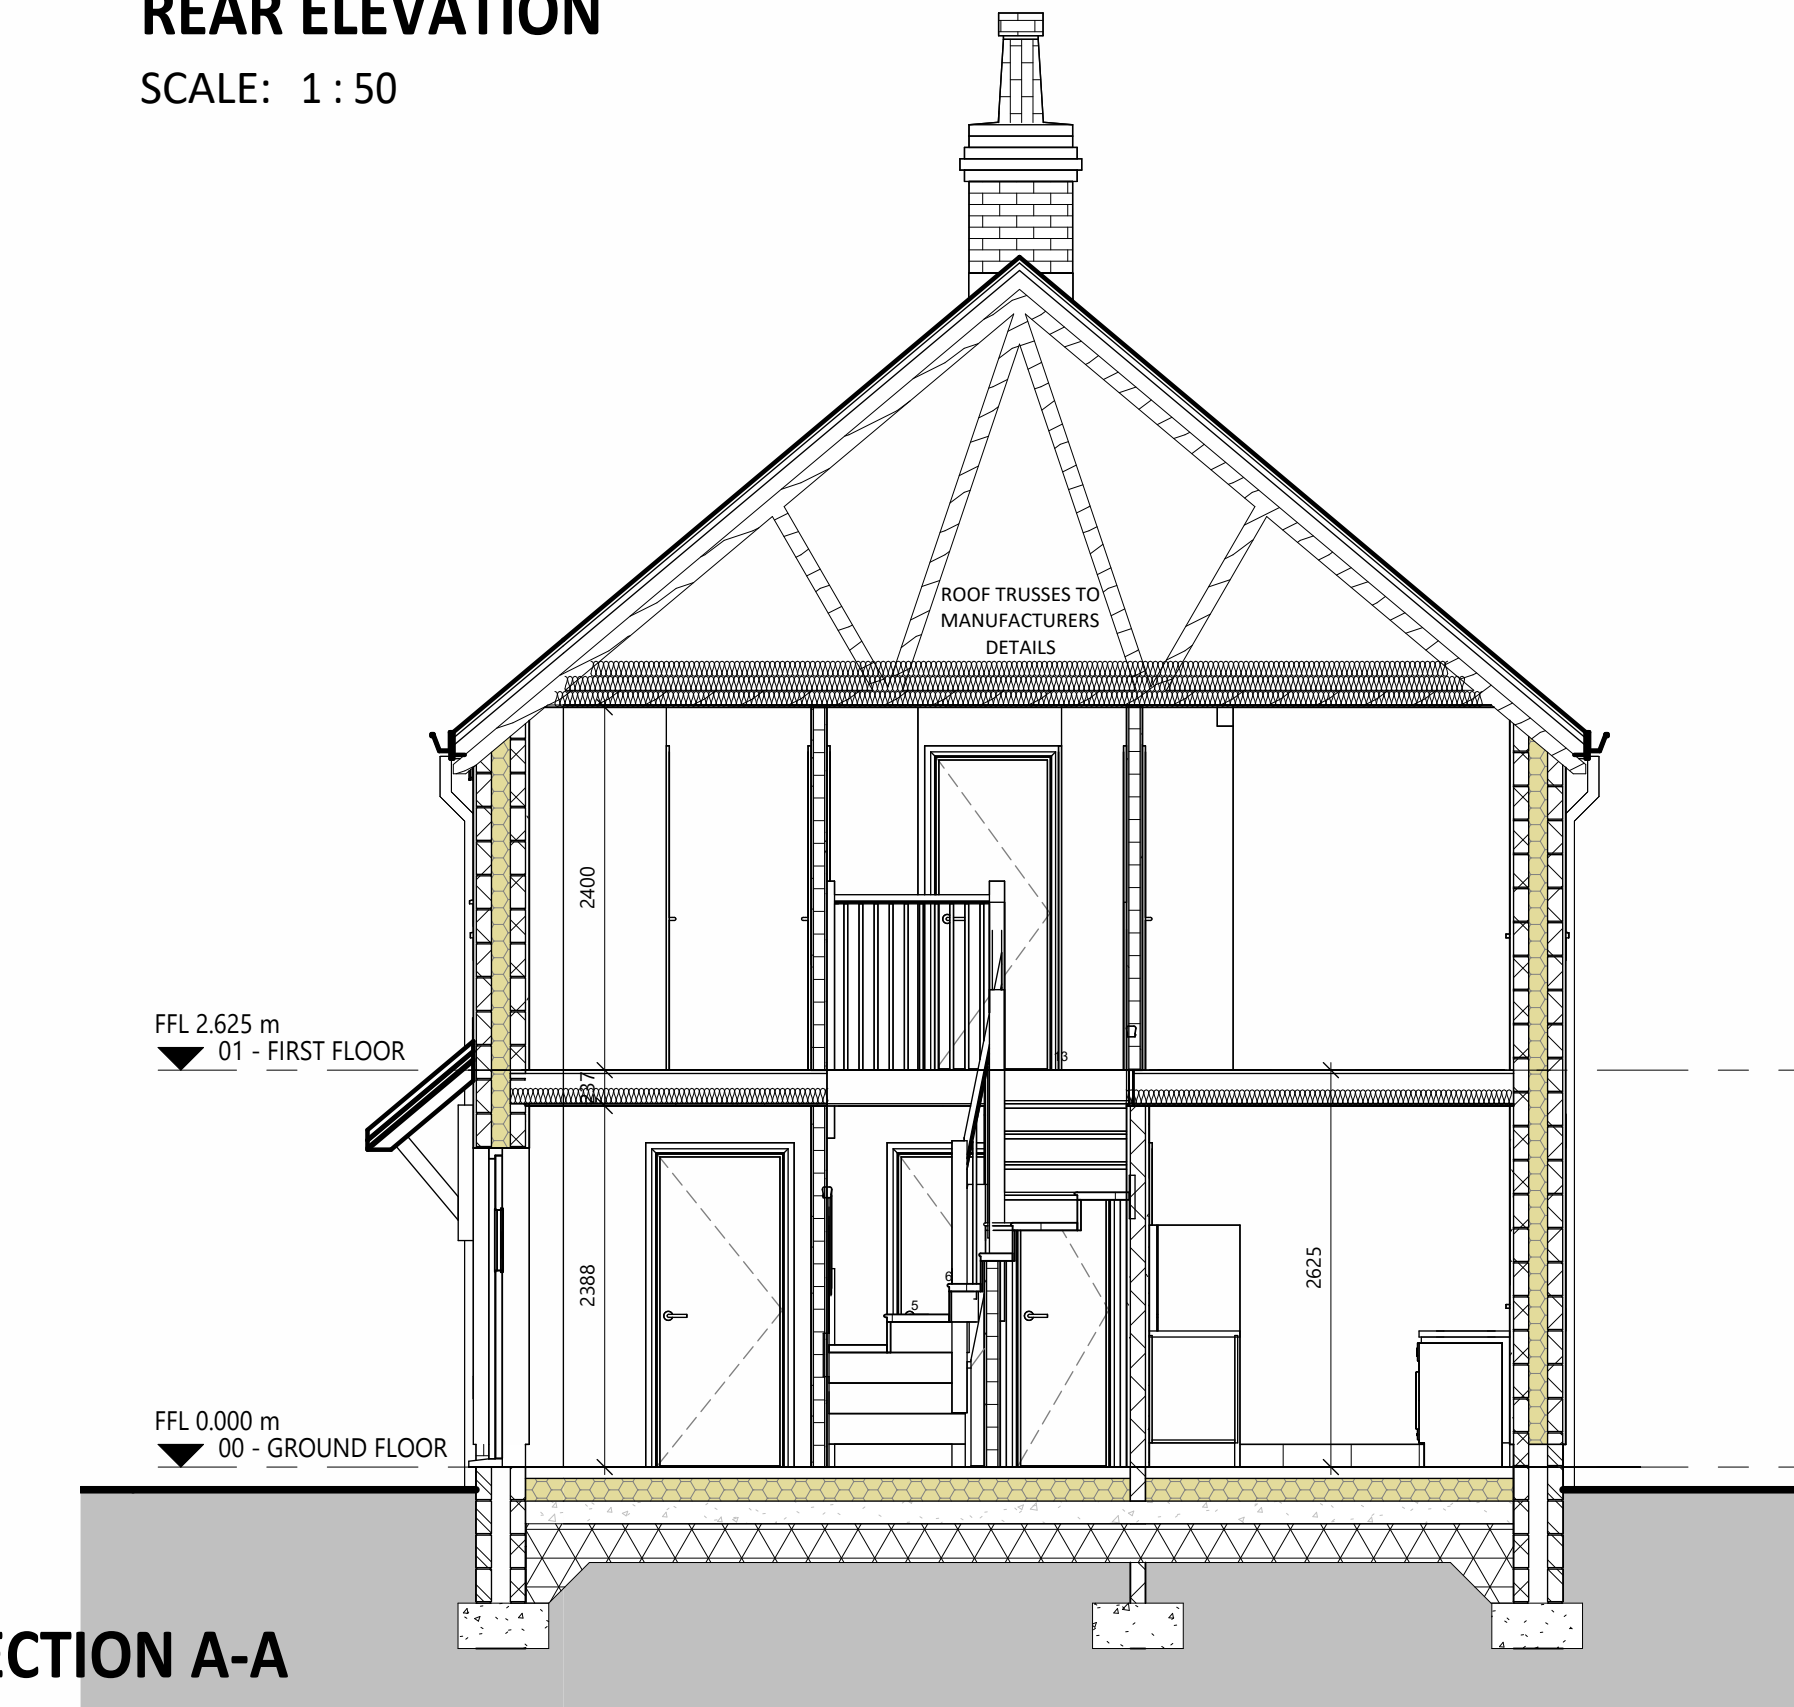

SECTION A-A

SCALE: 1 : 50