



DOOR SCHEDULE - TYPE G					WALL TYPES
REF	TYPE	HEIGHT	WIDTH	COMMENTS	
ALL GLAZING BETWEEN FFL AND 800MM IN WALLS AND PARTITIONS AND BETWEEN FFL AND 1500MM IN A DOOR OR IN A SIDE PANEL CLOSE TO EITHER EDGE OF THE DOOR SHALL BE LAMINATED (NOT TOUCHED) GLASS AS DEFINED IN BS6206:1981. SAFETY GLAZING TO BE PERMANENTLY MARKED TO COMPLY WITH BS 6206:1981.					
00 - GROUND FLOOR					
D5	INT SINGLE	2110	836		
D6	INT SINGLE	2110	836		
D7	INT SINGLE	2110	760		
D8	INT SINGLE	2110	836		
D9	INT SINGLE	2110	836		
D10	INT SINGLE	2110	836		
D11	INT SINGLE	2110	912		
XD1	ExtSgl w/ XD63	2110	1023		
XD2	DoorExtDbl Glazed with reveals	2110	1585		
XD3	EXT SINGLE GLAZED	2110	910		
XD4	DoorExtDbl Glazed with reveals	2110	1585		
01 - FIRST FLOOR					
D12	INT SINGLE	2110	836		
D13	INT SINGLE	2110	836		
D14	INT SINGLE	2110	836		
D15	INT SINGLE	2110	760		
D16	INT SINGLE	2110	836		
D17	INT SINGLE	2110	836		
D18	INT SINGLE	2110	836		
D19	INT SINGLE	2110	836		
NOTE: BACKGROUND VENTILATION TO BE 8000 SQ MM TO HABITABLE ROOMS, 4000 SQMM TO BATHROOMS AND UTILITIES WHICH IS TO BE PROVIDED BY THE WINDOW AND EXTERNAL DOOR TRICKLE VENTS. GROUND FLOOR DOORS TO HABITABLE ROOMS AND ROOMS CONTAINING A WC TO HAVE A MINIMUM CLEAR OPENING OF 800MM WHEN NOT APPROACHED HEAD ON AND 750MM FINISHED GAP AT THE BOTTOM TO PROVIDE REQUIRED BACKGROUND VENTILATION (PROVIDE A 20MM UNFINISHED GAP WHERE FINISHES ARE NOT Laid). ALL CYLINDER DOORS TO BE VENTED EQUIVALENT TO 600MM2.					
WINDOW SCHEDULE - TYPE G					WALL TYPES
REF	TYPE	WIDTH	HEIGHT	COMMENTS	
00 - GROUND FLOOR					
W1	1585 x 1510	1585	1510		
W2	1135 x 1510	1135	1510		
W3	450 x 1510	450	1510		
W4	450 x 1510	450	1510		
W5	460 x 1510	460	1510		
W6	460 x 1510	460	1510		
01 - FIRST FLOOR					
W7	GGL Integre size 660x978 (TK04)	660	978		
W8	GGL Integre size 660x978 (TK04)	660	978		
W9	1135 x 1210	1135	1210		
W10	460 x 760	460	760	OBSCURE	
W11	1135 x 1210	1135	1210		
W12	1135 x 1210	1135	1210		
W13	460 x 1060	460	1060		
W14	460 x 1060	460	1060	OBSCURE	
W15	910 x 1060	910	1060	OBSCURE	
W16	910 x 760	910	760		
W17	1585 x 760	1585	760		
W18	910 x 1210	910	1210		
W19	460 x 1210	460	1210		
NOTE: BACKGROUND VENTILATION TO BE 8000 SQ MM TO HABITABLE ROOMS, 4000 SQMM TO BATHROOMS AND UTILITIES WHICH IS TO BE PROVIDED BY THE WINDOW AND EXTERNAL DOOR TRICKLE VENTS. GROUND FLOOR DOORS TO HABITABLE ROOMS AND ROOMS CONTAINING A WC TO HAVE A MINIMUM CLEAR OPENING OF 800MM WHEN NOT APPROACHED HEAD ON AND 750MM FINISHED GAP AT THE BOTTOM TO PROVIDE REQUIRED BACKGROUND VENTILATION (PROVIDE A 20MM UNFINISHED GAP WHERE FINISHES ARE NOT Laid). ALL CYLINDER DOORS TO BE VENTED EQUIVALENT TO 600MM2.					




01 FIRST FLOOR STRUCTURAL
SCALE: 1 : 50

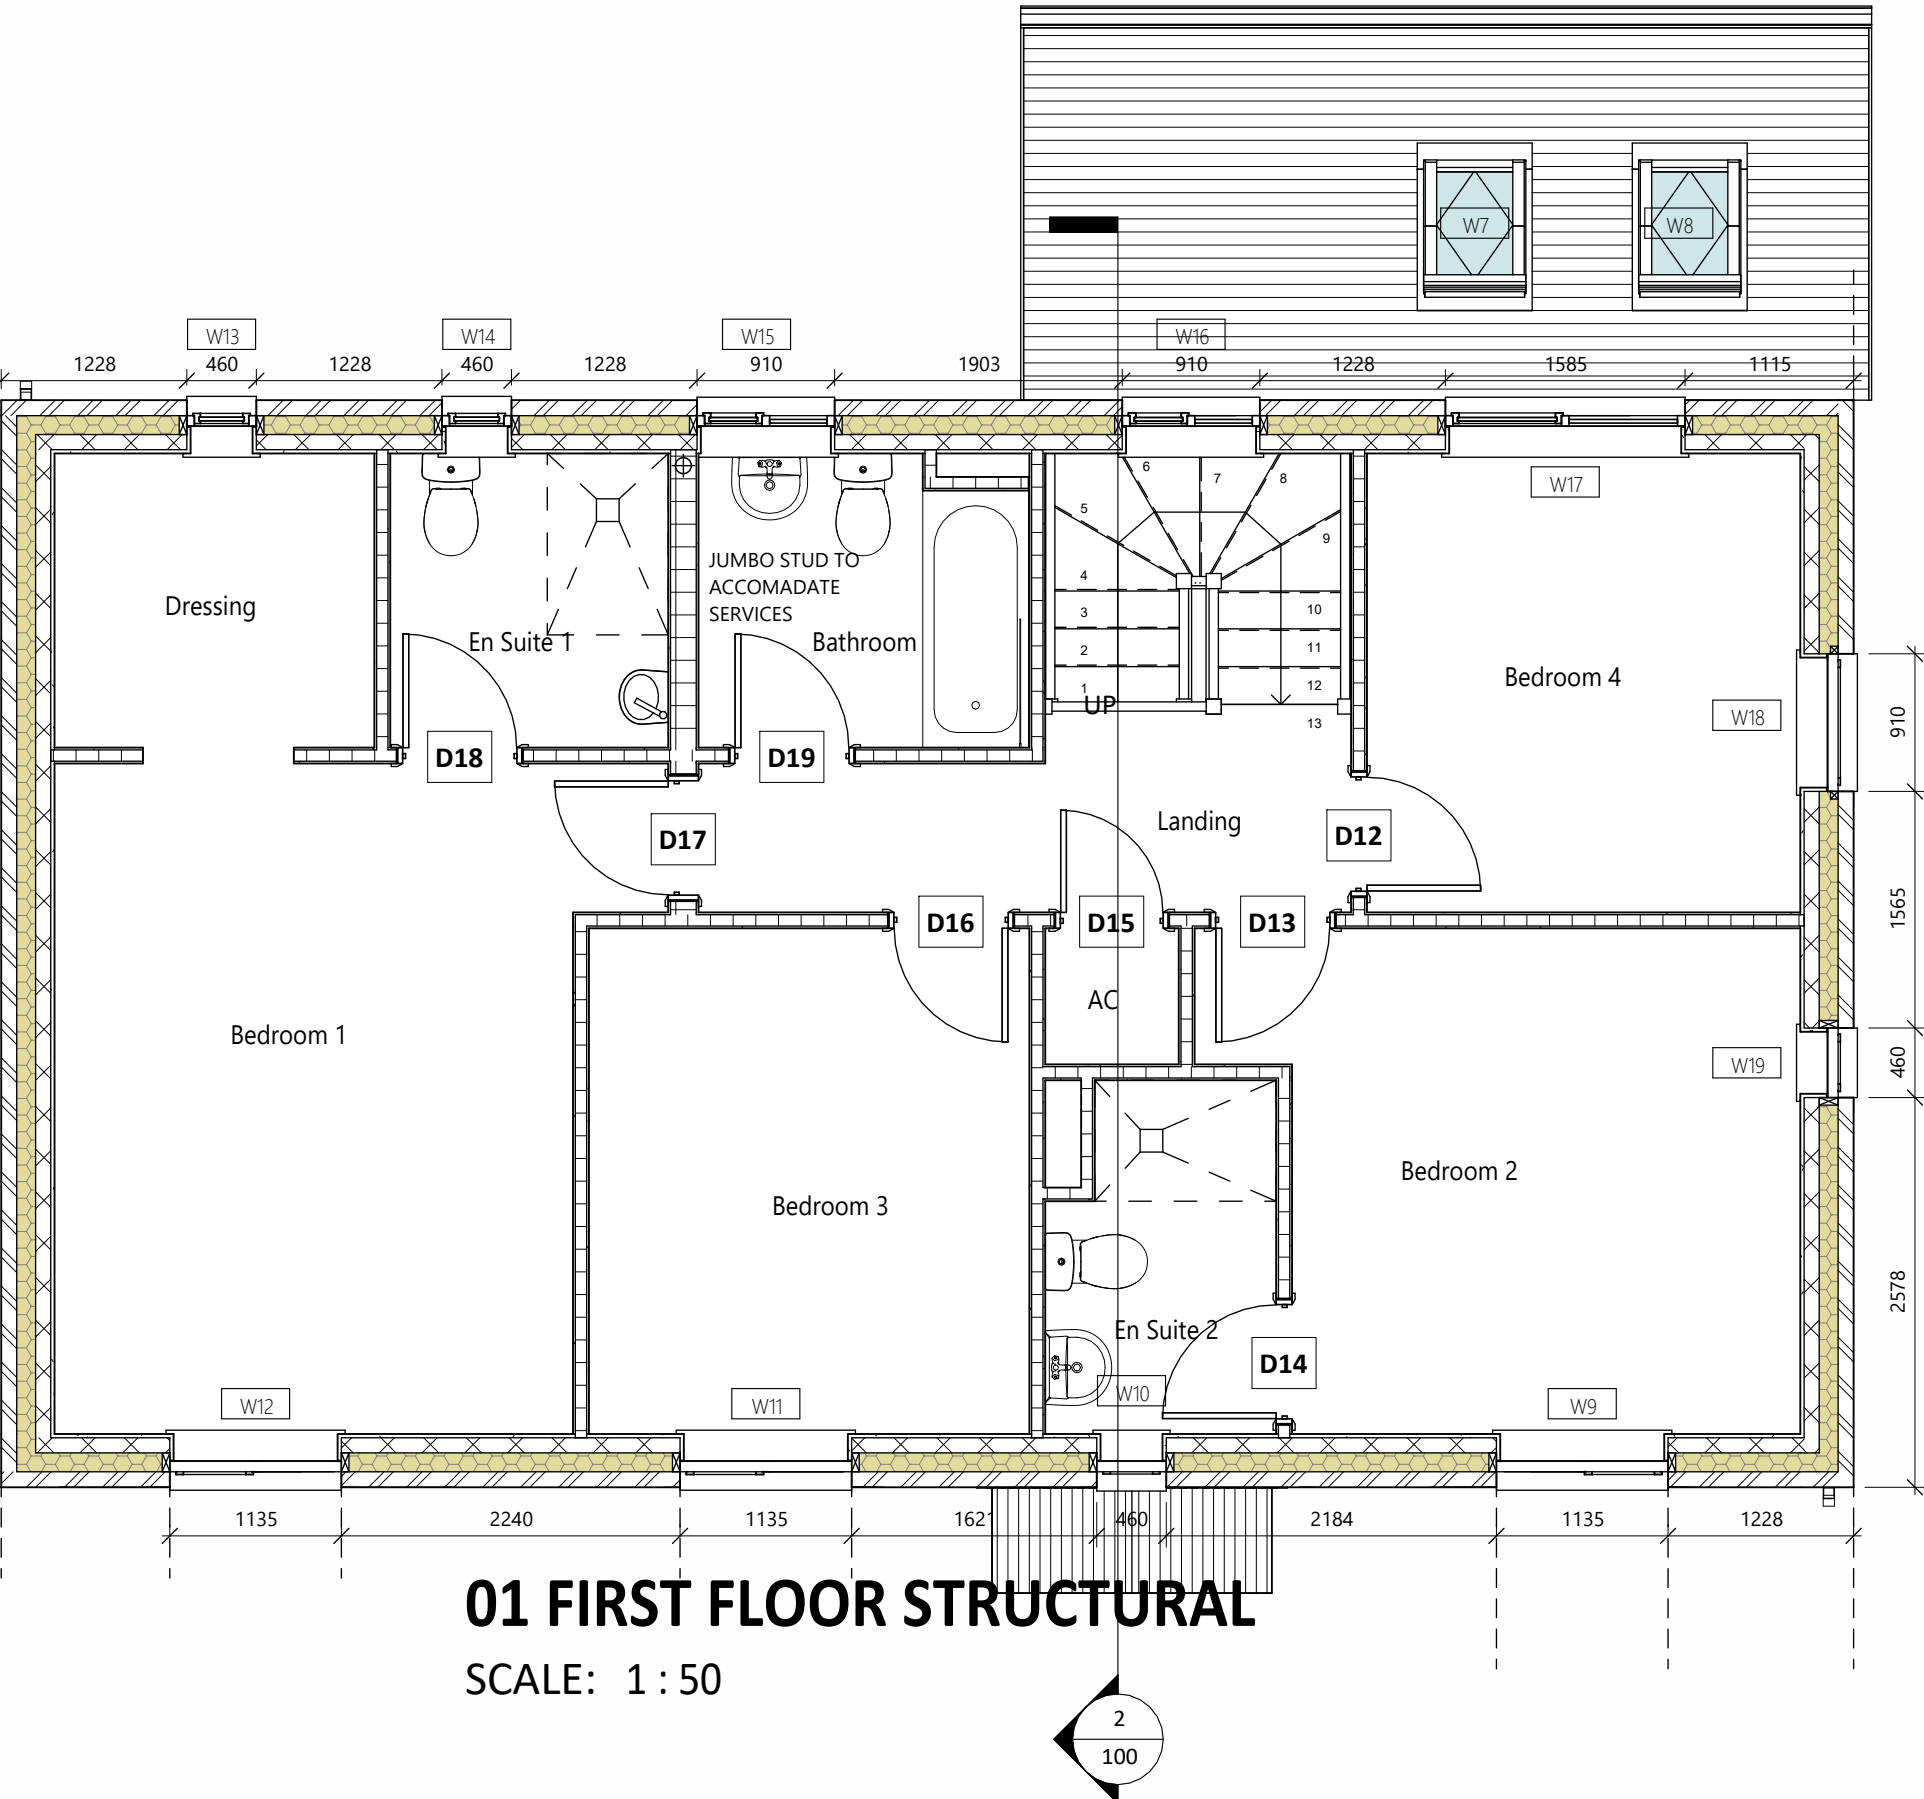


FRONT ELEVATION
SCALE: 1 : 50

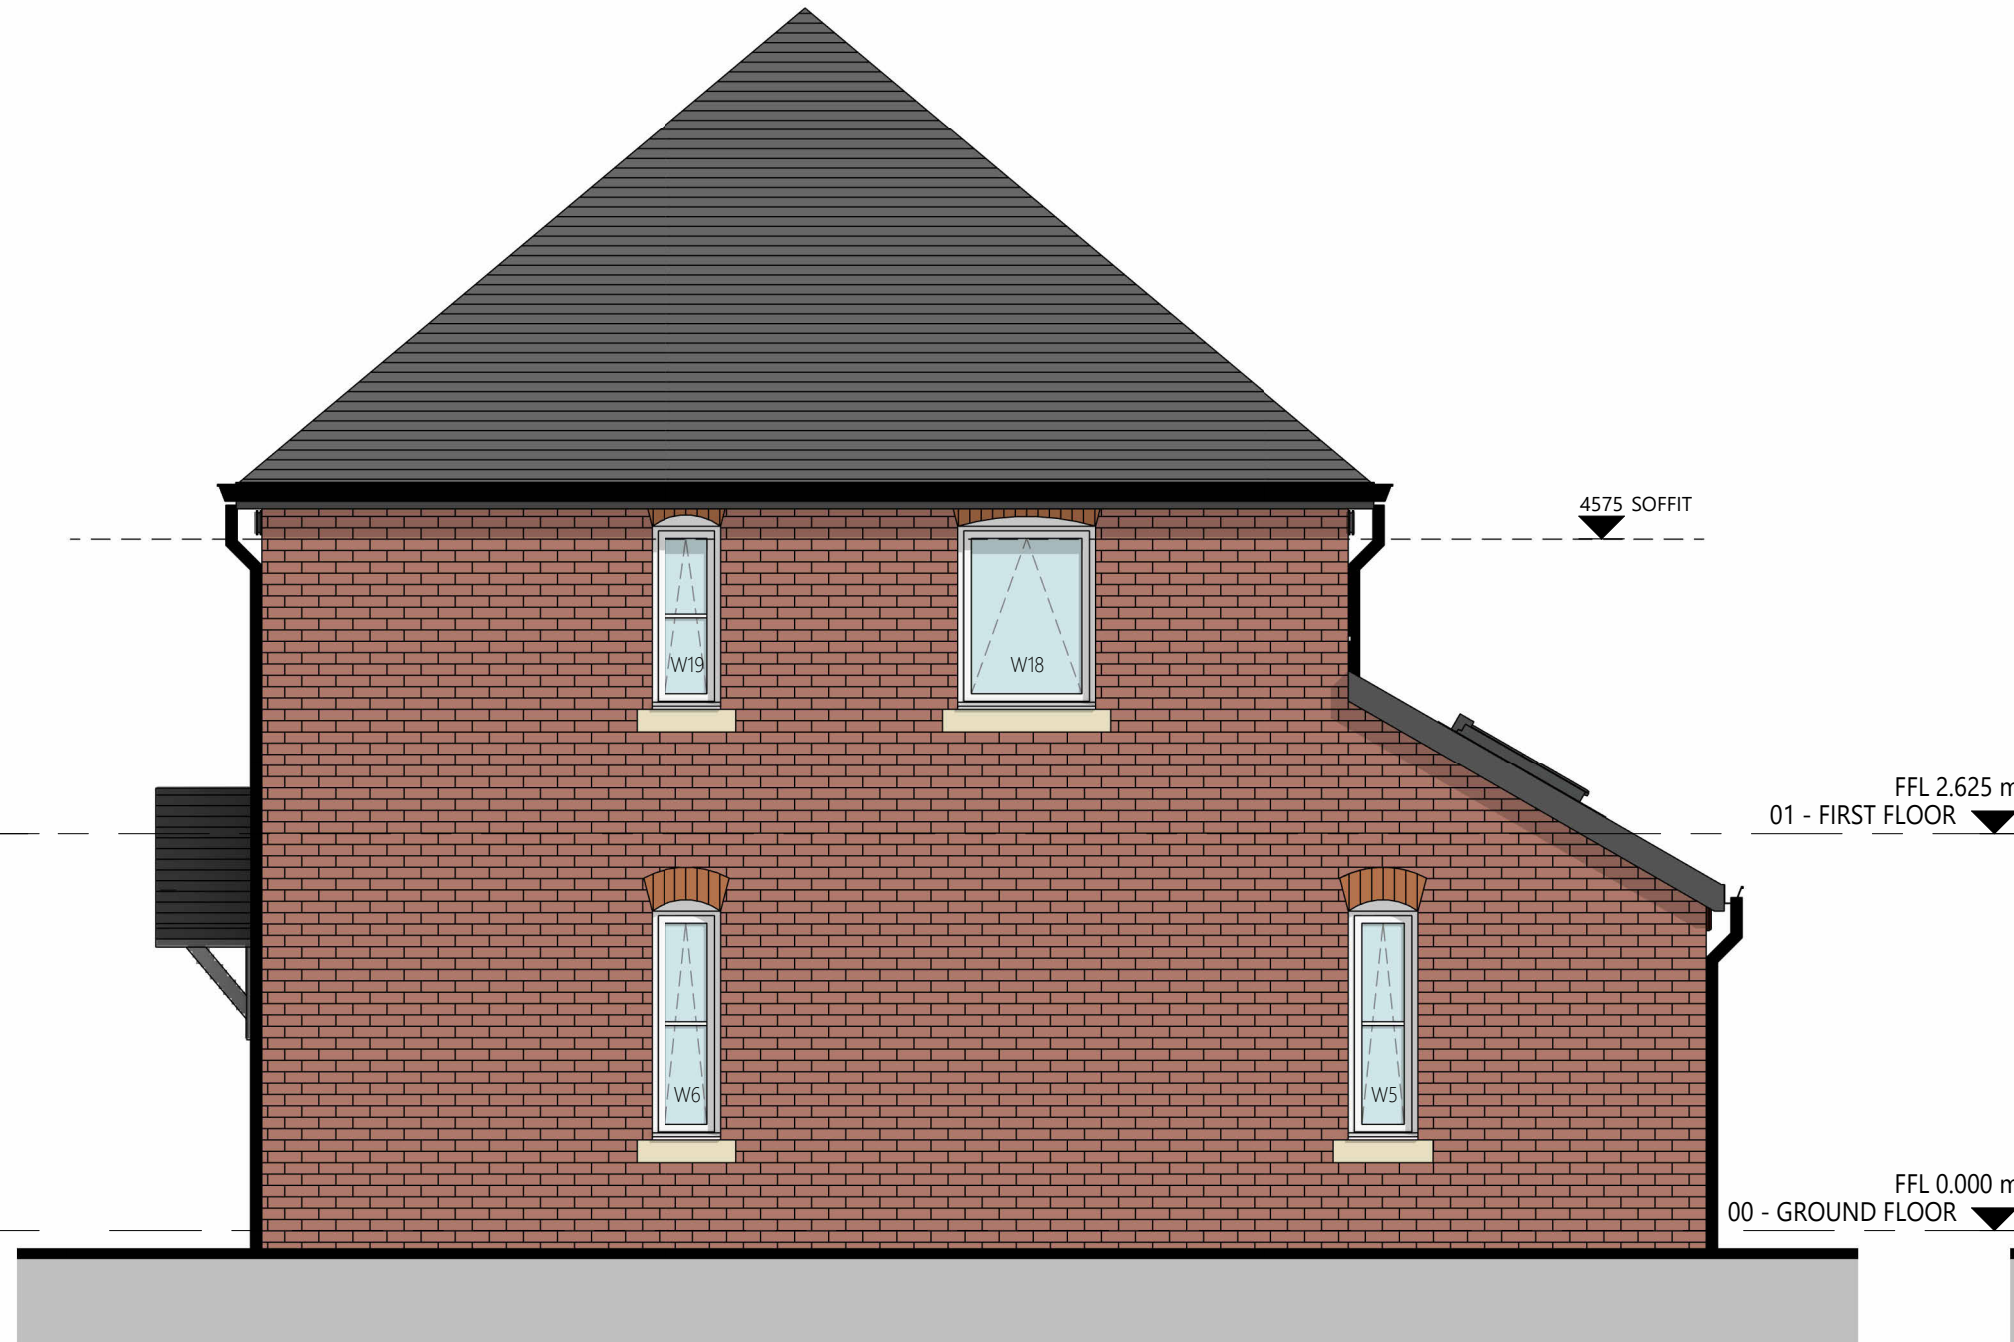

RH GABLE ELEVATION
SCALE: 1 : 50

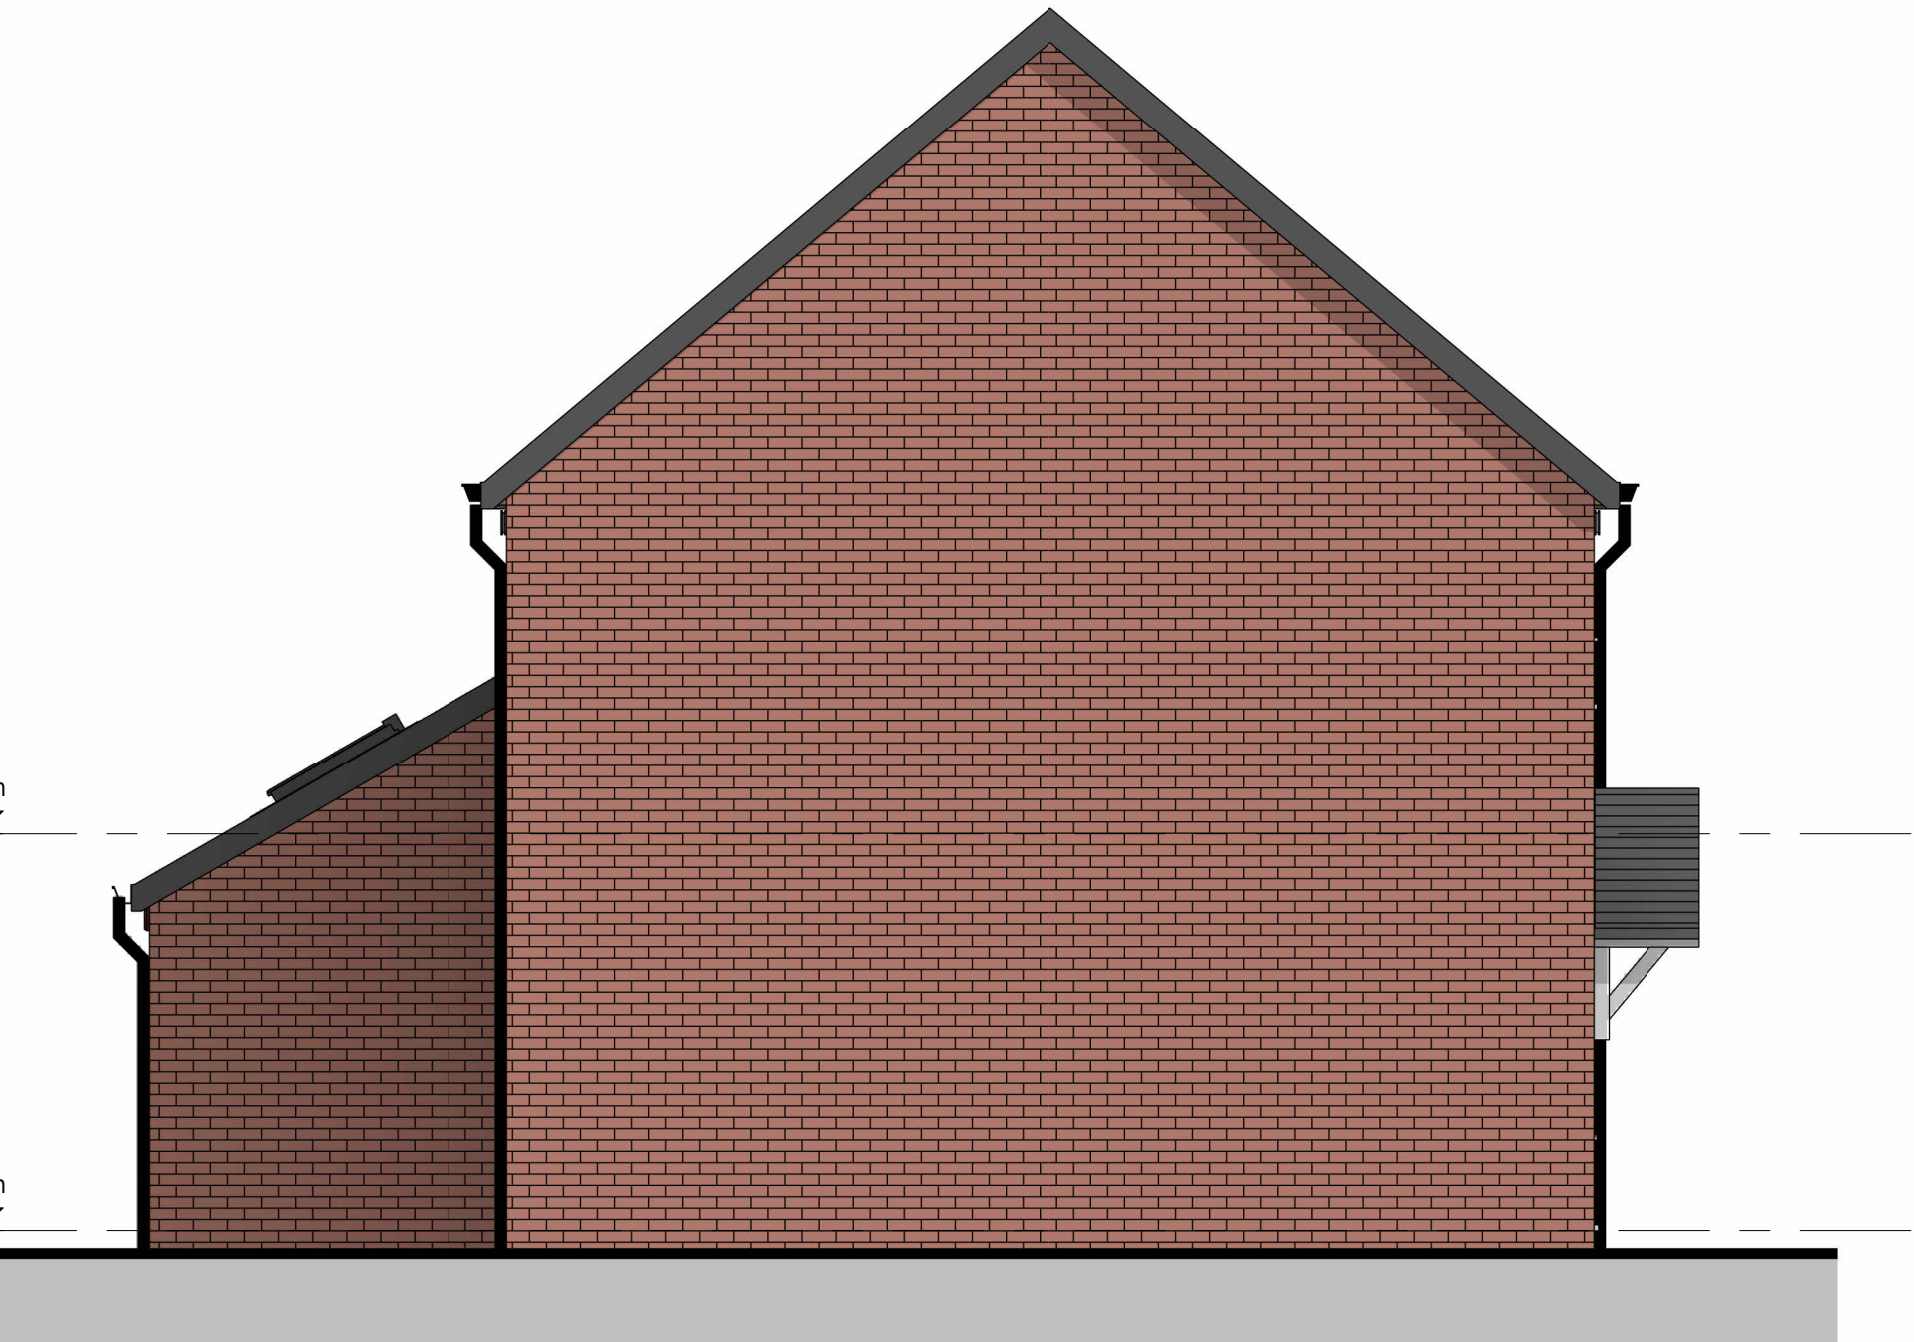


LH GABLE ELEVATION
SCALE: 1 : 50

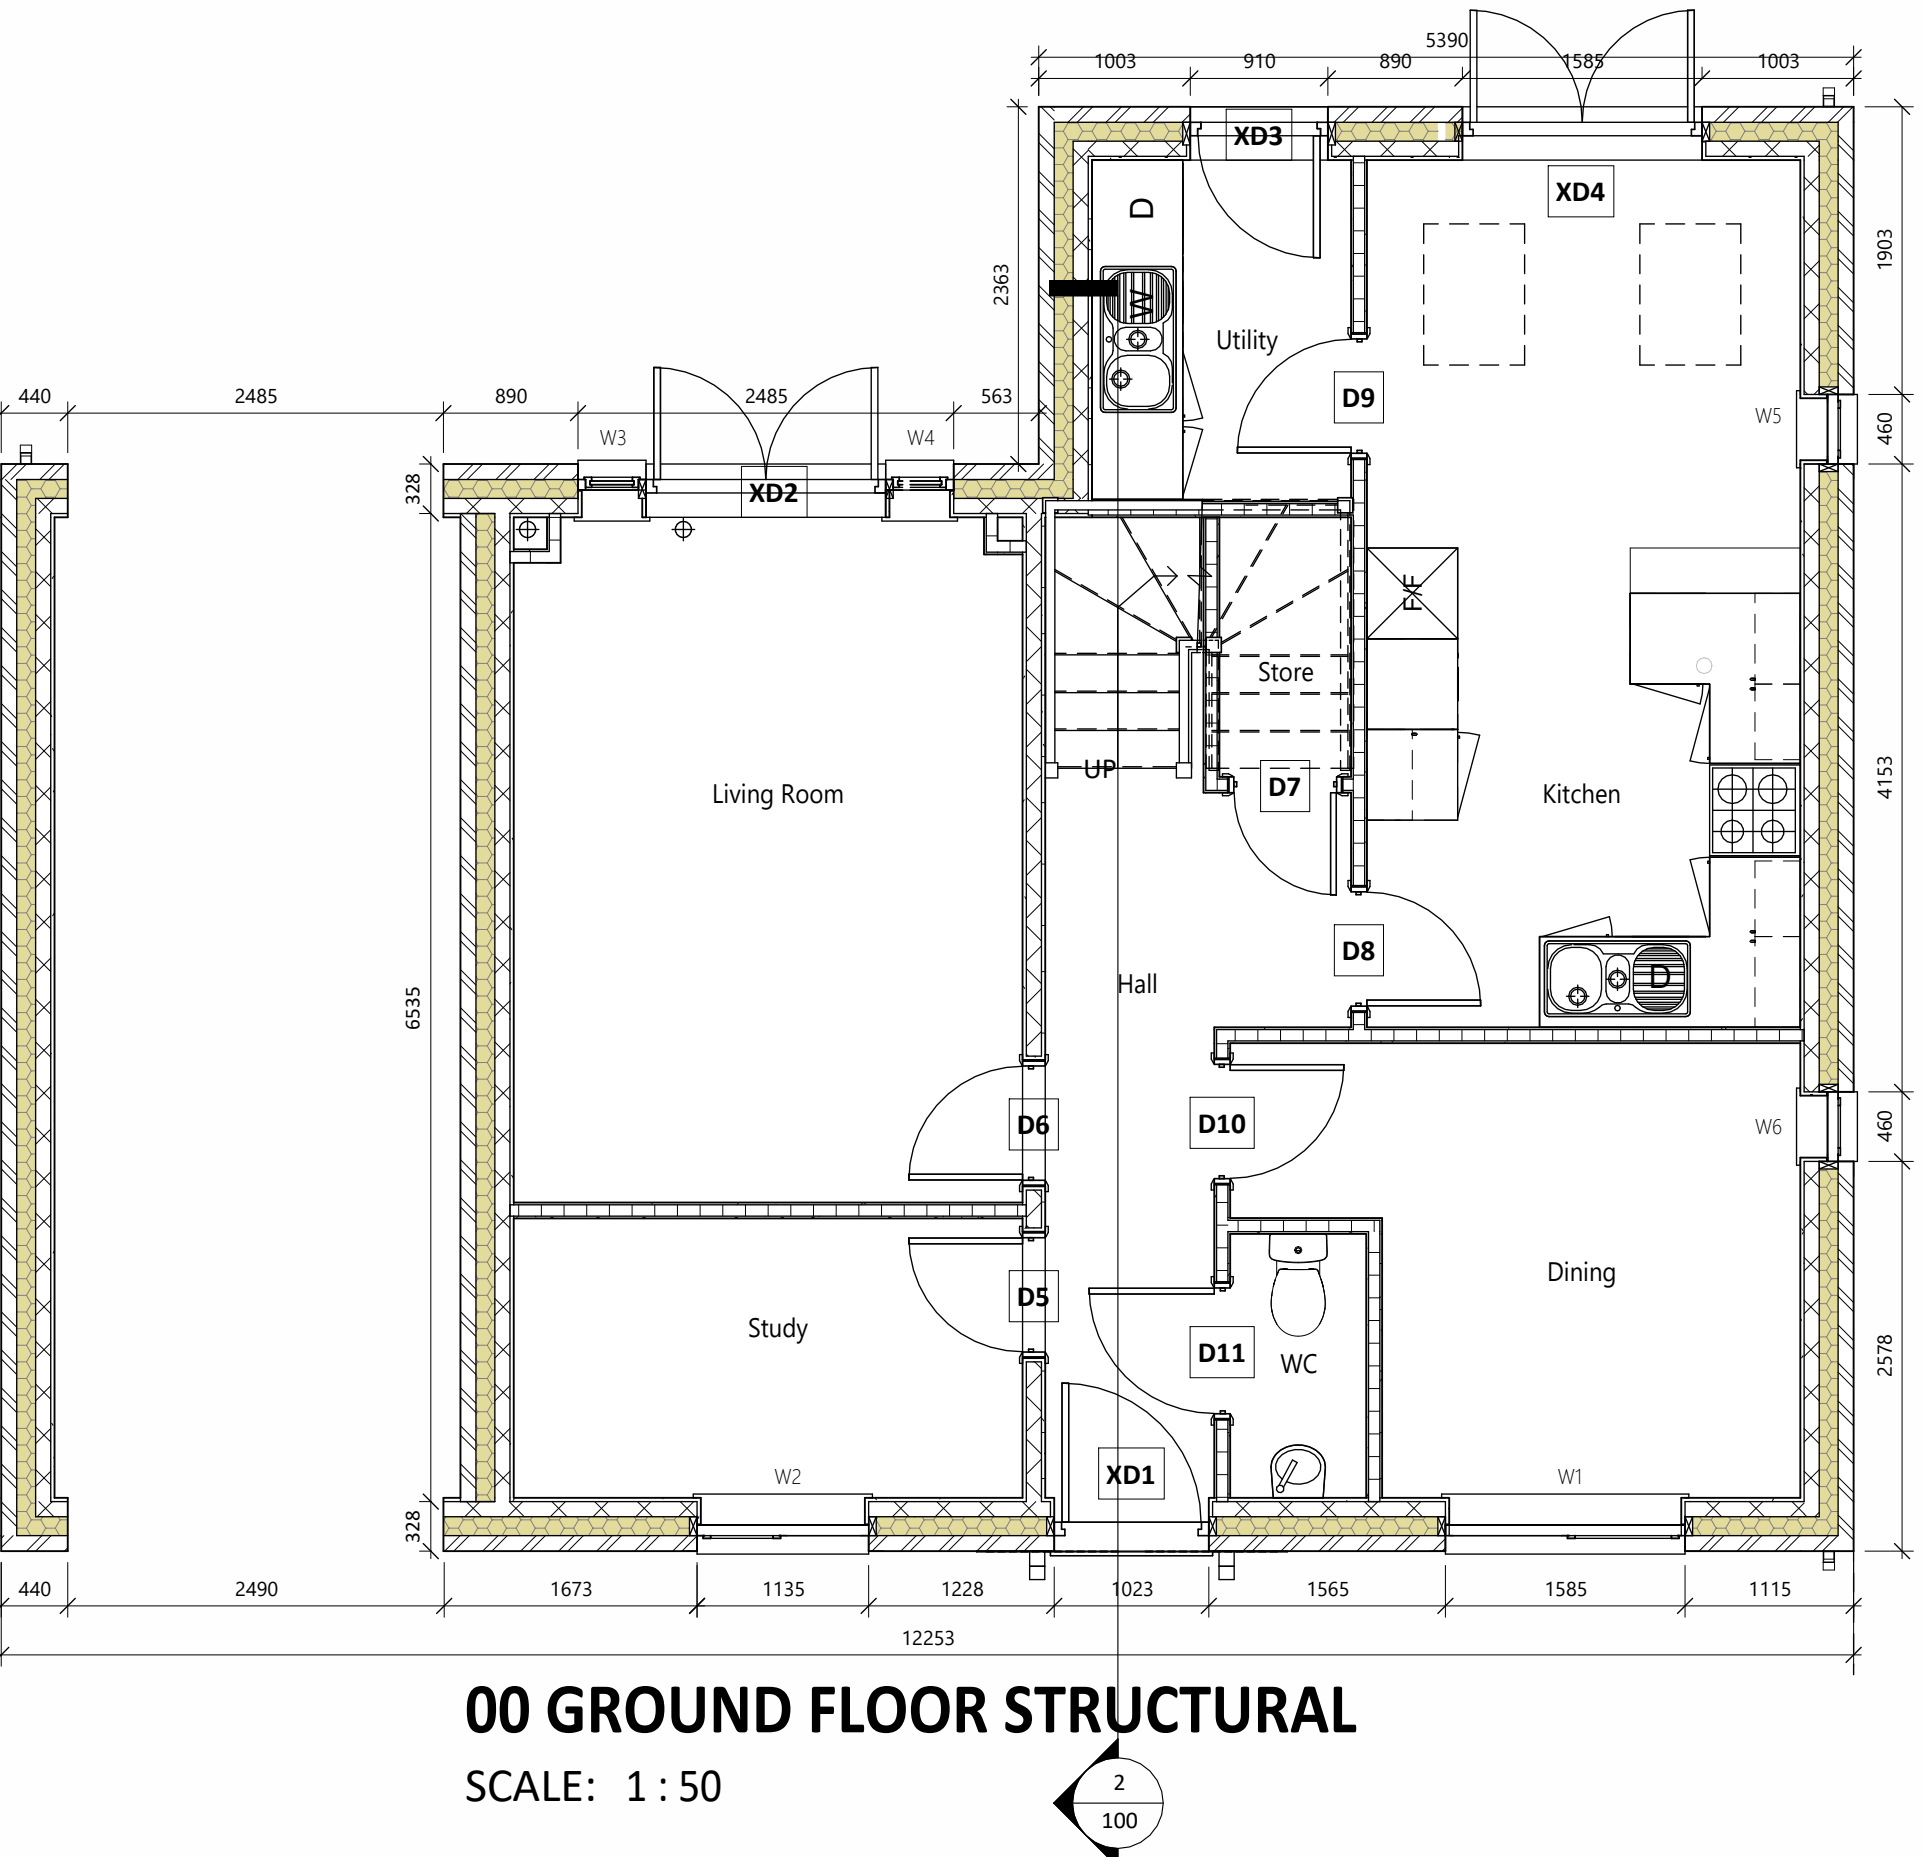

00 GROUND FLOOR STRUCTURAL
SCALE: 1 : 50



REAR ELEVATION
SCALE: 1 : 50

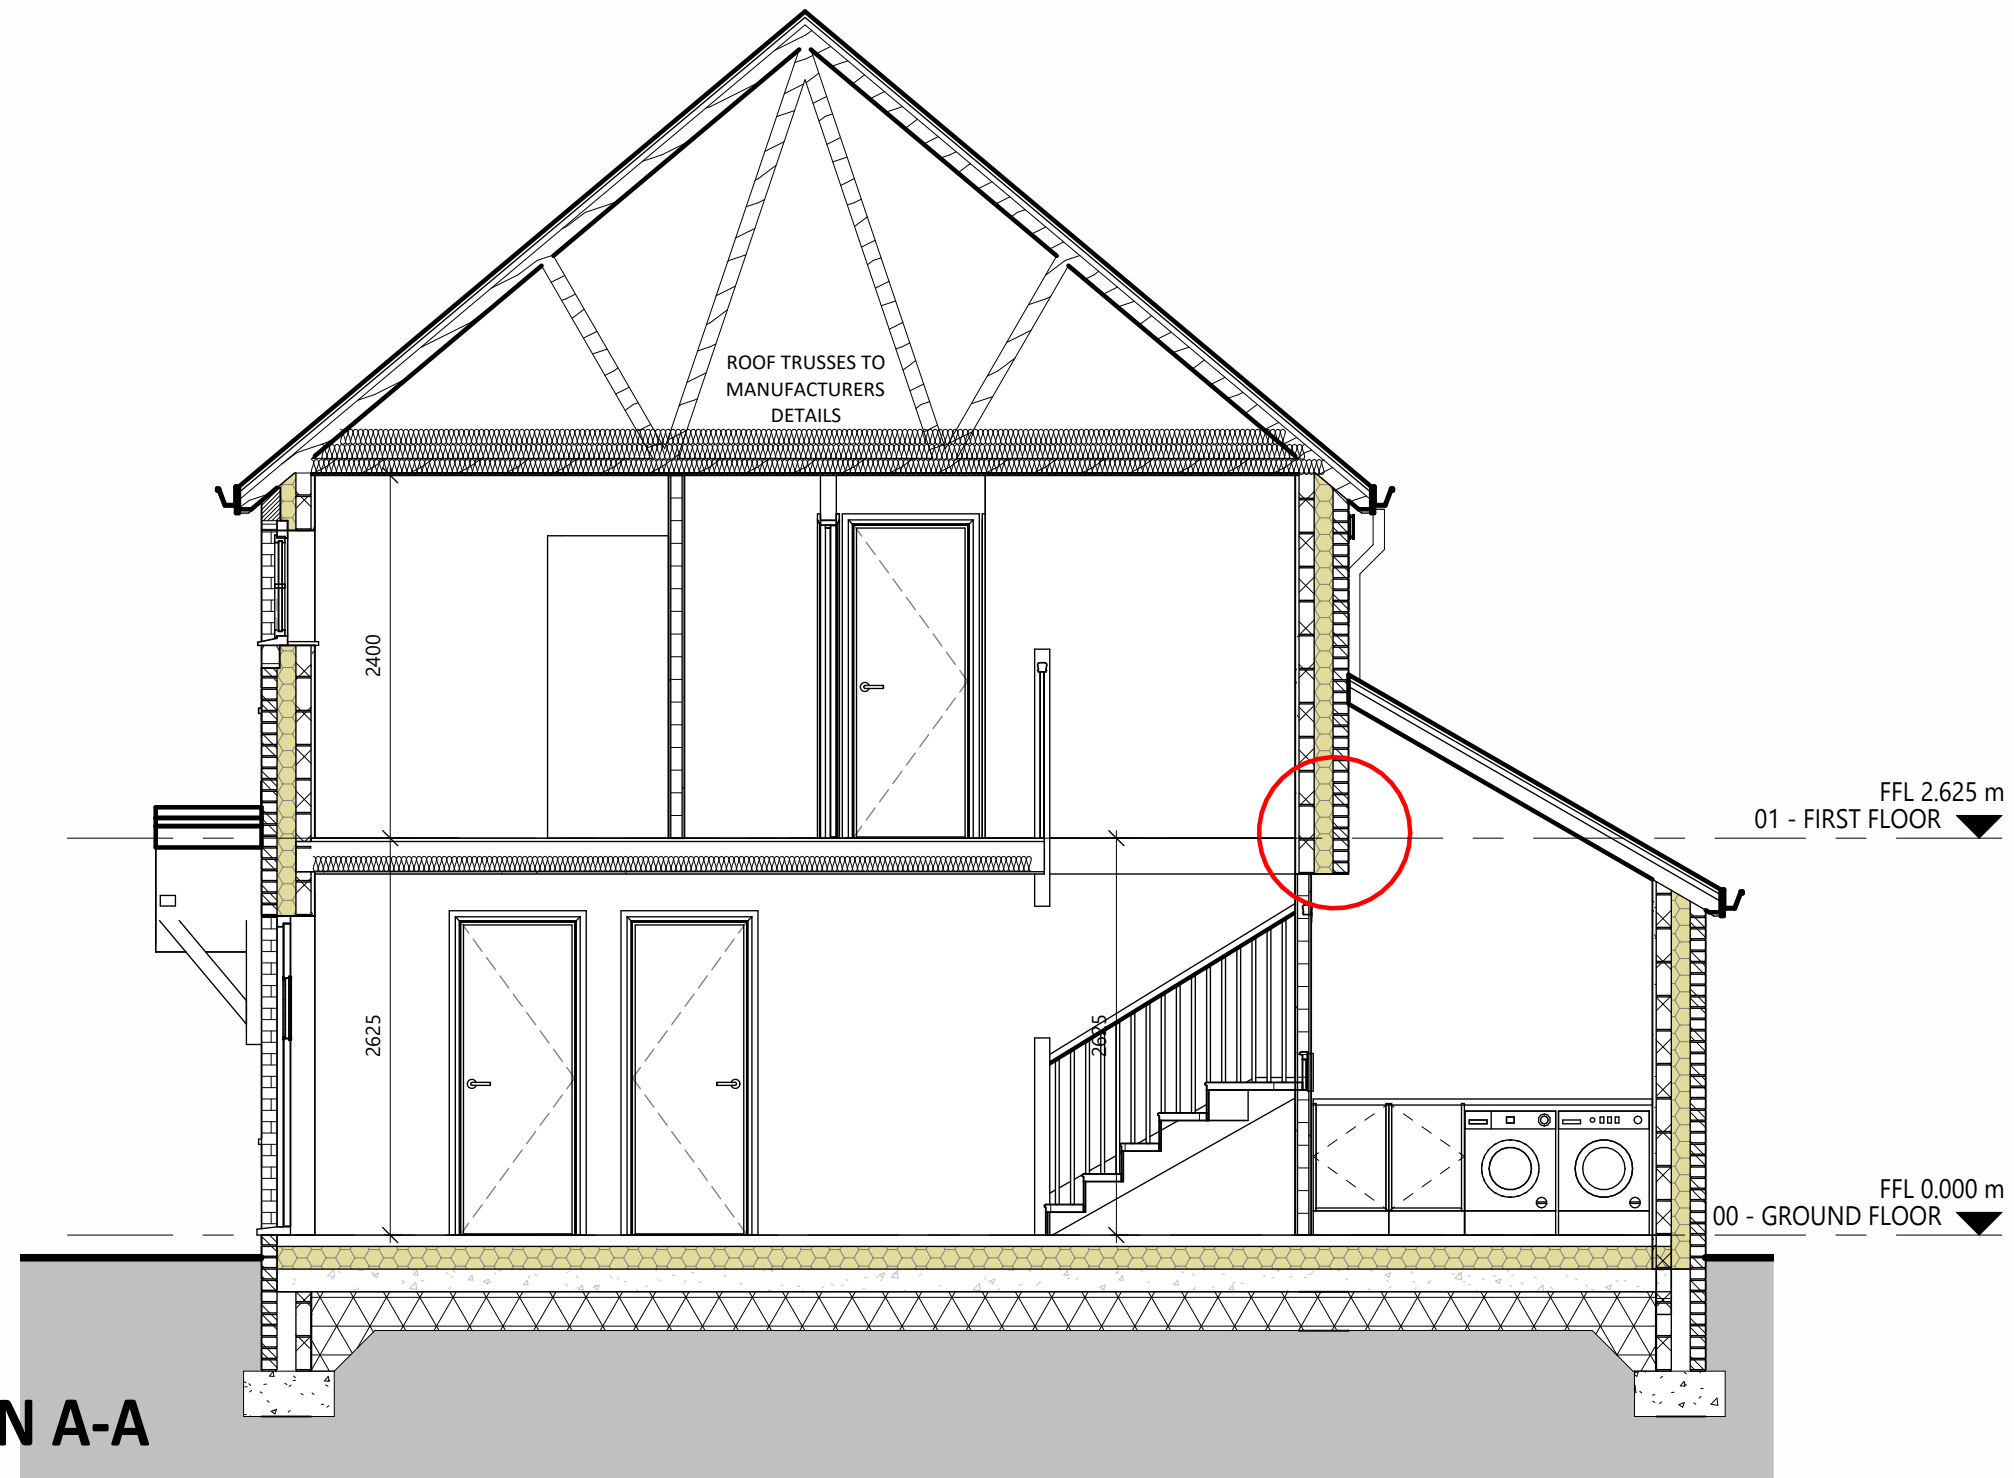

SECTION A-A
SCALE: 1 : 50