




DOOR SCHEDULE - TYPE P					WALL TYPES		
REF	TYPE	HEIGHT	WIDTH	COMMENTS			
00 - GROUND FLOOR							
D01	INT SINGLE	2110	912				
D02	INT SINGLE	2110	760				
D03	INT SINGLE	2110	836				
X01	4-5/51 TO X063	2110	1023				
01 - UPPER GROUND							
D04	INT SINGLE	2110	836				
X02	Downward Glazed with reveals	2110	1585				
X03	EXT SINGLE GLAZED	2110	910				
02 - FIRST FLOOR							
D10	INT SINGLE	2110	836				
D11	INT SINGLE	2110	836				
D12	INT SINGLE	2110	836				
X04	UPPER FIRST	2110	836				
D8	INT SINGLE	2110	836				
D9	INT SINGLE	2110	836				
02 - SECOND FLOOR							
D13	INT SINGLE	1410	684				
D14	INT SINGLE	2110	836				
D15	INT SINGLE	2110	760				

WINDOW SCHEDULE - TYPE P				
REF	TYPE	WIDTH	HEIGHT	COMMENTS
W4 BAY CORNER R				
W5 BAY CORNER R				
W6 BAY CORNER R				
00 - GROUND FLOOR				
W1 1135 x 1510 1135 1510				
W3 1360 x 1060 1360 1060				
01 - UPPER GROUND				
W2 1135 x 1510 1135 1510				
02 - FIRST FLOOR				
W7 460 x 760 460 760 OBSCURE				
W10 572.5 x 1210 573 1210				
W11 1360 x 1510 1360 1510				
03 - UPPER FIRST				
W8 1135 x 1510 1135 1510				
W9 1135 x 1510 1135 1510				
04 - SECOND FLOOR				
W12 1135 x 1510 1135 1510				
W13 GGL Integra size 660x978 (R04) 660 978				
W14 GGL Integra size 660x978 (R04) 660 978				

ALL GLAZING BETWEEN FFL AND 800MM IN WALLS AND PARTITIONS AND BETWEEN FFL AND 1500MM IN A DOOR OR IN A SIDE PANEL, CLOSE TO EITHER EDGE OF THE DOOR SHALL BE LAMINATED (NOT TOUCHED) GLASS AS DEFINED IN BS EN 1865. SAFETY GLAZING TO BE PERMANENTLY MARKED TO COMPLY WITH BS 6206:1981.


EXTERNAL WALL
BRICK OR RENDER ON LAY LITE OUTER LEAF, 150MM CAVITY FILL WITH SUPABOND INSULATION @ 0.033, 100MM THERMATEC TUNING BLOCK, PLASTERBOARDS ON DABS, U-VALUE = 0.20 W/M². IF USING THERMATEC 7N BLOCK THEN U-VALUE IS 0.21 W/M².

PARTY WALL
120MM FILL CLEAR CAVITY WITH EACH SIDE 100MM BLOCKWORK
12.5MM PLASTERBOARD ON DABS WITH SKIM FINISH


INTERNAL LOADEARING WALL (REF TO ENGINEERS DETAILS)
100MM BLOCKWORK & 12.5MM PLASTERBOARD ON DABS WITH SKIM FINISH TO BOTH SIDES

INTERNAL NON-LOADEARING WALL
TIMBER STUDS (75x75 @ 600C/1600C) WITH 75MM REVERA-ACoustic PARTITION (R04) (ONCE WHERE INDICATED)
WALL FINISHED BOTH SIDES WITH 120 LAYERS OF 12.5MM PLASTERBOARD AND SKIM FINISH UNLESS TOLD.


NOTE: BACKGROUND VENTILATION TO BE 8000 SQ MM TO HABITABLE ROOMS, 4000 SQ MM TO BATHROOMS AND UTILITIES, WHICH IS TO BE PROVIDED BY THE WINDOW AND EXTERNAL DOOR. TRICKLE VENTS, GROUND FLOOR DOORS TO HABITABLE ROOMS AND ROOMS CONTAINING A WC TO HAVE A MINIMUM CLEAR OPENING OF 800MM WHEN NOT APPROACHED HEAD ON AND 750MM FINISHED GAP AT THE BOTTOM TO PROVIDE REQUIRED BACKGROUND VENTILATION (PROVIDE A 20MM UNFINISHED GAP WHERE FINISHES ARE NOT LAID). ALL CYLINDER DOORS TO BE VENTED EQUIVALENT TO 600MM².

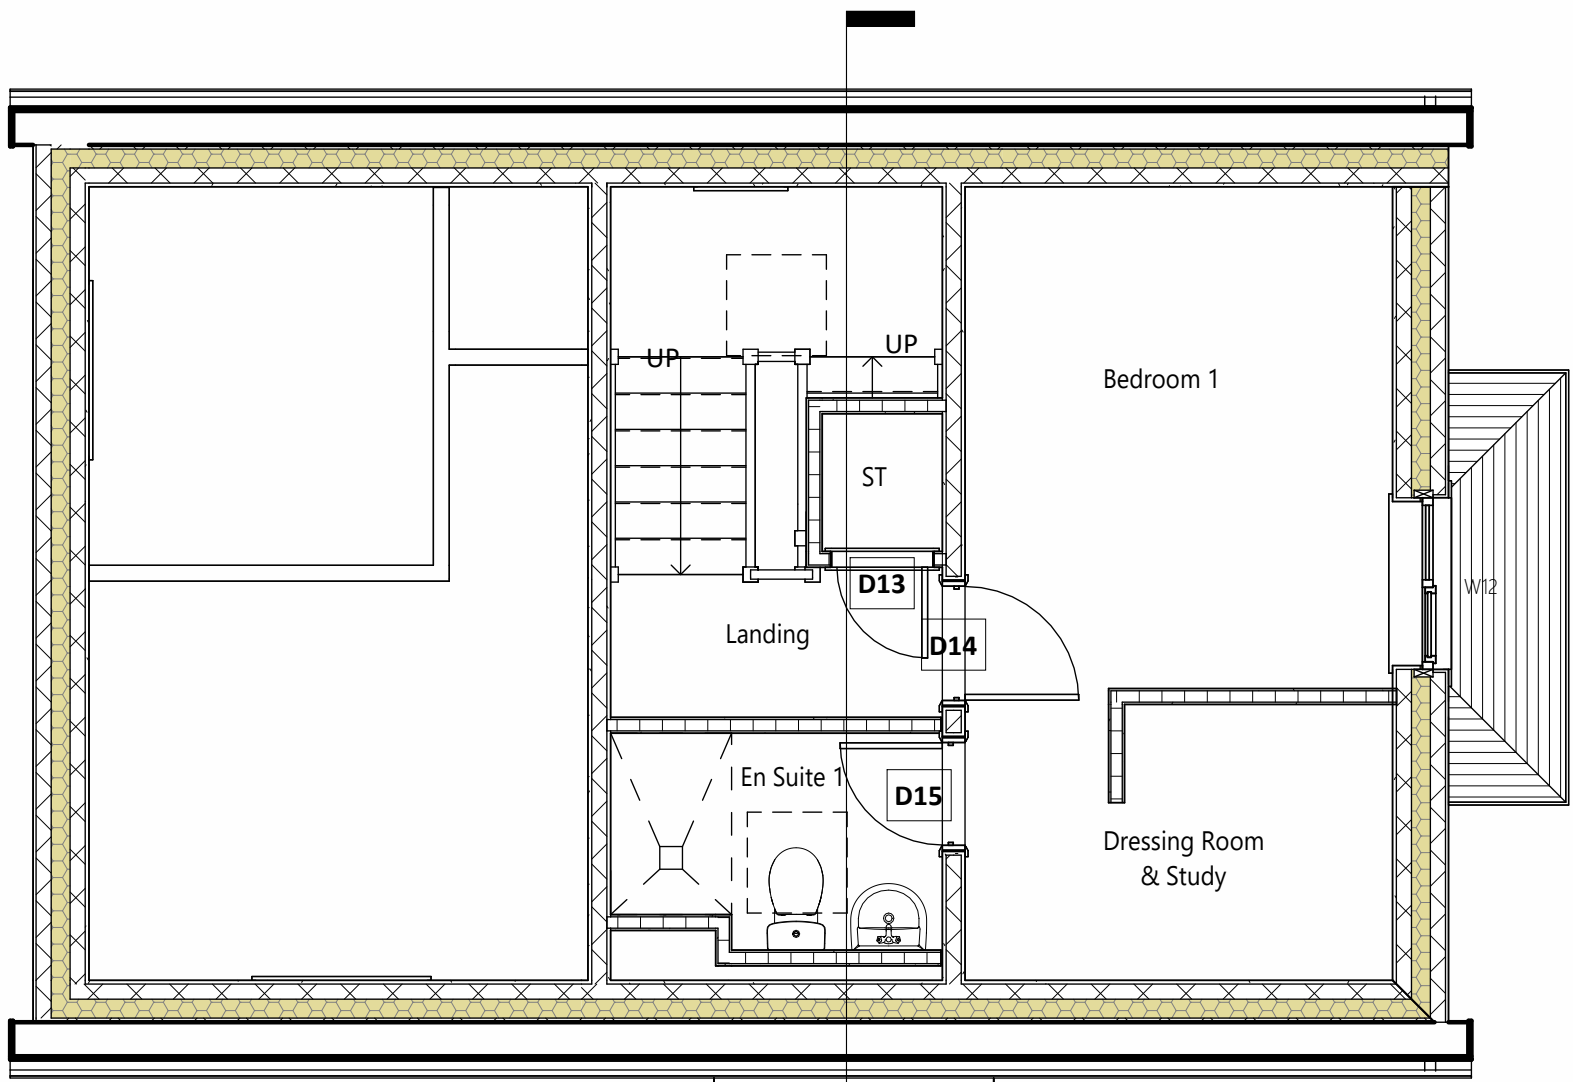

02 SECOND FLOOR STRUCTURAL
SCALE: 1 : 50

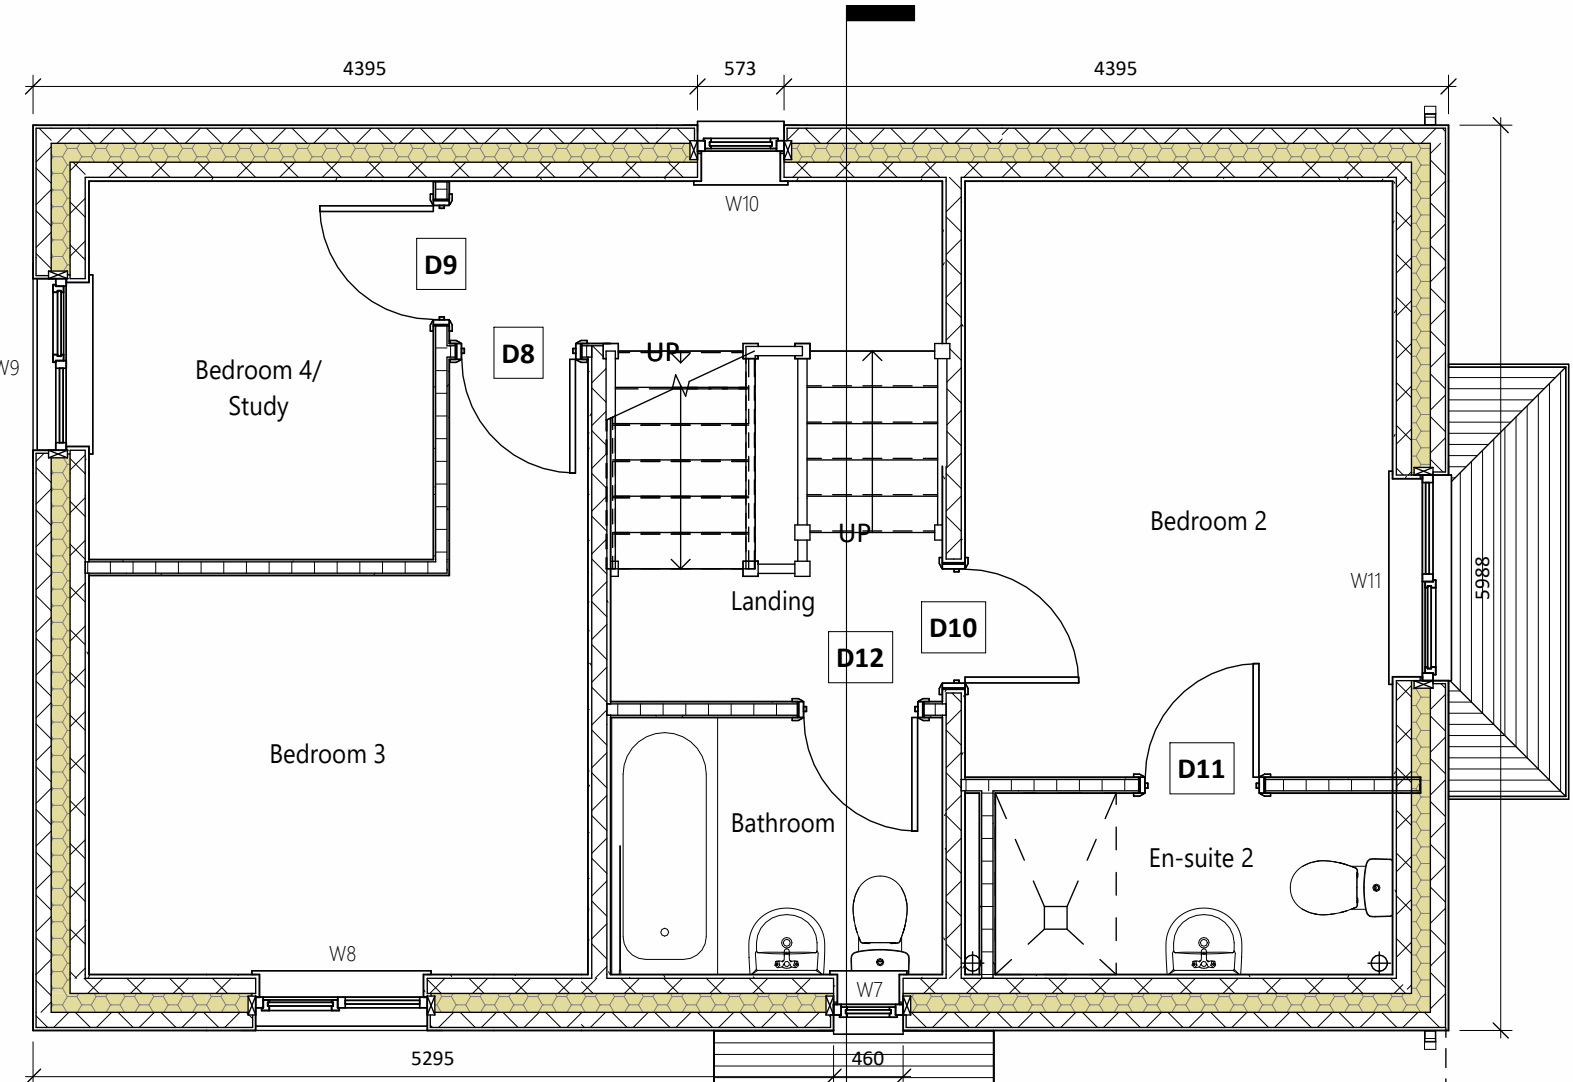

01 FIRST FLOOR STRUCTURAL
SCALE: 1 : 50

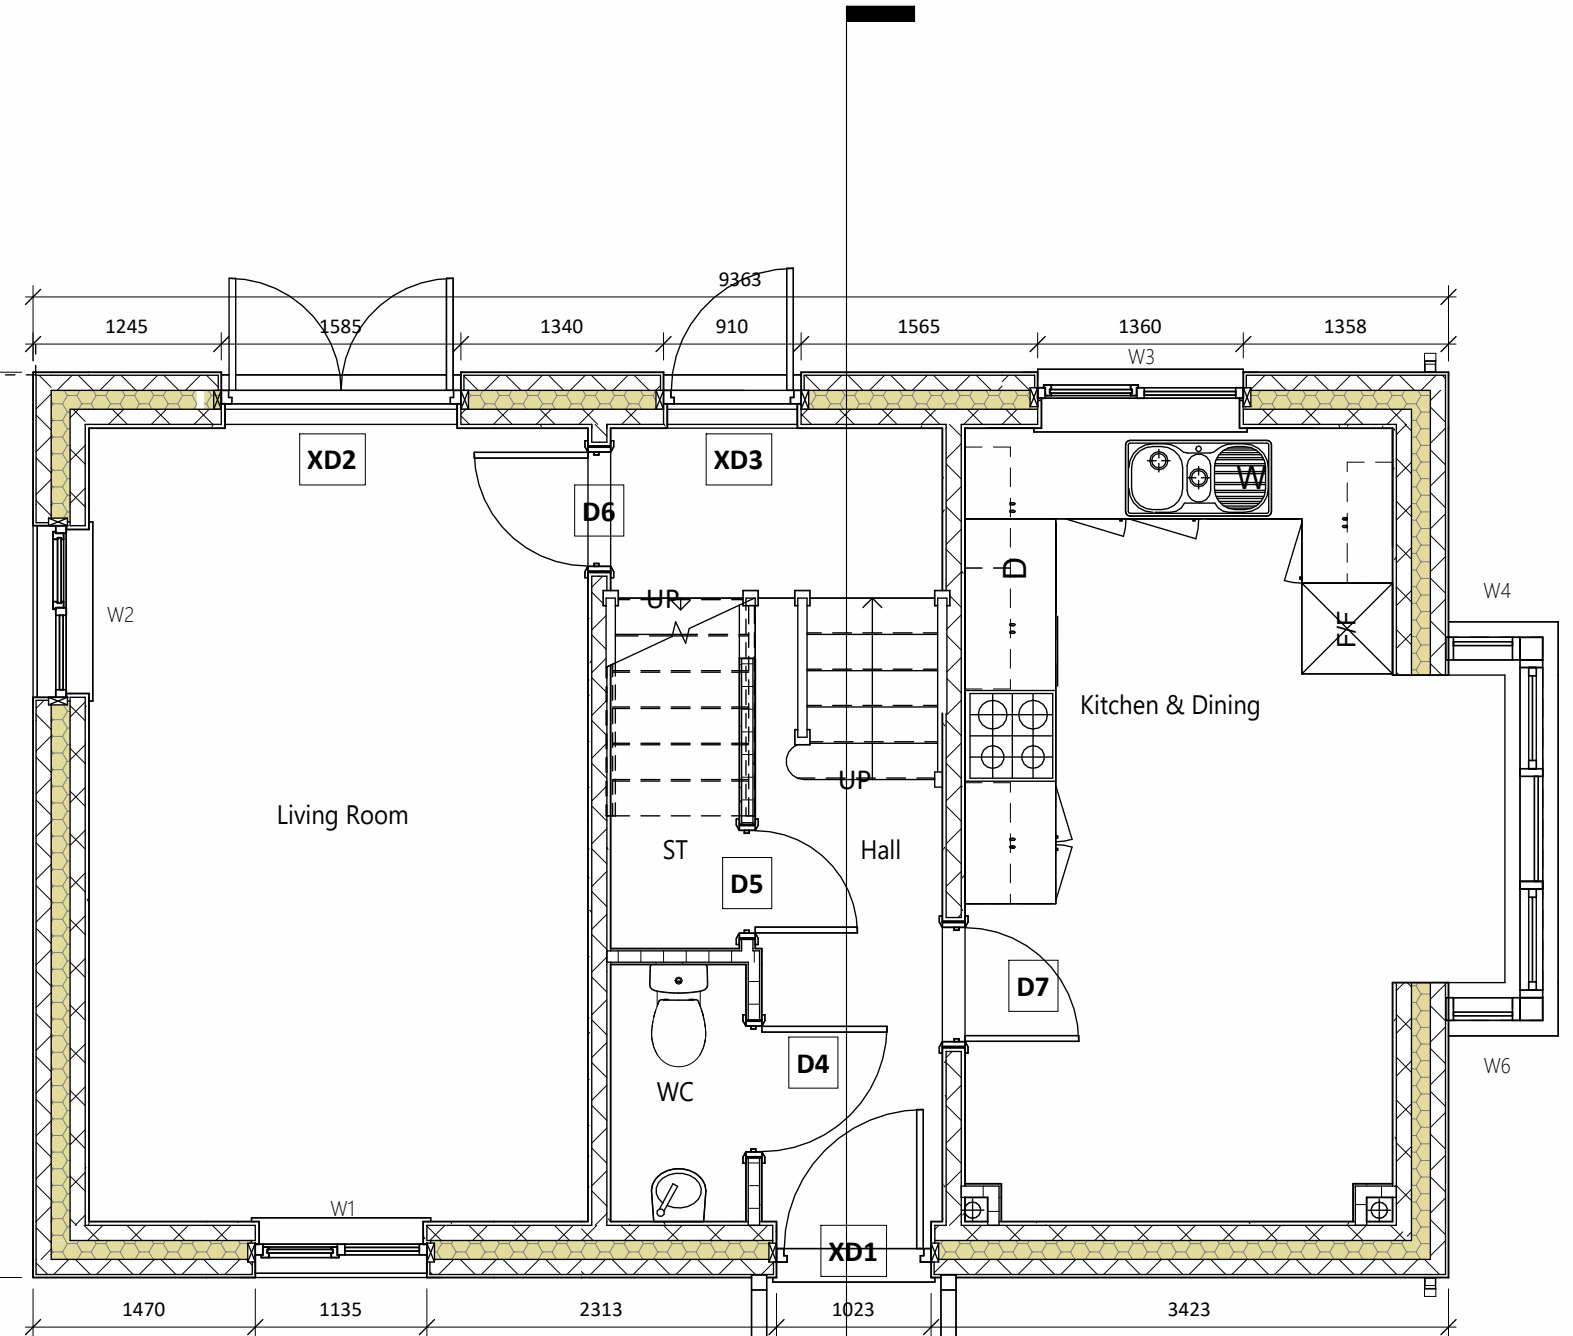


00 GROUND FLOOR STRUCTURAL
SCALE: 1 : 50




FRONT ELEVATION
SCALE: 1 : 50




REAR ELEVATION
SCALE: 1 : 50

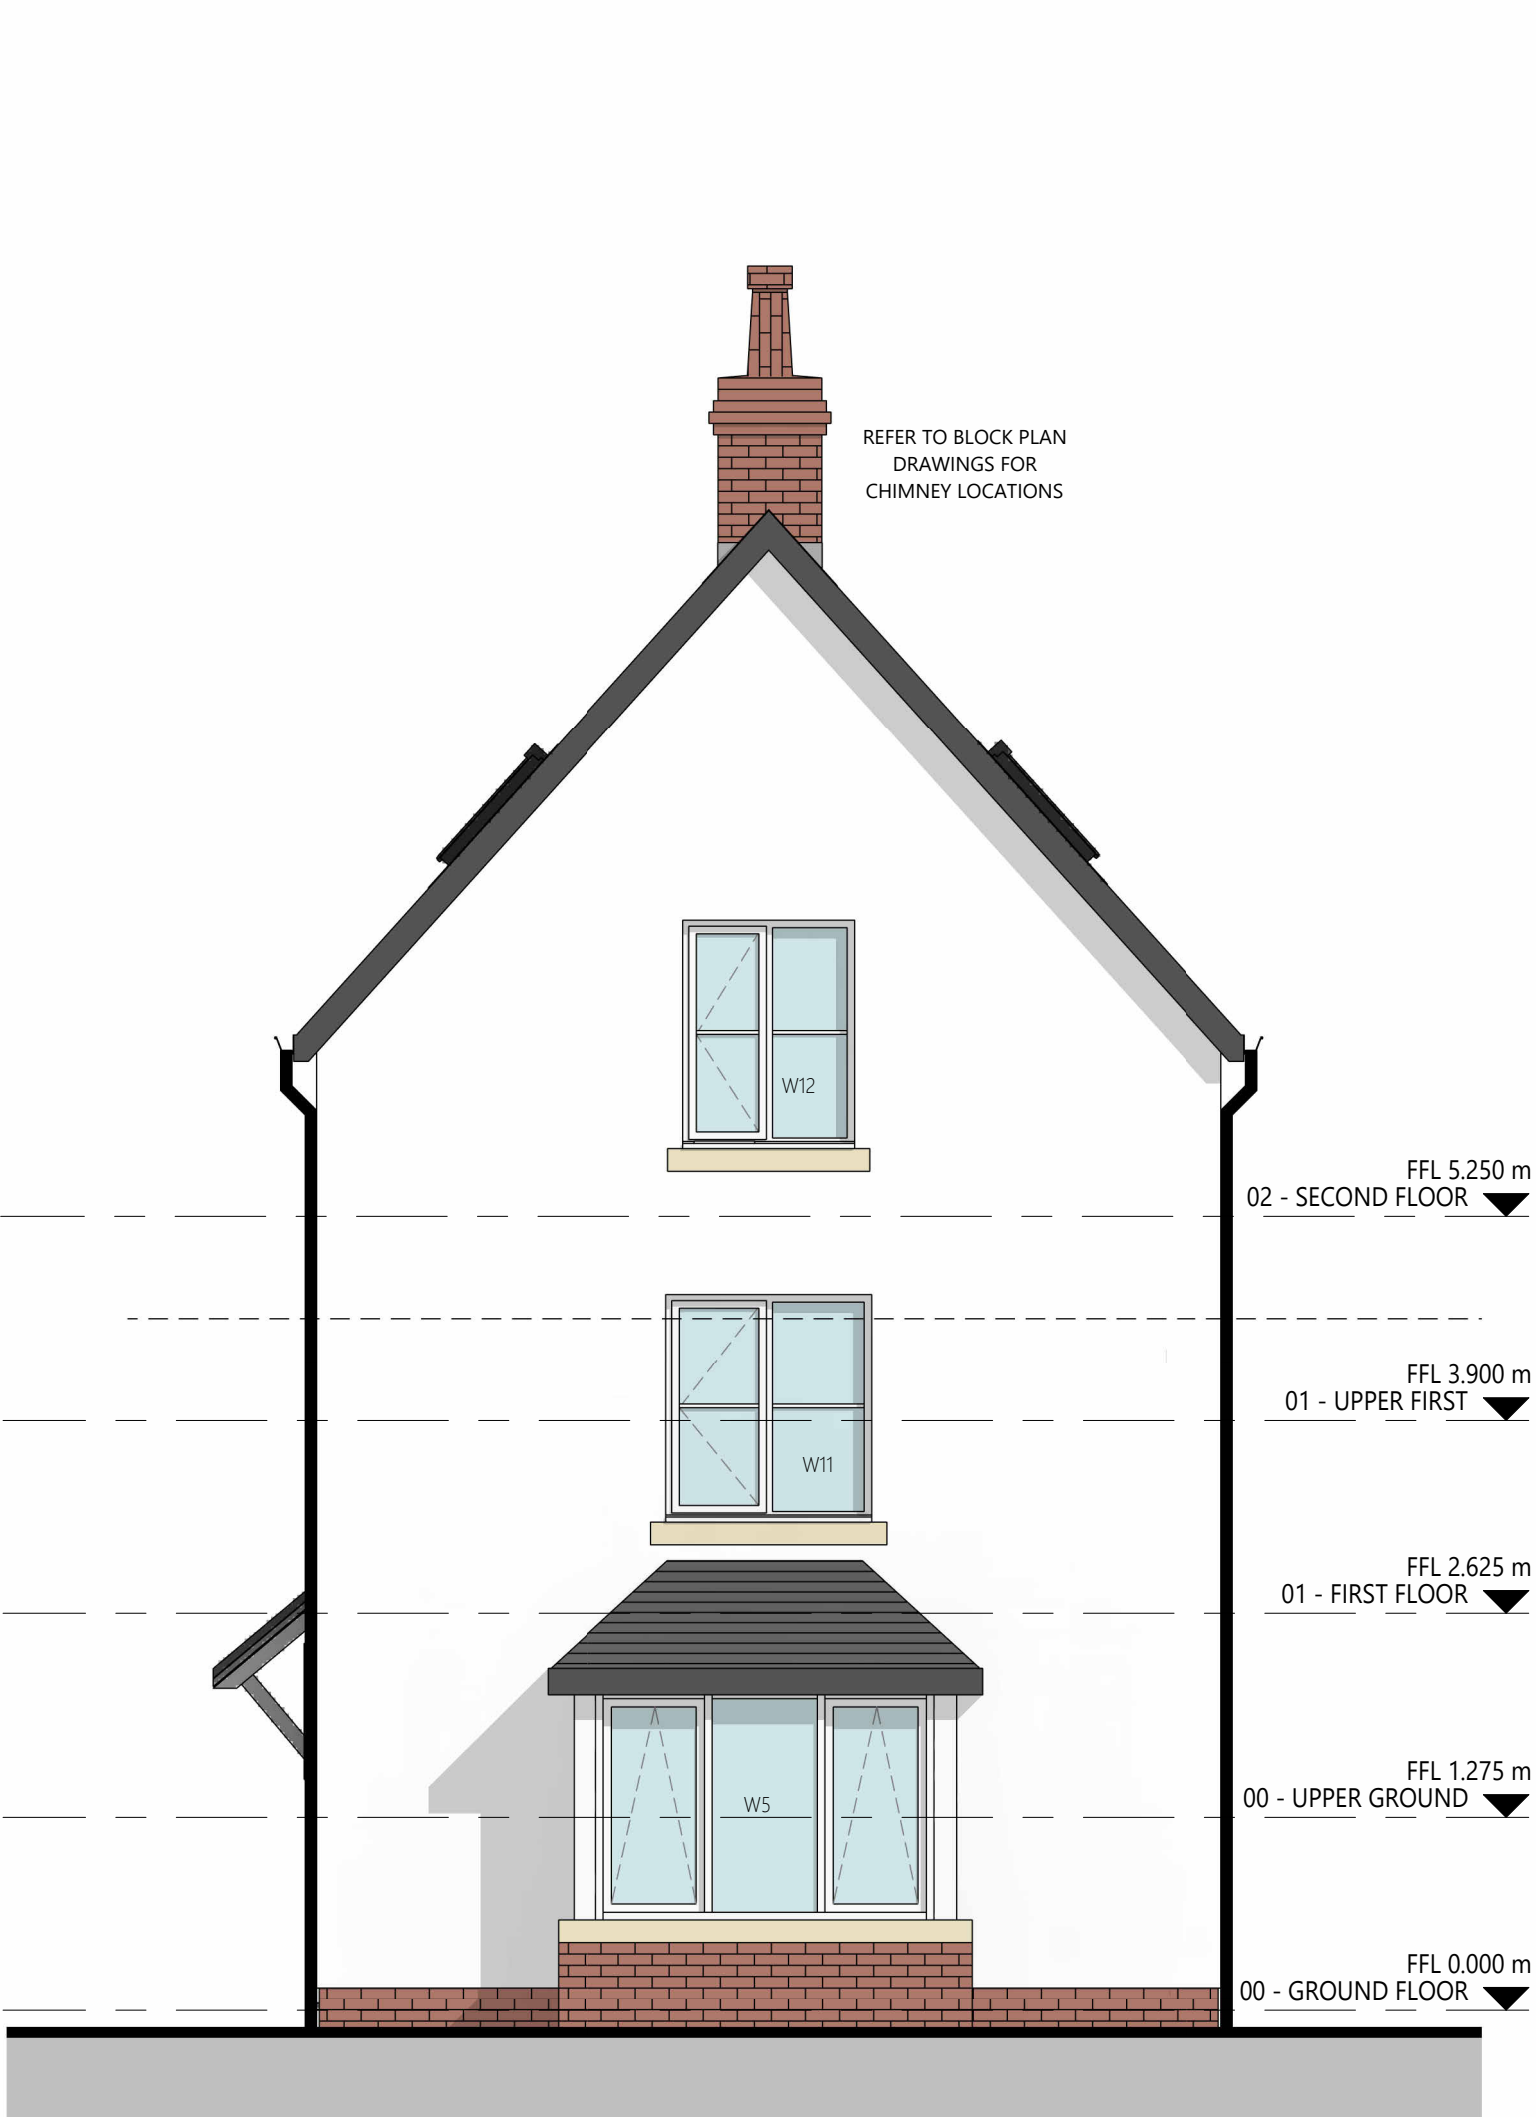

RH GABLE ELEVATION
SCALE: 1 : 50

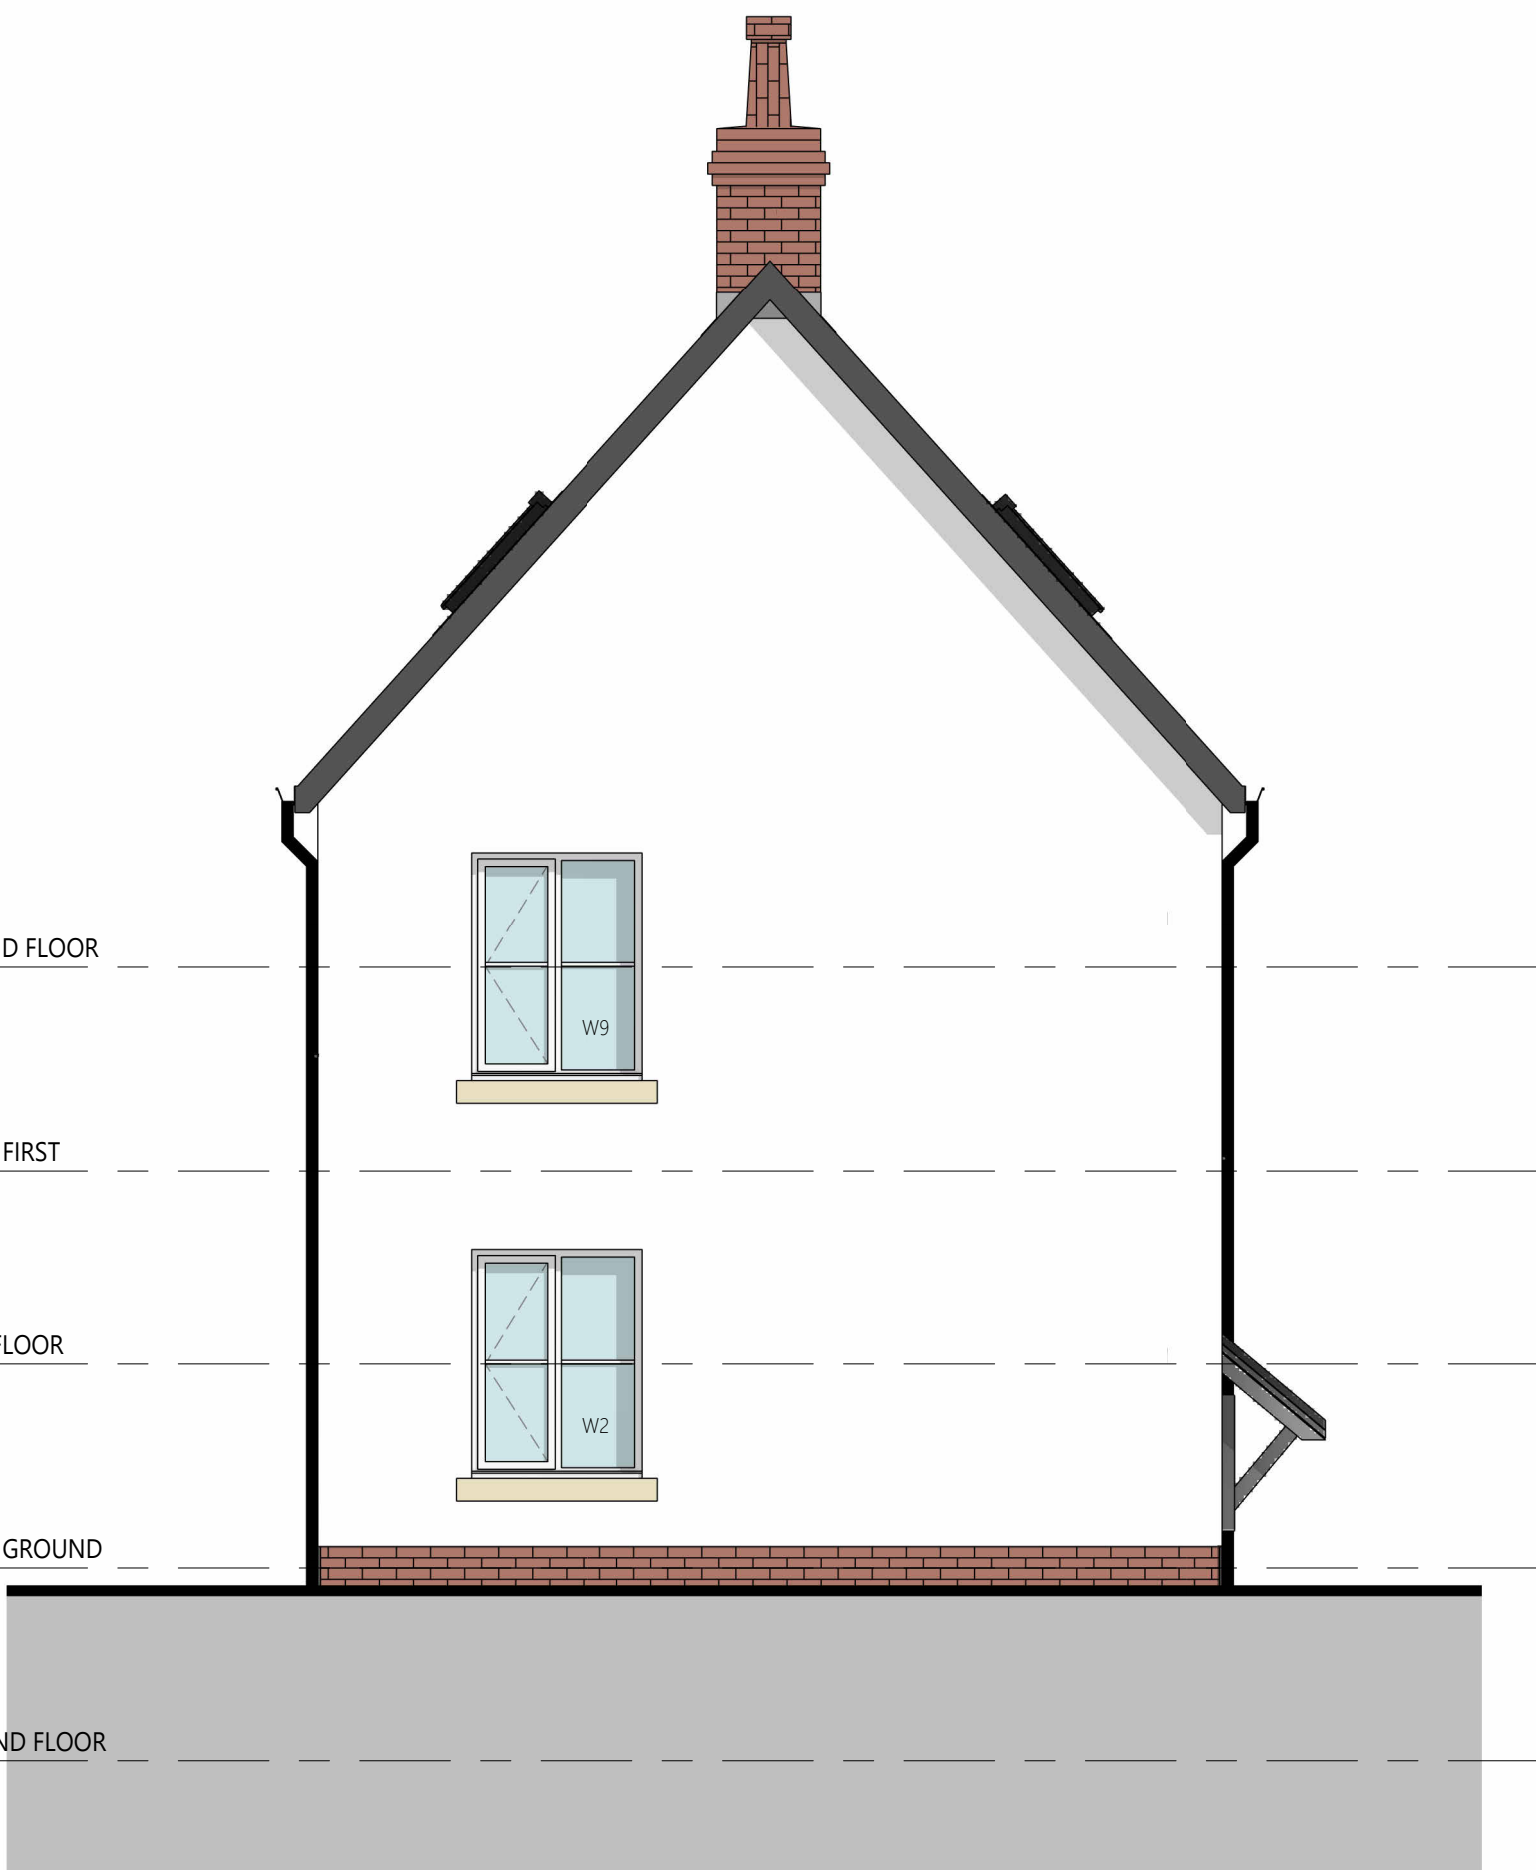

LH GABLE ELEVATION
SCALE: 1 : 50

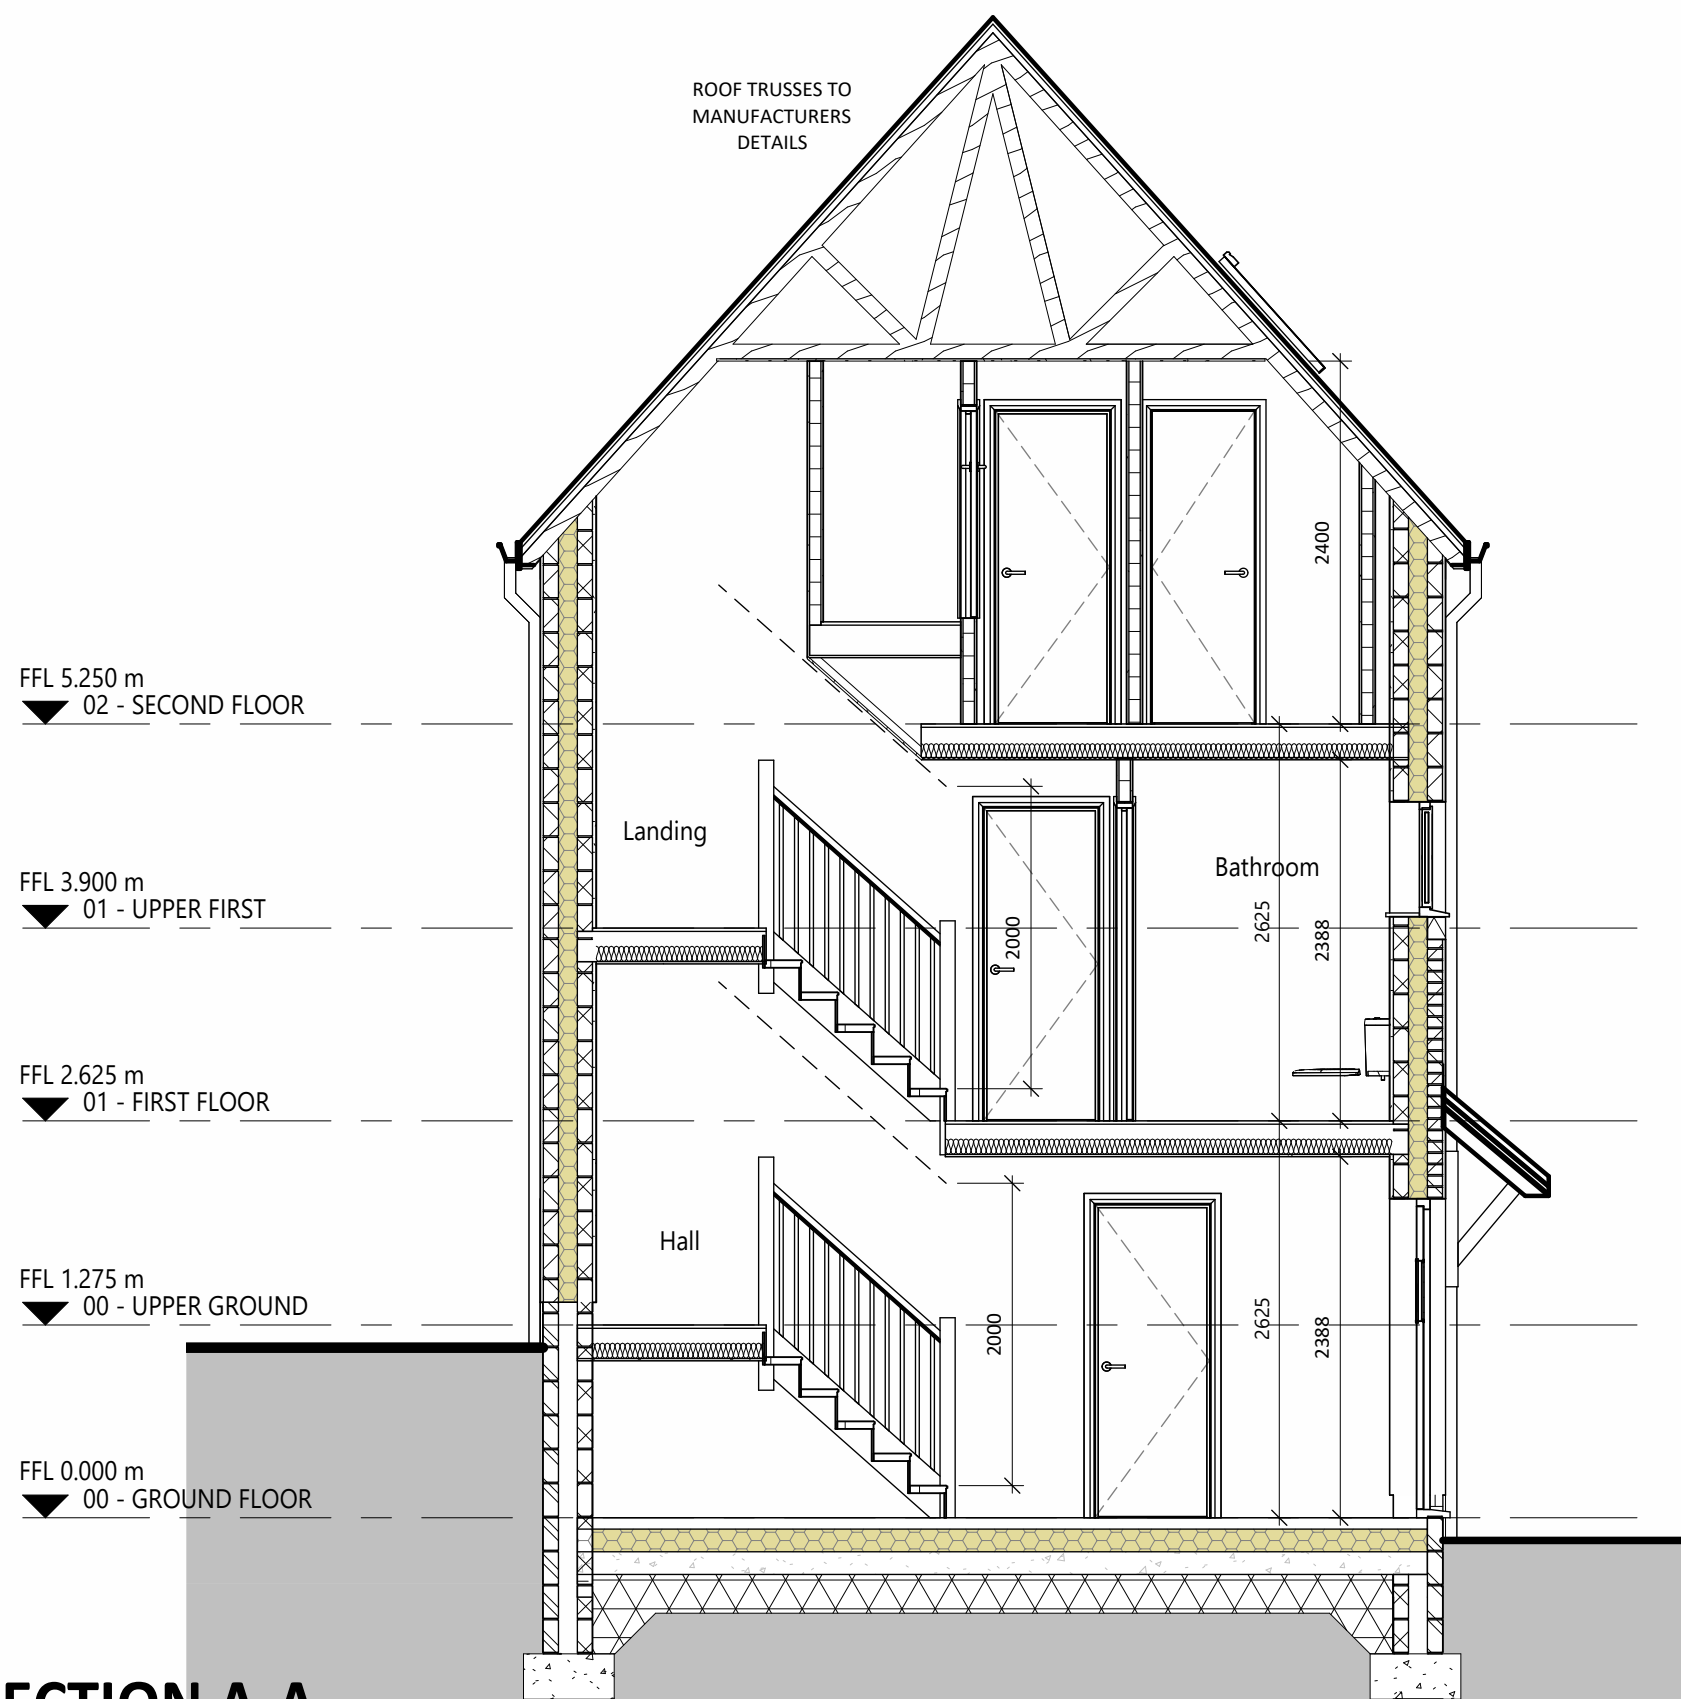

SECTION A-A
SCALE: 1 : 50