


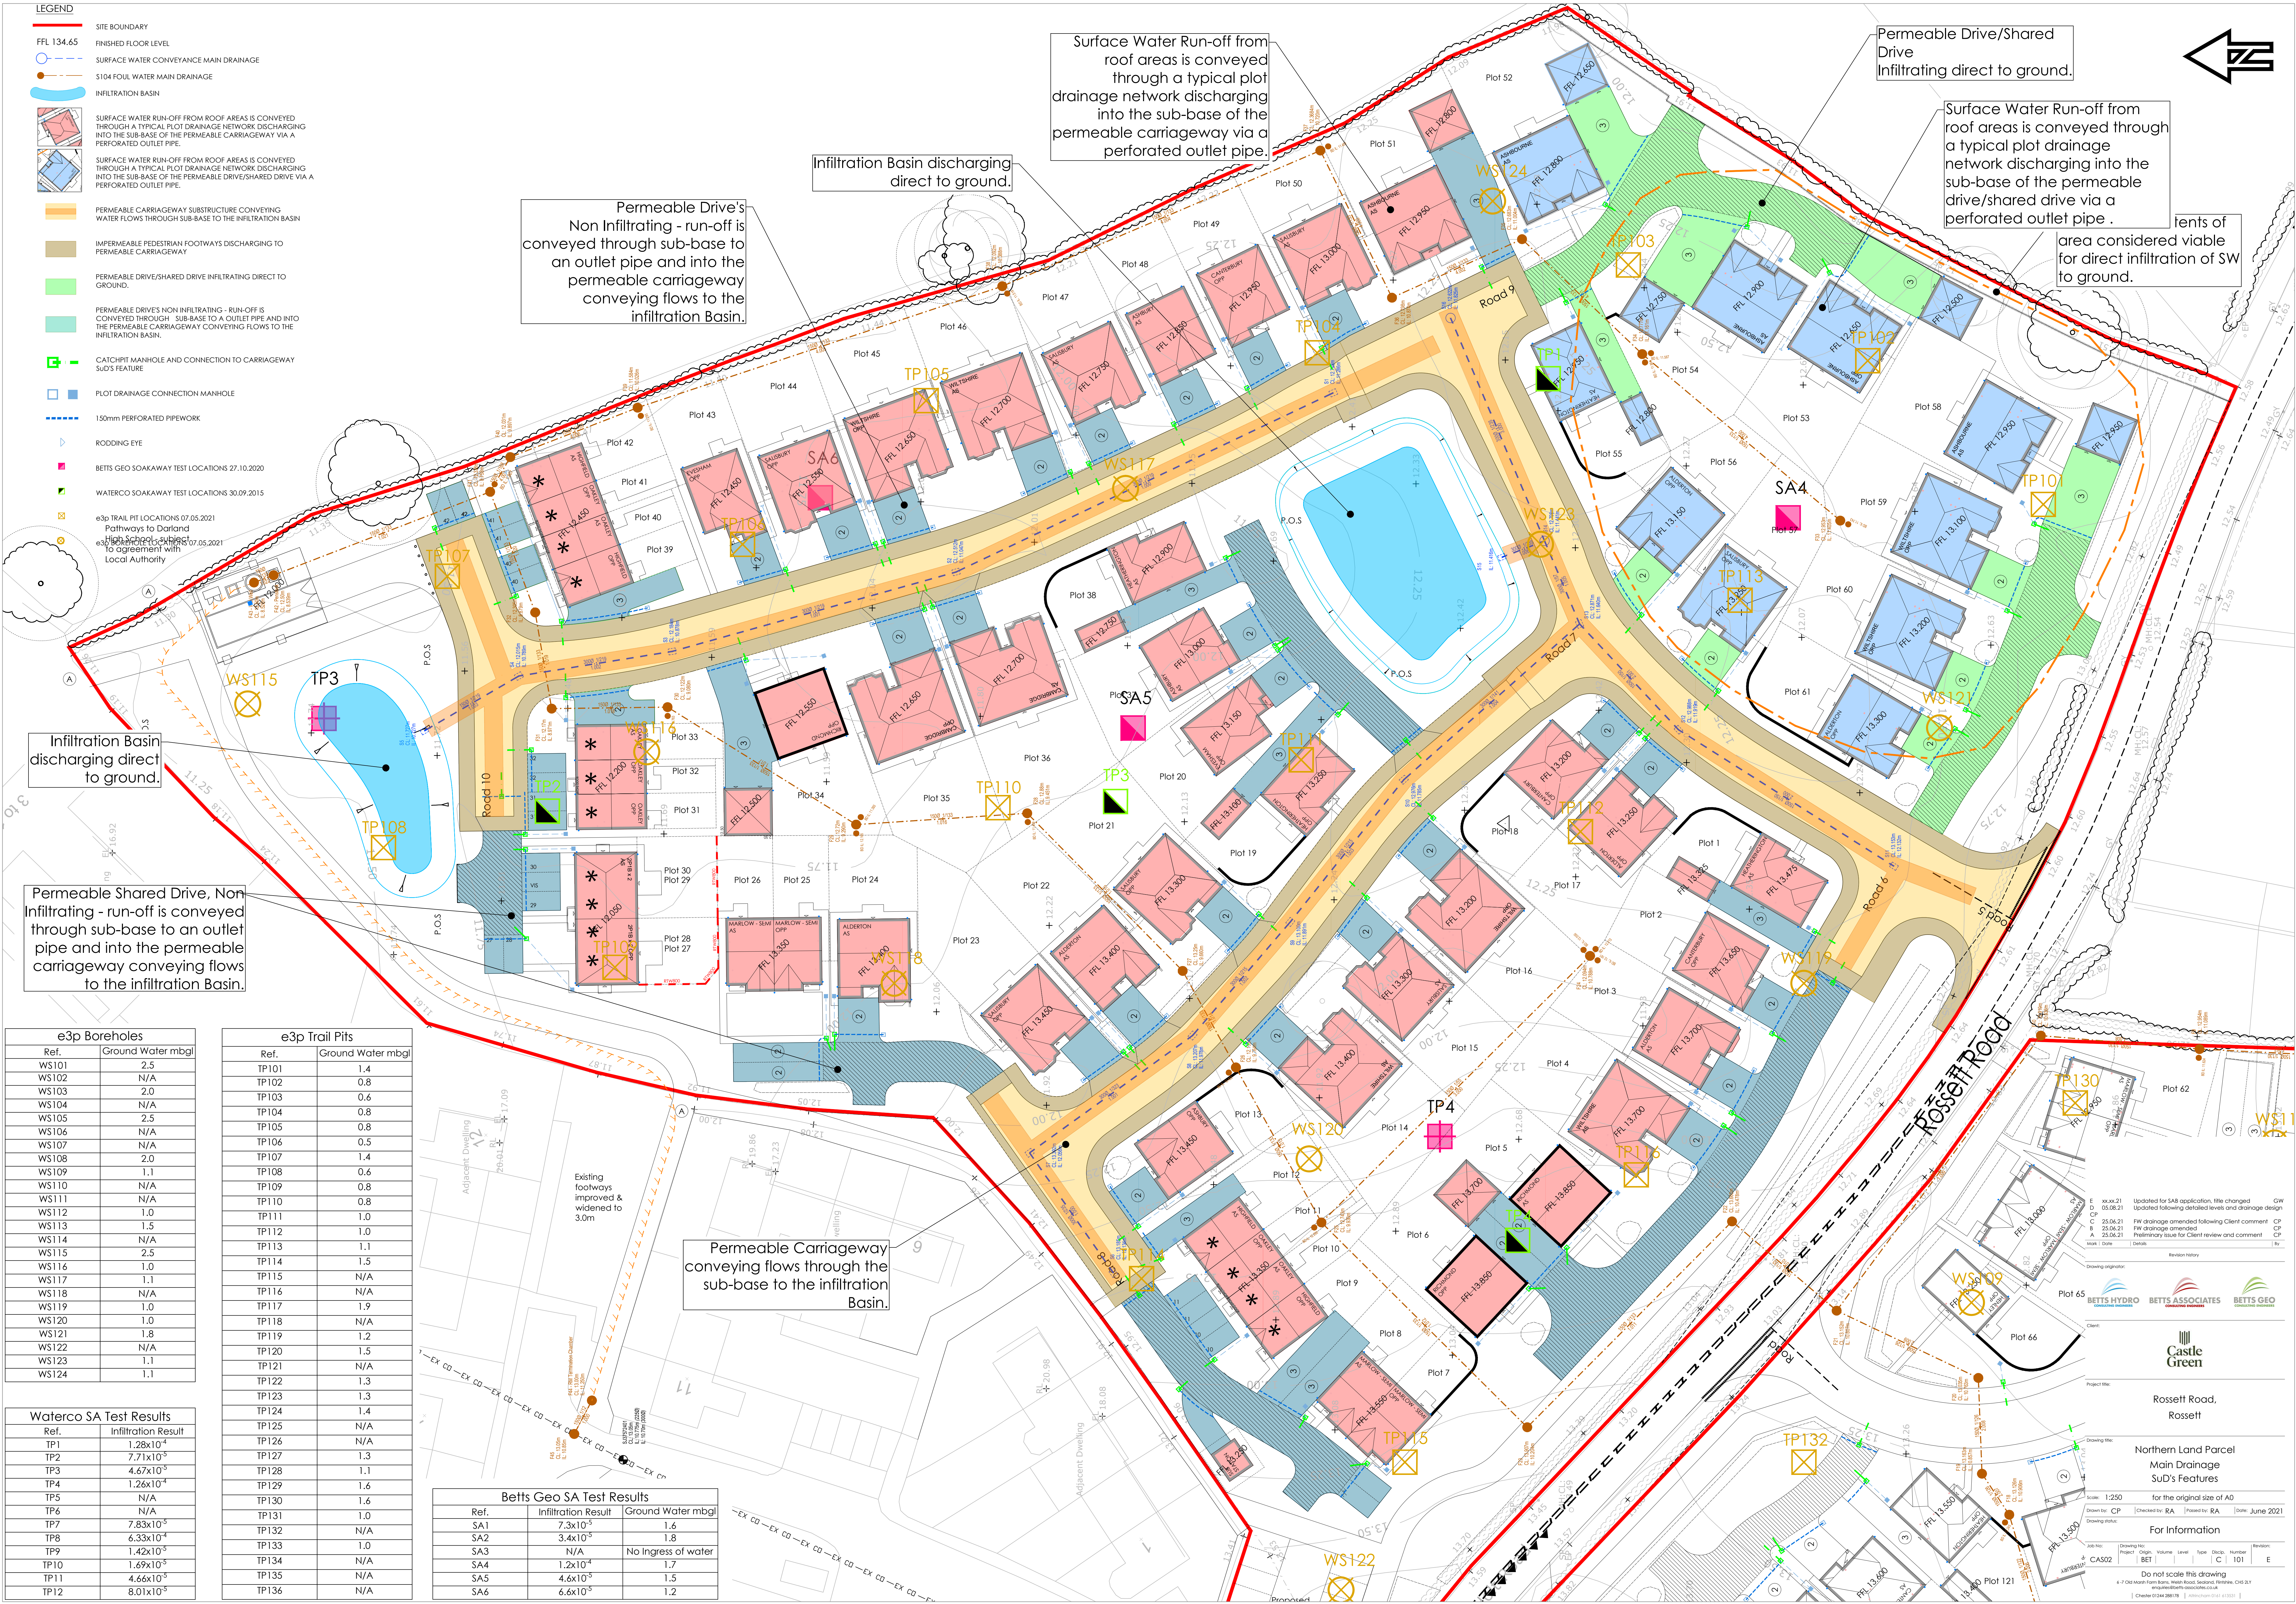

e3p Boreholes	
Ref.	Ground Water mbgl
WS101	2.5
WS102	N/A
WS103	2.0
WS104	N/A
WS105	2.5
WS106	N/A
WS107	N/A
WS108	2.0
WS109	1.1
WS110	N/A
WS111	N/A
WS112	1.0
WS113	1.5
WS114	N/A
WS115	2.5
WS116	1.0
WS117	1.1
WS118	N/A
WS119	1.0
WS120	1.0
WS121	1.8
WS122	N/A
WS123	1.1
WS124	1.1

Waterco SA Test Results	
Ref.	Infiltration Result
TP1	1.28x10 ⁻⁴
TP2	7.71x10 ⁻⁵
TP3	4.67x10 ⁻⁵
TP4	1.26x10 ⁻⁴
TP5	N/A
TP6	N/A
TP7	7.83x10 ⁻⁵
TP8	6.33x10 ⁻⁴
TP9	1.42x10 ⁻⁵
TP10	1.69x10 ⁻⁵
TP11	4.66x10 ⁻⁵
TP12	8.01x10 ⁻⁵

e3p Trail Pits	
Ref.	Ground Water mbgl
TP101	1.4
TP102	0.8
TP103	0.6
TP104	0.8
TP105	0.8
TP106	0.5
TP107	1.4
TP108	0.6
TP109	0.8
TP110	0.8
TP111	1.0
TP112	1.0
TP113	1.1
TP114	1.5
TP115	N/A
TP116	N/A
TP117	1.9
TP118	N/A
TP119	1.2
TP120	1.5
TP121	N/A
TP122	1.3
TP123	1.3
TP124	1.4
TP125	N/A
TP126	N/A
TP127	1.3
TP128	1.1
TP129	1.6
TP130	1.6
TP131	1.0
TP132	N/A
TP133	1.0
TP134	N/A
TP135	N/A
TP136	N/A

Betts Geo SA Test Results		
Ref.	Infiltration Result	Ground Water mbgl
SA1	7.3x10 ⁻⁵	1.6
SA2	3.4x10 ⁻⁵	1.8
SA3	N/A	No Ingress of water
SA4	1.2x10 ⁻⁴	1.7
SA5	4.6x10 ⁻⁵	1.5
SA6	6.6x10 ⁻⁵	1.2

Revision History

Rev	Date	By	Description
1	05.08.21	RA	Updated following detailed levels and drainage design
2	25.04.21	CP	FW drainage amended following Client comment
3	25.04.21	CP	FW drainage amended
4	25.04.21	RA	Preliminary issue for Client review and comment
5	25.04.21	RA	Details

Project title: Rossett Road, Rossett

Client: Northern Land Parcel Main Drainage SuD's Features

Scale: 1:250 for the original size of A0

Drawn by: CP, Checked by: RA, Projected by: RA, Date: June 2021

For Information

Job No: CAS02, Drawing No: CAS02, Volume: 1, Sheet: 1 of 1, Date: 101, E

Do not scale this drawing

© 2021 Castle Green. All rights reserved. Castle Green is a registered trademark of Castle Green.