




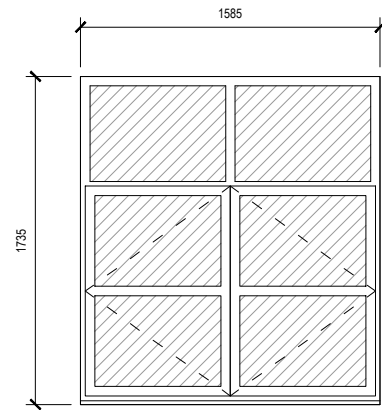

WT01A - 14No. - Aluminium Framed Windows
WT01B - 12No. - UPVC Framed Windows

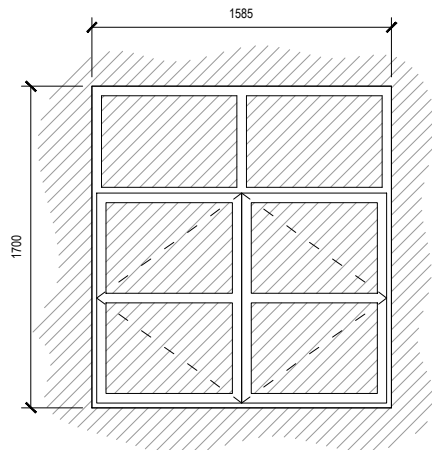

WT02 - 2No. - Aluminium Framed Window

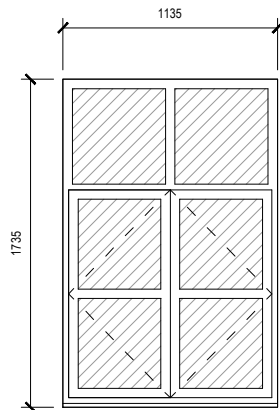

WT03 - 2No. - Aluminum Framed Window

WT01 to Apartment 27 to be fire rated to achieve 60 minutes Insulation and Integrity.

WINDOWS & DOORS

CDM 2015 - (Refer to Project Health & Safety Information)

HAZARDS

- 1. Live services adjacent/on site.
- 2. Excavations - Ground Collapse
- 3. Handling major components
- 4. Working at height - Falling
- 5. Machinery & Equipment
- 6. Ensure all blockwork has a minimum crushing strength of 3.5N/mm²
- 7. The weight of each block must not exceed 20Kg

NOTES :

DO NOT SCALE FROM THIS DRAWING.

- 1. This drawing is copyright of WardmanBrown. WardmanBrown is a trading name of Wardmans Architectural Services Limited.
- 2. All dimensions to be verified on site prior to any shop or site works being commenced.
- 3. Any discrepancies to be reported to the Designer BEFORE any work is put in hand.
- 4. This drawing must be read in conjunction with relevant consultants and specialists drawings.
- 5. This drawing must be read in conjunction with the drawings specified.

NOTE - ALL INTERNAL COURTYARD WINDOWS TO HABITABLE ROOMS TO RECEIVE ONE WAY SILVER REFLECTIVE FILM (REF RF 220)

NOTE - Aluminium windows to be colour coated grey to match existing

NOTES - EXTERNAL WINDOWS & DOORS



- 1. Windows and Doors to be manufactured to BS 7412:2007 Specification for UPVC Windows & Doors or BS 1474 for extruded aluminium. Frames to be Grey colour.
- 2. Provide Catnic insulated steel lintels to new openings - duty to be confirmed by supplier
- 3. Windows and Doors to be fitted with trickle vent(s) located in head of frame, providing 8000mm² ventilation.
- 4. Windows and Doors to be fully weatherstripped.
- 5. Windows and Doors to be securely fixed to building structure at maximum 600mm centres, with minimum 2no fixing points per side.
- 6. Window supplier to confirm all critical dimensions prior to manufacture of windows and doors.
- 7. Provide 25mm MDF bullnosed cill boards to all new windows internally.
- 9. Windows to be Double glazed to achieve a minimum 'U' value of 1.4 W/m²K
- 10. All glazing in critical locations to be laminated or toughened in accordance with BS6206 - refer to table below.

HARDWARE GENERALLY CONTRACTOR TO INCLUDE FOR STANDARD HARDWARE TO NEW WINDOWS & DOORS.


IMPORTANT THE DIMENSIONS INDICATED ARE APPROXIMATE. THE CONTRACTOR IS TO UNDERTAKE ALL NECESSARY SITE CHECKS PRIOR TO MANUFACTURE OF WINDOWS & DOORS.

— DENOTES STRUCTURAL OPENING

GLAZING IN CRITICAL LOCATIONS

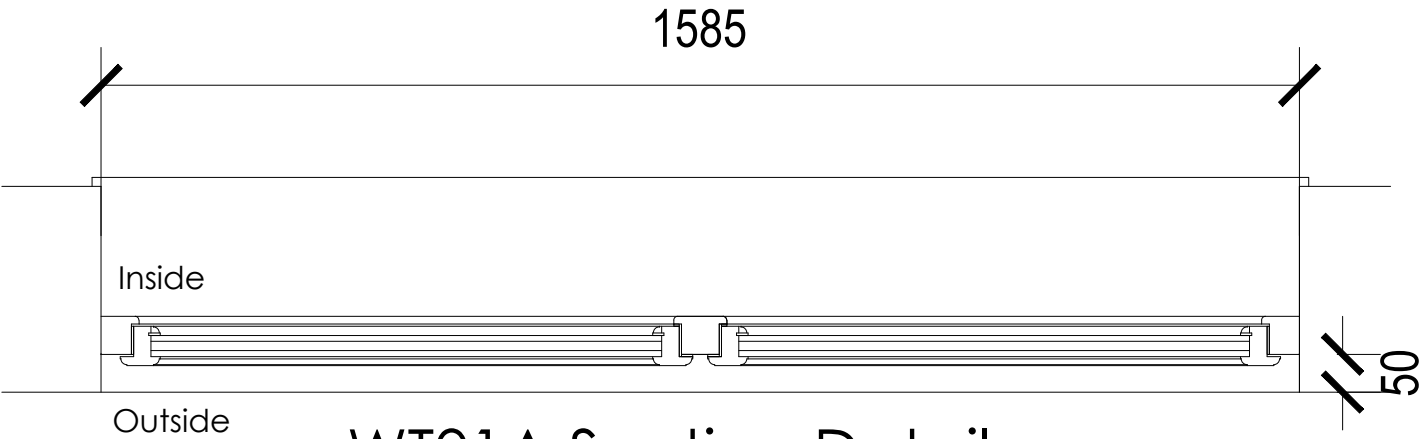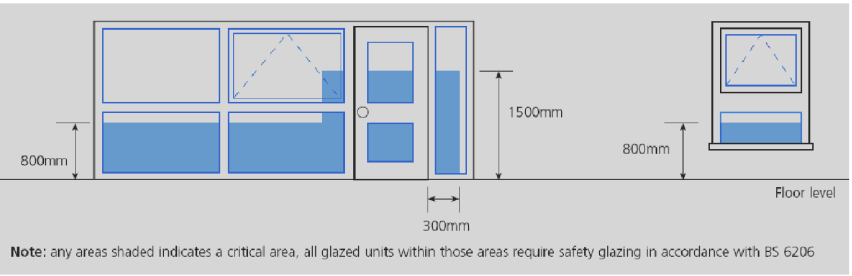

WT01A Section Detail
WT01B Section Detail

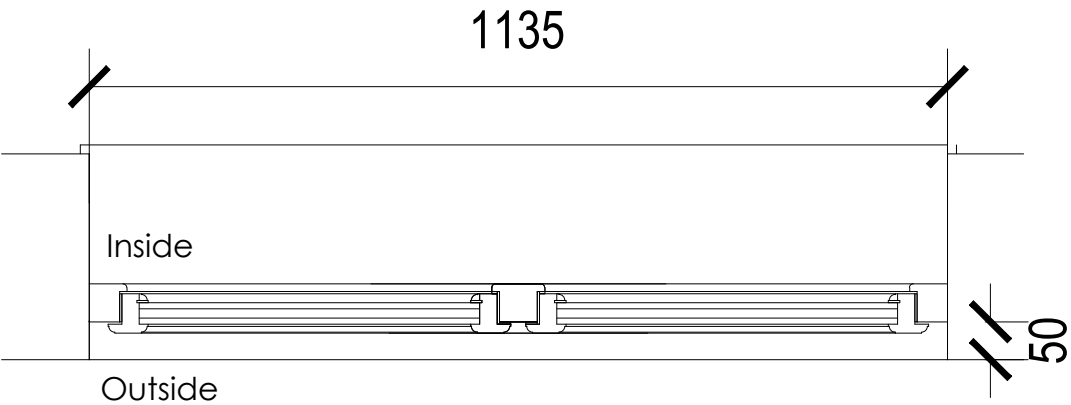

WT03 Section Detail

REV	DATE	DETAILS
B	22-11-18	Amendments Scales
A	14-11-18	Amendments to opening sashes
REVISIONS:		



113 Stanhope Road South
Darlington, DL3 7SF
Tel: 01325 460227
info@wardmanbrown.com
www.wardmanbrown.com



Architectural Services Limited
Registered Practice

CLIENT: Mandale
PROJECT: Herblas - Wrexham
DRAWING TITLE: Window Schedule Sheet 1 of 2
PURPOSE OF ISSUE: CONSTRUCTION
SCALE: 1:40 & 1:10 @ A3 1:20 & 1:5 @ A1
DATE: NOV 18 DRAWN:CB DRG REVISION:
DRAWING NO: L018022-144 B