
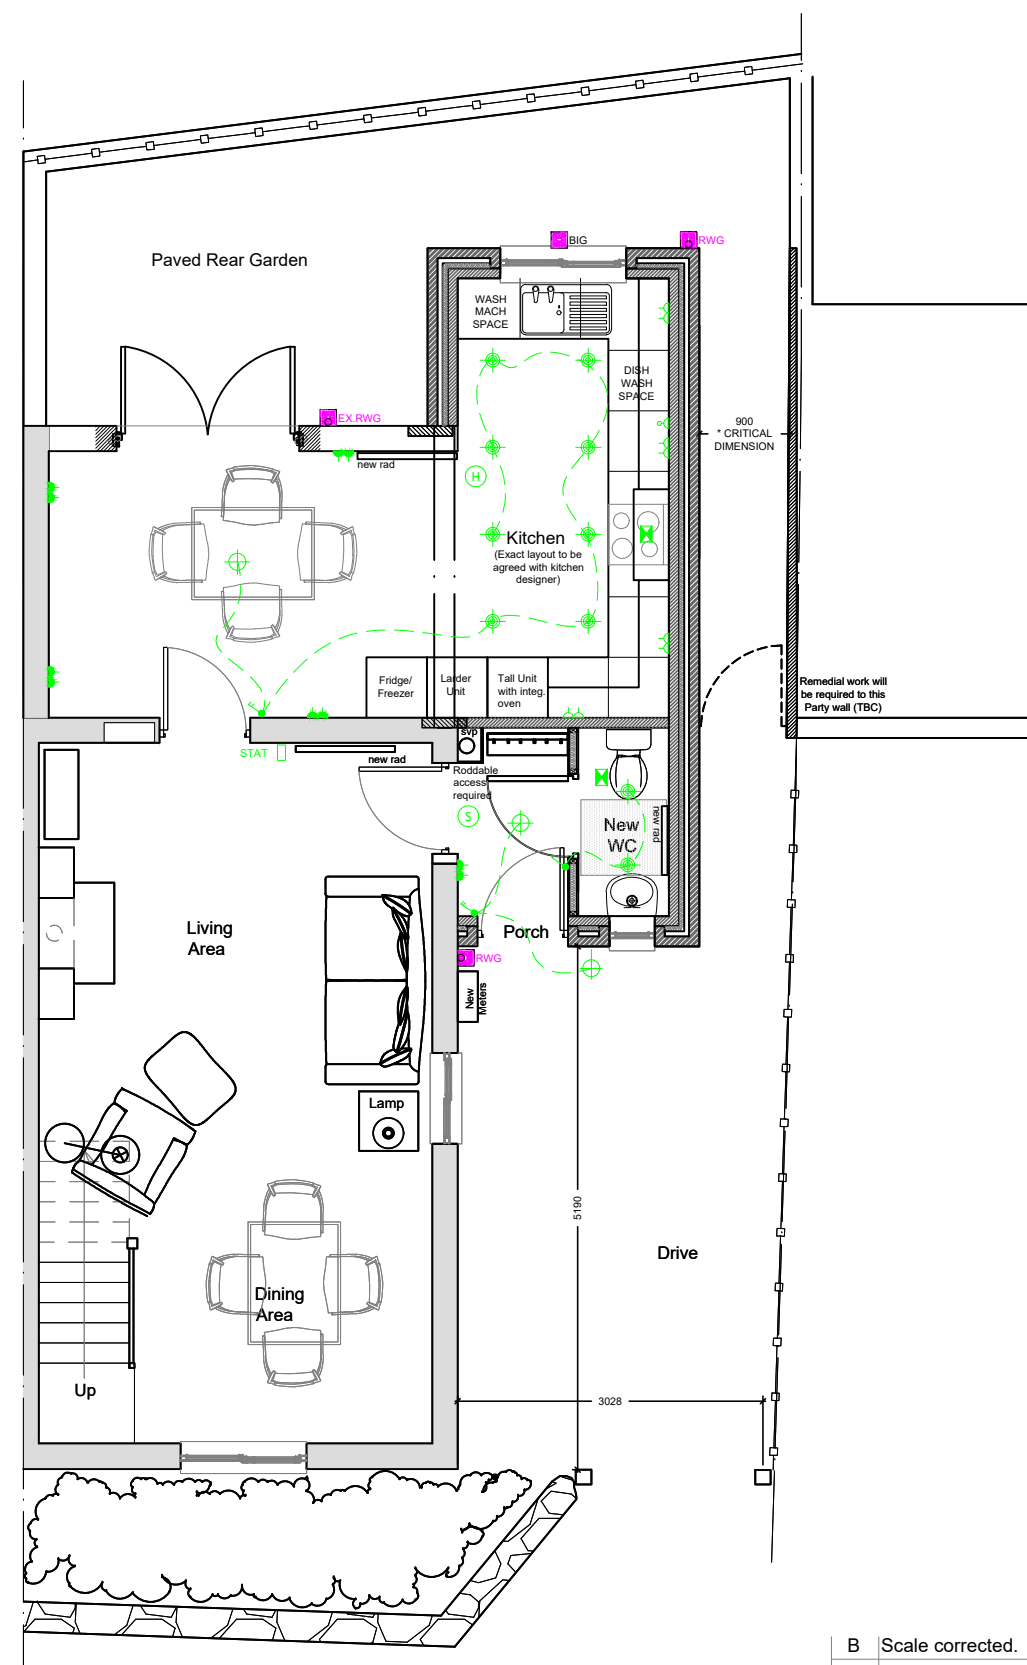


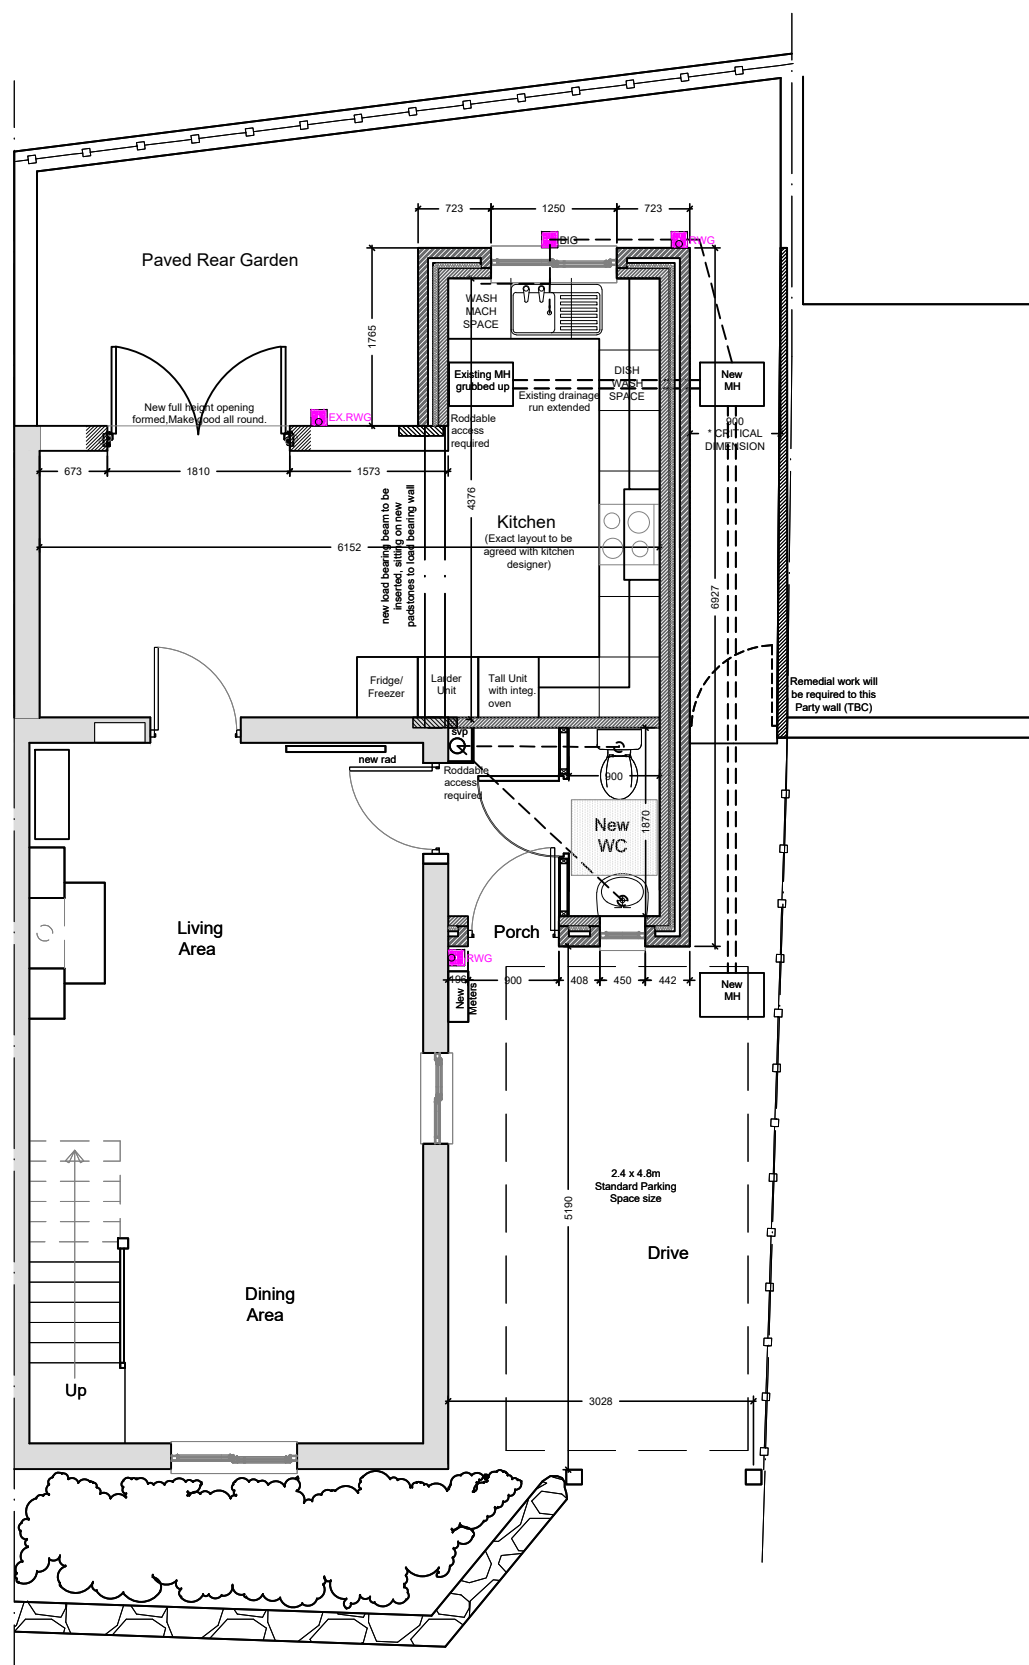

- | | |
|---|--|
|  | LOW VOLTAGE DOWNLIGHTER FITTING, |
|  | PENDANT TYPE LIGHT FITTING |
|  | DOUBLE S/W SOCKET OUTLET (LOW LEVEL) |
|  | DOUBLE S/W SOCKET OUTLET (HIGH LEVEL) |
|  | BANK OF SWITCHES TO ISOLATE APPLIANCES |
|  | LIGHT SWITCH |
|  | TELEPHONE POINT |
| <p>SMOKE DETECTOR TO BS 5839-6: 2004, TO BE PERMANENTLY WIRED TO A SEPARATELY FUSED CIRCUIT AT THE DISTRIBUTION BOARD, WHERE MORE</p> <p>(S) THAN ONE ARE INSTALLED THEY WILL BE INTER-CONNECTED. WIRING SHALL CONFORM TO IEE WIRING REGULATIONS. SMOKE DETECTOR TO HAVE BATTERY BACKUP AND TO BE LOCATED A MIN. OF 300mm AWAY FROM ANY WALL AND LIGHT FITTING.</p> | |
| STAT  | ROOM THERMOSTAT |
|  | EXTERNAL WALL LIGHT FITTING |
| <p>HEAT DETECTOR TO BS 5446-2: 2003, TO BE PERMANENTLY WIRED TO A SEPARATELY FUSED CIRCUIT AT THE DISTRIBUTION BOARD, WHERE MORE</p> <p>(H) THAN ONE ARE INSTALLED THEY WILL BE INTER-CONNECTED. WIRING SHALL CONFORM TO IEE WIRING REGULATIONS. HEAT DETECTOR TO HAVE BATTERY BACKUP AND TO BE LOCATED A MIN. OF 300mm AWAY FROM ANY WALL AND LIGHT FITTING.</p> | |
| <p>Mechanical extract fan:</p> <p> Kitchen = 60l/sec wall fan or 30l/sec hood
Int WC = 6l/sec wall fan with overrun</p> | |

NOTE:
Kitchen appliance layout
to be confirmed. Fused
spur sockets required to
appliances and
positioned as required.

B	Scale corrected.	14.08.18	AP
REV:	Description:	Initial:	Checked:
Client	C. Edwards	Drawg. Title	Proposed Floorplan & Electrics
Project	Jasmine Cottage Rossett	Scale	1:75
		Drawn	AP
		Checked	
		Date	24/02/18
		Drawg. No.	006
		Revision	B