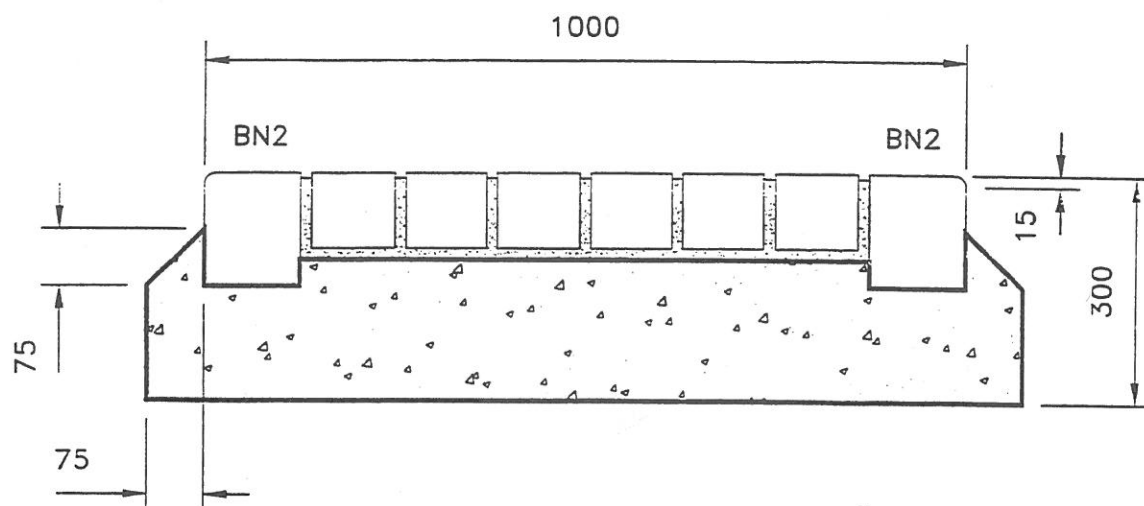


Notes:

1. Edge restraint to be 125x150 BN kerbs type BN2.
2. Concrete base to be C10 or ST2 laid on 150mm min. thickness of granular sub-base type 1.
3. Remainder of strip to be 100x100 nominal size granite sets bedded in designation (ii) mortar with 15 recessed joints or 65 thick brick/concrete pavers laid in herringbone pattern on 35 naturally occurring silica sand complying with Table 2 BS 6717 Part 3, but with not more than 2% by mass passing a 75 sieve. The gap filling sand shall be naturally occurring silica sand complying with above.

WLB

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

WREXHAM COUNTY BOROUGH COUNCIL


revisions	title	scale	date
	ACCESSWAY RAMP	1/10	1/95
		drawing no	11/01/06
		sheet	1 of 1

NOTES

To be read in conjunction with drgs. 11/01/01 & 11/01/02 (Kerbing Details).


ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

Pedestrian Crossing point to 11/01/11

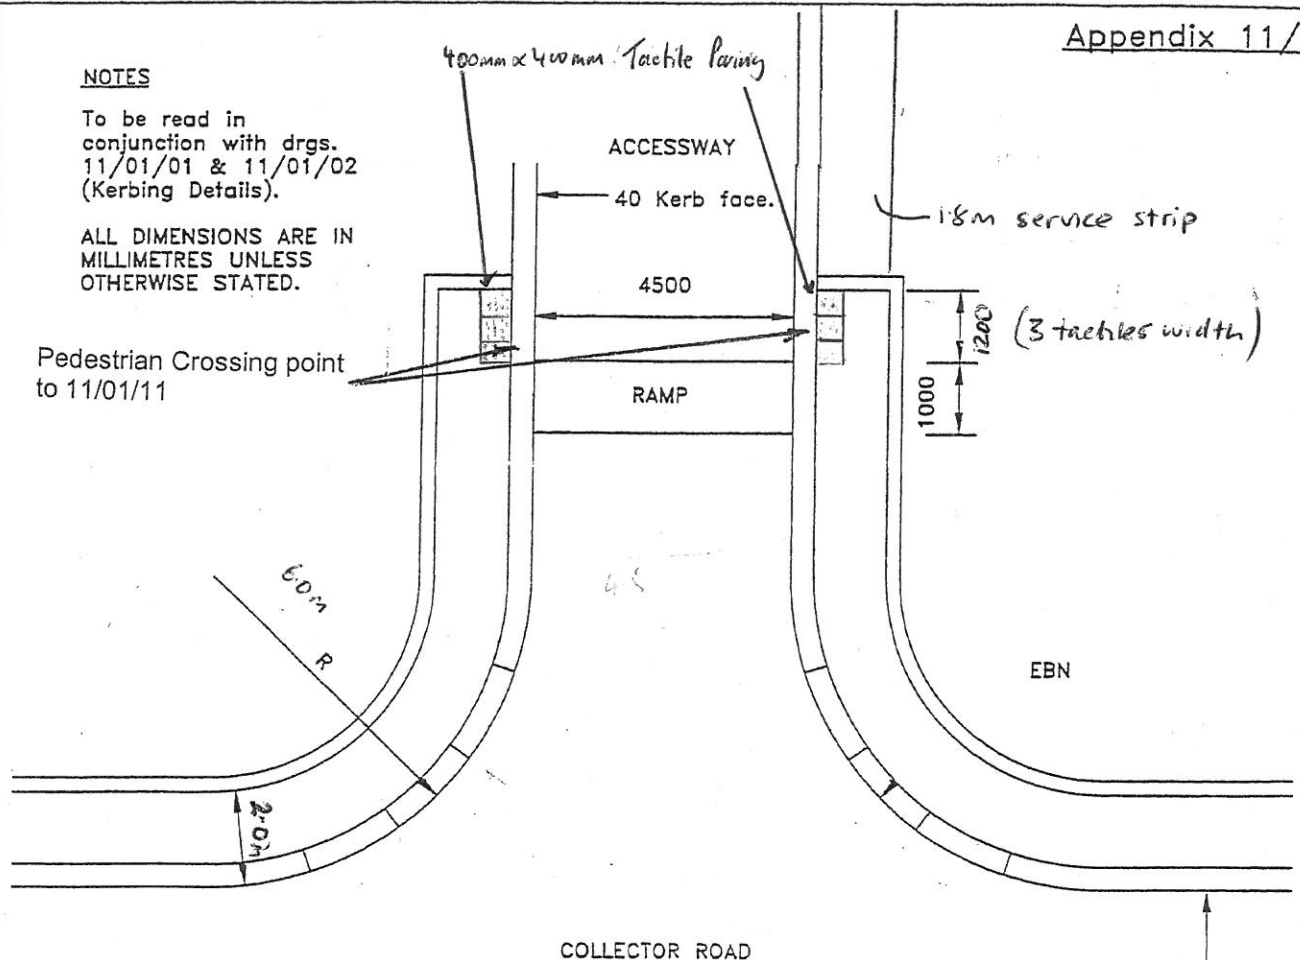

Note

Tactile paving will be required at all pedestrian crossing points.

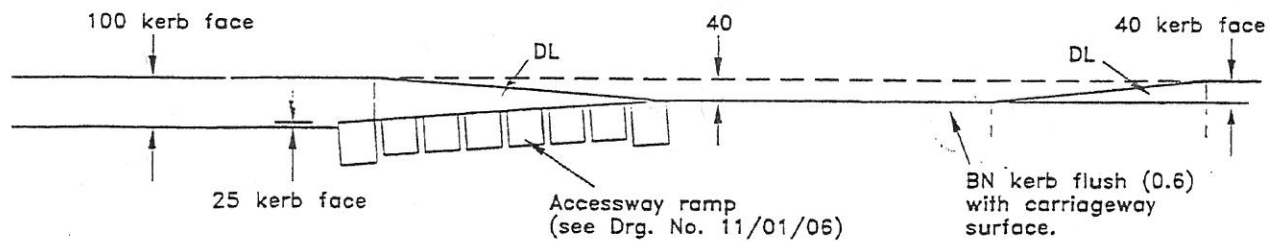

SECTION THROUGH ACCESSWAY RAMP DETAILING LOCATION OF DROPPER AND BULLNOSE KERBS FOR PEDESTRIAN ACCESS TO ACCESSWAY.

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

WREXHAM COUNTY BOROUGH COUNCIL

revisions

title

JUNCTION ACCESSWAY/
COLLECTOR ROAD

scale

N.T.S.

date

12/94

drawing no 11/01/07

sheet 1 of 1