



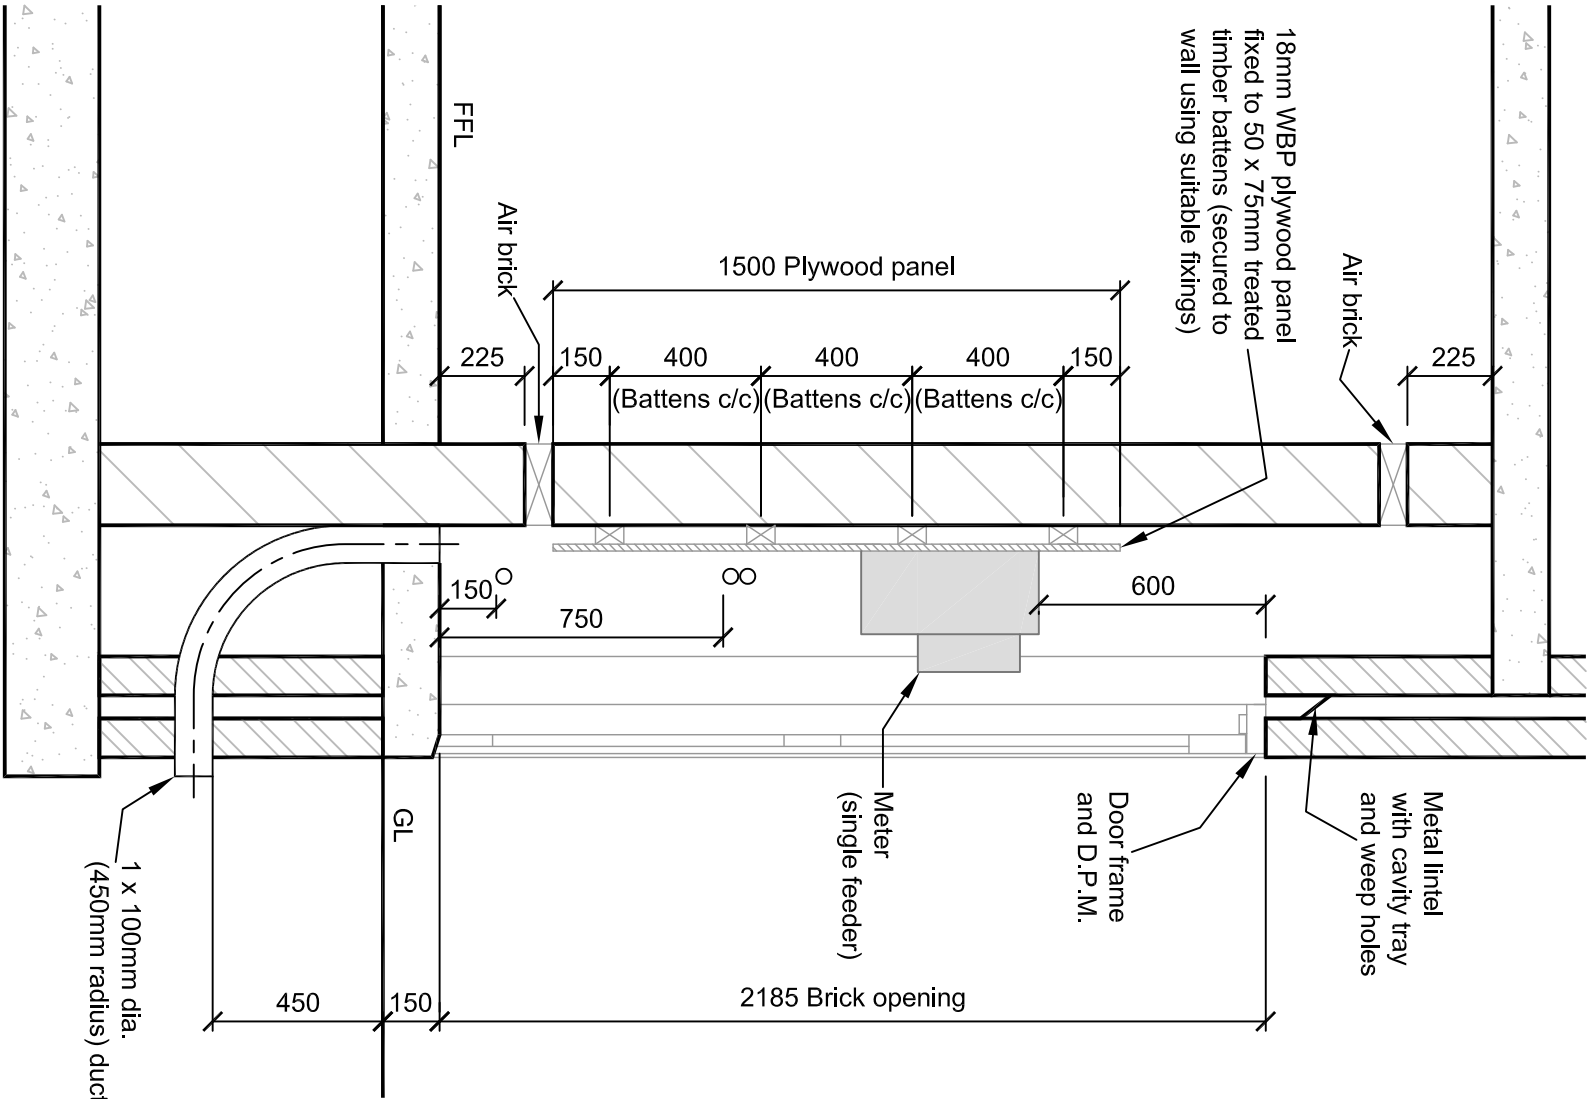


SECTION 'A-A' - Scale 1:20

NOTES :-


- * Fixings to treated timber battens shall be corrosion resistant.
- * Fixings to treated timber battens supporting meters shall be designed to safely carry applied loadings to meter operator requirements (meters will typically not exceed 30kg).
- * External doors to metering rooms/cabinets shall be to meter operator requirements providing a level of security and weathering appropriate for an enclosure containing live electrical equipment eg:- typical framed tongue and groove boarded hardwood construction to drawing SP4000543 including protective decorative finish.
- * Locks to doors to metering rooms/cabinets shall be 'Yale' type night-latch mechanisms; Energy Networks will supply replacement cylinder barrels suited for SP Manweb metering access, to be fitted by the Constructor.

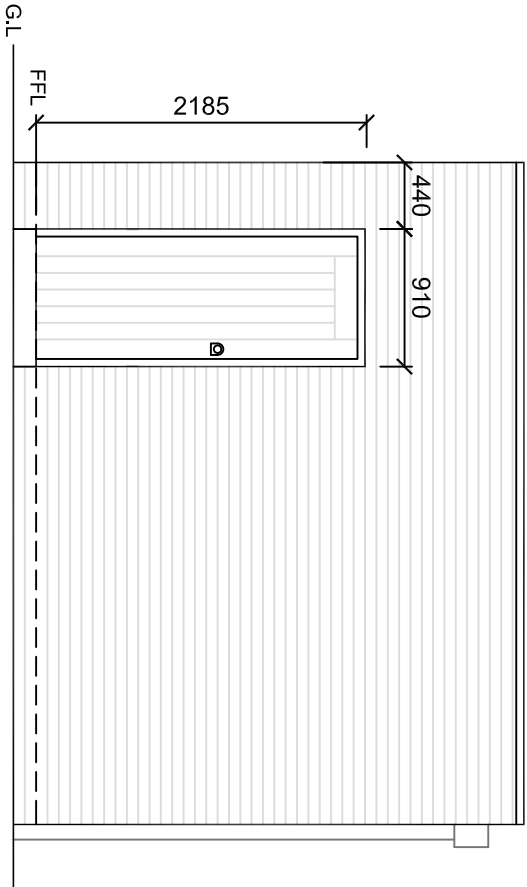

SIDE ELEVATION - Scale 1:50

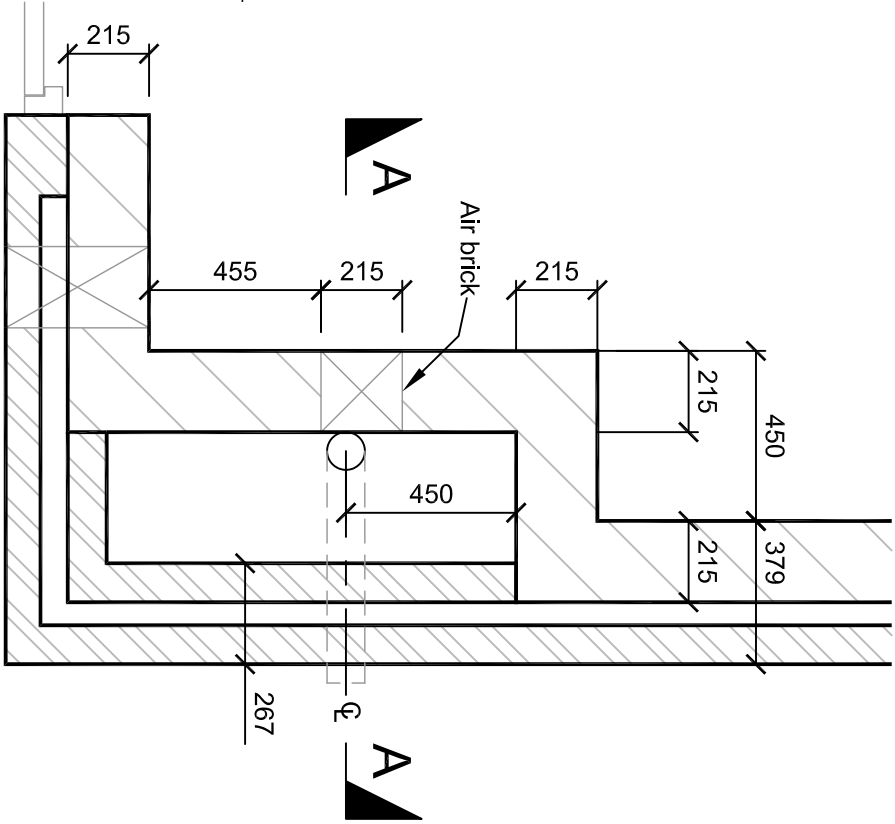

PLAN VIEW - Scale 1:20

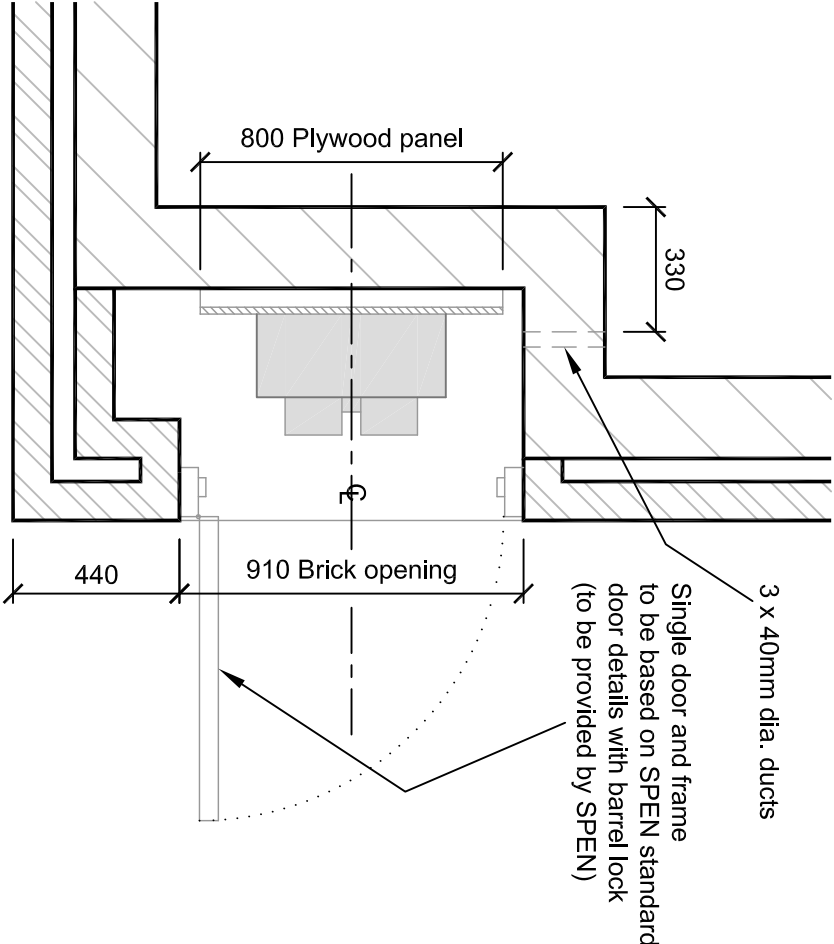

METERING PANEL PLAN VIEW - Scale 1:20

Rev.	Date	CUSTOMER SERVICE DUCT ADDED.
2.0	1/11/11	
Drawn	M.T.	
Checked	S.H.	
Approved	A.J.R.	



SP PowerSystems Ltd
System Design, Drawing Office
3 Prenton Way , Prenton , CH43 3ET
Tele 0151 6092491

Title					
11kV SUBSTATION METER CUPBOARD DETAIL FOR SINGLE FEEDER METERING (HV)					
Location					
STANDARDS					
Drawn	Date	Checked	Date	Approved	Date
P.R./M.T.	03/06/11	M.T	03/06/11	A.J.R	JULY 11
Status	Dwg. No.				Rev.
FOR ISSUE	SP4078901				2.0
© Copyright property of SP PowerSystems Ltd.				Scale	Size
				AS SHOWN	A3