


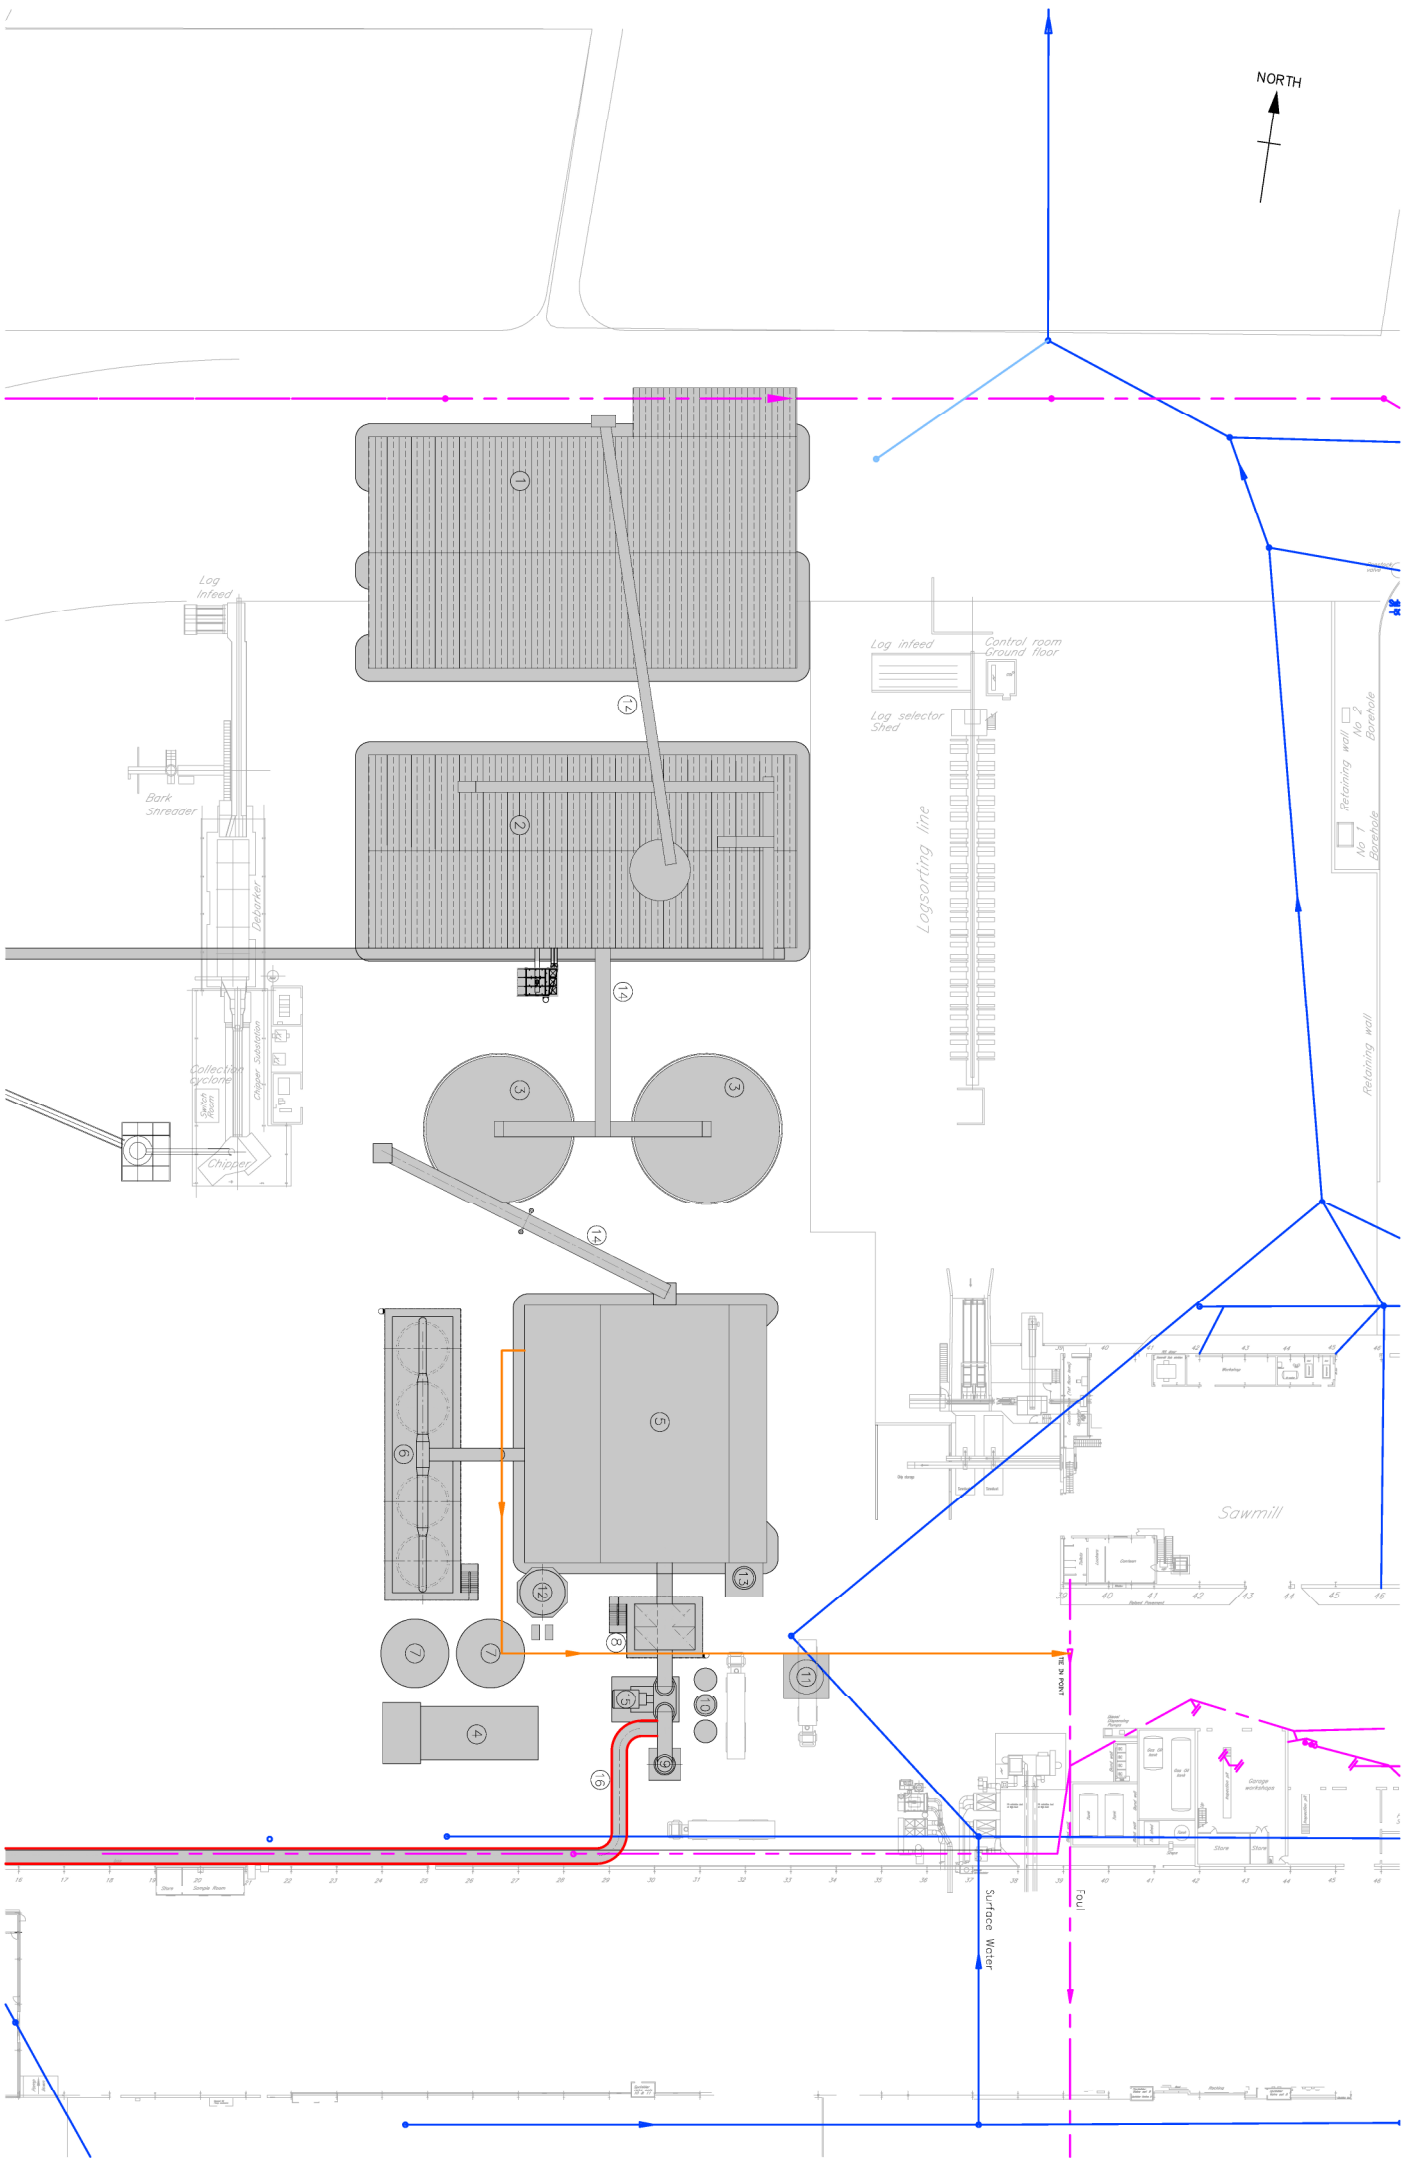

- KEY:
- | | | | |
|------------------------------|------------------------------|---------------------|--|
| ① RCF OFFLOADING BUILDING | ⑥ AIR COOLED CONDENSER (ACC) | ⑪ APC RESIDUE SILOS | ⑯ HEAT OFF TAKE PIPELINE |
| ② RCF SCREENING BUILDING | ⑦ DUST STORAGE SILOS | ⑫ FIREWATER TANK | HEAT OFF TAKE PIPELINE ROUTING |
| ③ MAIN BIOMASS STORAGE SILOS | ⑧ FGT FACILITY | ⑬ FUEL OIL TANK | NEW BUILDING / EQUIPMENT |
| ④ SUBSTATION | ⑨ STACK | ⑭ ENCLOSED CONVEYOR | PROPOSED CONNECTION TO EXISTING FOUL SEWER |
| ⑤ BIOMASS PLANT | ⑩ APC REAGENT SILOS | ⑮ ID FAN | PROPOSED CONNECTION TO EXISTING SURFACE WATER DRAINAGE |

Kronospan Biomass Plant

Figure 5.6

Indicative Drainage Layout

Scale	Date
1:1000@A3	February 2012