



Site 2, Clywedog Road North, Wrexham Industrial Estate

Proposed Industrial Development

Drainage Strategy

For: FI Real Estate Management

Integra Consulting
Suite 4
14-32 Hewitt Street
Manchester
M15 4GB

Ref: 3036-FCA
Job: 3036
Rev: -
By: NS

Date: Nov 2018

Civil Structural Highways Geotechnical Environmental

CONTENTS

1.0 INTRODUCTION

2.0 STANDARDS AND LIMITATIONS

3.0 CURRENT SITUATION

3.1 Site Location and Description

3.2 Hydrology and Flooding

3.3 Existing Sewers

4.0 PROPOSED DEVELOPMENT

4.1 Development Proposals

4.2 Surface Water Drainage

4.3 Foul Water Drainage

4.4 Planning Policy Wales and Technical Guidance

4.5 Wrexham Borough Council Guidance and NRW Mapping Review

4.6 Safe Access and Egress

5.0 CONCLUSIONS

5.1 Flooding

5.2 Site Surface Water Drainage

5.3 Site Foul Water Drainage

5.4 Flood Risk Management Measures

5.5 Off Site Impacts

5.6 Residual Risk

Environmental

Geotechnical

Highways

Structural

Civil

APPENDICES

Appendix	Title
Appendix 1	Site Location Plan
Appendix 2	Existing Topographical Survey
Appendix 3	Natural Resources Wales Flood Mapping
Appendix 4	Welsh Water Sewer Plans
Appendix 5	Proposed Site Masterplan
Appendix 6	Existing Drainage Connectivity
Appendix 7	Existing and Proposed Impermeable Area Plans
Appendix 8	Greenfield Runoff Rate
Appendix 9	Micro Drainage Analysis
Appendix 10	Surface Water Storage Calculations
Appendix 11	Overland Flood Routes
Appendix 12	Proposed External Levels General Arrangement
Appendix 13	Proposed Drainage General Arrangement

REVISIONS

Revision	Date	Prepared By	Authorised By	Remarks
	8 th November 2018	Neville Shaw BSc ACGI MBA CEng MICE MIStructE	Rory Harris MSc CEng MIStructE	-

Civil Structural Highways Geotechnical Environmental

1.0 **INTRODUCTION**

Integra Consulting has been commissioned by FI Real Estate Management Ltd. to undertake a Drainage Strategy for Site 2 at Clywedog Road North, Wrexham Industrial Estate. This document has been prepared to accompany the full planning application for the proposed industrial development of the application site.

The objective of the drainage strategy is to demonstrate that the proposed industrial development is appropriate with reference to TAN15.

Specifically, the drainage strategy will demonstrate that:

- i) The consequences and implications of flooding at the development site have been fully considered and any consequent implications on the proposed site development suitably implemented against for the lifetime of the development;
- ii) There will be no increase in flooding (from rivers, surface water or sewers) at the subject site or third-party land as a result of the development proposals.

The drainage strategy has been undertaken in accordance with the pro-forma guidance contained in:

- Planning Policy Wales (5th edition – November 2012) sets out the Welsh Government's objectives for the planning system together with how the planning process should facilitate and promote sustainable development practices whilst avoiding enhanced flood risk and accommodating the impacts of climate change;

- Technical Advice Note 15 (TAN15) 'Development and Flood Risk' issued in July 2004 which provides technical guidance to build on the salient policies set out on Planning Policy Wales. TAN15 provides a detailed framework for the consideration of new development with respect to the risk of flooding from rivers and seas together with the risks associated with additional run-off from new developments in all locations.
- Wrexham Borough Council planning guidance note 'Management of Surface Water generated from New Development' dated September 2015

To date, consultations have been undertaken with Natural Resources Wales (NRW), Welsh Water (WW) and Wrexham County Borough Council (WCBC) who act as the Lead Local Flood Authority.

2.0 STANDARDS AND LIMITATIONS

This report has been prepared solely for use by FI Real Estate Management Ltd.

It shall not be relied upon or transferred to any other party without the prior written authorisation of Integra Consulting.

The findings and opinions in the report are based on information derived from a variety of different sources. Integra Consulting do not accept any liability for the accuracy or otherwise of any information provided by third parties.

It should be noted that some of the aspects considered in this study may be subject to change with time. Therefore, if the development is delayed or postponed, consideration may need to be given to reviewing such issues to confirm that no changes have taken place, either at the site or within relevant legislation.

Further consultations with statutory bodies are likely as the scheme progresses. It should be noted that even where responses have been received from Regulators, these could be subject to change at a later date.

3.0 CURRENT SITUATION

3.1 Site Location and Description

The 0.9 hectare site is located to the south of the Wrexham Industrial Estate and to the east of Wrexham town centre (refer to Appendix 1 for site location plan). The national Ordnance Survey grid reference for the centre of the site is E337398, N349667 and the nearest post code is LL13 9XN.

The site is bounded by the Riello UPS warehouse to the north west, Clywedog Road North to the south west, 2 No. warehouses and a distribution yard to the south east and the Graphtec warehouse to the north east.

Access to the site can be obtained off Clywedog Road North. The site falls at a shallow gradient from north to south and is predominantly grassed with an area of denser vegetation in the north of the site (refer to Appendix 2 for topographical survey details).

3.2 Hydrology and Flooding

Current Natural Resources Wales flood data indicates the site to lie wholly in Flood Zone A with a negligible risk of river, surface water and reservoir flooding (refer to Appendix 3 for NRW flood mapping).

No historic site flooding associated with groundwater has been identified during the preparation of this report. Proposed building floor levels will be set 150mm above external levels following any earthworks re-modelling of the site in accordance with good design practice and this will mitigate any risk of groundwater flooding by providing a safe overland flood route.

There is a negligible residual fluvial or surface water risk and the site is not located within an NRW 'Flood Warning / Alert Area.

Review of the both the Wrexham CBC Flood Risk Management Plan 2016-2021 dated July 2016 together with consultation with various parties including Welsh Water has not identified any evidence of existing sewer flood risk issues or historical flooding on or in the immediate vicinity of the site.

3.3 Existing Sewers

The existing adopted sewers surrounding the site are noted as follows (refer to Appendix 4 for detailed Welsh Water sewer plans):

- 150mm diameter combined water sewer immediately to the south of Clywedog Road North extending from north west to south east
- 150mm diameter surface water sewer beneath Clywedog Road North extending from north west to south east

It is noted that the recent drainage survey undertaken (refer to Appendix 6 for details) has identified a private 900mm diameter surface water sewer to extend from a connection point on the boundary of the development site – this sewer is then projected along the route of Clywedog Road South to eventually discharge to ordinary watercourse to the south west of the site.

4.0 PROPOSED DEVELOPMENT

4.1 Development Proposals

It is proposed to undertake an industrial development of the application site with access from Clywedog Road North (refer to Appendix 5 for site masterplan details).

4.2 Surface Water Drainage

The issue of surface water drainage to the proposed development has been considered with reference to the hierarchy of surface water disposal as noted in the Building Regulations H3:

- i) Sustainable Urban Drainage Systems (SUDS)
- ii) Discharge of surface water off site direct to watercourse
- iii) Discharge to adopted sewer

SUDS are made up of one or more structures built to manage surface water runoff. They are used in conjunction with good management of the site to prevent flooding and pollution. There are four general methods of control:

- Filter strips and swales
- Filter drains and permeable surfaces
- Infiltration devices
- Basins and Ponds

The BGS Geological Map of the area (reference: SJ34NE) shows that the site is underlain by superficial deposits consisting of glacial till (clay) which are in turn underlain by solid geology of the Salop Formation of the Warwickshire Group (main bed), typically consisting of mudstones and sandstones.

The impermeable nature of the clay drift soils at the site together with the previous contaminative nature of the site use (part of the Royal Ordnance Factory, Wrexham) indicate the site is not suitable for post-development surface water infiltration techniques.

The nearest watercourse to the site is located circa 150m to the south east of the site through third party land and therefore direct connection to this watercourse is not considered feasible.

It is noted that the recent drainage survey undertaken (refer to Appendix 6 for details) has identified a private 900mm diameter surface water sewer to extend from a connection point on the boundary of the development site along the route of Clywedog Road South to eventually discharge to ordinary watercourse to the south west of the site.

Accordingly, it is proposed to discharge suitably attenuated post-development surface water to an ordinary watercourse to the south west of the development site via the above noted private sewer system.

Proposed post-development run off from the existing greenfield area of the development site equates to less than 5 litres per second over a 0.9 hectare area (refer to Appendix 8) and hence, in line with the Wrexham Borough Council planning guidance note 'Management of Surface Water generated from New Development' dated September 2015, it is proposed to adopt a practicable minimum post-development surface water discharge limit of 5 litres per second.

The above proposed greenfield runoff rate results in estimated on site storage to cater for a 1 in 100 year plus 30% climate change event of approximately 300m³ (refer to Appendix 10 for estimated storage calculation details). It is noted that this estimated figure is subject to future detailed drainage design.

As noted on our drainage general arrangement drawing in Appendix 13 of this report, it is proposed to accommodate the approximate storage volume noted above within a combination of below ground storage crates, drainage pipework and manholes with a nominal volume stored above ground level but naturally retained within the site boundary in a critical storm event.

Our overland flood route drawing in Appendix 11 of this report indicates that, in the event of a drainage failure / extreme flooding in excess of the design event, only localised ponding of the post-development service yard (north western area of the site) and car park (southern area of site) will occur with an overland flood route towards Clywedog Road North.

The post development surface water drainage system will be designed to ensure that:

- There is no surcharge in the 1 in 1 year event;
- Surface water flows up to a 1 in 30 year event remain in below ground storage;
- Surface water flows remain on site up to a 1 in 100 year + 30% climate change storm event. Sufficient surface water storage and shallow ponding volume will be available to ensure there is no risk to property.

4.3 Foul Water Drainage

It is proposed that post-development foul water flows are connected into the existing adopted Welsh Water 150mm diameter combined water sewer which is located parallel to and directly to the south of Clywedog Road North (refer to Appendix 13 for details).

Consent to discharge to the adopted sewer network will naturally be required from Welsh Water and early discussion will be undertaken in order to agree on a suitable point of connection.

4.4 Planning Policy Wales and Technical Guidance

The industrial site development proposals are classed as 'less vulnerable' in Technical Advice Note 15.

'Less vulnerable' developments in Flood Zone A are classed as appropriate in Technical Advice Note 15.

Proposed post development levels will be engineered in order to protect the development and not provide any increased flood risk elsewhere.

4.5 Wrexham Borough Council Guidance and NRW Mapping Review

From our review of Wrexham Borough Council planning guidance note 'Management of Surface Water generated from New Development' dated September 2015, it is proposed that post-development surface water discharges at 5 litres per second into an ordinary watercourse located to the south west of the development site via the existing 900mm diameter private sewer system that extends from the site boundary and projects along Clywedog Road South (refer to Appendices 6 and 13 for details).

There is negligible residual fluvial or surface water risk and the site is not located within an NRW 'Flood Warning / Alert Area'.

4.6 Safe Access and Egress

Safe access / egress from the site in extreme conditions will be via the entrance on Clywedog Road North.

5.0 CONCLUSIONS

5.1 Flooding

Following review of the Natural Resources Wales flood maps and data, it has been confirmed that the site lies wholly within Flood Zone A.

The nature of the industrial development proposals is considered as 'less vulnerable' which is acceptable in Flood Zone A and the development is considered to be appropriate in accordance with TAN15 based on the drainage proposals outlined in this report.

There are to be no off site surface water flood routes generated by the development during an enhanced 1 in 100 year storm. All surface water run-off will remain on site in the 1 in 100 year + 30% climate change event.

Following review of the Development Advice Map, it has been confirmed that the site lies wholly within Flood Zone A.

5.2 Site Surface Water Drainage

It is proposed to discharge suitably attenuated post-development surface water from the site at the minimum practicable rate of 5 litres per second to an ordinary watercourse located to the south west of the site via the existing 900mm diameter private sewer system that extends from the site boundary and projects along Clywedog Road South (refer to Appendices 6 and 13 for details).

5.3 Site Foul Water Drainage

It is proposed that post-development foul water flows are connected into the existing adopted Welsh Water 150mm diameter combined water sewer which is located parallel to and directly to the south of Clywedog Road North.

5.4 Flood Risk Management Measures

There will be a site management Health and Safety document prepared in respect of the site.

5.5 Off Site Impacts

All roofed and paved areas are to be formally drained into the site surface water drainage system. The design of the site surface water system will ensure that no off-site flood flows are generated by the proposed development in the 1% plus climate change event.

5.6 Residual Risk

With careful design of the drainage elements as described above, there will be no residual flood related risks remaining after the development has been completed.


The proposed building envelopes will naturally all lie in Flood Zone A.

A post-development safe emergency access can be maintained at all times during a flood event. Emergency access will be from Clywedog Road North.

APPENDIX 1


SITE LOCATION PLAN




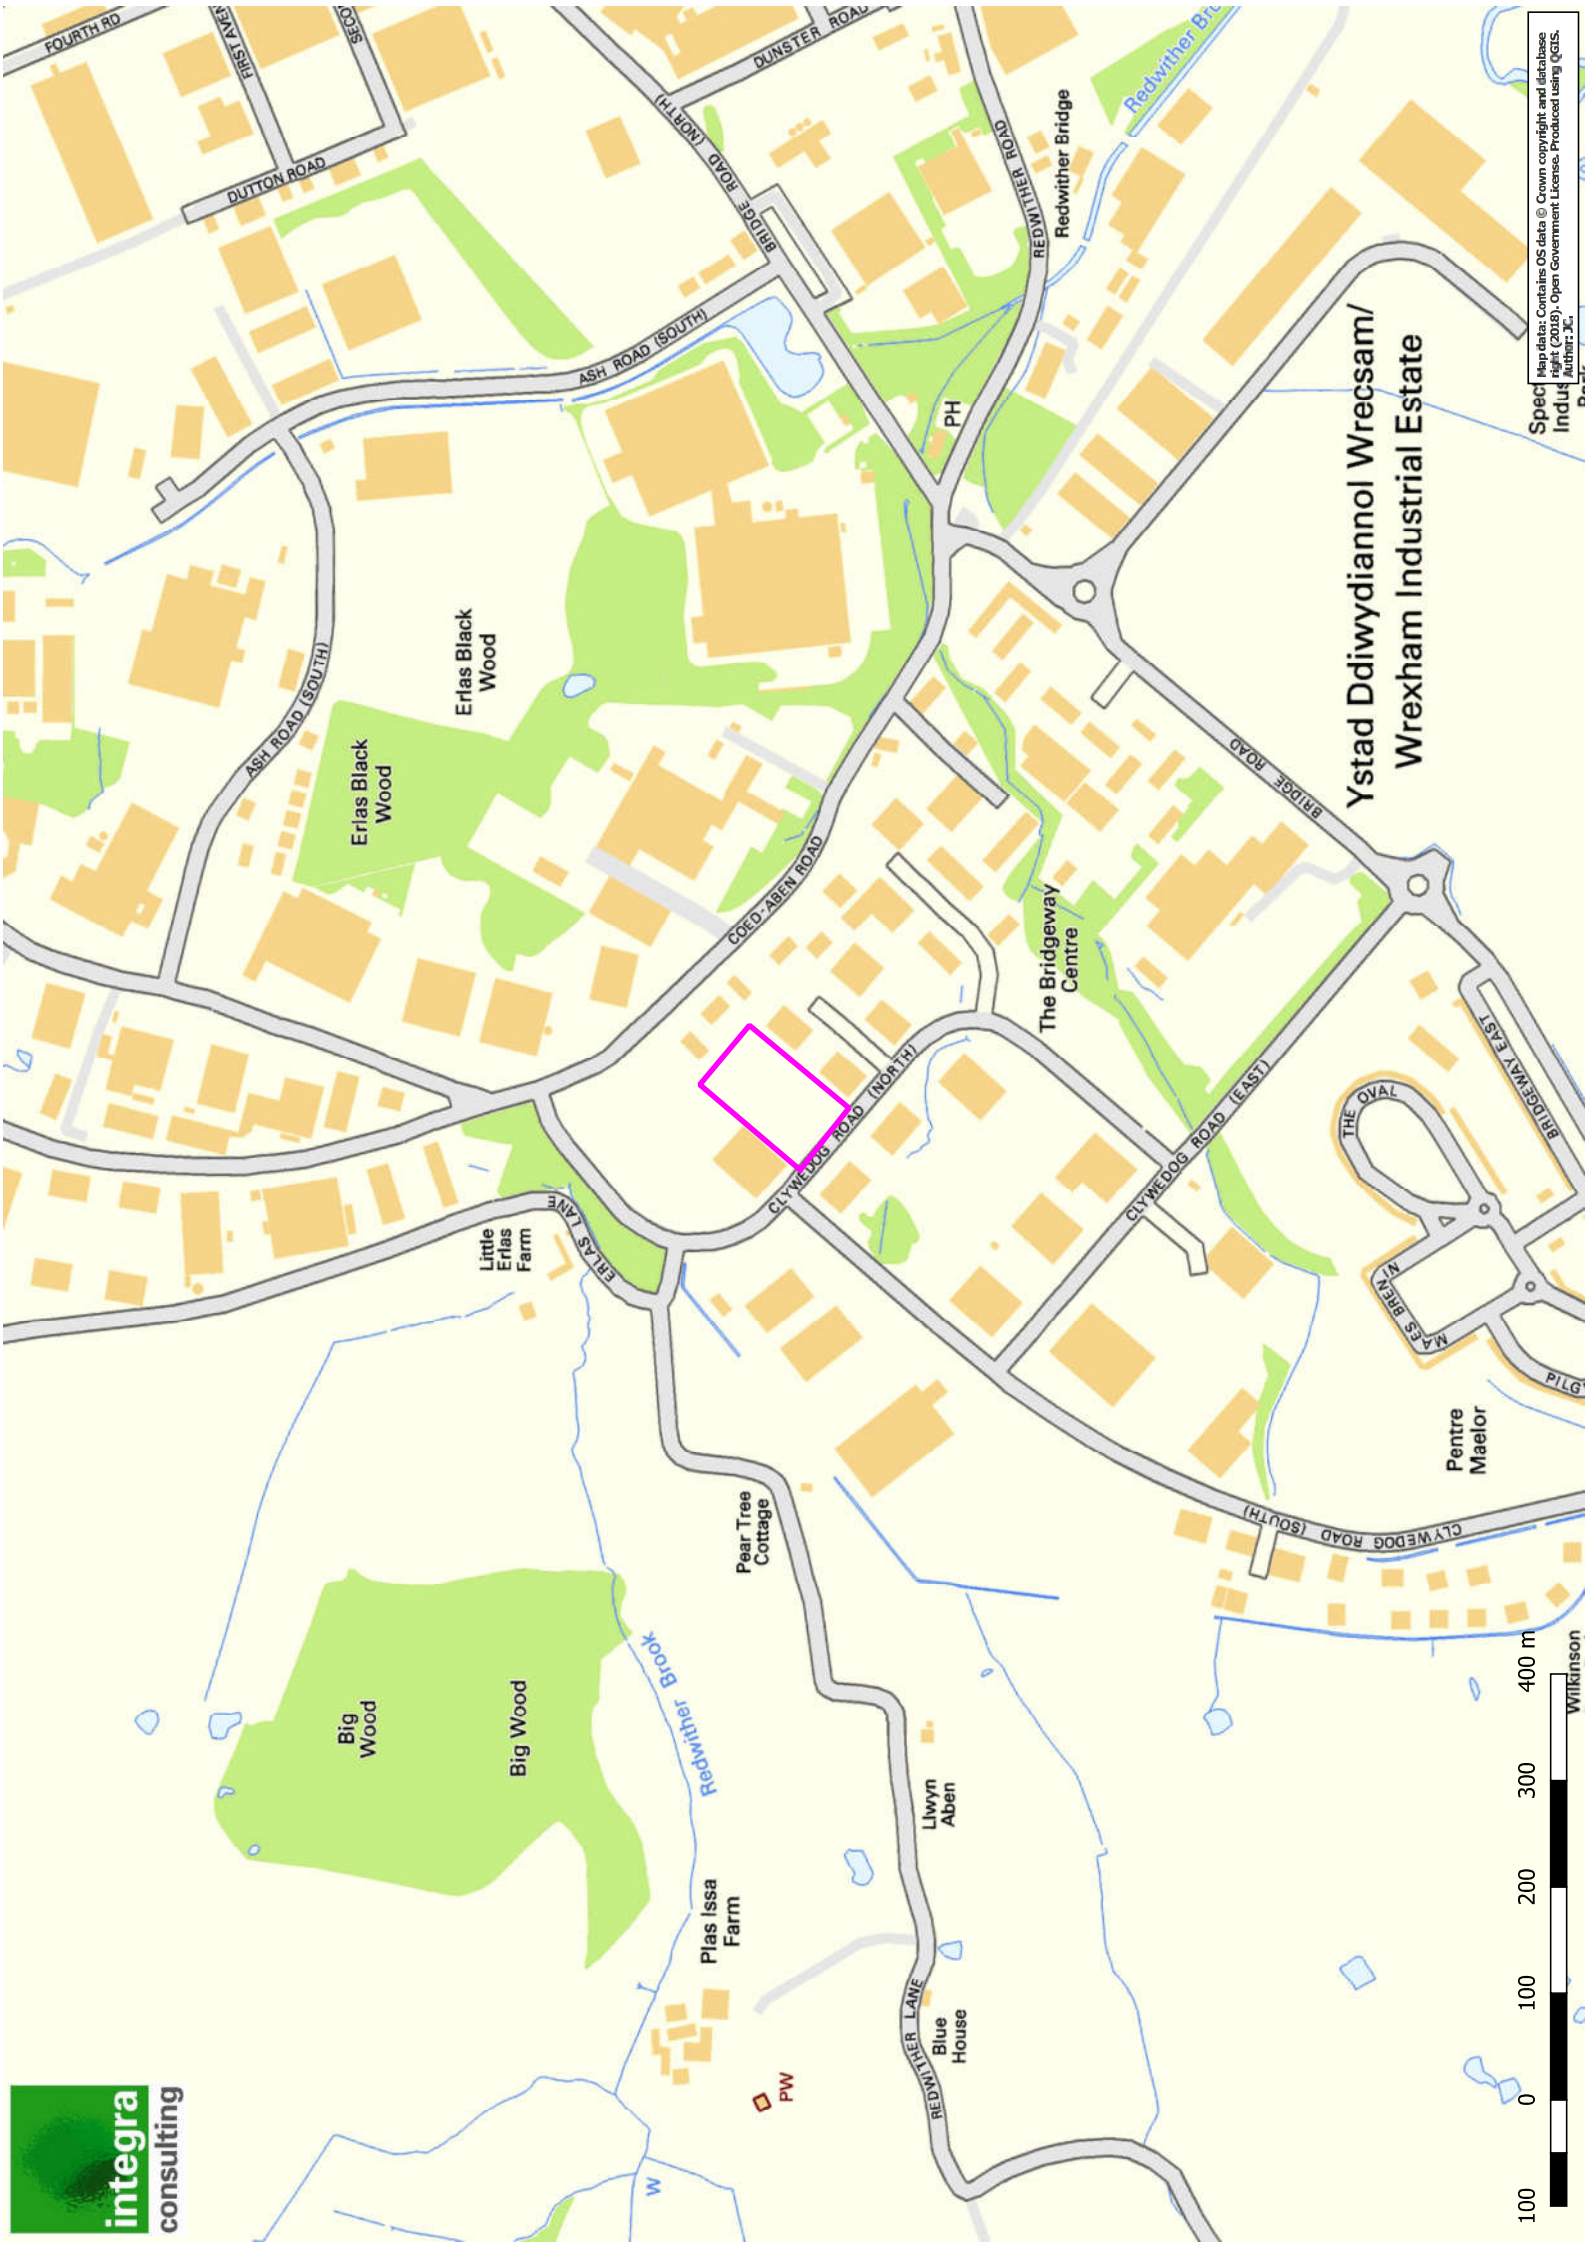


Map data: Contains OS data © Crown copyright and database right (2019). Open Government Licences. Produced using QGIS. Author: J. K.

Ystad Ddiwydiannol Wrecsam/ Wrexham Industrial Estate



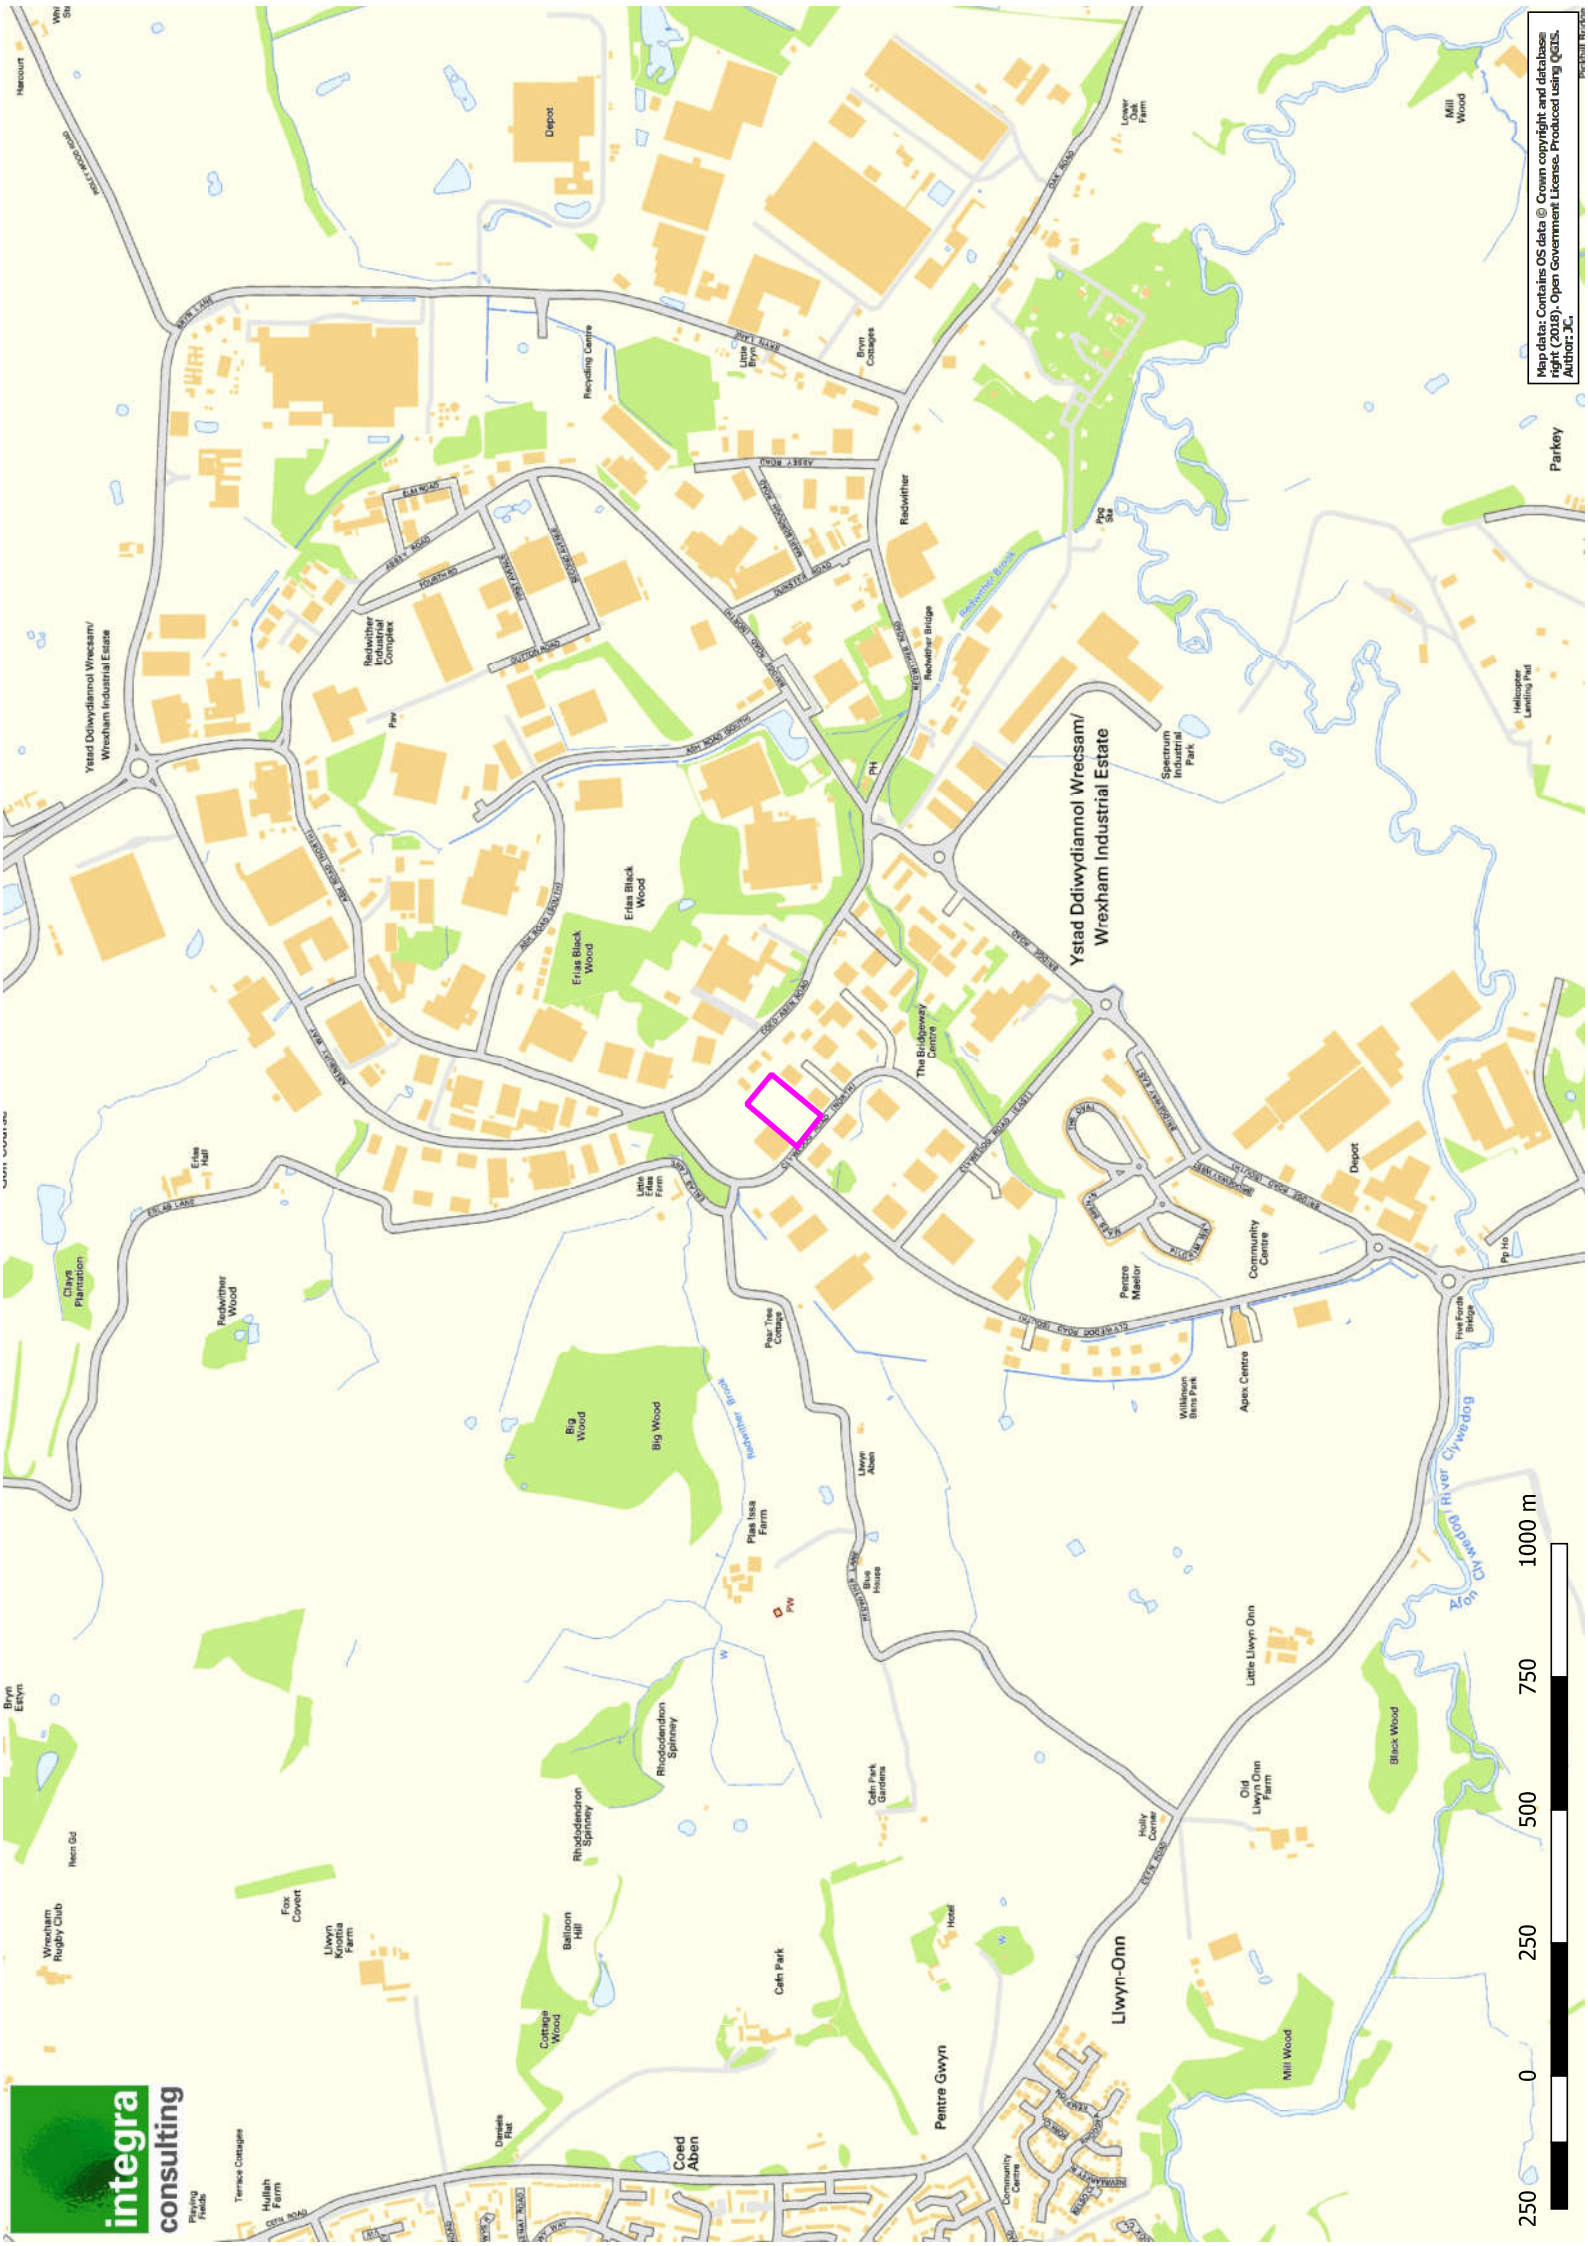

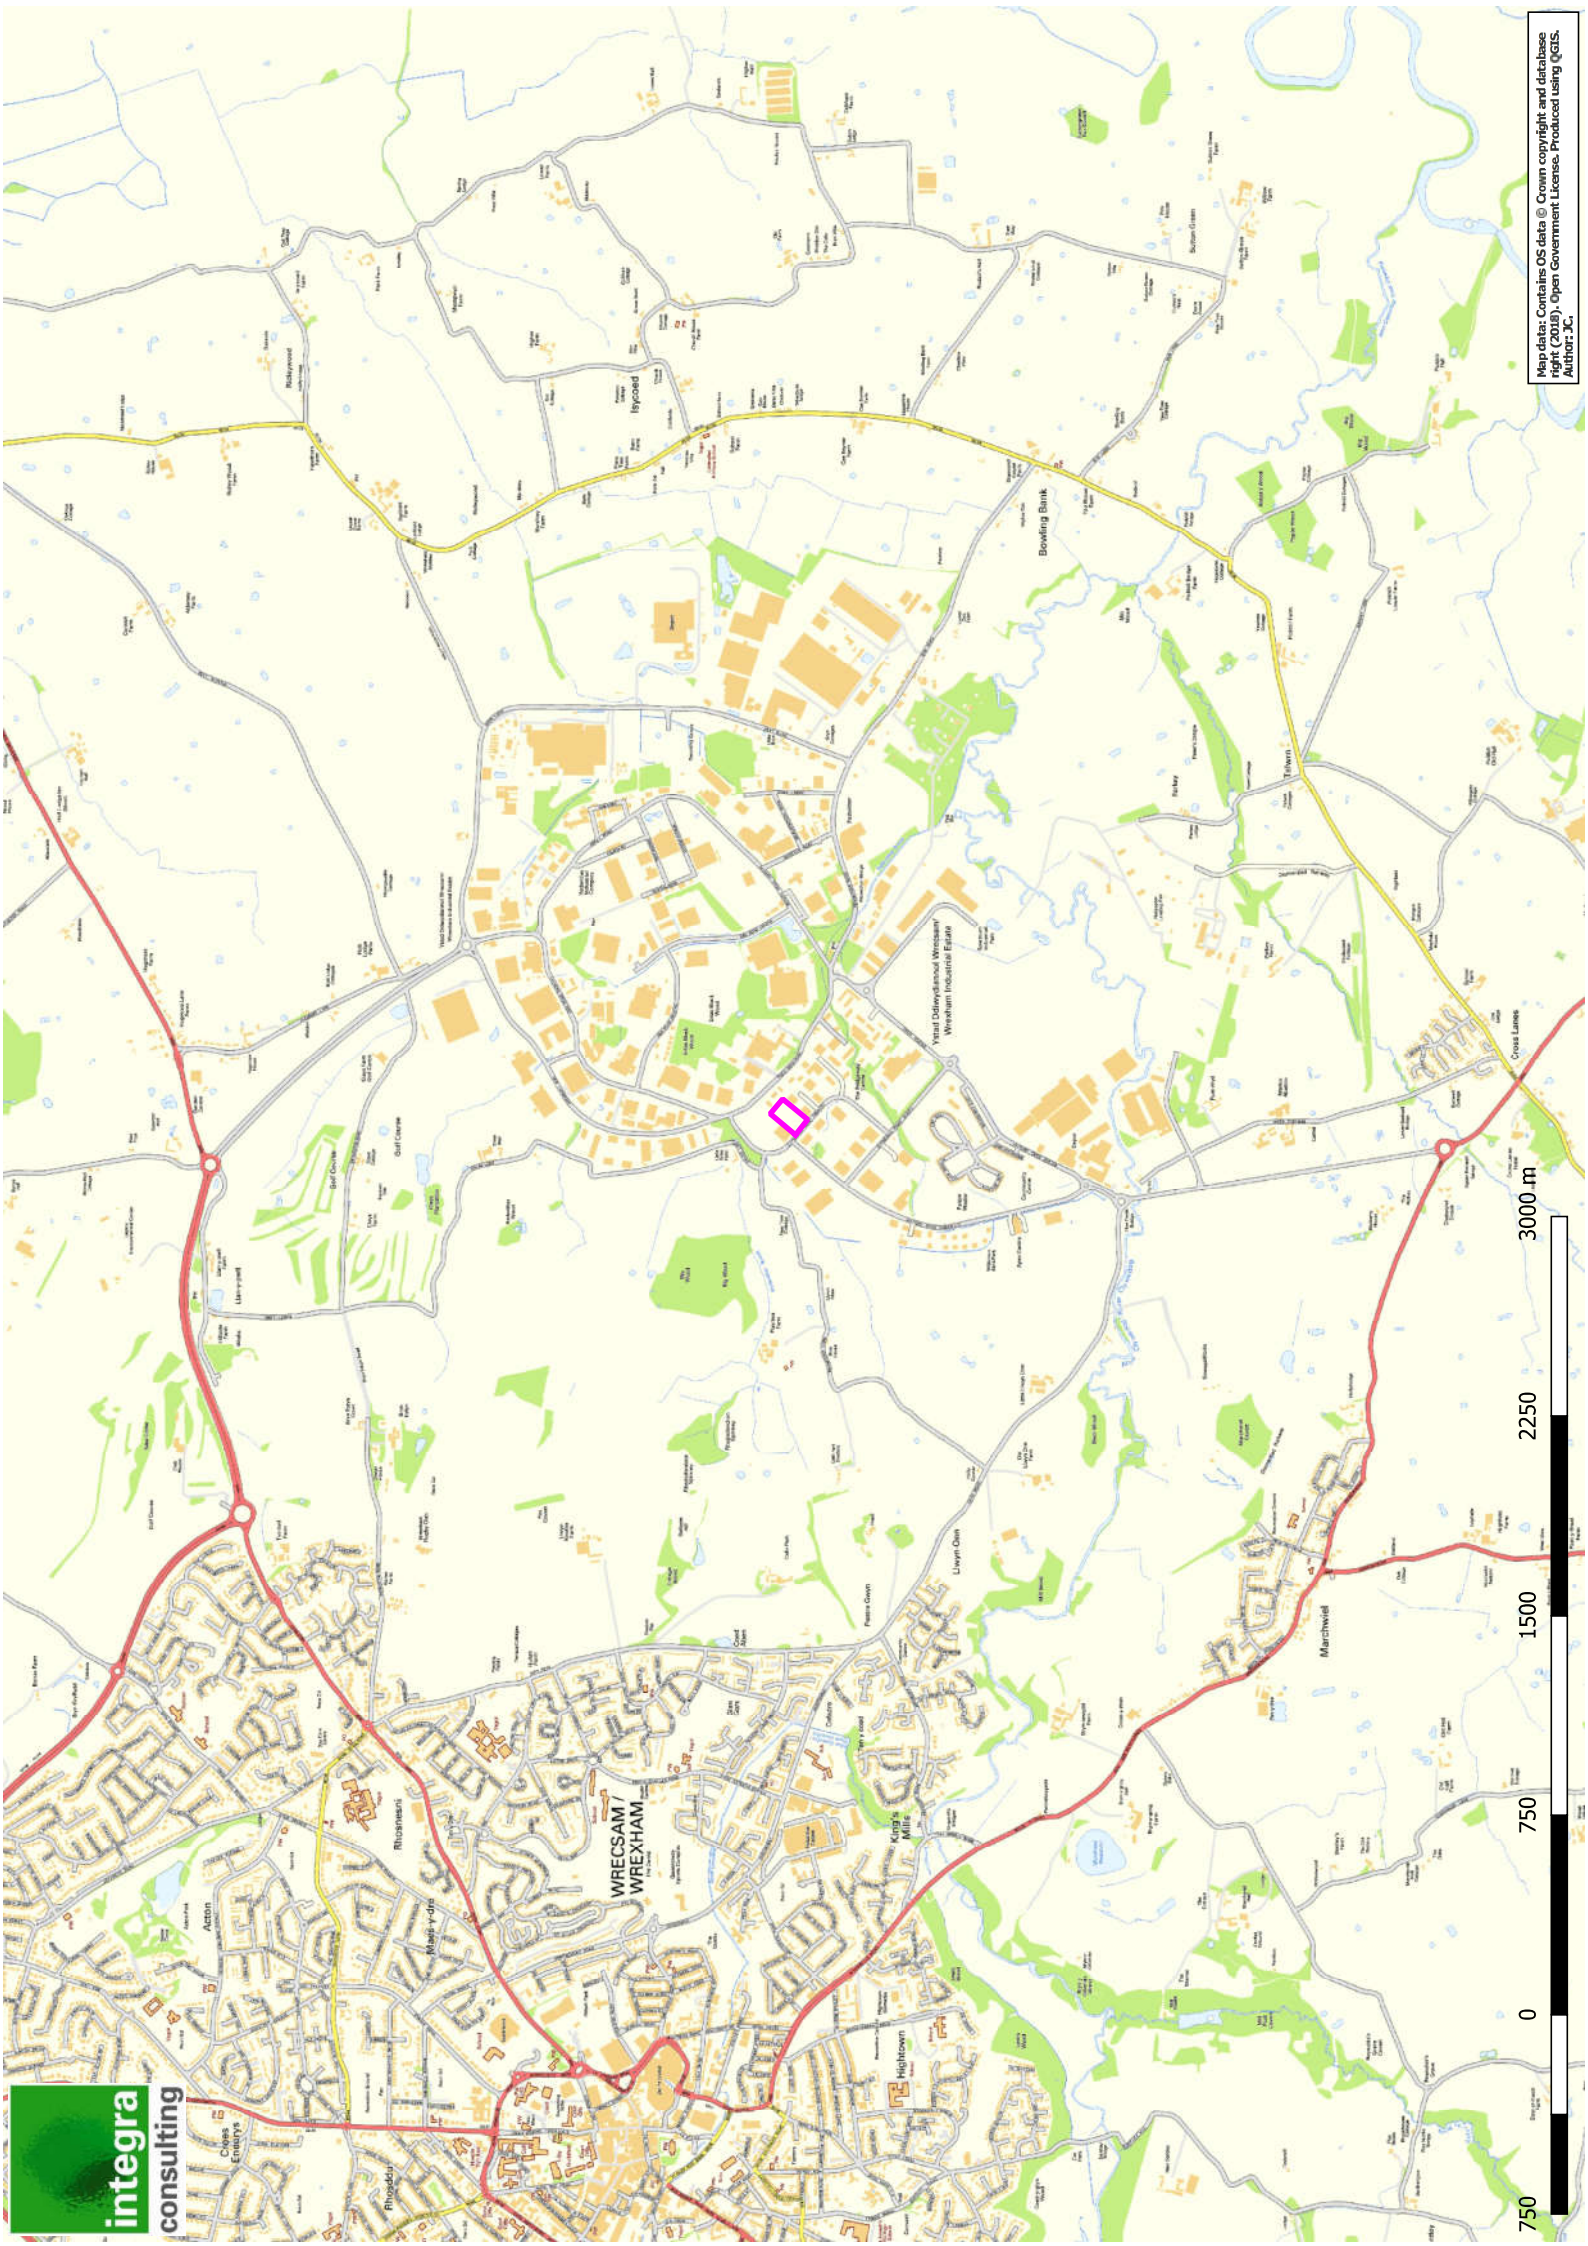

Map data: Contains OS data © Crown copyright and database right (2019) © Open Government Licences Produced using QGIS
Author: J.C.

APPENDIX 2

EXISTING TOPOGRAPHICAL SURVEY

APPENDIX 3

NATURAL RESOURCES WALES FLOOD MAPPING

Site 2, Wrexham Industrial Estate
Map Perygl Llifogydd / Flood Risk Map


Allwedd / Map Key

Flood Defences

Risk of Flooding from Rivers & Sea

High
Medium
Low
Very Low

Risk of Flooding from Reservoirs - Extent
High Surface Water Flood Risk - Extent
Medium Surface Water Flood Risk - Extent
Low Surface Water Flood Risk - Extent

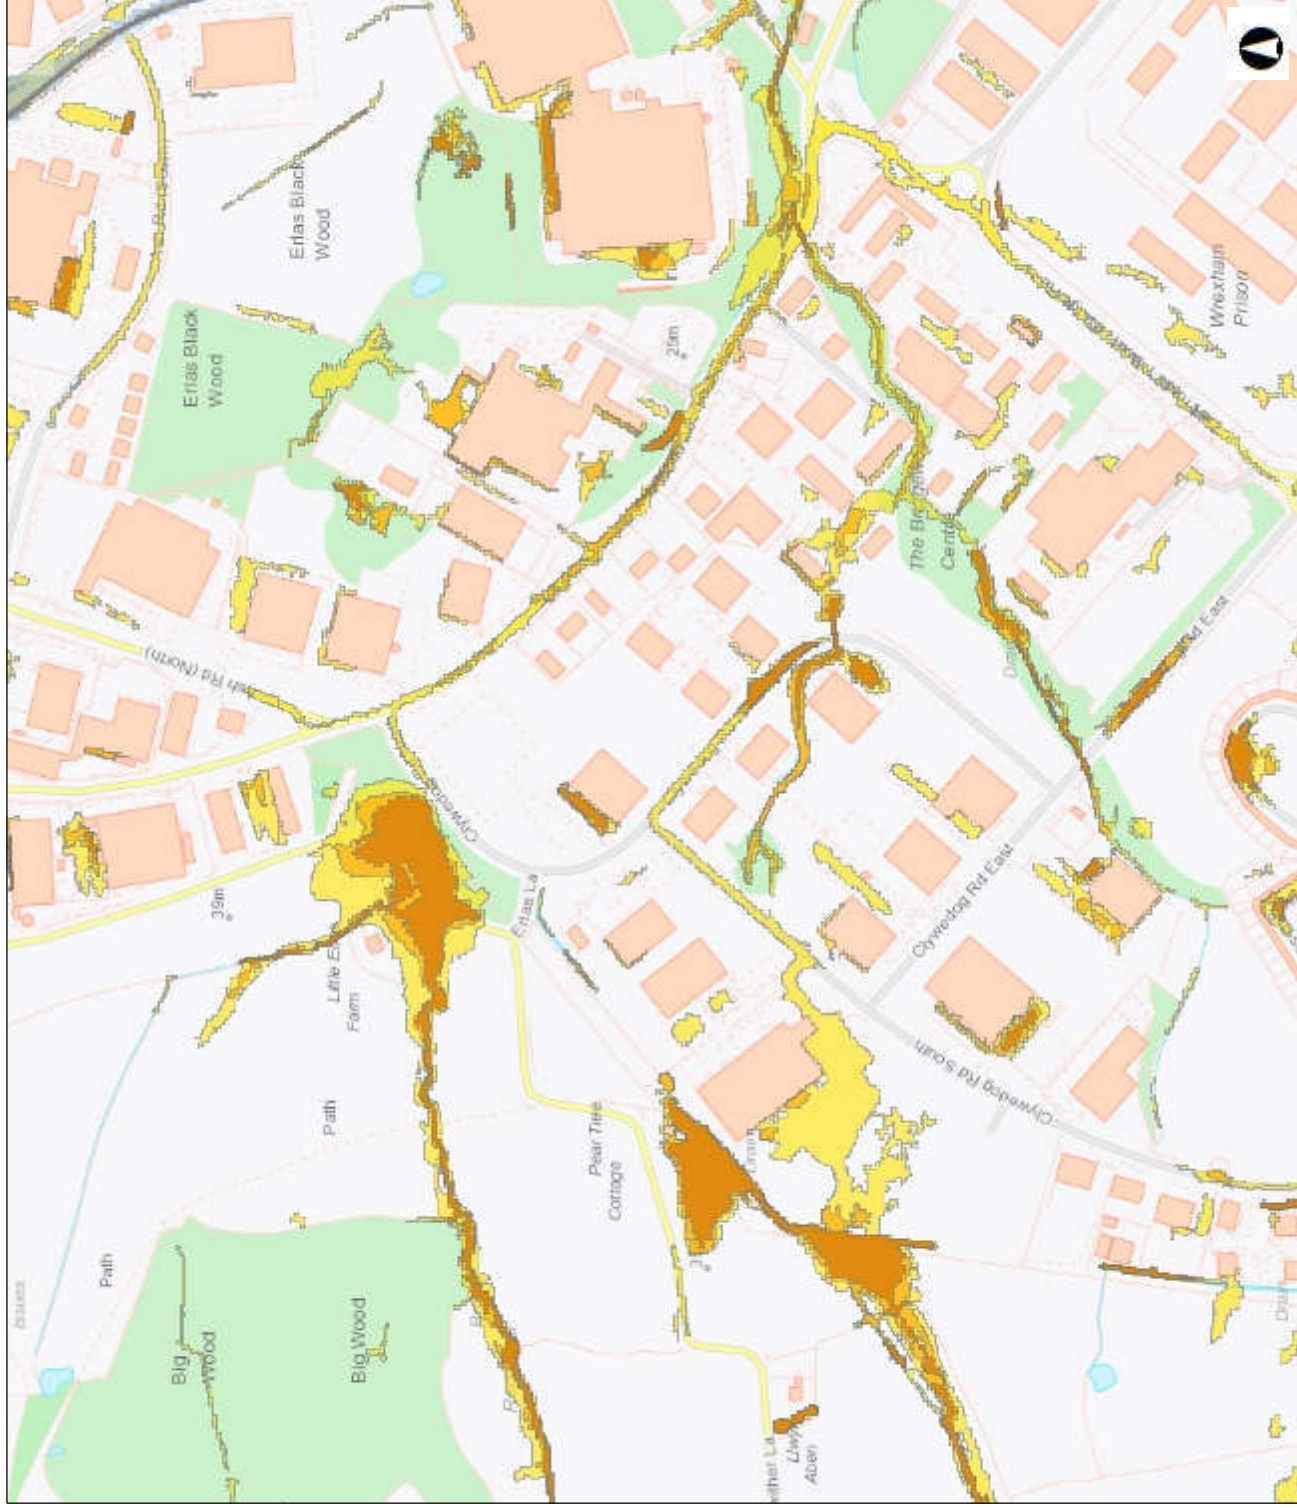

Graddfa / Scale 1: 6,720

Dyddiad / Date
06/10/2018

Ceir rhestr lawn o delerau ac amodau yn <https://naturalresources.wales/rhybuddsafonol> neu drwy gysylltu ag ymholiadau@cyfoethnaturiolcymru.gov.uk. A full list of terms and conditions is available from the <https://naturalresources.wales/StandardNotice> or by contacting enquire@naturalresources.wales.gov.uk © Crown copyright and database rights 2017 Ordnance Survey 100019741. Geological Mapping: British Geological Survey ©NERC. Centre for Ecology & Hydrology © NERC (CEH). Defra and Met Office © Crown copyright. © Cranfield University. © James Hutton Institute. Land & Property Services © Crown copyright and database right.

