

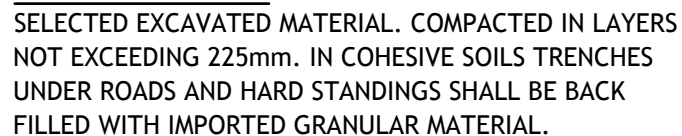


B. S. 410 TEST SIEVE	PERCENTAGE BY MASS PASSING			
	TYPE A40	TYPE A20	TYPE A14	TYPE A10
63mm	100	-	-	-
37.5mm	85-100	100	-	-
20mm	0-25	85-100	100	-
14mm	-	-	85-100	100
10mm	0-5	0-25	0-50	85-100
5mm	-	0-5	0-10	0-25
2.36mm	-	-	-	0-5

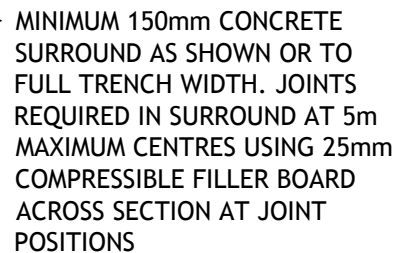


SCALE 1:20

PIPE BEDDING MATERIAL	
NOMINAL PIPE SIZE mm	BEDDING MATERIAL
LESS THAN 300	A10
300 - 525	A14


TRENCH WIDTHS	
MAXIMUM TRENCH WIDTHS	
PIPE Ø	WIDTH
100	550
150	600
225	700
300	750
375	1050



SCALE 1:20




SCALE 1:20




SCALE 1:20




SCALE 1:20

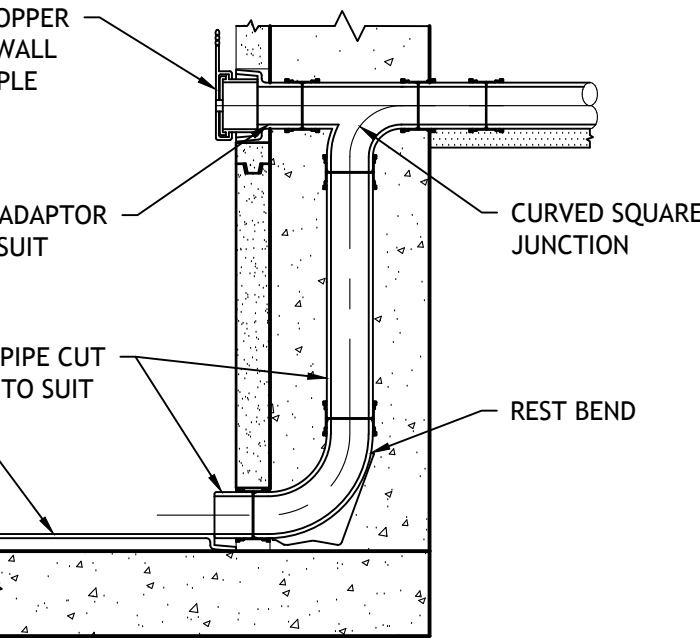


SCALE 1:20

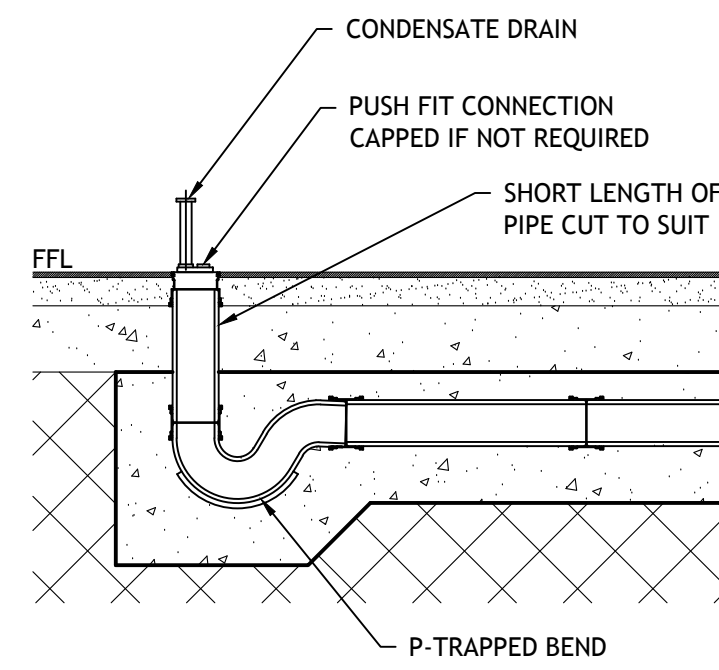


SCALE 1:20




SCALE 1:20

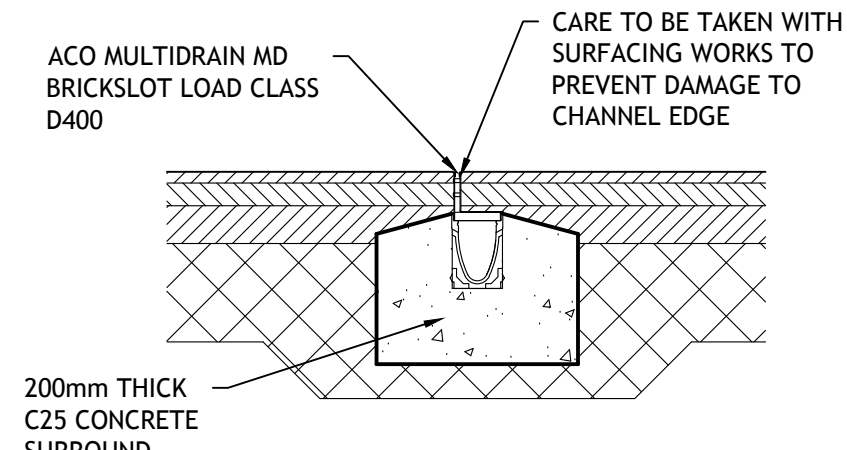


SCALE 1:20

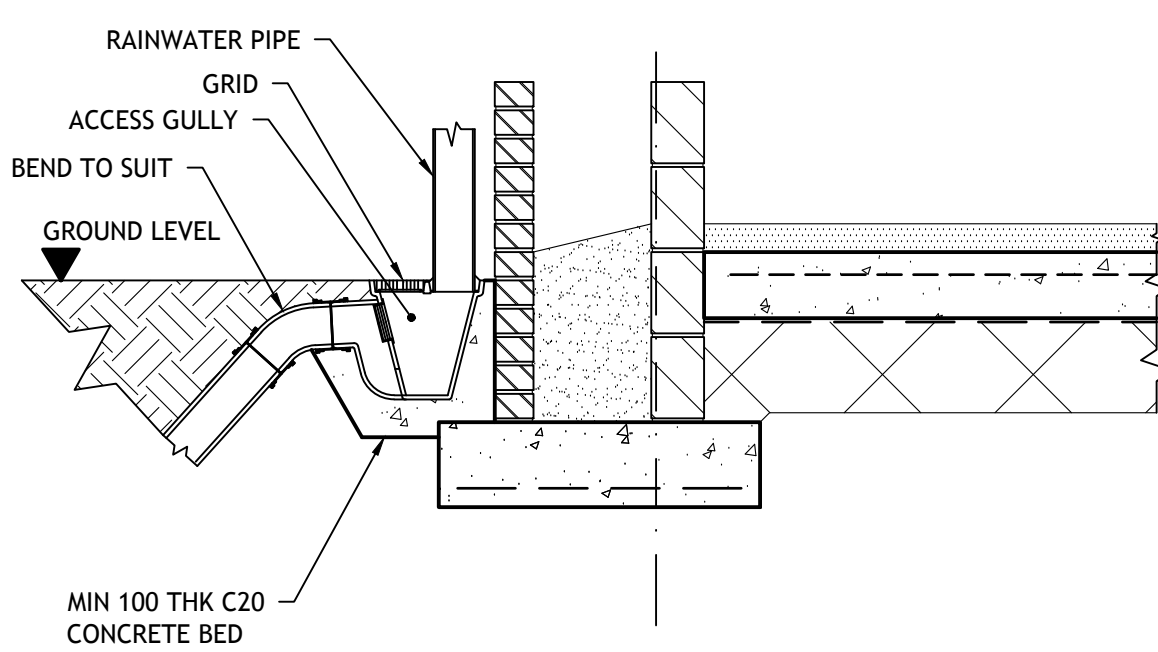

SCALE 1:20

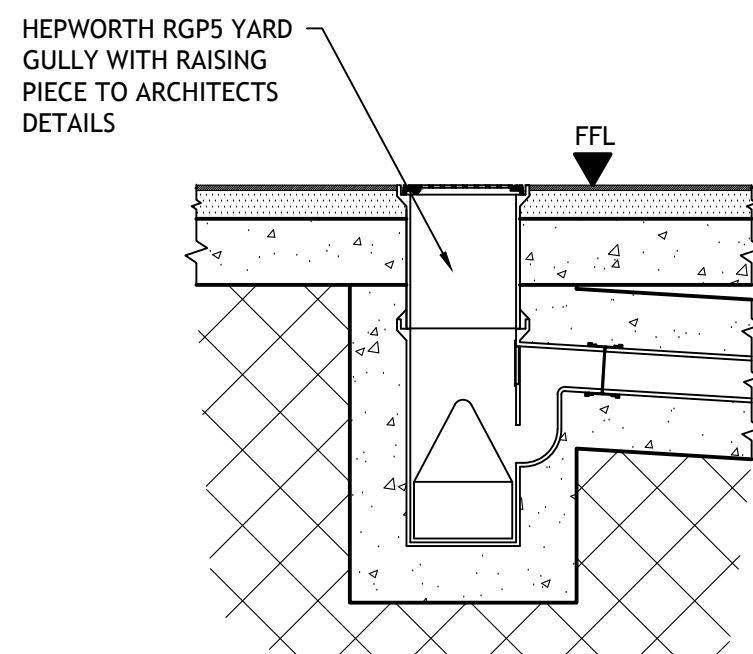

SCALE 1:20

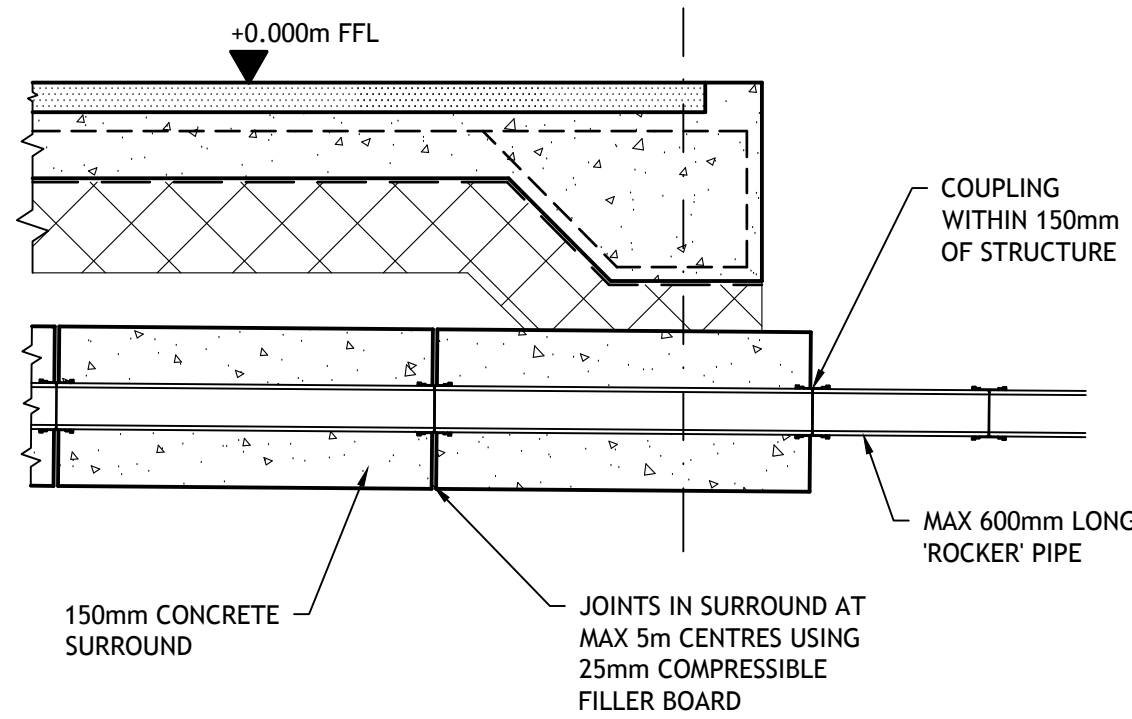

SCALE 1:20

11. POSITIONS OF MANHOLES, GULLYS AND DRAINAGE ARE TO BE SET OUT BY THE CONTRACTOR TO AVOID WHITE LINING DELINEATING CAR PARKING AREAS. KERB LINES ETC.

THE ARCHITECTURAL BACKGROUNDS ARE A VISUAL REPRESENTATION OF THE PROPOSED BUILDING LAYOUT, BUT ARE NOT NECESSARILY DIMENSIONALLY ACCURATE AND THUS MAY NOT RELATE TO THE LOCATION OF THE STRUCTURAL MEMBERS

- CL - COVER LEVEL
- IL - INVERT LEVEL
- G - GULLY
- RE - RODDING EYE
- SVP - SOIL & VENT PIPE/ STUB STACK
- C - CONDENSATE DRAIN
- FC - FUTURE CONDENSATE

P1	01/10/19	ISSUED FOR INFORMATION	PSS	PSS
Rev	Date	Description	By	Chkd

Client

Drawing Title

Suitability Status

Scale 1: 20

De

email: mail@swf.uk.com
www.swf.uk.com

