




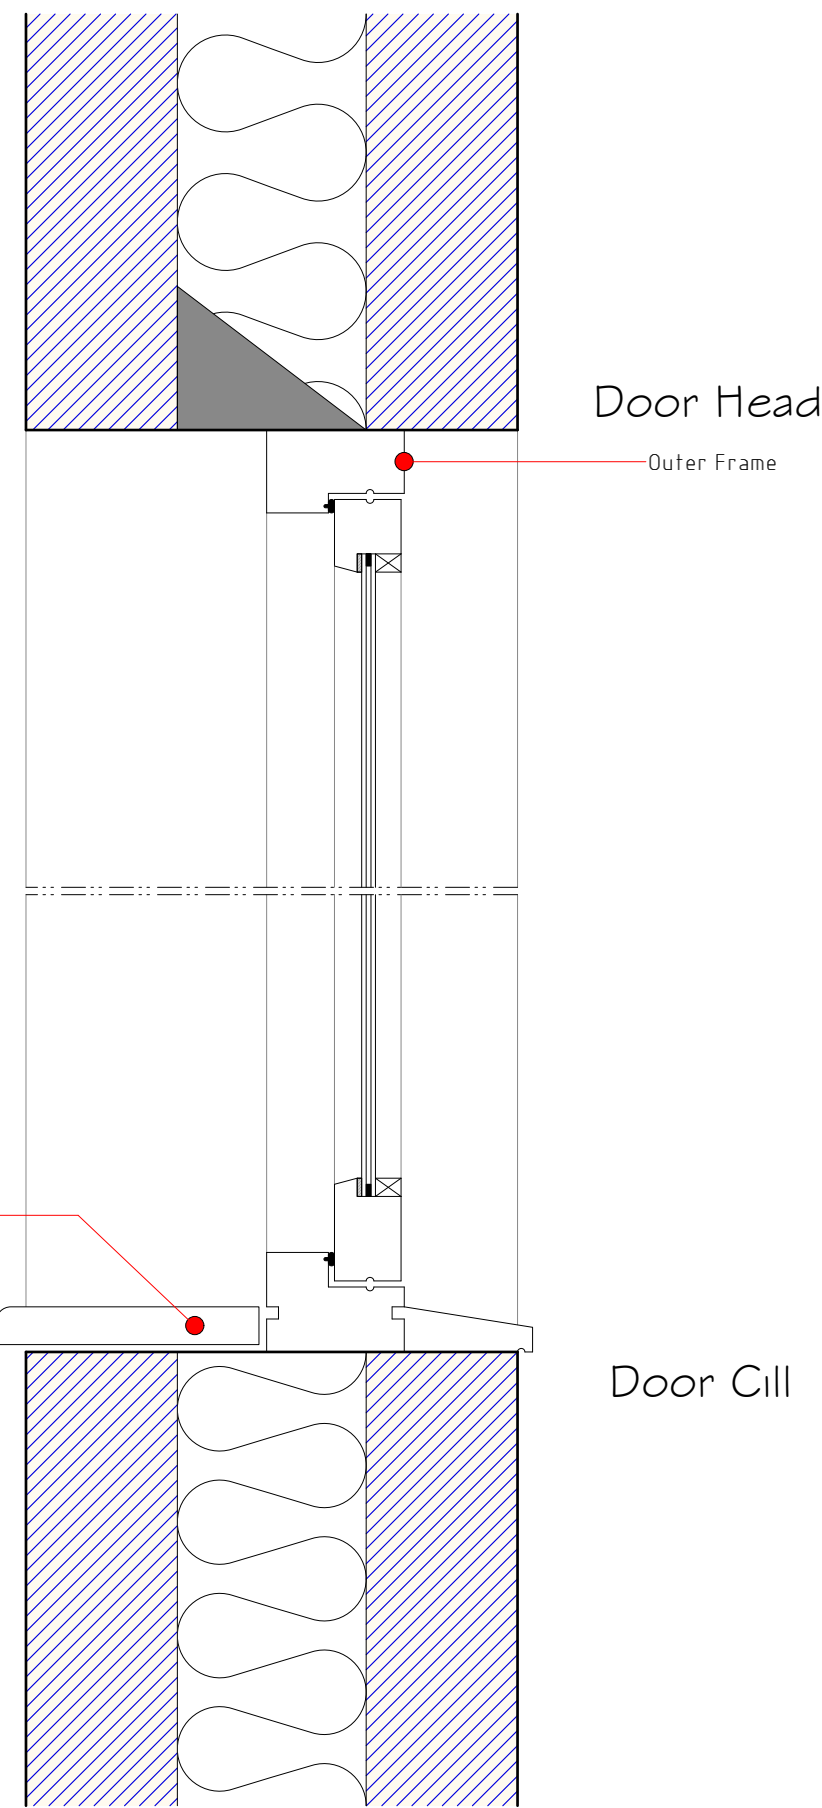


Door Section 1:5

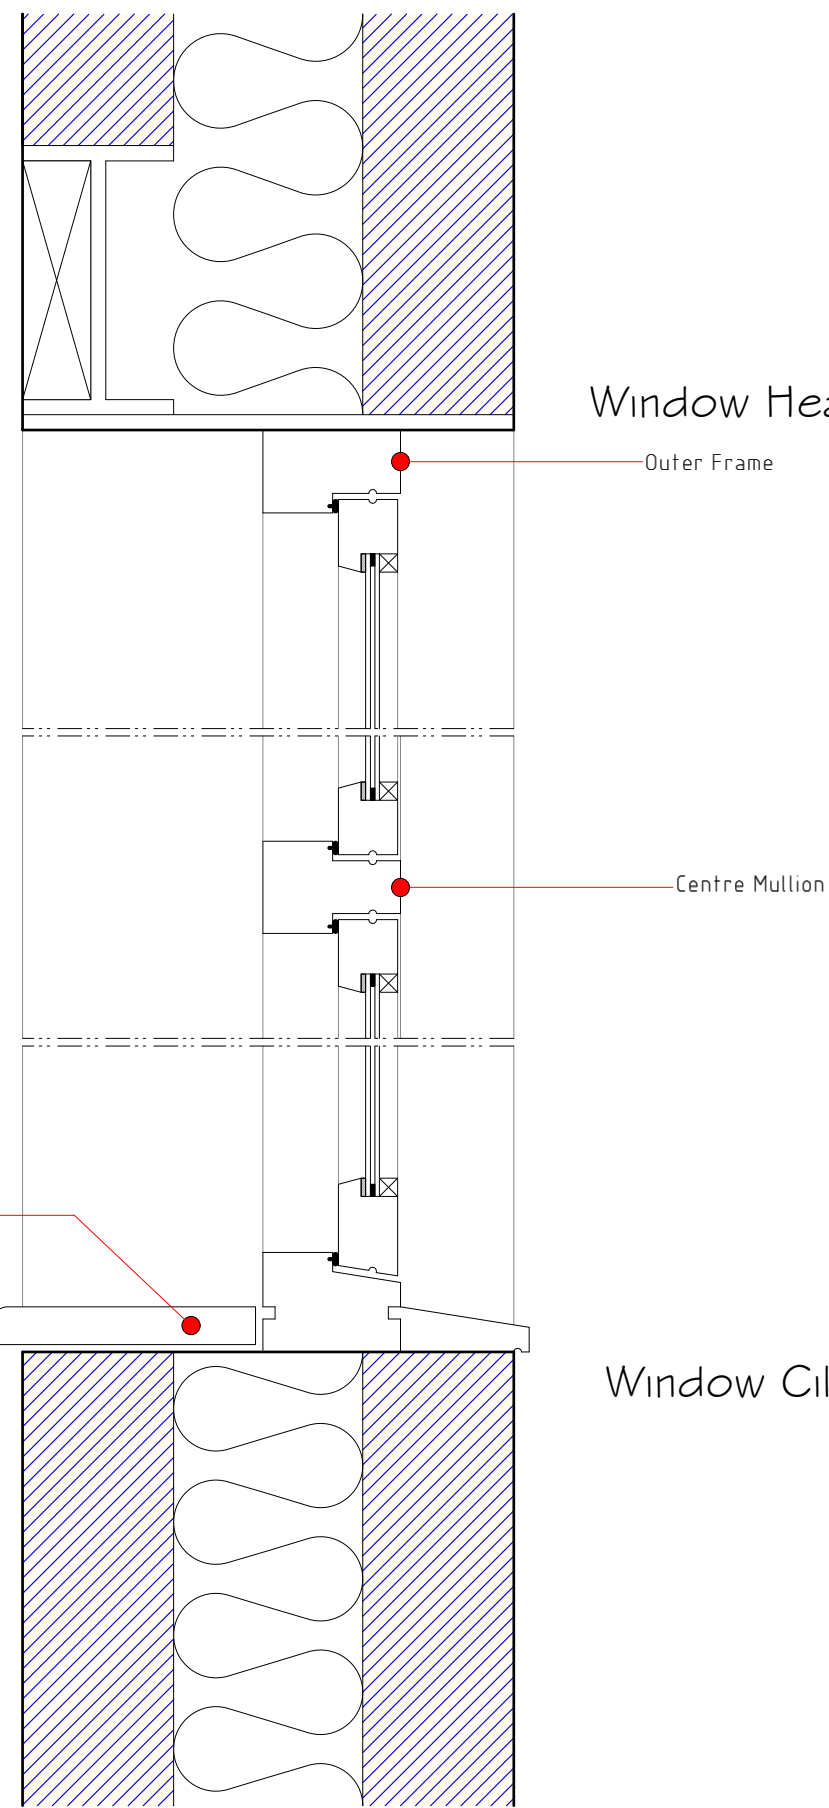


Window Section 1:5

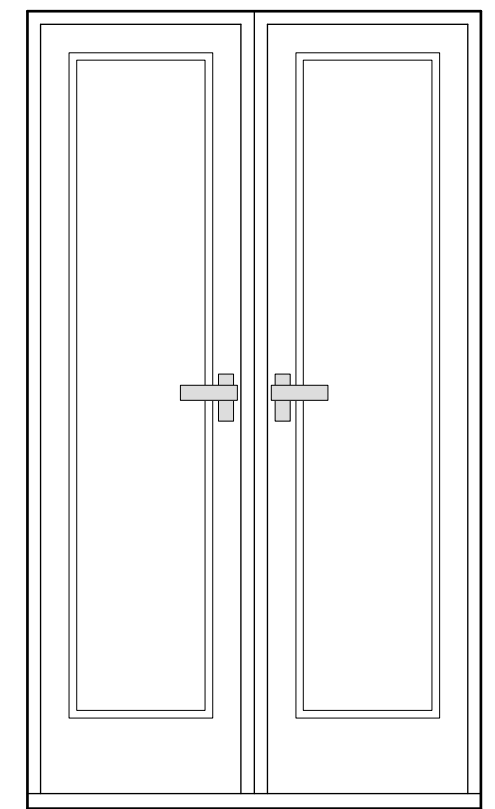


Door Elevation
1:20

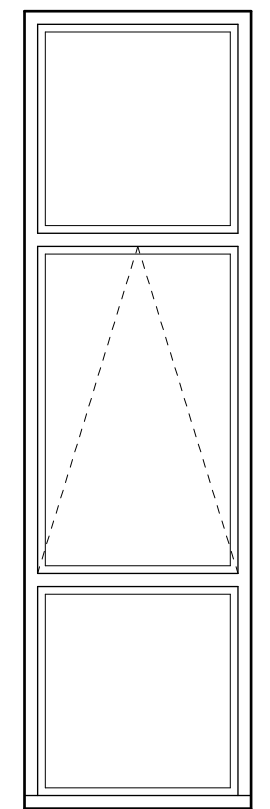

Window Elevation
Style A 1:20

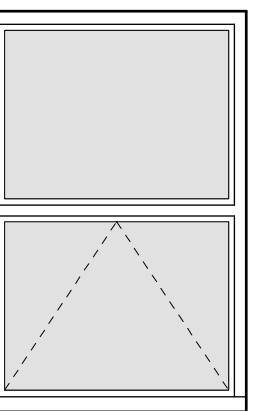

Window Elevation
Style B 1:20

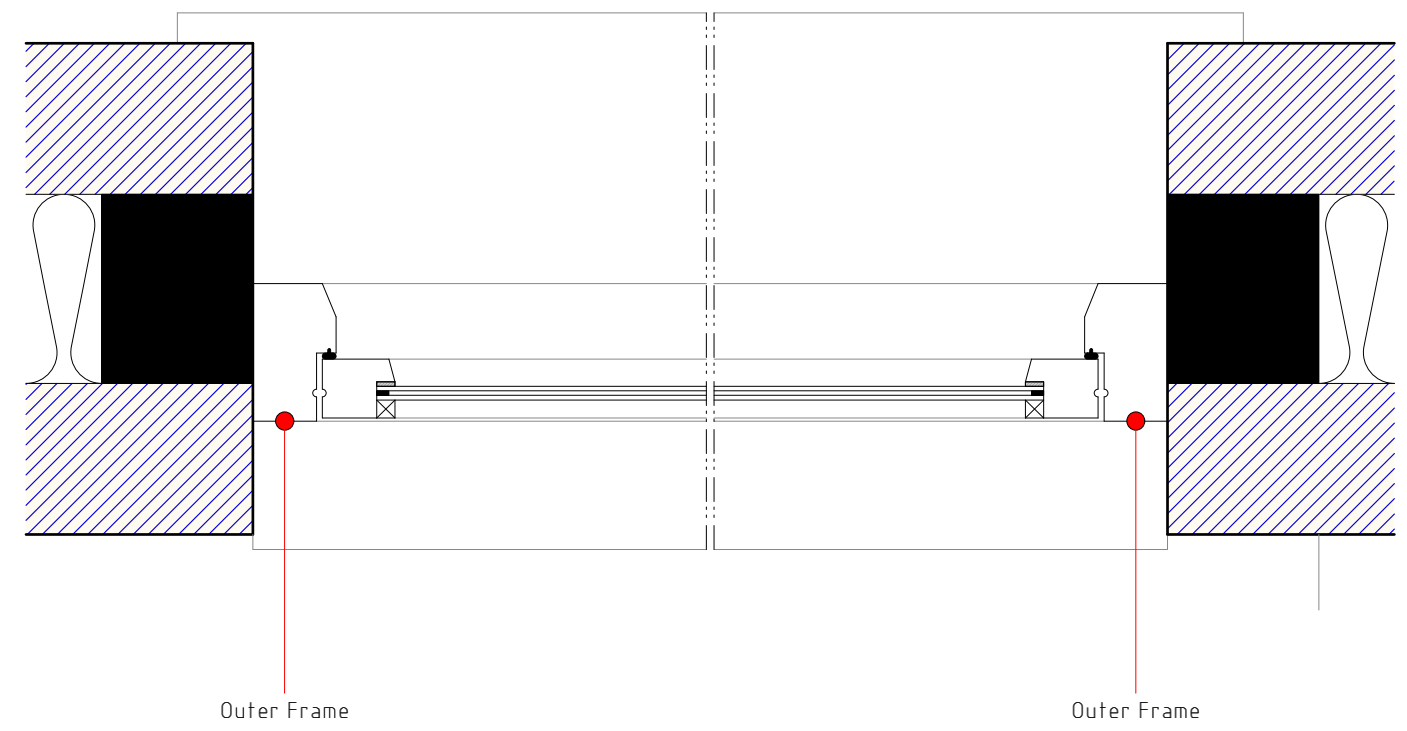

Window Plan 1:5

WINDOWS & DOORS / GLAZING

All windows and doors are to comprise sealed double glazed units set within good quality anthracite grey aluminum frames to local authority approval. Sealed double glazed units are to have 16mm minimum air gap and Low-E (soft-coated) glass to styles generally as indicated. Windows and doors are to achieve a minimum U-value of 1.6 W/m²K. Opening areas of windows are to be equal to at least 5% of enclosed floor area with part of the opening set at 1760mm above floor level. Provide background ventilation to habitable rooms by means of 8000mm² controllable trickle ventilators set in head frame member of windows. Glazing in critical locations, such as within 800mm of floor level to windows, within 1500mm of floor level to doors, and windows adjacent to doors are to consist of laminated toughened safety glass in accordance with BS 6206 and permanently marked.

Rev	Date	Detail	Initial

Project: Proposed alterations at Advance Brighter Future, Belmont Road, Wrexham, LL13 7PW	
Title: Window & Door Details	Scale: (A2) 1:5 & 1:10

Drawn By: S M Eltham	Date: Jan 2019
Drawing No: ACO49/007	Sheet: 1 of 1



Office 3K4,
Redwither Business Tower,
Wrexham. LL13 9XT
Tel: 01978 356500
www.blueprintarchitectural.com
© copyright all rights reserved