
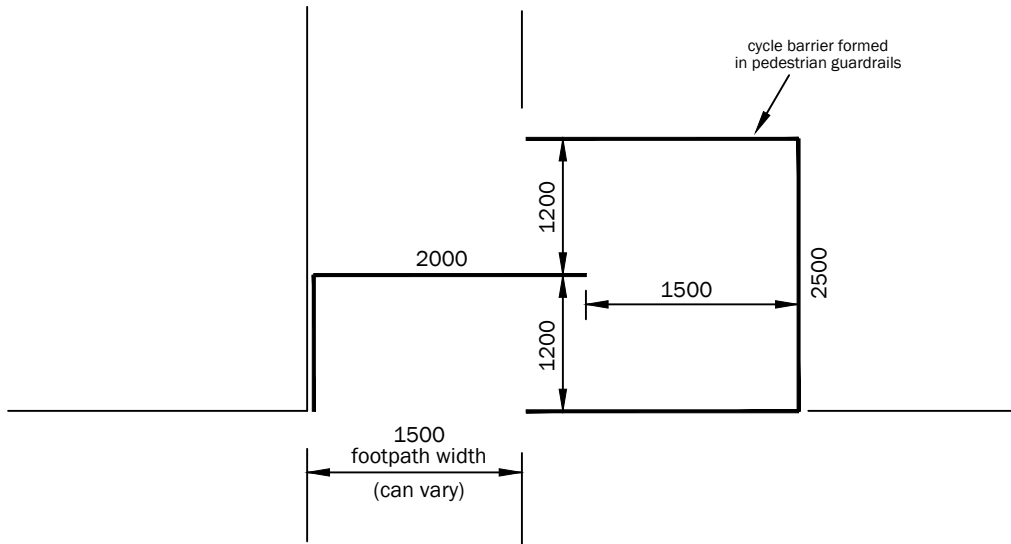


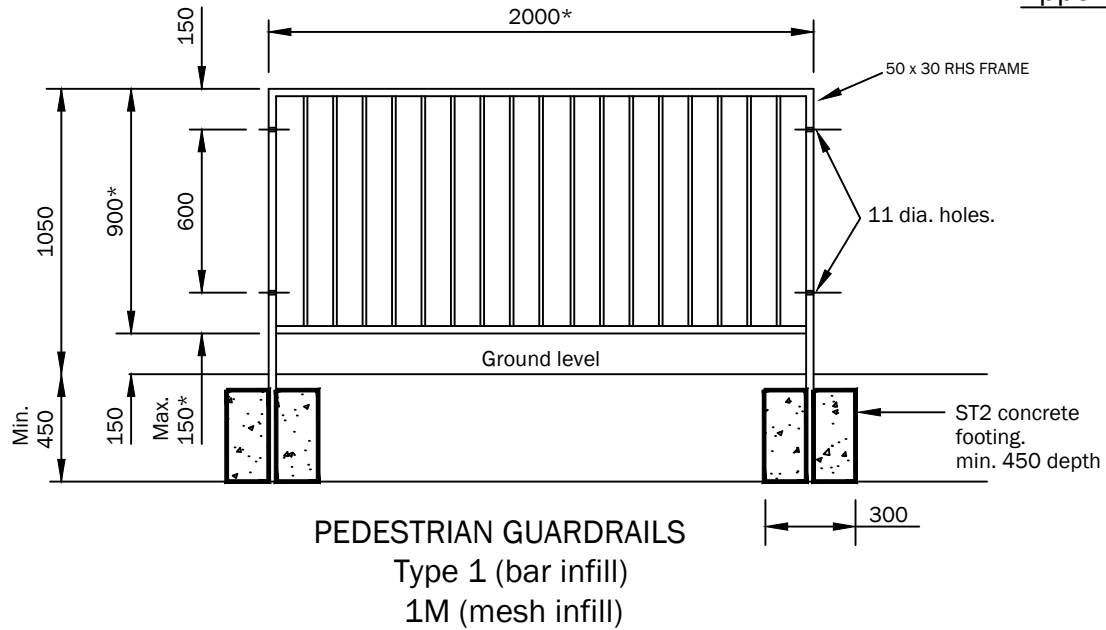

NOTES:

- 1) Pedestrian guardrails shall be to BS 7818 : 1995
- 2) Infilling shall be vertical bar or mesh.
- 3) Steel guardrails are to be galvanized to BS 729.
- 4) Aluminium guardrails are to be painted or anodized.
- 5) Manufacturers details may vary. Asterisks denote specified dimensions in BS 7818 : 1995.
- 6) High visibility infill panels can be utilised, but type, angle etc. depend on location and road conditions.
- 7) Top of concrete footing shall be 100mm below ground level. In footpath reinstatement to surface shall be with bitumen macadam material.

All dimensions in millimetres

TITLE: NON-STANDARD DETAILS				
DRAWING TITLE: PEDESTRIAN GUARDRAILS Type 1 & 2				
	SCALES:	SHEET	AMENDMENTS	DATE
	N.T.S.	1 of 1	A Original drawing	11/93
	DRAWN BY:	CHECKED BY:	B BS Amended	06/07
			C Revision	09/17
STATUS: SCHEME			DRAWING No.	400/12/01/B