

This drawing is the property of CB ARCHITECTURAL DESIGN.
Copyright is reserved by them and the drawing issued on the
condition that it is not copied, reproduced, retained or disclosed to
any unauthorised person either wholly or in part without the written
consent of CB ARCHITECTURAL DESIGN.


1. All dimensions to be verified on site prior to any shop works being commenced.
2. Any discrepancies to be reported to the Designer before any work is put in hand.
3. Do not scale from this drawing.
4. This drawing is to be read in conjunction with relevant consultants and specialists drawings.
5. This is a metric drawing.
6. Dimensions indicated thus "xxx" are site dimensions and are to be adjusted onsite by the Contractor accordingly.

26 FEB 2019
PLANNING DEPARTMENT

SANITARY/DRAINAGE NOTES:

P2019/0151

Above slab level sanitary drainage designed and installed to meet the requirements of BS5572: 1978 using upvc pipework.
Wastes to discharge into new vertical stack through boss pipes and branches, basin waste 32mm diameter fitted with 75mm bottle trap and WC connecting with 100mm multi-kwik adapters. Soil pipes to be fitted with access saddle for rodding purposes. All wastes and pipes to be adequately supported at maximum vertical centres of 2.0m and 1.0m horizontally.
Wastes from w.h.b.'s to be fitted with anti-vac traps.
Positions shown on plans are indicative only and all depths locations etc are to be determined on site and any discrepancy to be reported to the designer immediately. Any drainage running under the building, where the crown of the pipe is within 300mm of the underside of the slab, concrete encasement should be integral with the slab.
Any drainage running under the building to be encased in min. 150mm concrete surround.
All drainage to accord with BSEN 295.
Drainage running through the footings are to be protected by a re-inforced pre-cast conc. lintel over, providing 50mm space all around the pipe.
Mask opening both sides of the opening with a rigid sheet material to prevent entry of fill or vermin.
IMPORTANT: Fill any voids with compressible sealant to prevent entry of gas.
All external drainage to be proprietary pipework as detailed on drawings.
All pipe runs, inspection chambers and manholes to be bedded and surrounded in strict accordance with the manufacturer's recommendations.
Generally, 150mm dia PVC pipework to BS 4660:1989 with flexible joints laid to minimum 1:40 fall for foul and 1:80 for surface and bedded on 50mm layer of 10mm granular material, PPIC's (100's and 150's) to BS 7158:1989 up to max 930mm deep and encased in 150mm concrete to manufacturers recommendations.
Any drainage trench within 1m of the foundation shall be filled with concrete at least to the level of the underside of the foundation.
All lengths to be tested as works proceed and with the approval of the Building Control Officer.
All surface water drainage from new rwg's to connect to soakaway min. 5m from the building.
Soakaway to be in accordance with BRE Digest 365 and sized appropriately.
Contractor to allow for permeability test.
NOTE: FW drainage to run under SW system in all cases.

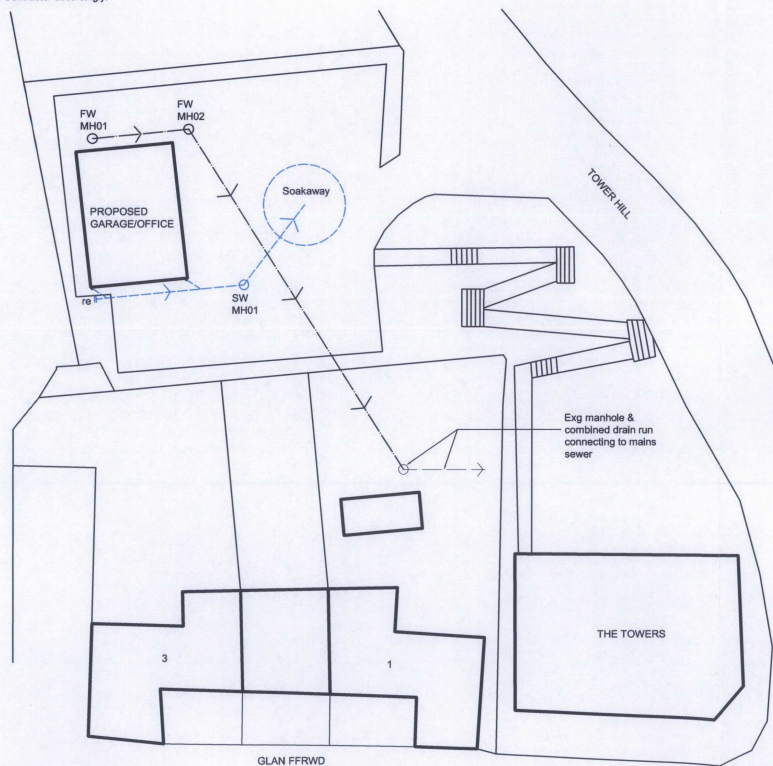

T: 07833 029535
E: info@cbarchitecturaldesign.co.uk
W: www.cbarchitecturaldesign.co.uk

Architectural Design

Rev	Date	Description	Issue	Check
Client	MRS RUTH ROBERTS		Drawn To	Drainage AS PROPOSED
Scale	1:250	Drawn	CB	Check CB
Project	The Towers Nursery, Trevor Wrexham LL14 3SG		Date	24/02/19
Drawn No.	813/L(52)01		Revision	-

ORIGINAL DRAWING SIZE 420 x 297 (A3)

0 10 20 50mm NATURAL SCALE