


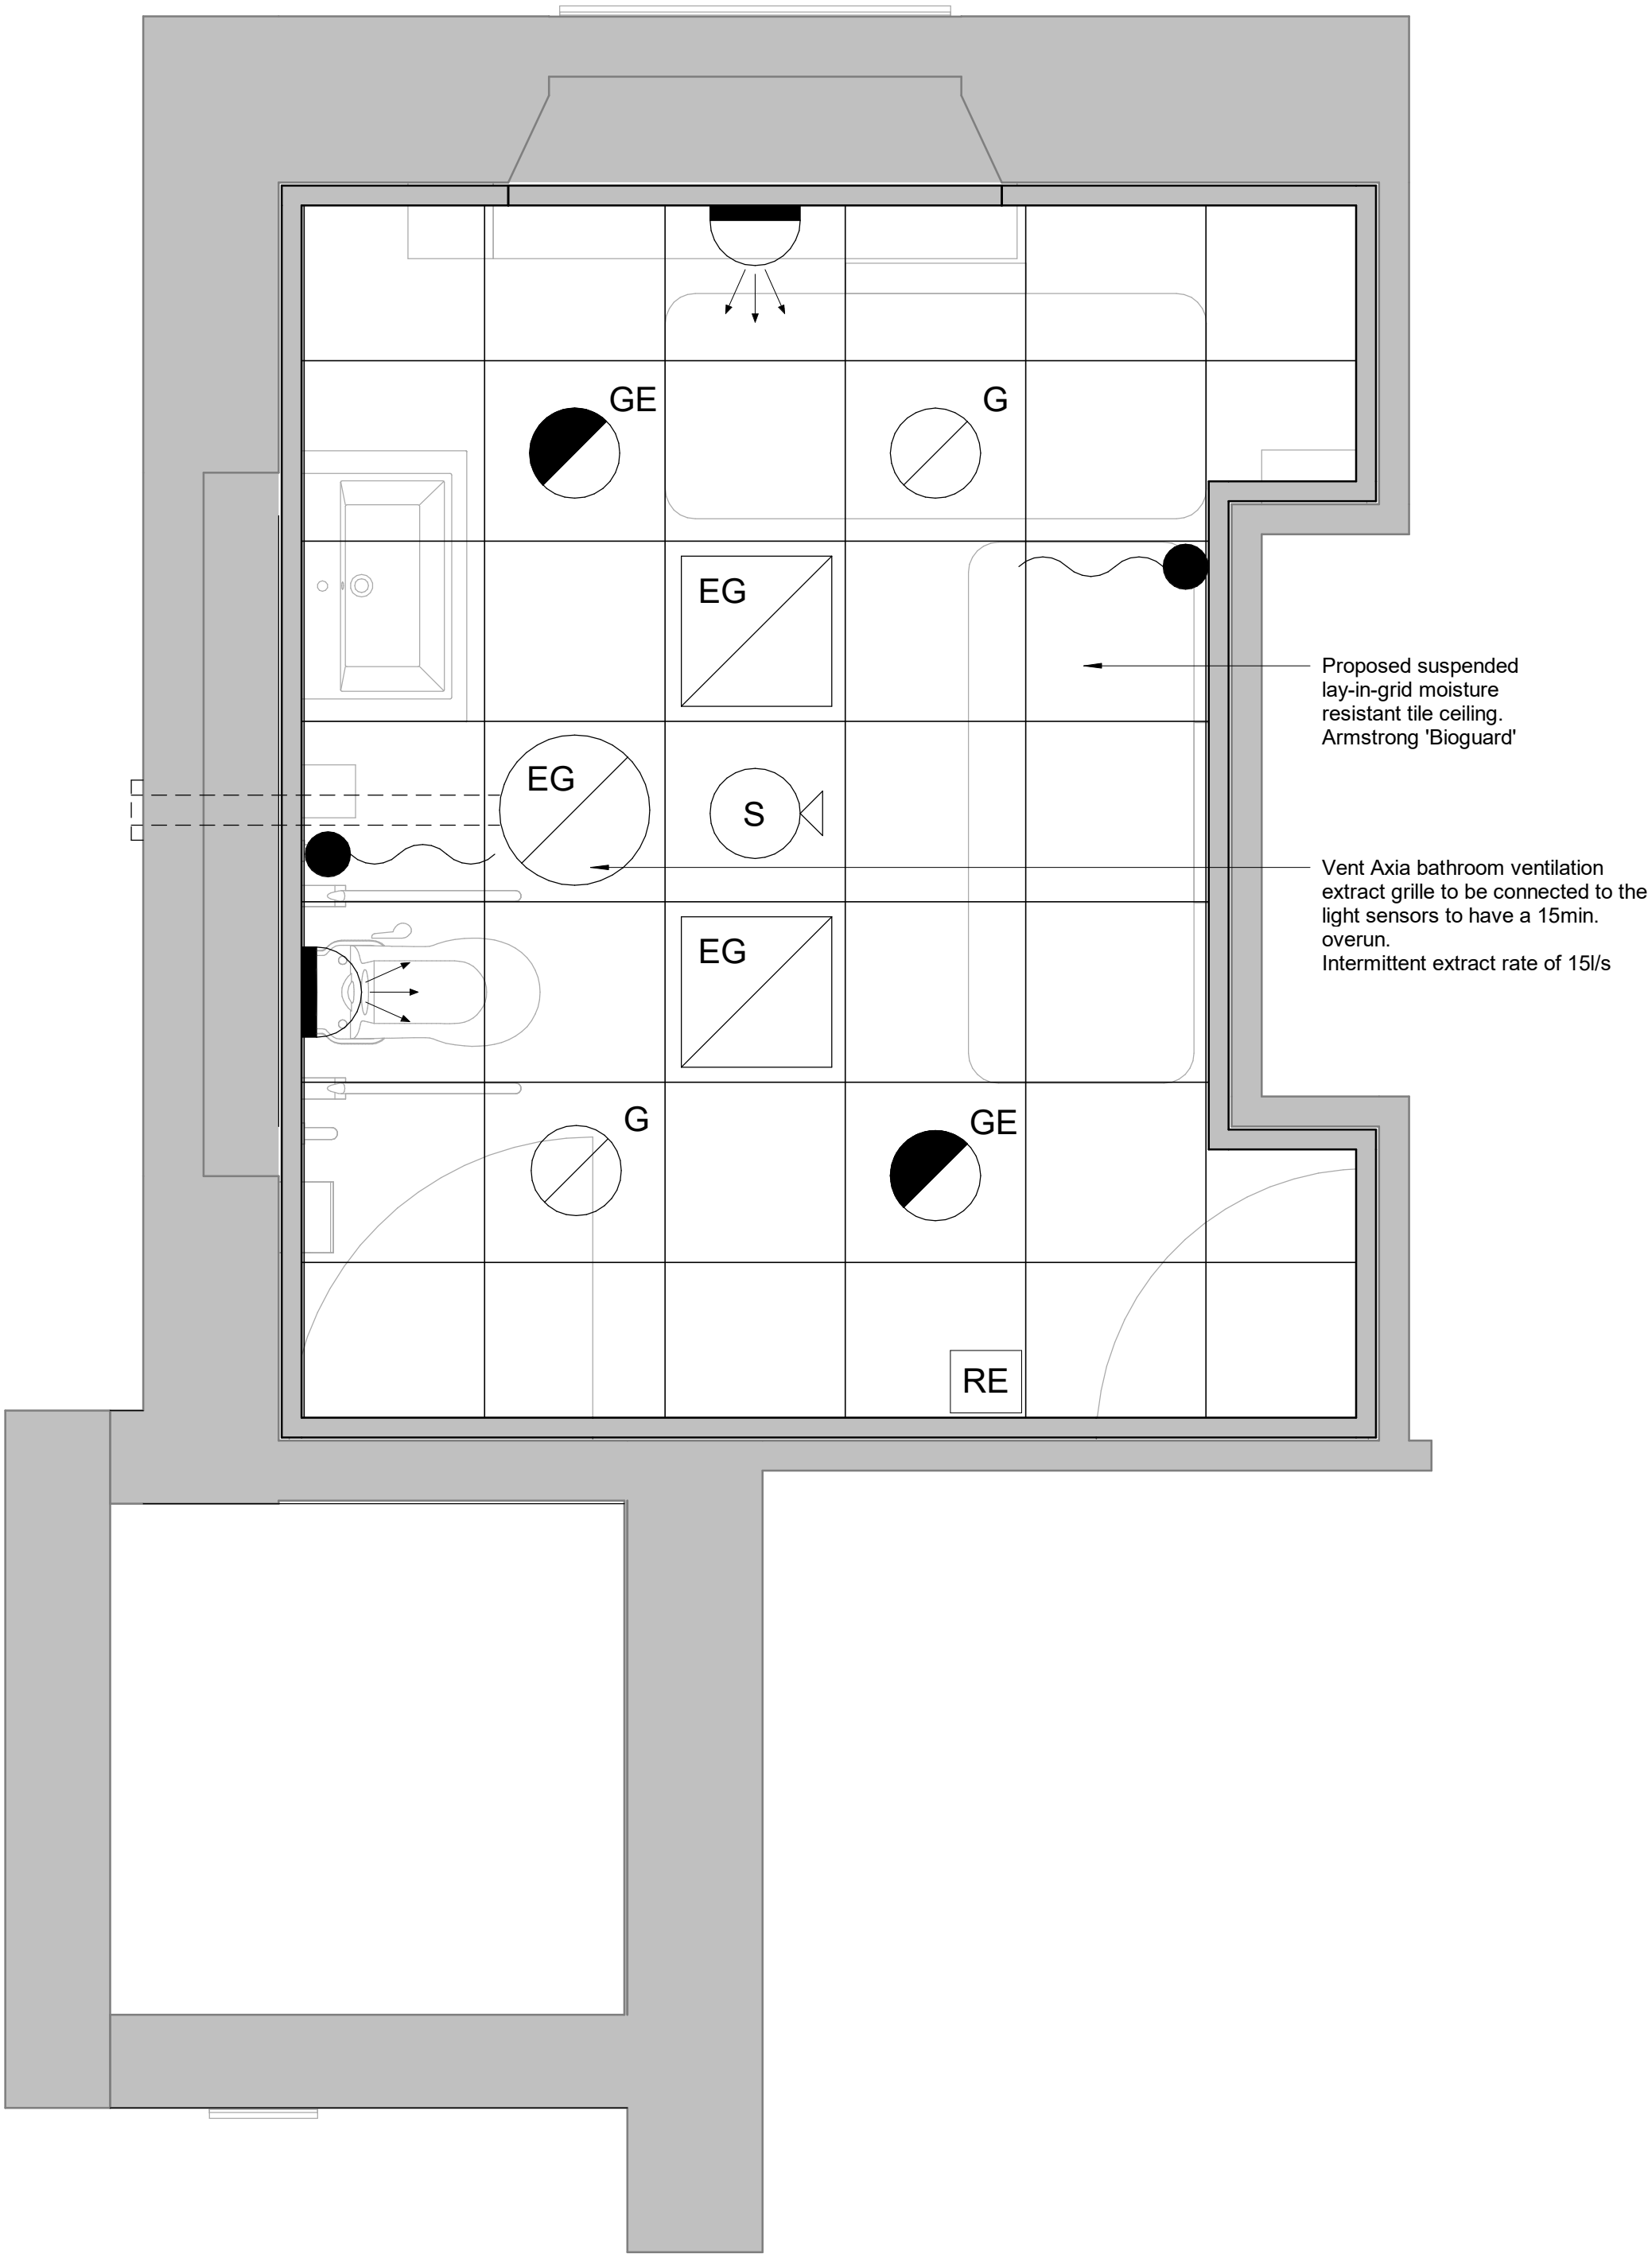

M&E CEILING KEY

- Whitecroft - Mirage LED Compact 1xLED 10W
E Denotes Emergency
- GE
- PIR
- Patient / staff call with integral light
- RE Reset push and emergency pull
- S Smoke detector with sounder base
- EG Extract Grille for general ventilation
- EG Extract Grille Vent Axia extract fan connected externally

- General Notes
1. Contractor to verify all dimensions and check level datums on site
 2. All of the designs are the sole property of TACP Architects Ltd and may not be used without their written agreement
 3. All prints, specifications and their copyright are the property of TACP Architects Ltd
 4. Do not scale off drawings
 5. All dimensions shall be checked on site before commencement of shop drawings, manufacture and all discrepancies must be reported to TACP Architects Ltd

Revisions				
Rev	Date	Description	By	Check

Consultants

Client
Dynamic Charity

Project Title
Bradbury House

Drawing Title
Proposed Ceiling Plan

Scale	Date	Drawn By	Checked By	Office
1 : 20@A2	27/01/20	CT	MG	Wrexham

Job Number	Drawing Number	Revision
13054	GA-03	

TACP Architects Ltd
Pembroke House
Ellice Way, Wrexham Technology Park,
Wrexham, LL13 7YT
01978 291161

admin@tacparchitects.co.uk
www.tacparchitects.co.uk

Architecture • Interior Design • Healthcare Planning • Conservation • Masterplanning • Sustainable Design