

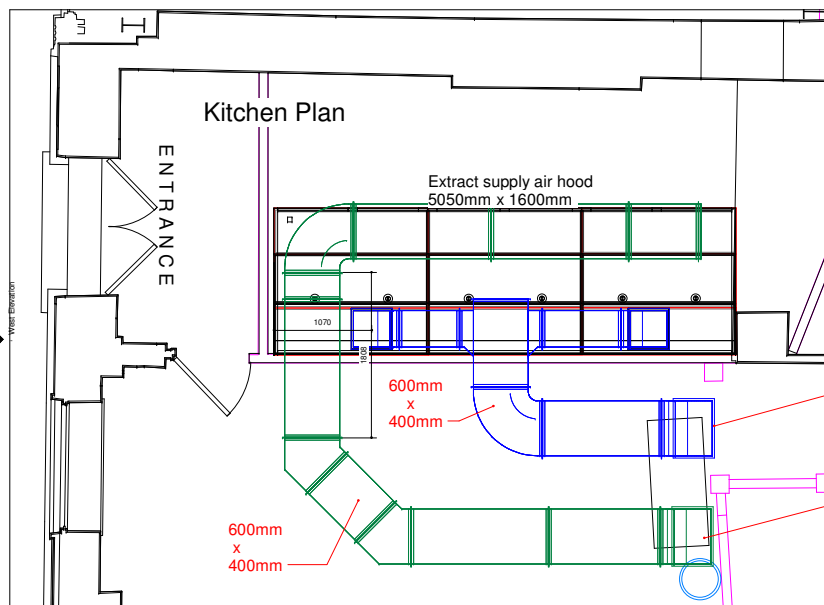


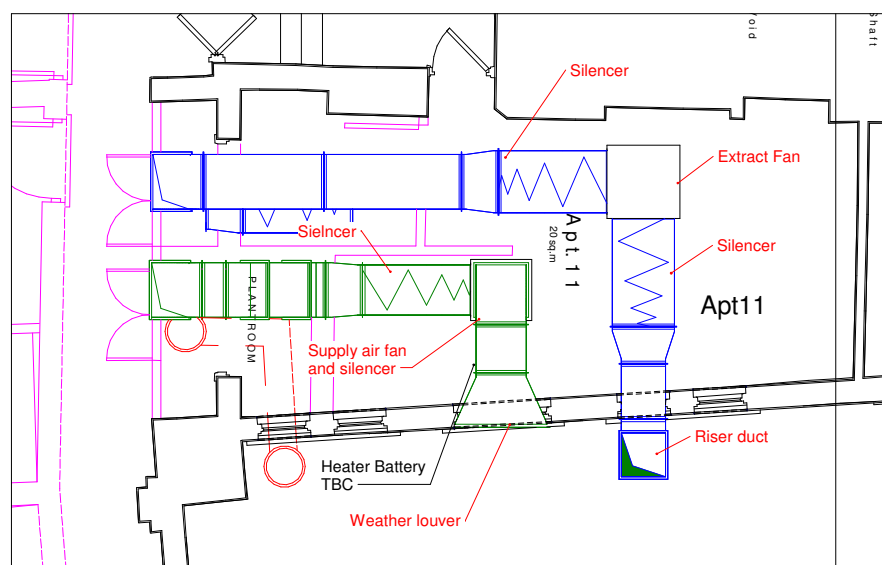

Proposed drawing
only for comment

EXTRACT DUCT
(NOT FIRE RATED)
WILL REQUIRE ENCLOSING IN
FIRE RATED COMPARTMENT OR
FIRE RATED DUCT WILL BE REQUIRED

SUPPLY AIR DUCT

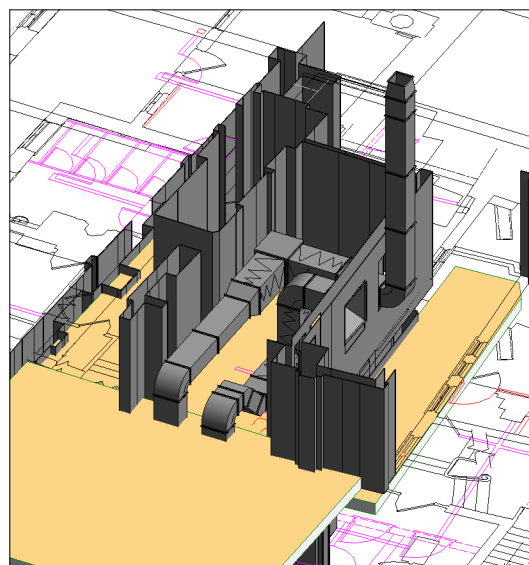

Rev	Description	Date

PROJECT		
Friskey pudding		
TITLE		
Proposed kitchen Vent		
CLIENT		
Vision		
DRAWN BY MP	CHECKED BY Checker	DATE 09/18/19
SCALE (@ A1) 1:25	PROJECT NUMBER 4197	
DRAWING NUMBER 001	REV	