

Holt Road, Rossett

Flood Consequences Assessment & Drainage Strategy

September 2019

Project Information	
Project:	Holt Road, Rossett
Report Title:	Flood Consequences Assessment & Drainage Strategy
Client:	Bellis Brothers Ltd
Instruction:	The instruction to carry out this Flood Consequences Assessment and Drainage Strategy was received from Roger Bellis of Bellis Brothers Ltd.
File Ref:	12307-FCA&Drainage_Strategy-01

Approval Record	
Author:	Harri Williams BSc (Hons)
Checker:	Aled Williams BSc (Hons) MCIWEM
Approver:	Victoria Griffin BSc (Hons) MSc CEnv MEnvSc

Document History		
Revision	Date	Comment
01	05/09/19	First issue

Contents

Introduction.....	1
Existing Conditions	1
Development Proposals	3
Flood Zone Category and Policy Context.....	3
Consultation	4
Sources of Flooding and Probability.....	5
Surface Water Management	8
Maintenance.....	14
Foul Drainage.....	14
Conclusions.....	15
Recommendations.....	16

Appendices

Appendix A	Location Plan & Aerial Image
Appendix B	Topographical Data
Appendix C	Development Plans
Appendix D	Natural Resources Wales Flood Maps
Appendix E	Consultation
Appendix F	PFRA Maps
Appendix G	Location of Waterlogged Area
Appendix H	Infiltration Location Maps
Appendix I	MicroDrainage Storage Estimates
Appendix J	Concept Drainage Sketch
Appendix K	Maintenance Schedules
Appendix L	Drainage Survey

Tables

Table 1 – Infiltration Rates10

Table 2 – Average Private Soakaway Sizing.....11

Table 3 – Pollution Hazard Indices13

Table 4 – SuDS Mitigation Indices13

Introduction

Waterco Consultants have been instructed to prepare a Flood Consequences Assessment (FCA) and Drainage Strategy in respect of a proposed residential development on land off Holt Road (B5102), Rossett, Wrexham, LL12 0ED.

The purpose of this report is to outline the potential flood risk to the site, the impact of the proposed development on flood risk elsewhere, and the proposed measures which could be incorporated to mitigate the identified flood risk. The report has been prepared in accordance with the guidance contained in Planning Policy Wales (PPW) and Technical Advice Note 15 (TAN15): Development and Flood Risk.

From April 2015, Wrexham County Council as a Lead Local Flood Authority (LLFA) is a statutory consultee for major planning applications in relation to surface water drainage, requiring that all planning applications are accompanied by a Sustainable Drainage Strategy. The aim of the Sustainable Drainage Strategy is to identify water management measures, including Sustainable Drainage Systems (SuDS), to provide surface water runoff reduction and treatment. Wrexham County Council are also the Sustainable Drainage Approval Body (SAB) who review and approve drainage schemes on developments over 100m².

This report has been prepared in consultation with Natural Resources Wales (NRW) and Dwr Cymru Welsh Water (DCWW).

The copyright in this document (including its electronic form) shall remain vested in Waterco Limited (Waterco) but the Client shall have a licence to copy and use the document for the purpose for which it was provided. Waterco shall not be liable for the use by any person of the document for any purpose other than that for which the same was provided by Waterco. This document shall not be reproduced in whole or in part or relied upon by third parties for any use whatsoever without the express written authority of Waterco.

Existing Conditions

The development is divided into 2 land parcels. Parcel 1 (grid reference: 337350, 357371) is located to the north of Holt Road and covers an area of 2.798ha. Parcel 2 (grid reference 337283, 357183) is located to the south of Holt Road and covers an area of 3.454ha. A location plan and an aerial image are included in Appendix A.

Land parcel 1 comprises agricultural land and is bordered by residential properties and agricultural land to the north, agricultural land to the east, Holt Road to the south and residential properties to the west.

Land parcel 2 comprises agricultural land and is bordered by Holt Road to the north, agricultural land and a single residential property to the east, Harwood's Lane (road) to the south and residential properties and Trevalyn Way (road) to the west.

Local Topography

A topographical survey has been undertaken by MB Surveying Limited in January 2015 and is included in Appendix B. The topographical survey is relative to an arbitrary site datum. The topographical survey shows that land in the northern parcel slopes from approximately 51.25m Above Datum (AD) in the south-west to approximately 48.75m AD in the north. Site levels fall from south to north. There is a topographical depression identified in the northern extent of the site with a minimum level of 48.93m AD.

Site levels in the southern land parcel slope from approximately 52.13m AD in the south-west to approximately 50.16m AD in the east.

Topographic levels to metres Above Ordnance Datum (m AOD) have been derived from a 1m resolution Environment Agency (NRW) composite 'Light Detecting and Ranging' (LiDAR) Digital Terrain Model (DTM). A review of LiDAR data shows that land in the northern parcel slopes from 13.58m AOD in the south-west to 11.55m AOD in the north. Land in the southern parcel falls from 14.2m AOD in the south-west to 12.58m AOD in the east. A LiDAR extract is included in Appendix B.

Ground Conditions

Reference to the British Geological Survey online mapping (1:50,000 scale) indicates that the majority of the site is underlain by superficial River Terrace Deposits (undifferentiated) generally comprising sand and gravel. The north-western extent of land parcel 1 is underlain by Alluvium generally comprising clay, silt, sand and gravel. The superficial deposits are identified as being underlain by The Alop Formation consisting of mudstone, sandstone and conglomerate.

According to the EA's 'Groundwater Vulnerability Mapping' accessed via Magic's online mapping application, the superficial River Terrace Deposits and Alluvium Deposits are classified as a Secondary A aquifer. These are permeable layers capable of supporting water supplies at a local rather than strategic scale and in some cases form an important source of base flow to rivers. The underlying bedrock is also classified as a Secondary A aquifer.

The Cranfield University 'Soilscapes' map indicates that the site is underlain by 'freely draining loamy soils'.

Infiltration tests have been conducted by Waterco Consultants in October 2015 (report reference w1938-151014-Infiltration Report). The infiltration testing concluded that the majority of the site is well drained and suitable for infiltration drainage techniques. An isolated area in the eastern extent of the southern land parcel was shown to be underlain by clay. The infiltration tests were unsuccessful in this area.

A Geophysical Survey Report has been undertaken by TigerGeo in March 2016 (reference: RWB161). The Geophysical Survey identified an area of waterlogged ground in the northern extent of the northern land parcel. The area of waterlogged ground corresponds to an isolated area of Alluvium deposits (clay) and a topographical low point.

Local Drainage

DCWW sewer records shows that there are no public sewers crossing through the site. There is a 375mm public combined sewer located to the west of Parcel 1 and a 150mm public combined sewer in Trevalyn Way (Road) to the west of Parcel 2. There is also a private surface water sewer located adjacent to the north-

western boundary of Parcel 1.

Development Proposals

The proposed development is for approximately 132 dwellings with associated access roads and landscaping. 61 dwellings are proposed in Parcel 1 with 71 dwellings proposed in parcel 2. A proposed development plan is included in Appendix C.

The proposed development will introduce approximately 12,767m² of hardstanding in the form of buildings and roads. Land parcel 1 will introduce approximately 6,382m² of hardstanding. Land parcel 2 will introduce approximately 6,383m² of hardstanding. The measurements have been taken from a .dwg version of the proposed site plan.

Flood Zone Category and Policy Context

Flood Zone Category

The Welsh Government Development Advice Map, included in Appendix D, shows that the majority of the site is located within Flood Zone A – an area considered to be at little or no risk of fluvial or tidal flooding, with a less than 0.1% (1 in 1000) annual probability of flooding. The north-western extent of land parcel 1 is located within Flood Zone B - an area known to have flooded in the past (evidenced by superficial deposits).

The NRW 'Flood Map for Planning', included in Appendix D, shows that the site is located within an area outside of the extreme flood extent (Flood Zone 1), meaning it has a less than 0.1% annual probability of flooding.

Development Vulnerability Classification

The proposed residential development is considered to be 'highly vulnerable' in accordance with Figure 2 of the Welsh Government's Technical Advice Note 15 – Development and Flood Risk (TAN15).

TAN15 states that highly vulnerable development can be considered in Flood Zone A and Flood Zone B subject to demonstrating that the site falls outside of the 0.1% annual probability flood extent and demonstrating that the development will not increase flood risk elsewhere.

Local Policy

The currently adopted Wrexham Unitary Development Plan 1996 – 2011, contains the following policies in relation to flood risk and drainage.

Policy EC12 – Development and Flood Risk

'Development (including the raising of land) within defined flood plains will only be permitted if it:- a) would not be subject to an unacceptable risk of flooding on-site; and/or b) does not result in an unacceptable risk of flooding on or off-site; and/or c) does not adversely affect flood management or maintenance schemes.'

Policy EC13 – Surface Water Run-off

Development which would result in an unacceptable adverse impact on the water environment due to additional surface water run-off will not be permitted.'

The Welsh Government: 'Recommended non-statutory standards for sustainable drainage (SuDS) in Wales' (2017) contains the following standards for surface water drainage:

S1 - Surface water runoff destination

Priority Level 1: Surface water runoff is collected for use;

Priority Level 2: Surface water runoff is infiltrated to ground;

Priority Level 3: Surface water runoff is discharged to a surface water body;

Priority Level 4: Surface water runoff is discharged to a surface water sewer, highway drain, or another drainage system;

Priority levels 5: Surface water runoff is discharged to a combined sewer.

G2.33 *The design of the site drainage system should take account of the potential for runoff which might flow onto the site during an extreme event up to the 1:100 year event.*

Local guidance documents including the Wrexham Council Preliminary Flood Risk Assessment (PFRA) (June 2011) have been reviewed for site specific information.

Consultation

A pre-planning opinion request was submitted to the DCWW in May 2018 with regards to development foul flows. A response is included in Appendix E. DCWW have stated:

'The foul flows only from the proposed development can be accommodated within the public sewerage system. We advise that the flows should be taken to the foul sewer at or beyond manhole SJ37572301 within Holt Road/Rossett Road...

...With reference to the surface water flows from the proposed development, you are required to fully exhaust all technical options outlined under Sections 3.2 and 3.4 of Part H of the publication 'Building Regulations 2000; Disposal should be made through the hierarchical approach, preferring infiltration and, where infiltration is not possible, disposal to watercourses in liaison with the Land Drainage Authority and/or Natural Resources Wales. Discharge of surface water to the public sewer is only to be made as a last resort...

...In addition, please note that no highway or land drainage run-off will be permitted to discharge directly or indirectly into the public sewerage system. ADVISORY The applicant may need to apply to Dwr Cymru / Welsh Water for any connection to the public sewer under S106 of the Water industry Act 1991...

No problems are envisaged with the Waste Water Treatment Works for the treatment of domestic discharges from this site.'

A meeting was held between Waterco and Wrexham County Council in its capacity as LLFA and SAB. A summary of the meeting is provided below;

- A drainage scheme based on infiltration is proposed;
- Water butts are encouraged for each property;
- Individual (private) soakaways are encouraged where possible for all properties;
- Permeable surfacing should be used for all surfaces although it is acknowledged that a tarmac surface will be required for adoptable roads as the local highways department do not yet have a specification for an adoptable permeable surface;
- Preference should be given to above ground drainage features i.e. infiltration basins for any shared drainage systems (serving the adoptable road or multiple properties);
- The SAB will adopt shared drainage features and will be responsible for future maintenance;
- The SAB will approve the design of any private drainage features i.e. individual property soakaways;
- The SAB will not adopt permeable surfaces (roads and driveways). Maintenance of shared access roads / shared parking areas could be secured through appointment of a site management company and funded by future residents (through maintenance fees);
- The groundwater level at the site should be established and the invert (base) of infiltration devices set 1m above the groundwater level.

Sources of Flooding and Probability

Fluvial

The nearest watercourse is an unnamed land drain which is located approximately 75m north-east of parcel 1. The unnamed land drain flows north in this location and away from the site. The nearest designated main river is the River Alyn which is located approximately 150m south of Parcel 2. The River Alyn flows east in this location to its confluence with the River Dee, approximately 2.7km south-east of the site. Other watercourses in the area include Lavister Brook which is located approximately 560m north-west of Parcel 1. Lavister Brook flows north-east in this location to its confluence with Pulford Brook, approximately 1.1km from the site.

The PFRA contains no records of fluvial flooding at the site. An internet search found records of flooding from the River Alyn in 2000. This flooding affected properties on Station Road approximately 730m west of the site. The site was not affected during this event.

Any potential flooding from the unnamed land drain located 80m north-east of the northern land parcel would be directed north away from the site following the local topography.

The southern land parcel is in close proximity to the extreme 1% and 0.1% annual probability fluvial flood extents associated with the River Alyn. The flood extent reaches the southern side of Harwood's Lane. As shown on the topographical survey, Harwood's Lane, where it is shown in Flood Zone 3, is situated at approximately 51.07m AOD and 600mm below adjacent site levels.

The site is situated outside of the 0.1% annual probability fluvial flood extent and as such, it can be concluded that the risk of fluvial flooding is very low.

Tidal

The site is situated at a minimum of 12m AOD. The site is therefore not at risk of tidal flooding.

Surface Water

Surface water flooding occurs when rainwater does not drain away through the normal drainage system or soak into the ground. It is usually associated with high intensity rainfall events, however can also occur with lower intensity rainfall or melting snow where the ground is saturated, frozen or developed, resulting in overland flow and ponding in depressions in topography. Surface water flooding can occur anywhere without warning. However, flow paths can be determined by consideration of contours and relative levels.

The NRW 'Flood Map for Surface Water' (Appendix D) shows that the majority of the site is at very low risk of surface water flooding, meaning it has a less than 0.1% annual probability of flooding. An area at low risk of surface water flooding is identified centrally within Parcel 1. An isolated area of low flood risk is also identified in the eastern extent of parcel 2. Low risk is classified as having between a 1% and 0.1% annual probability of occurrence.

The PFRA 'Flooding Incidents within WCBC' map, provided as Appendix F, shows no records of surface water flooding at or near to the site.

An area of waterlogged ground has been identified in the northern extent of parcel 1. A photograph of the waterlogged ground is provided as Figure 1. The waterlogged ground corresponds with an isolated topographical low point and underlying Alluvium (clay) deposits. The underlying clay is limited in extent. A map showing the location and approximate extent of the waterlogged area, extracted from the TigerGeo Geophysical Survey Report, is included in Appendix G.



Figure 1 – Waterlogged Ground.

There are no distinct flow routes in the area that would direct any potential surface water flooding towards the site. Any potential surface water flooding on site would be associated with ponding in isolated topographical low points which are underlain by isolated outcrops of clay.

It can be concluded that the majority of the site is not at risk of surface water flooding. Isolated areas of the site, underlain by superficial Alluvium deposits (clay), are at potential risk of waterlogging, especially during wet winter months. The risk of waterlogging / surface water ponding will be removed post development through consideration of site levels and inclusion of a sustainable drainage system accommodating the 1 in 100 year plus 30% climate change event.

Sewer

Flooding from sewers can occur when a sewer is overwhelmed by heavy rainfall, becomes blocked, is damaged, or is of inadequate capacity. Flooding is mostly applicable to combined and surface water sewers.

DCWW sewer records shows that there are no public sewers crossing through the site. There is a 375mm public combined sewer located to the west of Parcel 1 and a 150mm public combined sewer in Trevalyn Way (Road) to the west of Parcel 2. There is also a private surface water sewer located adjacent to the north-western boundary of Parcel 1.

The PFRA states that 'there were no records of properties affected by sewer flooding with significant consequences' in WCBC. The PFRA 'Sewer Flooding Incidents' map (Appendix F) shows no records of sewer flooding at or near to the site.

There are no distinct flow routes in this area which would direct any potential sewer flooding towards the

site. It can therefore be concluded that the risk of sewer flooding is low.

Groundwater

Groundwater flooding occurs when water levels underneath the ground rise above normal levels. Prolonged heavy rainfall soaks into the ground and can cause the ground to become saturated. This results in rising groundwater levels which leads to flooding above ground.

The PFRA states: 'there were no records of past groundwater flooding within Wrexham County Borough Council (WCBC); this is due to the topography and geology of the area'.

There are no records of groundwater flooding at the site. It can therefore be concluded that the risk of groundwater flooding is low.

Artificial Sources

There are no canals in the immediate vicinity of the site.

The online NRW 'Risk of Flooding from Reservoirs' map shows that the site is not at risk of flooding from reservoirs.

Summary of Potential Flooding & Mitigation

It can be concluded that the majority of the site is at low risk of flooding from all sources. Waterlogged ground has been identified in the northern extent of parcel 1. The waterlogged ground is attributed to the underlying superficial Alluvium deposits (clay), which are limited in extent, and isolated topographical low points. The compacted nature of the existing agricultural ground may also be a contributing factor to the waterlogging.

The risk of waterlogging / surface water ponding will be removed post development through consideration of site levels and inclusion of a sustainable drainage system accommodating the 1 in 100 year plus 30% climate change event.

Finished floor levels should be set 150mm above surrounding ground levels.

Surface Water Management

The site is not formally drained and is considered to be 100% permeable.

The proposed development will introduce approximately 12,767m² of hardstanding in the form of buildings and roads. Land parcel 1 will introduce approximately 6,382m² of hardstanding. Land parcel 2 will introduce approximately 6,383m² of hardstanding.

In accordance with TAN15, new development should not create additional runoff when compared with the undeveloped situation.

In order to ensure no increase in surface water runoff as a result of the development, sustainable drainage systems will be used to accommodate the 1 in 100 year plus 30% climate change storm event.

Discharge Method

The Welsh Government: 'Statutory standards for sustainable drainage systems' (2018) contains the following standards for surface water runoff destination:

S1 - Surface water runoff destination

Priority Level 1: Surface water runoff is collected for use;

Priority Level 2: Surface water runoff is infiltrated to ground;

Priority Level 3: Surface water runoff is discharged to a surface water body;

Priority Level 4: Surface water runoff is discharged to a surface water sewer, highway drain, or another drainage system;

Priority Level 5: Surface water runoff is discharged to a combined sewer.

Priority Level 1: Surface water runoff collected for use

Surface water re-use is applicable for residential properties. A water butt will be provided for each dwelling to promote external water re-use. Rainwater harvesting systems are not proposed. In line with section G1.4 of the 'Statutory standards for sustainable drainage systems', rainwater harvesting is not proposed for this site as:

- 1) There is no foreseeable demand for non-potable water on the site throughout its design life;
- 2) There is no foreseeable need to harvest water at the site and Welsh Water have not identified potential stresses on mains water supplies in this area;
- 3) The use of rainwater harvesting is not a cost-effective part of the solution for managing surface water runoff on the site, taking account of the potential water supply benefits of such a system.

With regards to point 3 above, section G1.6 of the 'Statutory standards for sustainable drainage systems' states that; in most cases, rainwater harvesting alone will not be adequate to deal with the site drainage and provision will be required for an overflow to a Level 2 or lower priority runoff destination. As a lower priority runoff destination will be required to accommodate for rainwater harvesting system overflows, rainwater harvesting is not considered a cost-effective solution for managing surface water runoff.

The water saving costs of rainwater harvesting do not outweigh unit costs; installation costs; maintenance costs and ongoing running costs.

Priority Level 2: Surface water runoff is infiltrated to ground

Infiltration tests have been carried out by Waterco Consultants in October 2015. The infiltration tests were carried out in accordance with the BRE 365 specification.

11 No. trial pits (TP1-TP11) were excavated, and infiltration testing undertaken. Infiltration test results show that all trial pits with the exception of TP5 and TP6 drained to 100% empty during all 3 repeated tests. The location of the trial pits can be found in the 'Trial Pit Locations' map in Appendix H.

The eastern extent of parcel 2 (location of TP5 and TP6) is underlain by clay. Furthermore, the northern extent of parcel 1 is also underlain by clay with historic records of waterlogging. Infiltration drainage features (soakaways and infiltration basins) will not be suitable within clay areas.

Properties and adopted roads located within clay areas could drain to communal infiltration features within public open space in areas with suitable infiltration characteristics.

Infiltration Test Results

The infiltration test results are shown in the Infiltration Test Report (reference w1938-151014-Infiltration Report). The Infiltration Test Report provides an average infiltration rate across the 3 tests repeated at each trial pit. However, the infiltration rate used for design should be taken from the 3rd and most conservative infiltration test at each trial pit. Infiltration rates from the third test for each trial pit are provided in Table 1:

Table 1 – Infiltration Rates

Trial Pit	Infiltration Rate (m/s)	Infiltration Rate (m/h)
1	1.028E-04	0.37008
2	6.355E-05	0.22878
3	3.22E-05	0.115992
4	7.15E-05	0.2574
5	-	-
6	-	-
7	7.83E-05	0.28188
8	6.33E-04	2.2788
9	1.22E-04	0.43812
10	1.42E-05	0.051012
11	3.86E-05	0.13896
12	6.18E-05	0.222444

No infiltration rate is calculated for TP5 and TP6 and the tests abandoned due to the underlying clay and resulting slow infiltration.

It can be concluded that infiltration-based drainage techniques will be a feasible option for surface water disposal from the site. Properties and adopted roads near to TP5 and TP6, and in the northern extent of parcel 1 (where waterlogging has been identified), will need to be drained via communal infiltration drainage features in public open space outside of the clay areas.

Infiltration Device Sizing

Surface water from individual dwellings, located within an area with suitable infiltration characteristics, will be discharged to private soakaways located in individual property gardens. Soakaways should be placed 5m from buildings.

Surface water from dwellings located within clay areas and from adopted roads will be discharged to communal infiltration devices located in areas of public open space with suitable infiltration characteristics.

Permeable surfaces will be used for all driveways and private roads on site. In accordance with Section G1.15 of the 'Statutory standards for sustainable drainage systems', 'effective infiltration can be achieved with lower [infiltration] rates under units such as permeable paving due to the large storage and infiltration surface area available.... All permeable surfaces, weather lined or not, can be assessed to comply provided that there is no additional area drained to the permeable paving.'

No additional area is drained to the majority of private roads and driveways on site. Areas of permeable paving which do accommodate inflow from other areas of the site have been designed appropriately.

Individual Property Soakaways

Soakaway sizing has been based upon an average house size of 60m² and infiltration rates obtained from the trial pits closest to the individual dwellings. A 'Trial Pit Designations' map is included in Appendix H. The map shows the trial pit (infiltration rate) designated to individual properties.

Soakaway sizing estimates for individual property soakaways are included in Appendix I with a summary provided in Table 2. A 95% void ratio has been used within the soakaway design which is applicable to storm crate (geo-cellular) style soakaways. The soakaways have been designed to accommodate a 1 in 100 year plus 30% climate change (CC) event.

Table 2 – Average Private Soakaway Sizing

Trial Pit Designation	Soakaway Length (m)	Soakaway Width (m)	Soakaway Depth (m)	Infiltration Rate (m/h)
TP 1	2	1.5	1	0.37008
TP 2	2	2	0.8	0.22878
TP 3	2	2	1	0.115992
TP 4	2	1.5	1	0.2574
TP 7	2	1.5	1	0.28188
TP 8	1.5	1	1	2.2788
TP 9	2	1.5	1	0.43812
TP 10	2.5	2	1	0.051012
TP 11	2	2	1	0.13896

TP 12	2	2	0.8	0.222444
-------	---	---	-----	----------

Communal Infiltration Features

Surface water from dwellings within clay areas and adoptable roads will be directed to communal infiltration devices located within open space in areas with suitable infiltration characteristics. Communal infiltration devices will include an infiltration basin and the sub-grade of permeable paving (beneath shared access roads and parking areas).

Infiltration basin and permeable paving sub-grade sizing estimates are also included in Appendix I.

A Concept Drainage Sketch is included in Appendix J and shows the location and sizes of all communal drainage features. Individual property soakaways are also identified on the Concept Drainage Sketch.

Concept Surface Water Drainage Scheme

Surface water runoff will be disposed of using infiltration techniques. Private individual property soakaways will be used for properties located in areas with suitable infiltration characteristics. Communal infiltration basins and permeable paving sub-grade storage will be used to accommodate surface water runoff from adoptable roads and dwellings located in clay areas. The communal infiltration basin and permeable paving sub-grade storage will be provided in areas of open space with suitable infiltration characteristics. Permeable paving will be used for all driveways and non-adoptable shared roads.

Infiltration devices (infiltration basins and permeable paving) will be sized to accommodate the 1 in 100 year plus 30% CC event.

Further infiltration testing may be required to validate the detailed design prior to the development commencing. As per SAB requirements, the groundwater level at the site should be established and the base of any infiltration device set 1m above the groundwater level.

The proposed drainage system will ensure no increase in flood risk elsewhere.

The proposed development is for outline planning permission. The future layout could include additional open space within areas with suitable infiltration characteristics i.e. the northern extent of land parcel 2. This would allow the placement of an infiltration basin in the southern land parcel to serve drainage from the adoptable access roads and properties within clay areas. An infiltration basin within the southern land parcel will facilitate simpler / more cost-effective maintenance requirements over the permeable paving sub-grade storage solution.

Exceedance Event

Storage will be provided for the 1 in 100 year plus 30% CC event. Storm events in excess of the 1 in 100 year plus 30% CC event should be permitted to produce temporary shallow depth flooding within the access roads,

driveways and landscaped areas. Exceedance events of individual property soakaways will be contained within private gardens.

Finished floor levels will be set at a minimum of 150mm above surrounding ground levels ensuring exceedance flooding will not affect the buildings.

Surface Water Treatment

In accordance with the CIRIA C753 publication 'The SuDS Manual' (2015), residential roofs have a 'very low' pollution hazard level, with low traffic roads classified as having a 'low' pollution hazard level. Table 3 shows the pollution hazard indices for each land use.

Table 3 – Pollution Hazard Indices

Land Use	Pollution Hazard Level	Total Suspended Solids (TSS)	Metals	Hydrocarbons
Residential Roofs	Very Low	0.2	0.2	0.05
Low Traffic Roads	Low	0.5	0.4	0.4

Table extract taken from the CIRIA C753 publication 'The SuDS Manual' – Table 26.2

* Indices values range from 0-1.

Runoff will be directed to soakaways, permeable paving and infiltration basins. Table 4 demonstrates the pollution mitigation indices for soakaways, permeable paving and infiltration basins.

Table 4 – SuDS Mitigation Indices

Type of SuDS	Mitigation Indices		
	Total Suspended Solids (TSS)	Metals	Hydrocarbons
Permeable Pavement	0.7	0.6	0.7
Soakaways	0.3	0.5	0.6
Infiltration / Detention Basin	0.5	0.5	0.6

Table extract taken from the CIRIA C753 publication 'The SuDS Manual' – Table 26.3

As shown in Table 4, permeable paving provides sufficient treatment for runoff from roads and roofs. Soakaways provide sufficient treatment for runoff from roofs. An infiltration basin will provide sufficient treatment for runoff from low traffic roads.

Maintenance

Maintenance of communal drainage features such as an infiltration basin will be the responsibility of SAB.

Maintenance of private drainage features such as water butts and individual property soakaways will be the responsibility of individual property owners.

Maintenance of shared permeable surfaces (permeable paved access roads and parking areas) can be arranged through appointment of a site management company.

Maintenance schedules for soakaways and permeable paving are included in Appendix K. Maintenance of water butts will include frequent removal of debris from the inlet filter.

Foul Drainage

DCWW have stated:

‘The foul flows only from the proposed development can be accommodated within the public sewerage system. We advise that the flows should be taken to the foul sewer at or beyond manhole SJ37572301 within Holt Road/Rossett Road.’

Manhole SJ37572301 is located in Holt Road immediately west of the site.

A survey of public combined sewer manhole SJ37572301 has been undertaken by Invek Surveys in July 2018. The survey is included in Appendix L. Manhole SJ37572301 has an identified invert level of 11.45m AOD. A gravity connection to manhole SJ37572301 from land parcel 2 (southern land parcel) will be achievable. A pumped solution will be required to achieve a connection to manhole SJ37572301 from properties in the northern extent of land parcel 1 (northern land parcel).

A pumping station will be required in the north-western extent of the northern land parcel. In accordance with Sewers for Adoption 7th Edition, a 15m stand-off will be required from the wet well of the pumping station to habitable dwellings.

In accordance with Sewers for Adoption 7th Edition, storage should be provided within the wet well of the pumping station to reduce the risk of flooding in the event of plant or power failure. 160 litres of storage is required per dwelling.

Conclusions

The proposed development is for approximately 132 dwellings with associated access roads and landscaping.

The site is located outside of the extreme flood extent on the Natural Resources Wales Flood Map for Planning, with a less than 0.1% (1 in 1000) annual probability of flooding.

The majority of the site is identified at very low risk of flooding from all sources. Waterlogged ground has been identified in the northern extent of the northern land parcel. The waterlogged ground is attributed to the underlying superficial Alluvium deposits (clay), which are limited in extent, and isolated topographical low points. The compacted nature of the existing agricultural ground may also be a contributing factor to the waterlogging.

The risk of waterlogging / surface water ponding will be removed post development through consideration of site levels and inclusion of a sustainable drainage system accommodating the 1 in 100 year plus 30% climate change event. Finished floor will be set 150mm above surrounding ground levels.

The proposed development will introduce impermeable drainage area in the form of buildings and roads. In order to ensure no increase in surface water runoff as a result of the development, sustainable drainage systems will be used to accommodate the 1 in 100 year plus 30% climate change storm event.

Infiltration test results show that the majority of the site is underlain by sand and gravel with infiltration characteristics suitable to support infiltration drainage. Isolated areas in the northern extent of the northern land parcel and eastern extent of the southern land parcel are underlain by clay. Infiltration drainage would not be suitable in clay areas.

Private individual property soakaways will be used for properties located in areas with suitable infiltration characteristics. An infiltration basin and permeable paving sub-grade storage will be used to accommodate surface water runoff from adoptable roads and dwellings located in clay areas. The infiltration basin and permeable paving sub-grade storage will be located in areas with suitable infiltration characteristics. Permeable paving will be used for all driveways and non-adoptable shared roads.


All infiltration features will be sized to accommodate the 1 in 100 year plus 30% climate change event.

DCWW have confirmed that foul flows can discharge to the 375mm public combined sewer in Holt Road at manhole SJ37572301. A gravity connection to manhole SJ37572301 can be made from the southern land parcel. A pumped solution to manhole SJ37572301 will be required from properties in the northern extent of the northern land parcel.

Recommendations

1. Submit this Flood Consequences Assessment and Drainage Strategy to the Planning Authority in support of the Planning Application;
2. Undertake site investigations to establish groundwater levels;
3. Any future site layout should consider public open space within areas with suitable infiltration characteristics, particularly the lower north-western extent of the southern land parcel. This will facilitate the inclusion of infiltration-based SuDS such as an infiltration basin.

Appendix A Location Plan & Aerial Image



Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

NOTES:
1) ALL DIMENSIONS ARE IN METRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS STATED OTHERWISE

LEGEND

Site Boundary

CLIENT:

BELLIS BROTHERS LTD

www.waterco.co.uk

SCHEME:

**LAND OFF HALT ROAD,
ROSSETT**

PLOT TITLE:

AERIAL PLAN

PLOT STATUS:			DATE:
FINAL			06/06/2018

DRAWN:	CHECKED:	APPROVED:	PLOT SCALE @ A3:
HW	AW	VG	1:2,500
(UNLESS STATED OTHERWISE)			

PLOT NAME:	REV:
w10685-Aerial_Image	-




NOTES:
1) ALL DIMENSIONS ARE IN METRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS STATED OTHERWISE

LEGEND


-  Site Boundary
-  Watercourses / Water Bodies



CLIENT:			
BELLIS BROTHERS LTD			
 www.waterco.co.uk			
SCHEME:			
LAND OFF HALT ROAD, ROSSETT			
PLOT TITLE:			
LOCATION PLAN			
PLOT STATUS:			DATE:
FINAL			06/06/2018
DRAWN:	CHECKED:	APPROVED:	PLOT SCALE @ A3:
HW	AW	VG	1:2,500 (UNLESS STATED OTHERWISE)
PLOT NAME:			REV:
w10685-Location_Plan			-



Appendix B Topographical Data

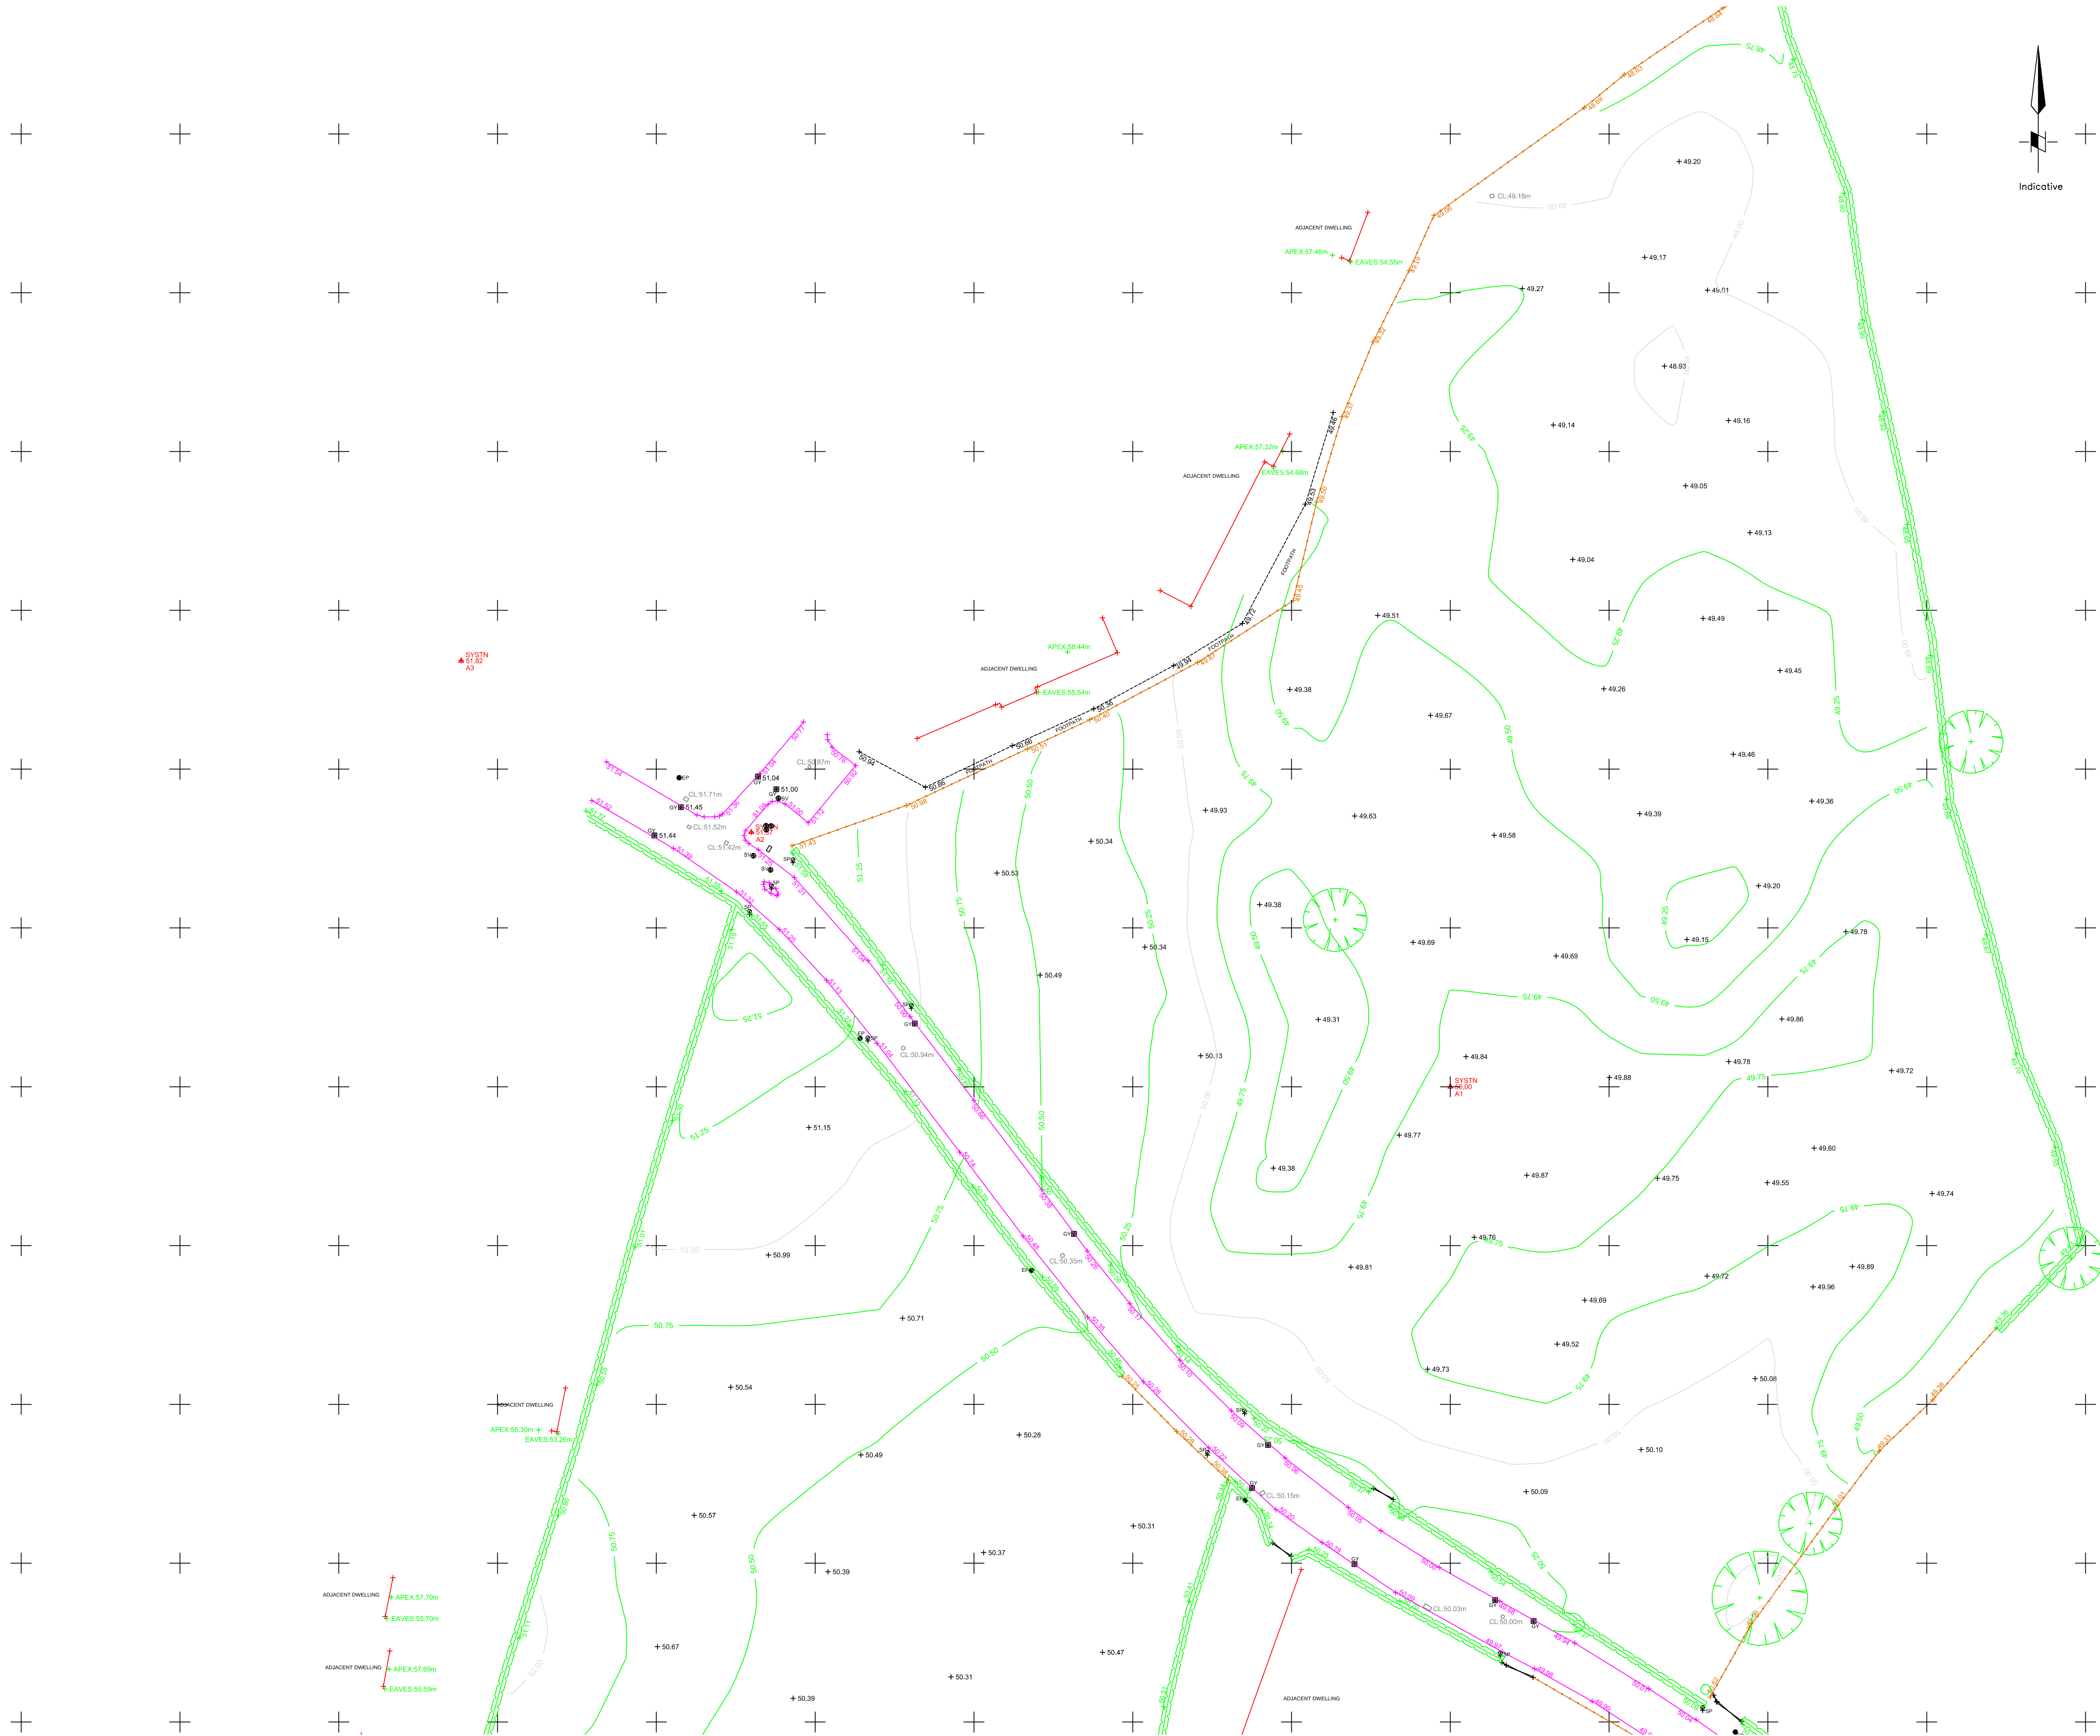

NOTES

Copyright of this drawing remains with M.B.Surveying Ltd. Do not scale from this drawing, work to figured dimensions. Check all dimensions on-site. In the event of any discrepancy, please refer query to M.B.Surveying Limited.

Legend

AV	Air valve
BH	Borehole
BOL	Bollard
BT	British Telecom cover
CATV	Cable television cover
CL	Cover level
DPC	Damp proof coarsing level
Earth/ER	Earthing rod
ELEC	Electric cover
EP	Electricity pole
Fence VR	Iron railing fence
Fence CB	Closeboard fence
Fence CP&P	Concrete post & panel fence
Fence Pa	Palisade fence
Fence PW	Post and wire fence
Fence PIR	Post and rail fence
Fence P/P	Post and panel fence
FFL	Finished floor level
FIB	Flower bed
FH	Fire Hydrant
GY	Gully
GAS	Gas cover
IC	Inspection chamber
IL	Invert level
INV	Invert level
LP	Lamp post
LT	Light
MH	Manhole
Nymex	Telecommunications cover
OSBM	Ordnance Survey Bench Mark
PTM	Parking ticket machine
RE	Rodding eye
RS	Road sign
R/W	Retaining wall
SBX	Switch box
SP	Sign post
SPS	Safety playing surface
ST	Stop tap
SV	Service valve
TBM	Temporary Bench Mark
TP	Telegraph pole
TRP	Trail pit
TRL	Traffic light
W	Water cover
WL	Water level
WO	Wash out

Building
Building overhead / Foundations / Ruins
Road edge / Change of surface / Drain
Change of slope
Fence

Safety barrier
Overhead cable
Gate
Hedge
Limit of foliage/tree
canopies
Spot level

Co-ordinates and Levels related to Local Site Grid.
Origin 1000.000mE 1000.000mN 50.000mAD at survey station A1

SURVEY STATIONS			
Name	Easting	Northing	Height
A1	1000.000	1000.000	50.000
A2	889.945	1040.057	51.367
A3	844.275	1067.062	51.623
A4	897.558	832.498	50.893
A5	812.368	774.472	51.115
A6	827.309	759.763	51.232

REV	DESCRIPTION	DWN	CHKD	DATE
-----	-------------	-----	------	------

CLIENT Bellis Bros

PROJECT Land Off Rossett Rd, Rossett.


TITLE Topographical Survey

DWN	DATE	CHKD	DATE	APPD	DATE	SCALE
MB	20/01/15					1:500@A1

Land & Engineering Surveyors
MB Surveying Limited
Pine Cottage, Kelsall Road,
Ashton Hayes, Cheshire, CH3 8BH
Tel: 01829 759306
www.mbsurveying.co.uk

Drawing Number MBS688 REV A1



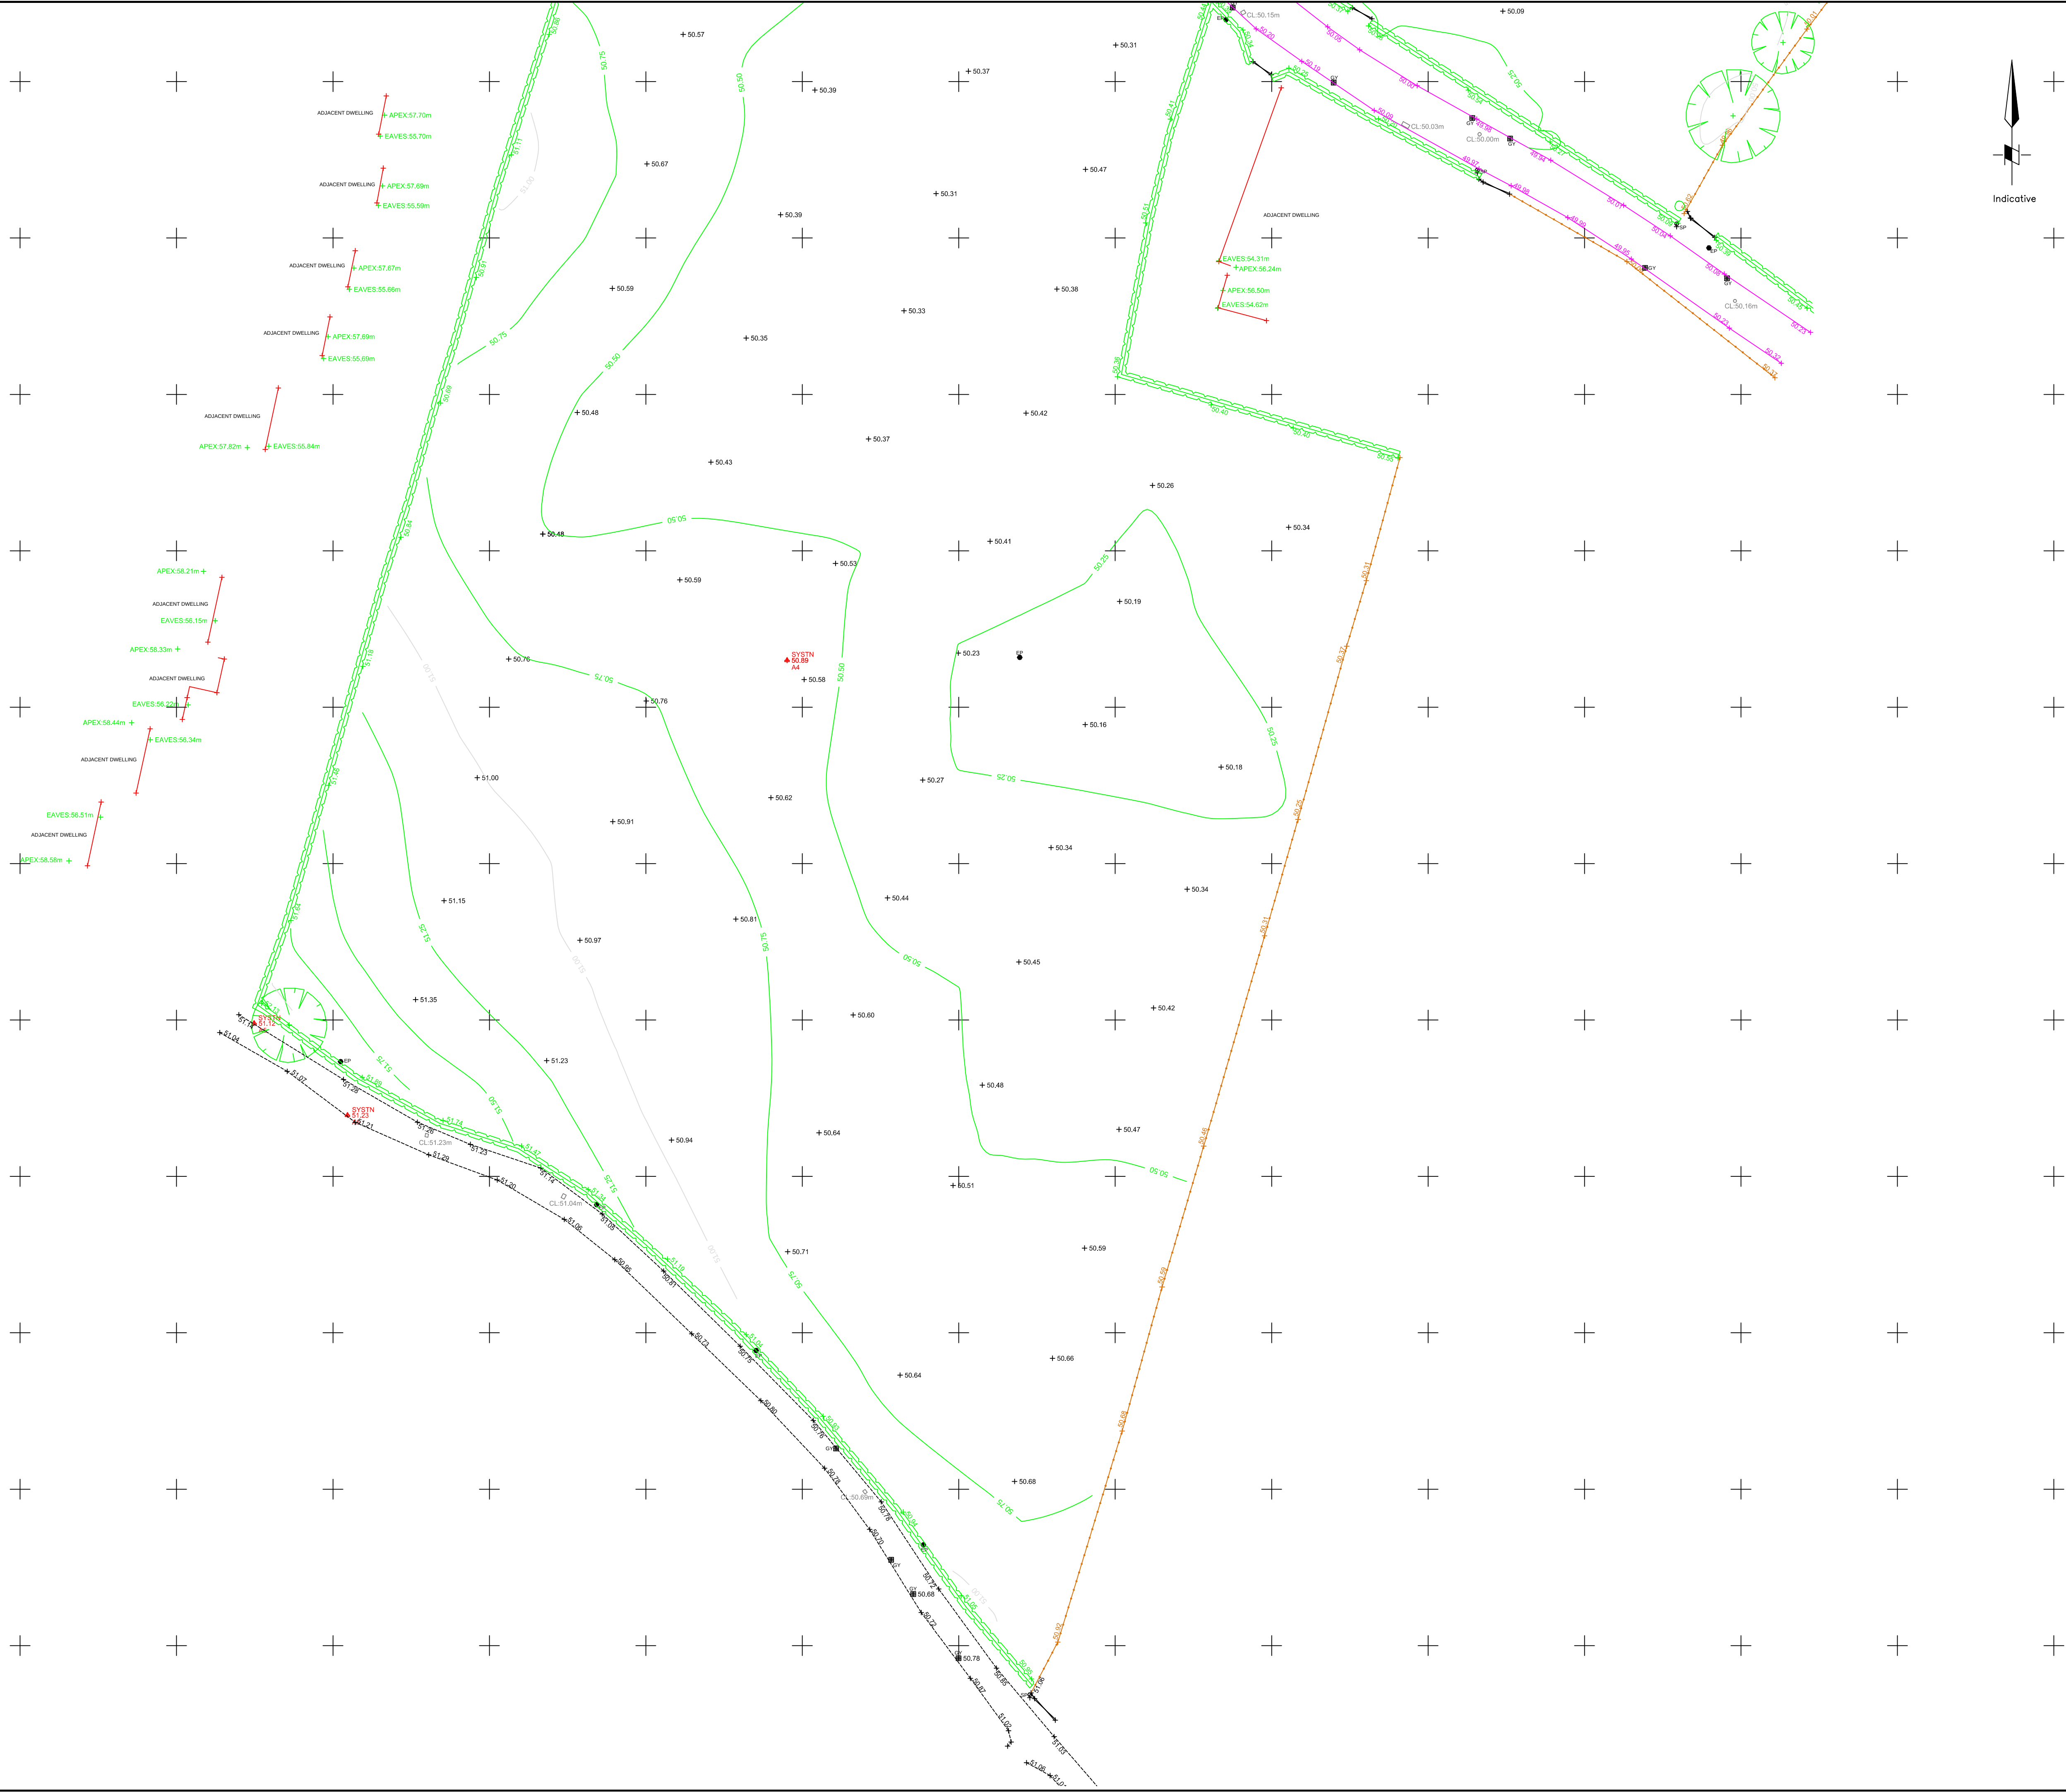


Legend	
AV	Air valve
BH	Borehole
BOL	Bollard
BT	British Telecom cover
CATV	Cable television cover
CL	Cover level
DPC	Damp proof coarsing level
Earth/ER	Earthing rod
ELEC	Electric cover
EP	Electricity pole
Fence VR	Iron railing fence
Fence CB	Closeboard fence
Fence CP&P	Concrete post & panel fence
Fence Pa	Palisade fence
Fence PW	Post and wire fence
Fence PIR	Post and rail fence
Fence P/P	Post and panel fence
FFL	Finished floor level
FIB	Flower bed
FH	Fire Hydrant
GY	Gully
GAS	Gas cover
IC	Inspection chamber
IL	Invert level
INV	Invert level
LP	Lamp post
LT	Light
MH	Manhole
Nymex	Telecommunications cover
OSBM	Ordnance Survey Bench Mark
PTM	Parking ticket machine
RE	Rodding eye
RS	Road sign
R/Wall	Retaining wall
SBX	Switch box
SP	Sign post
SPS	Safety playing surface
ST	Stop tap
SV	Service valve
TBM	Temporary Bench Mark
TP	Telegraph pole
TRP	Trail pit
TRL	Traffic light
W	Water cover
WL	Water level
WO	Wash out

Building	Building overhead / Foundations / Ruins
Building overhead / Foundations / Ruins	Building overhead / Foundations / Ruins
Road edge / Change of surface / Drain	Road edge / Change of surface / Drain
Change of slope	Change of slope
Fence	Fence
Safety barrier	Safety barrier
Overhead cable	Overhead cable
Gate	Gate
Hedge	Hedge
Limit of foliage/tree canopies	Limit of foliage/tree canopies
Stile	Stile
Tree	Tree
Spot level	Spot level

SURVEY STATIONS			
Name	Easting	Northing	Height
A1	1000.000	1000.000	50.000
A2	889.945	1040.057	51.367
A3	844.275	1067.062	51.623
A4	897.558	832.498	50.893
A5	812.368	774.472	51.115
A6	827.309	759.763	51.232

REV	DESCRIPTION	DWN	CHK'D	DATE
MB	08/01/15			
CLIENT				
Bellis Bros				
PROJECT				
Land Off Rossett Rd, Rossett.				
TITLE				
Topographical Survey				
DWN	DATE	CHK'D	DATE	APP'D
MB	08/01/15			
SCALE				
1:500@A1				
Land & Engineering Surveyors				
MB Surveying Limited				
Pine Cottage, Kelsall Road, Ashton Hayes, Cheshire, CH3 8BH				
Tel: 01829 759306				
www.mbsurveying.co.uk				
Drawing Number				
MBS688				
A1				
REV				




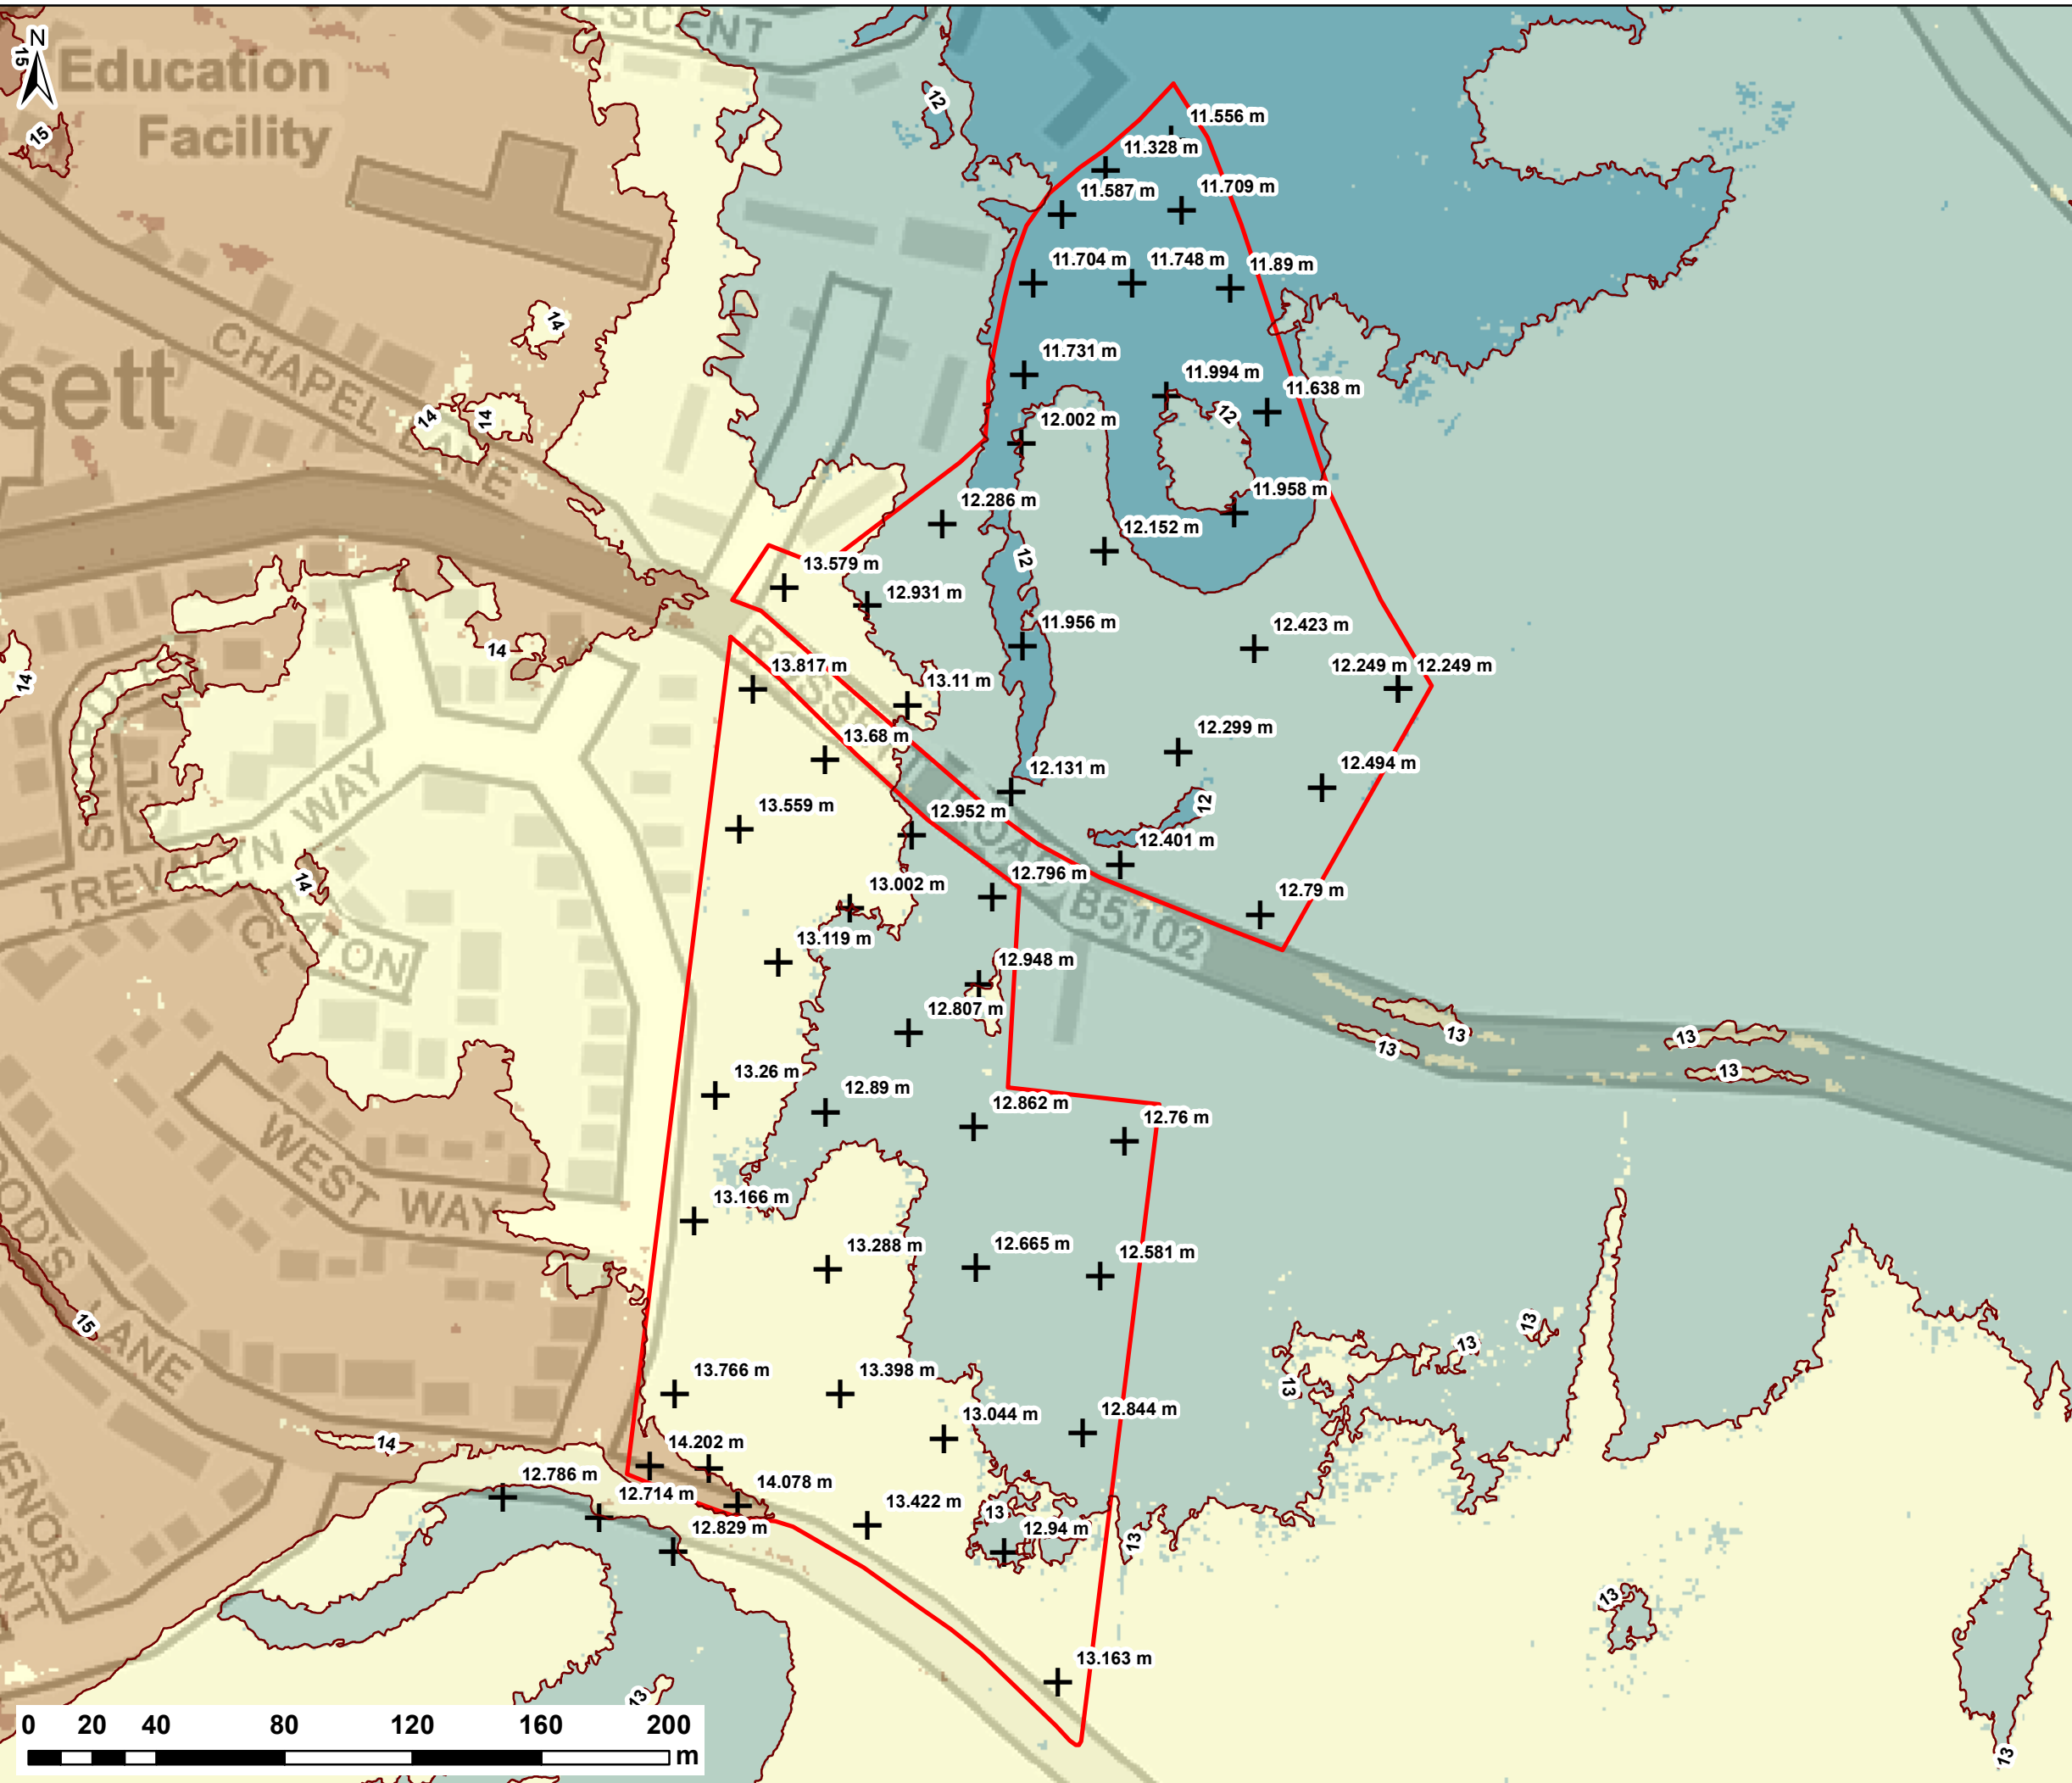

NOTES:
1) ALL DIMENSIONS ARE IN METRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS STATED OTHERWISE

LEGEND

- Site Boundary
- Site Levels
- Ground Elevation (m AOD)
 - < 12
 - 12 - 13
 - 13 - 14
 - 14 - 15
 - > 15

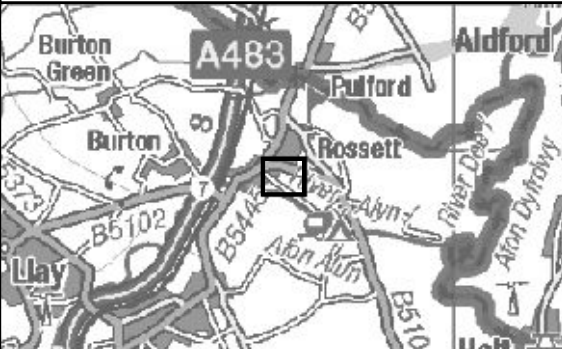


CLIENT: BELLIS BROTHERS LTD			
 www.waterco.co.uk			
SCHEME: LAND OFF HALT ROAD, ROSSETT			
PLOT TITLE: LIDAR ELEVATIONS 1m RESOLUTION			
PLOT STATUS: FINAL			DATE: 06/06/2018
DRAWN: HW	CHECKED: AW	APPROVED: VG	PLOT SCALE @ A3: 1:2,000 (UNLESS STATED OTHERWISE)
PLOT NAME: w10685-LIDAR			REV: -

Appendix C Development Plans



NORTH					
REF	BEDS	SQ FT	QTY	TOTAL	TYPE
A	2	700	10	7000	2 BED TERRACE
B	2	720	0	0	2 BED TERRACE
C	3	900	11	9900	3 BED TERRACE
D	3	1000	17	17000	3 BED TERRACE
E	3	1024	4	4096	3 BED SEMI
G	4	1350	0	0	4 BED DETACHED
H	4	1350	10	13500	4 BED DETACHED
I	4	1380	3	4140	4 BED DETACHED
J	4	1240	6	7440	4 BED DETACHED
TOTAL			61	63076	
Units / Net/ Hectare / Acre 31 / 12					
Gross area 6.94 acres					
POS area 1.17 acres					
Undevelopable area 0.4 acres					
Net area 5.37 acres					
SOUTH					
REF	BEDS	SQ FT	QTY	TOTAL	TYPE
A	2	700	1	700	2 BED TERRACE
B	2	720	1	720	2 BED TERRACE
C	3	900	21	18900	3 BED TERRACE
D	3	1000	11	11000	3 BED TERRACE
E	3	1024	9	9216	3 BED SEMI
G	4	1350	2	2700	4 BED DETACHED
H	4	1350	19	25650	4 BED DETACHED
I	4	1380	3	4140	4 BED DETACHED
J	4	1240	4	4960	4 BED DETACHED
TOTAL			71	77986	
Units / Net/ Hectare / Acre 30 / 11					
Gross area 8.41 acres					
POS area 1.69 acres					
Undevelopable area 0.5 acres					
Net area 6.20 acres					

Typical Property Sizes.



KEY

EXISTING TREES

EXISTING HEDGEROWS

PROPOSED TREES

PROPOSED HEDGEROWS

PROPOSED PARK

PROPOSED HOUSING

PROPOSED STREET

PROPOSED SHARED SURFACES

PROPOSED SUDS POND

REV. AMENDMENT. DATE

Parkinson
First Floor, 5 Union Court, Liverpool, L2 4SJ
T: 07970 686 302 E: ian@parkinsoninc.co.uk


PROJECT
HOLT ROAD / ROSSETT ROAD,
ROSSETT, CLYWD.

CLIENT
BELLIS BROS

DRAWING TITLE
MASTER PLAN (RENDERED)

SCALE 1:500 @A0 REV. G PROJECT REF ROSSETT
DATE Sept 2017 DRAWING No. Pinc 100-37-SMP-01
CHECKED IP

Appendix D Natural Resources Wales Flood Maps

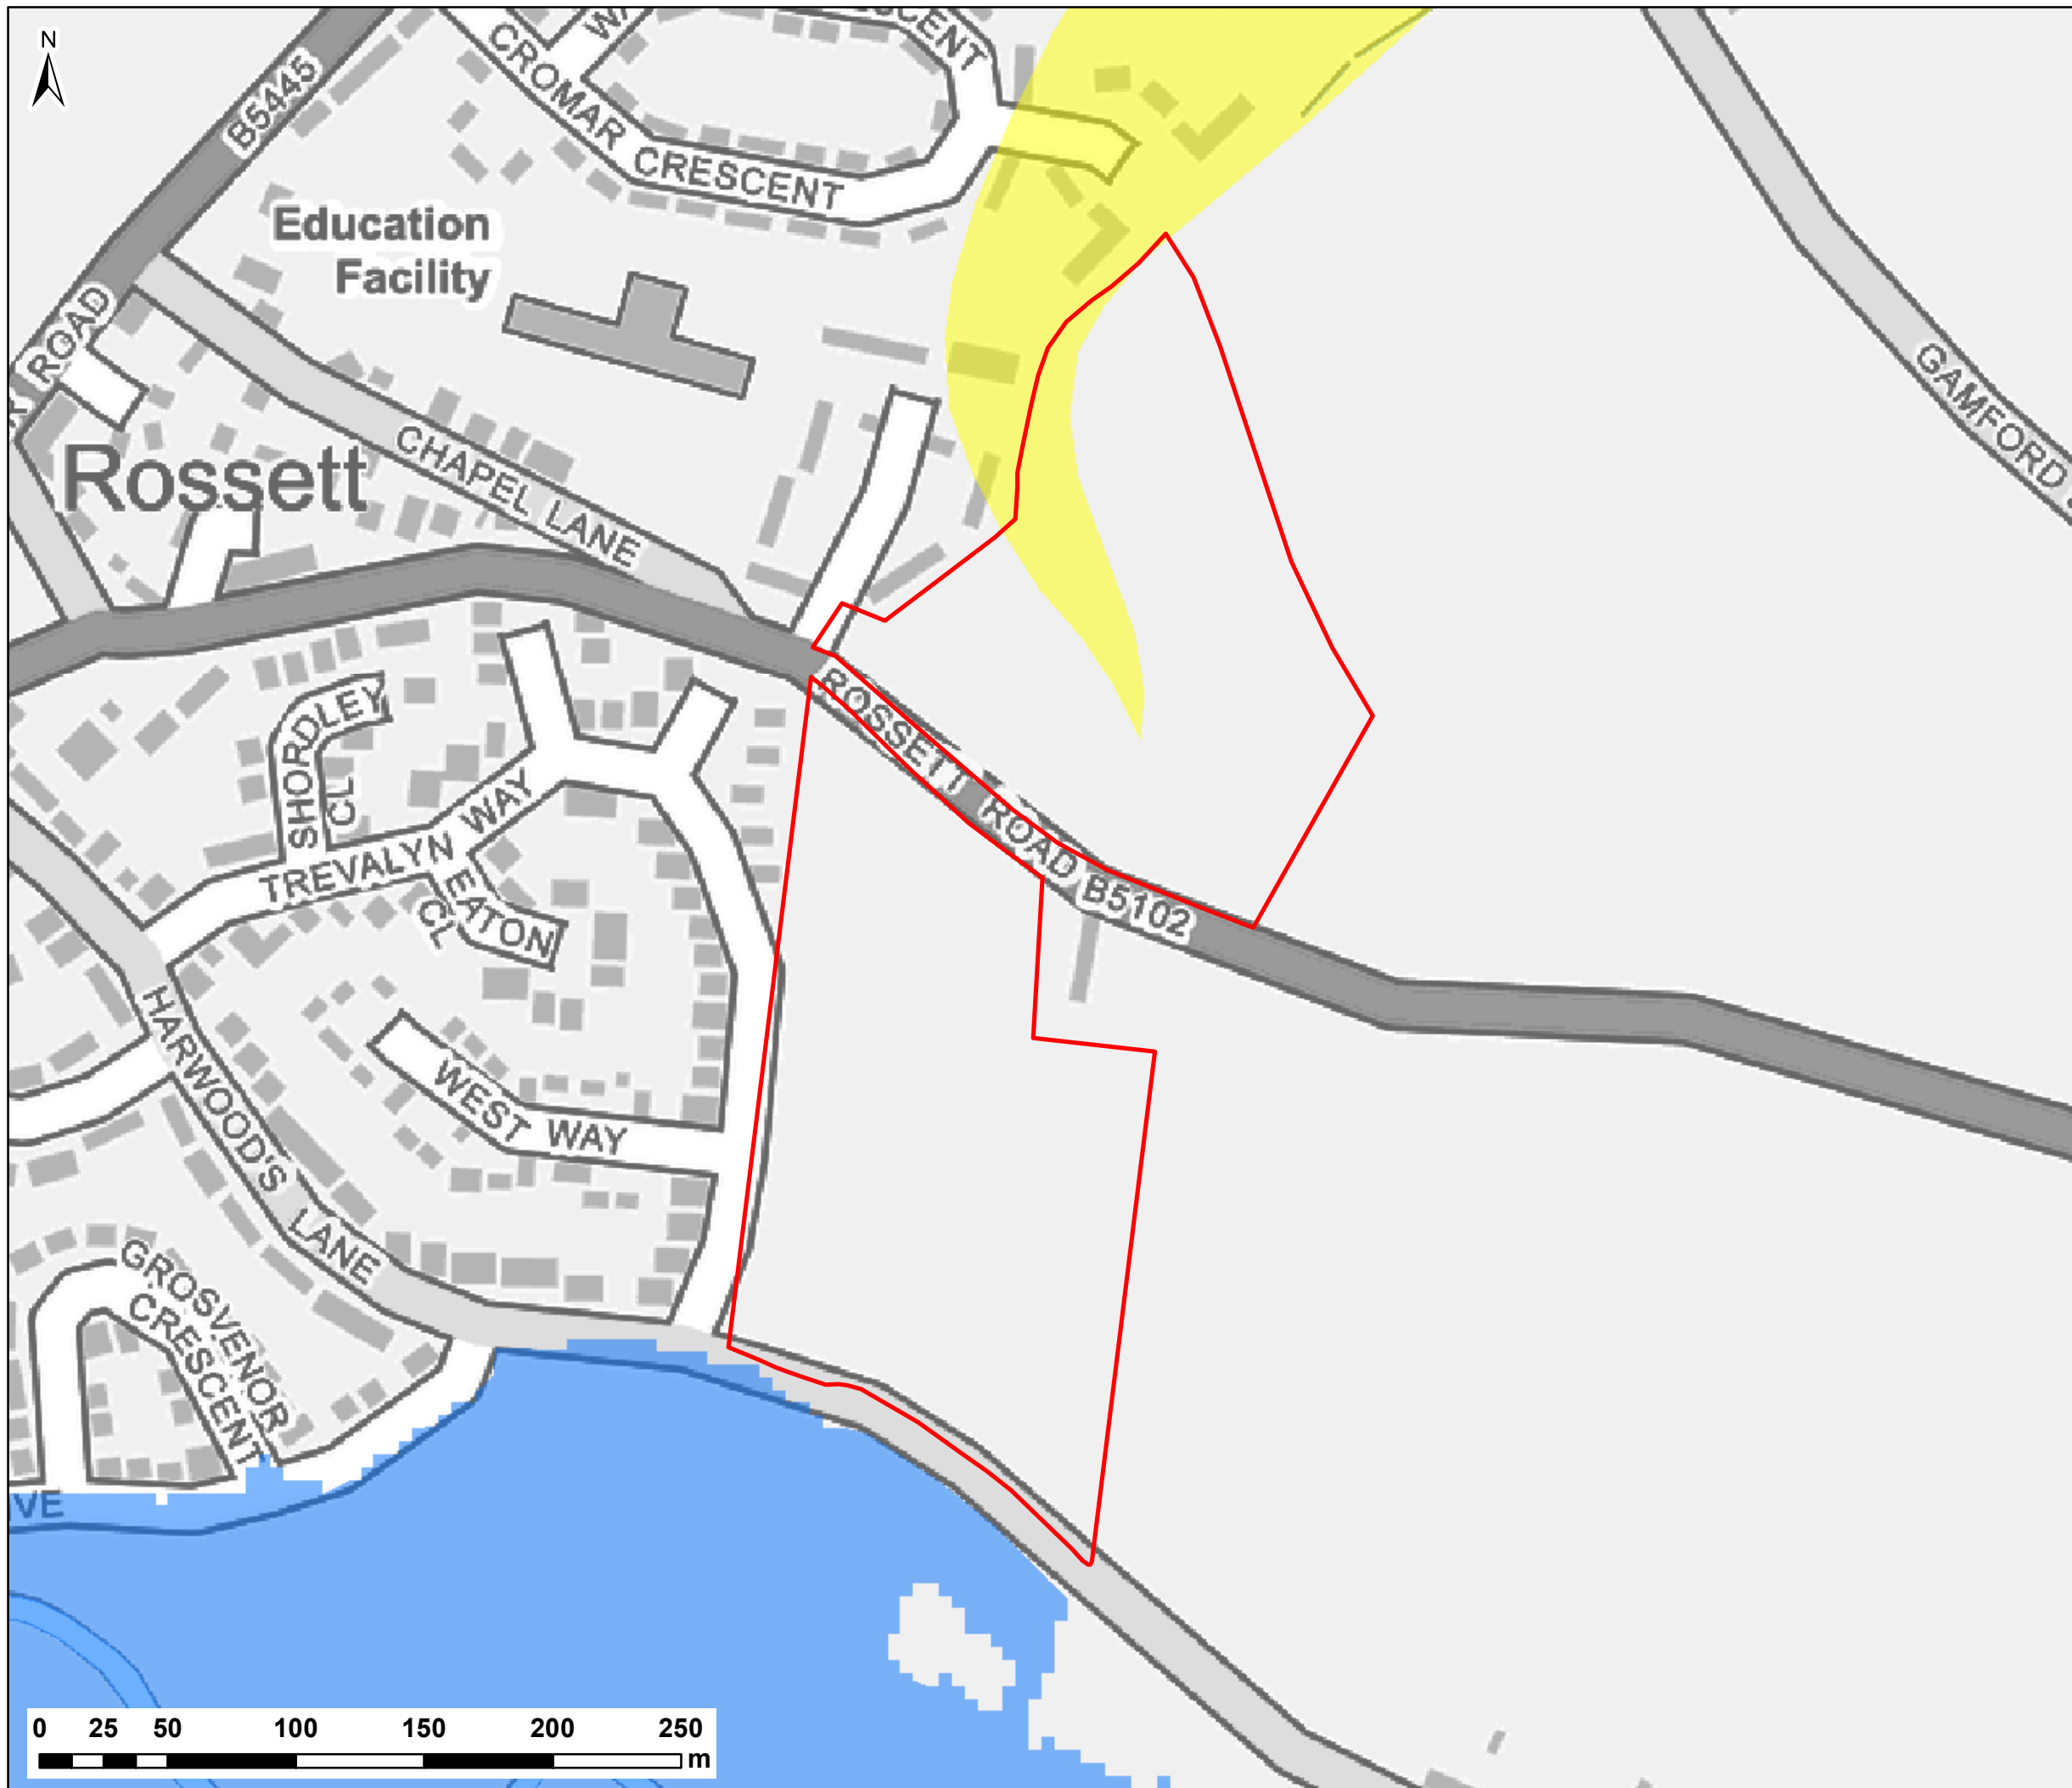

NOTES:
1) ALL DIMENSIONS ARE IN METRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS STATED OTHERWISE

LEGEND

Site Boundary

TAN15 Classification

Zone A

Zone B

Zone C1

Zone C2

CLIENT:

BELLIS BROTHERS LTD

waterco
consultants

www.waterco.co.uk

SCHEME:

**LAND OFF HALT ROAD,
ROSSETT**


PLOT TITLE:

**WELSH GOVERNMENT
DEVELOPMENT ADVICE MAP**
JUNE 2018

PLOT STATUS:			DATE:
FINAL			06/06/2018

DRAWN:	CHECKED:	APPROVED:	PLOT SCALE @ A3:
HW	AW	VG	1:2,500
			(UNLESS STATED OTHERWISE)

PLOT NAME:	REV:
w10685-EA_RES	-

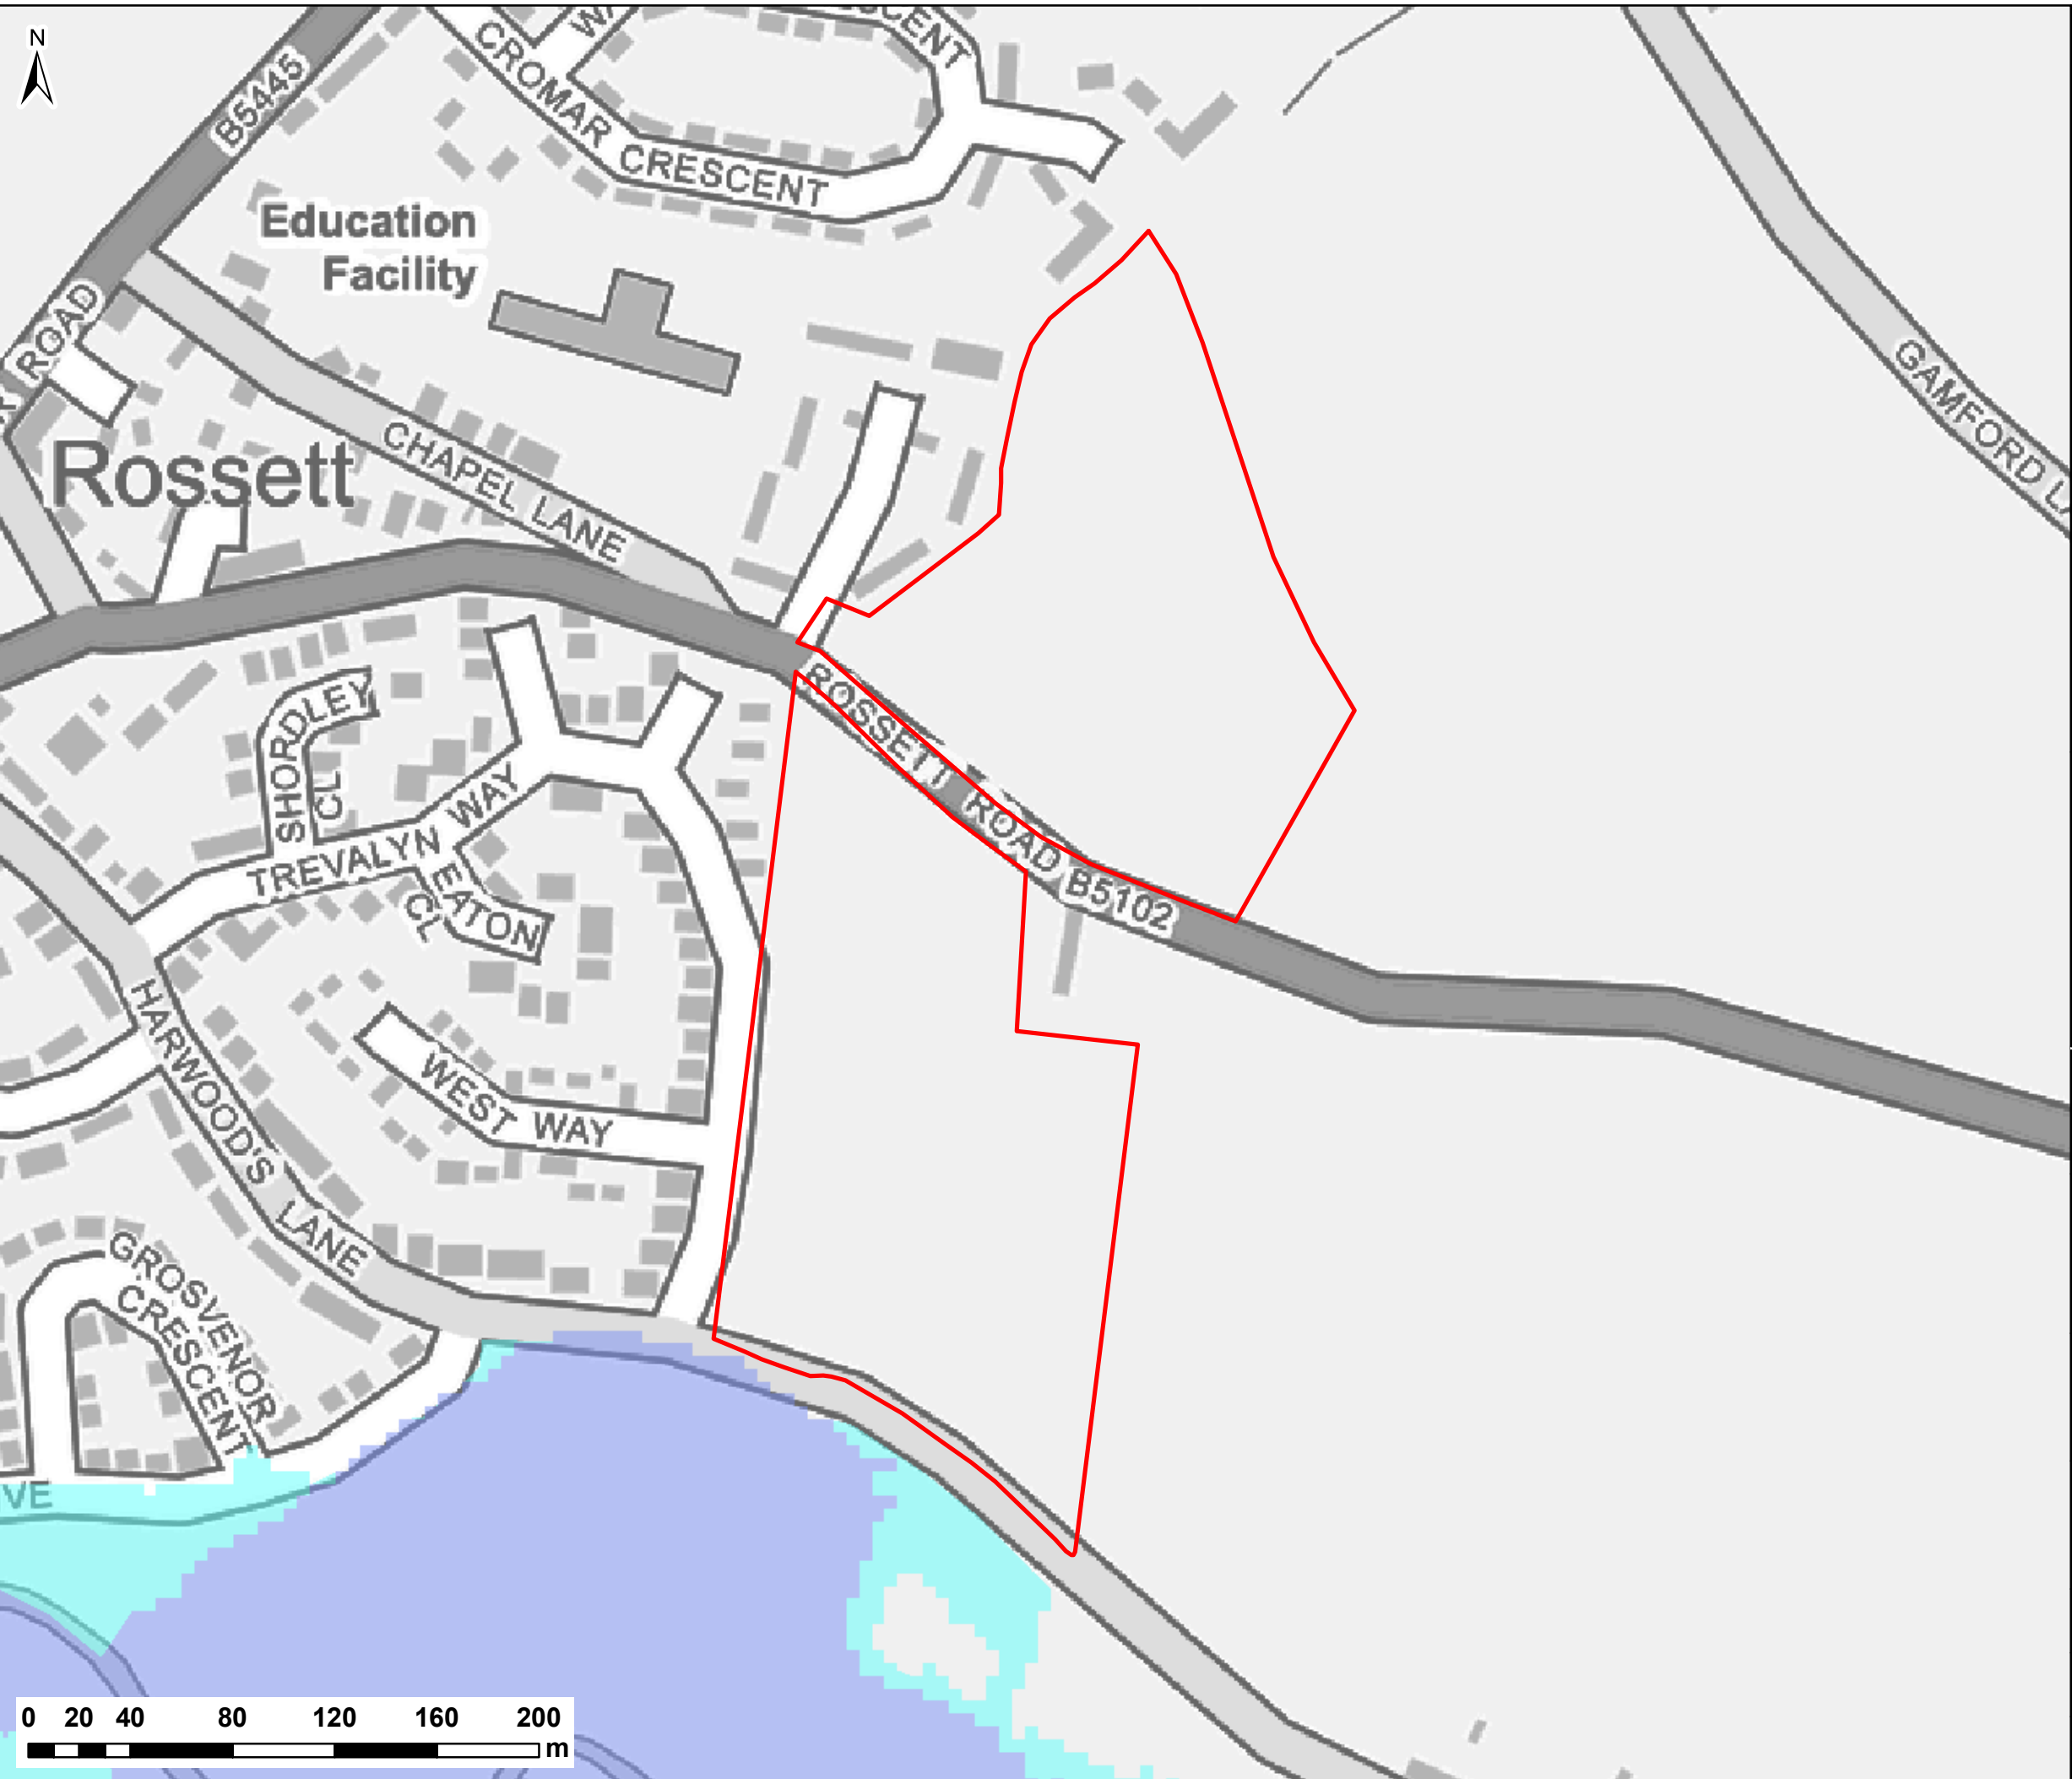

NOTES:
1) ALL DIMENSIONS ARE IN METRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS STATED OTHERWISE

LEGEND

Site Boundary

NRW Flood Zone 3

NRW Flood Zone 2

CLIENT:

BELLIS BROTHERS LTD

waterco
consultants

www.waterco.co.uk

SCHEME:

**LAND OFF HALT ROAD,
ROSSETT**

PLOT TITLE:


NRW FLOOD MAP FOR PLANNING
MAY 2018

PLOT STATUS:			DATE:
FINAL			06/06/2018

DRAWN:	CHECKED:	APPROVED:	PLOT SCALE @ A3:
HW	AW	VG	1:2,500
			(UNLESS STATED OTHERWISE)

PLOT NAME:	REV:
w10685-EA_FZ	-

CONTAINS NATURAL RESOURCES WALES INFORMATION © NATURAL RESOURCES WALES AND DATABASE RIGHT. ALL RIGHTS RESERVED. SOME FEATURES OF THIS INFORMATION ARE BASED ON DIGITAL SPATIAL DATA LICENCED FROM THE CENTRE FOR ECOLOGY AND HYDROLOGY © NERC (CEH). DEFRA, MET OFFICE AND DARD RIVERS AGENCY © CROWN COPYRIGHT. © CRANFIELD UNIVERSITY. © JAMES HUTTON INSTITUTE. CONTAINS OS DATA © CROWN COPYRIGHT AND DATABASE RIGHT 2015. LAND AND PROPERTY SERVICES © CROWN COPYRIGHT AND DATABASE RIGHT. CONTAINS OS DATA © CROWN COPYRIGHT (2018)

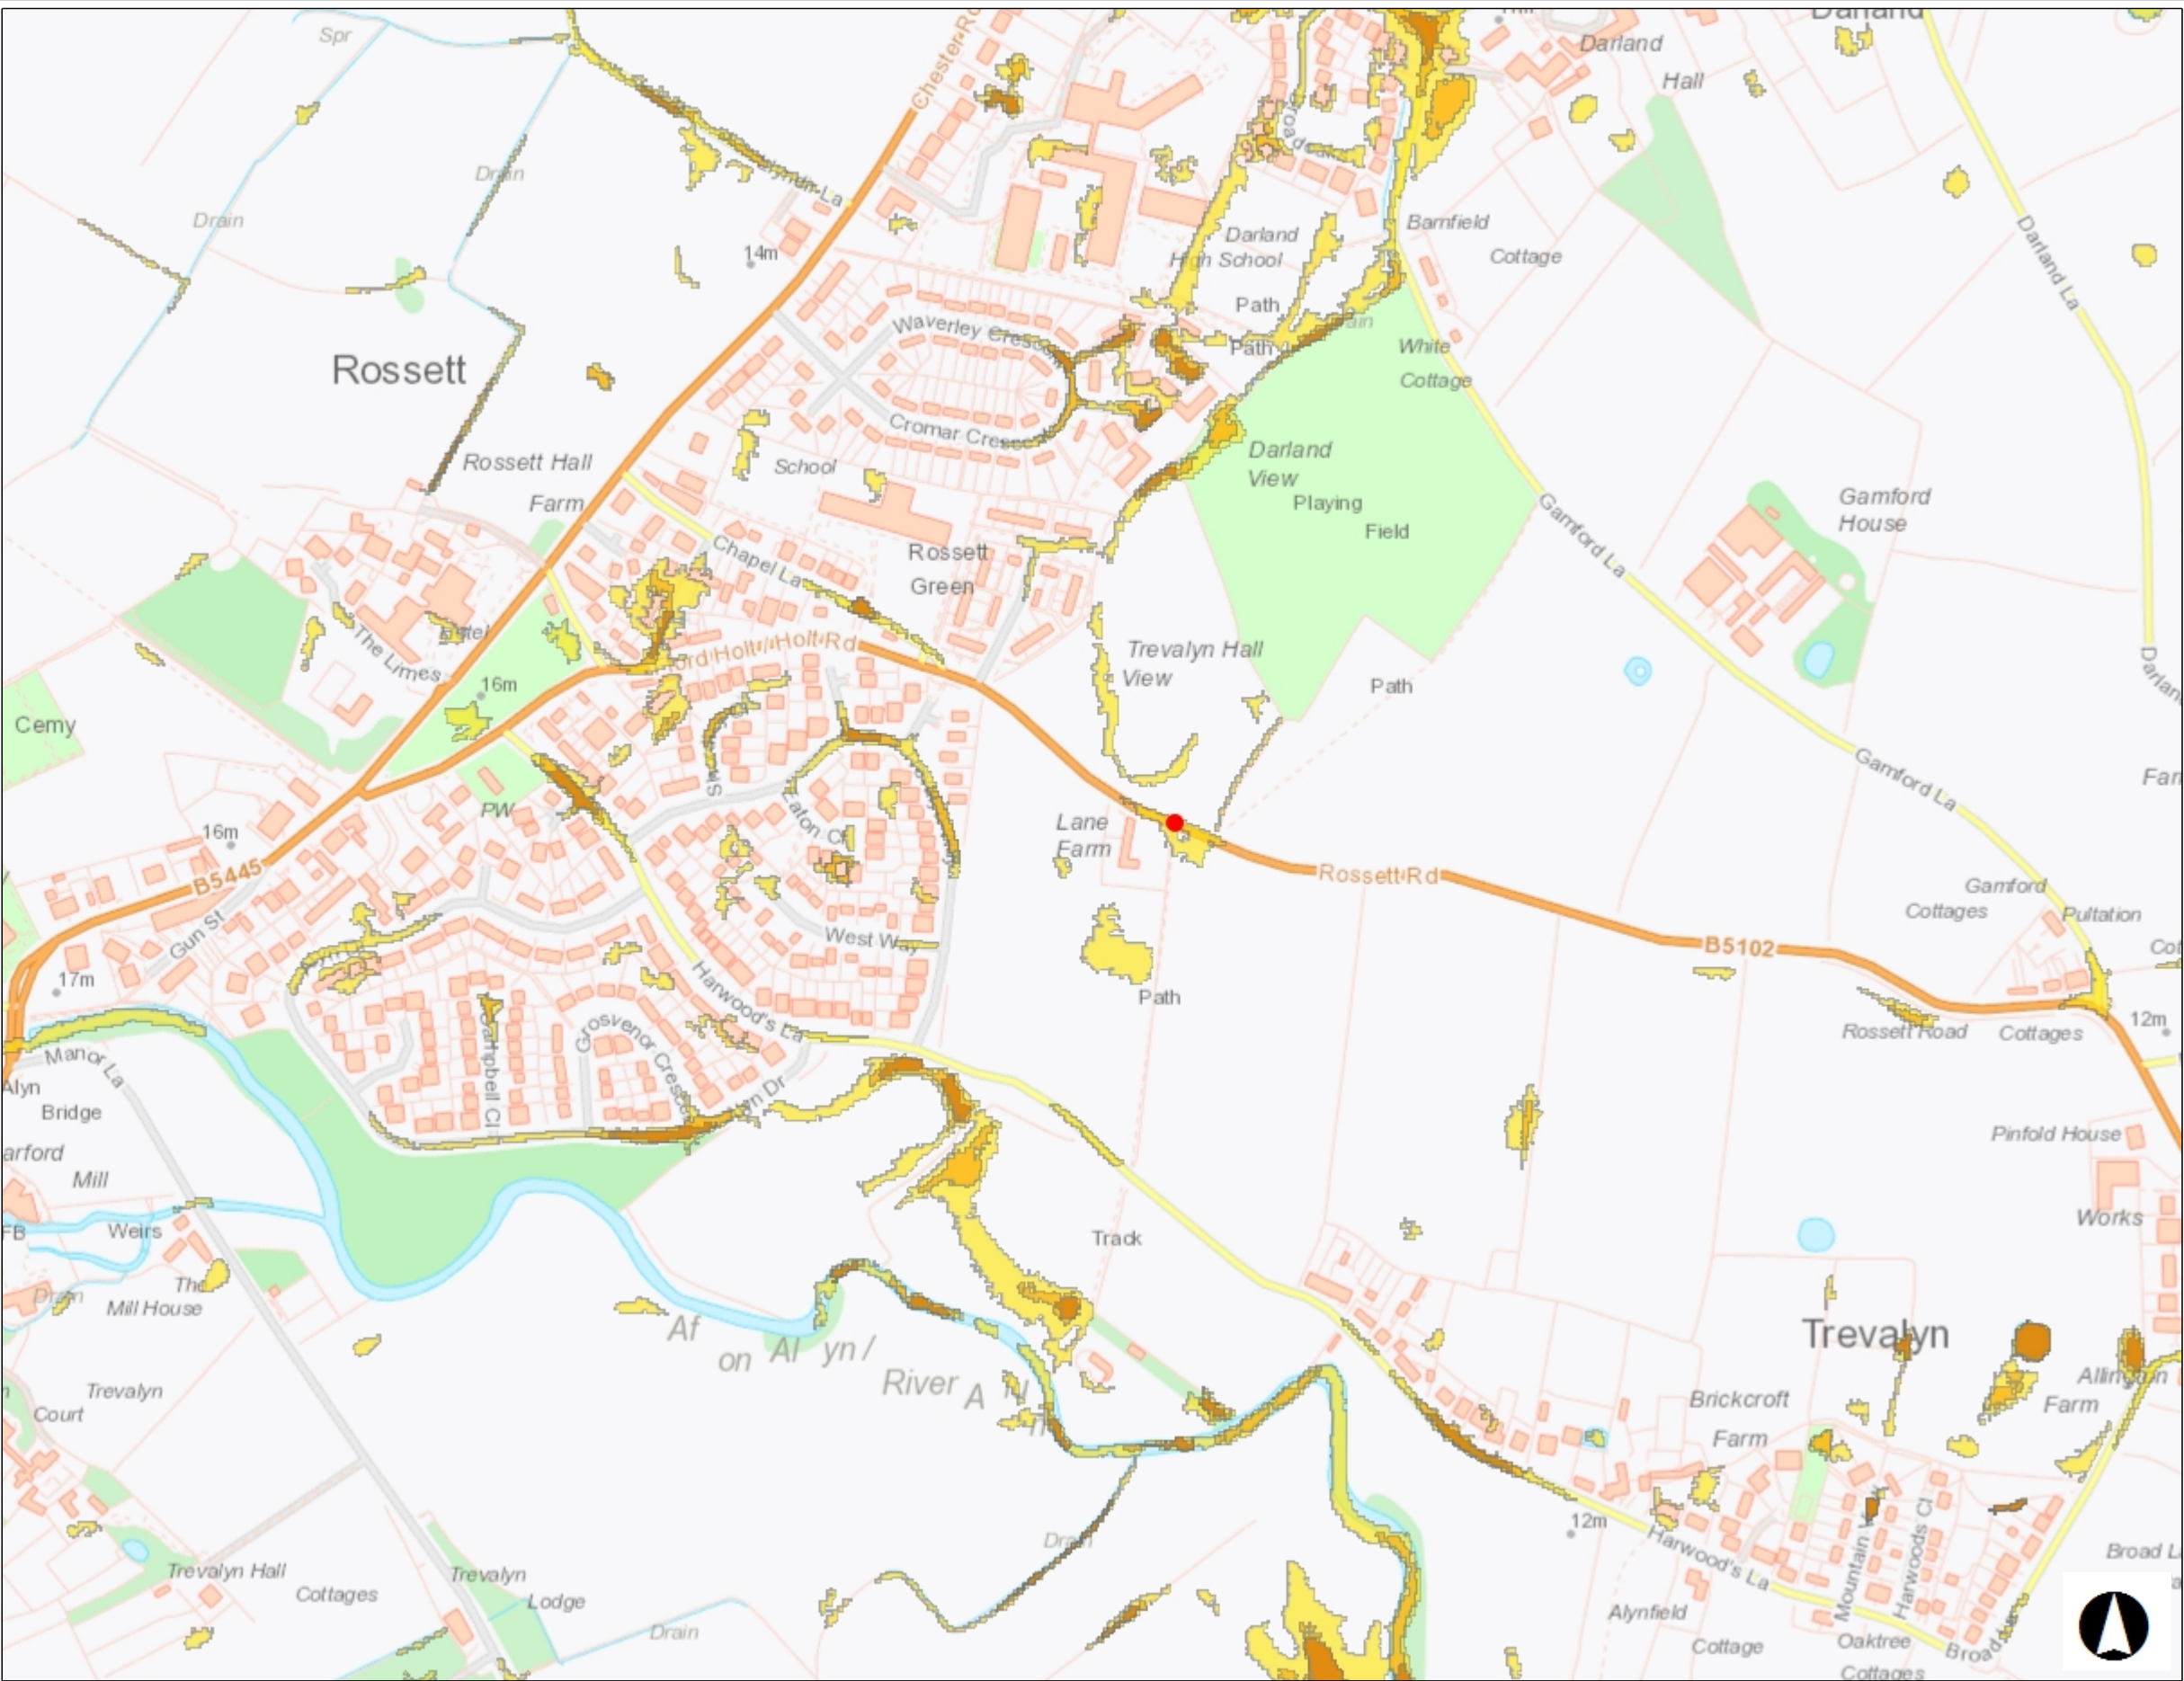

Flood Map for Surface Water

Map Perygl Llifogydd / Flood Risk Map

Allwedd / Map Key


-  High Surface Water Flood Risk - Extent
-  Medium Surface Water Flood Risk - Extent
-  Low Surface Water Flood Risk - Extent

Graddfa / Scale 1: 5,001

Dyddiad / Date
06/06/2018



Ceir rhestr lawn o delerau ac amondau yn <https://naturalresources.wales/rhybuddsafonol> neu drwy gysylltu ag ymholiadau@cyfoethnaturiolcymru.gov.uk. A full list of terms and conditions is available from the <https://naturalresources.wales/StandardNotice> or by contacting enquire@naturalresourceswales.gov.uk © Crown copyright and database rights 2017 Ordnance Survey 100019741. Geological mapping: British Geological Survey ©NERC. Centre for Ecology & Hydrology © NERC (CEH). Defra and Met Office © Crown copyright. © Cranfield University. © James Hutton Institute. Land & Property Services © Crown copyright and database right.

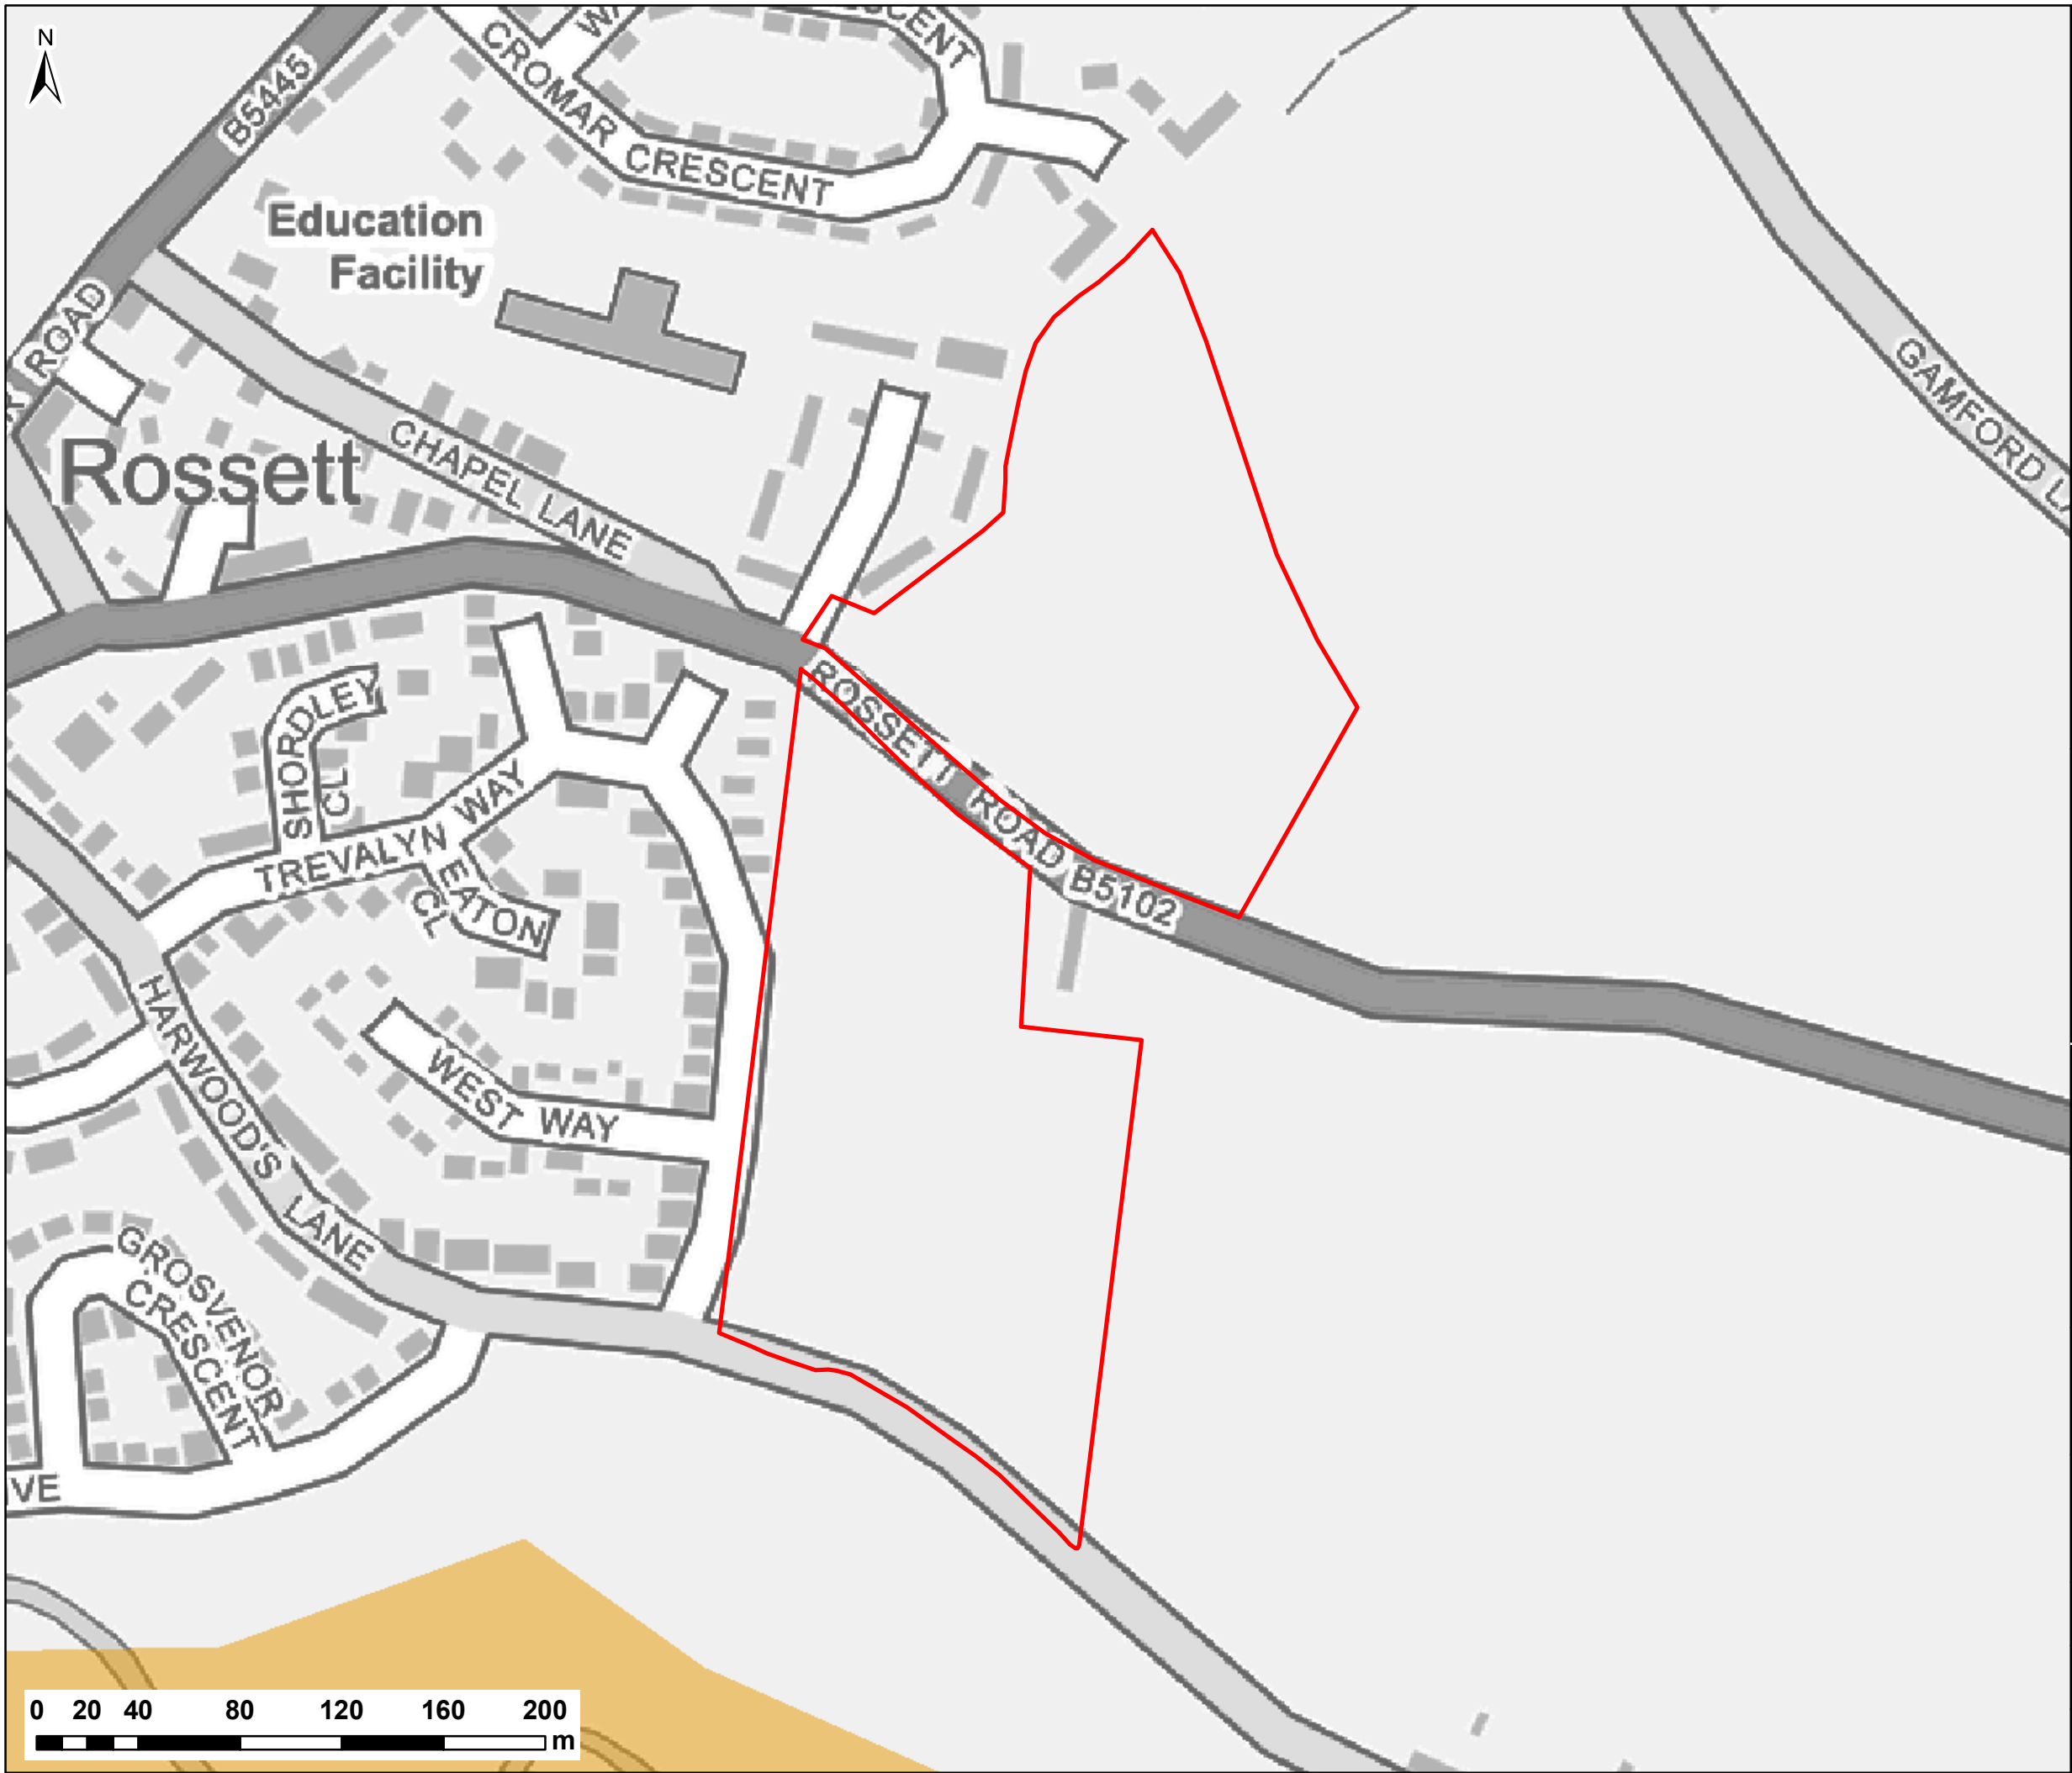

NOTES:
1) ALL DIMENSIONS ARE IN METRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS STATED OTHERWISE

LEGEND

- Site Boundary
- NRW Historic Flood Map



CLIENT:

BELLIS BROTHERS LTD



www.waterco.co.uk

SCHEME:

**LAND OFF HALT ROAD,
ROSSETT**

PLOT TITLE:

NRW HISTORIC FLOOD MAP

PLOT STATUS:

FINAL

DATE:

06/06/2018

DRAWN:

HW

CHECKED:

AW

APPROVED:

VG

PLOT SCALE @ A3:

1:2,500

(UNLESS STATED OTHERWISE)

PLOT NAME:

w10685-EA_HIS

REV:

-

Appendix E Consultation

Mr Harri Williams
Waterco Consultants
Eden Court
Lon Parcwr Business Park
Ruthin
Denbighshire
LL15 1NJ

Date: 25/05/2018
Our Ref: PPA0003089

Dear Mr Williams

Grid Ref: 337319 357262
Site Address: Land off Holt Road, Rossett
Development: Residential development – 132 units

I refer to your pre-planning enquiry received relating to the above site, seeking our views on the capacity of our network of assets and infrastructure to accommodate your proposed development. Having reviewed the details submitted I can provide the following comments which should be taken into account within any future planning application for the development.

SEWERAGE

The foul flows only from the proposed development can be accommodated within the public sewerage system. We advise that the flows should be taken to the foul sewer at or beyond manhole SJ37572301 within Holt Road/Rossett Road.

Should a planning application be submitted for this development we will seek to control these points of communication via appropriate planning conditions and therefore recommend that any drainage layout or strategy submitted as part of your application takes this into account.

However, should you wish for an alternative connection point to be considered please provide further information to us in the form of a drainage strategy, preferably in advance of a planning application being submitted.

SURFACE WATER

With reference to the surface water flows from the proposed development, you are required to fully exhaust all technical options outlined under Sections 3.2 and 3.4 of Part H of the publication 'Building Regulations 2000; Disposal should be made through the hierarchical approach, preferring infiltration and, where infiltration is not possible, disposal to watercourses in liaison with the Land Drainage Authority

and/or Natural Resources Wales. Discharge of surface water to the public sewer is only to be made as a last resort. Please refer to further detailed advice relating to surface water management included in our attached Advice & Guidance note.

In addition, please note that no highway or land drainage run-off will be permitted to discharge directly or indirectly into the public sewerage system.

ADVISORY

The applicant may need to apply to Dwr Cymru / Welsh Water for any connection to the public sewer under S106 of the Water Industry Act 1991. If the connection to the public sewer network is either via a lateral drain (i.e. a drain which extends beyond the connecting property boundary) or via a new sewer (i.e. serves more than one property), it is now a mandatory requirement to first enter into a Section 104 Adoption Agreement (Water Industry Act 1991). The design of the sewers and lateral drains must also conform to the Welsh Ministers Standards for Gravity Foul Sewers and Lateral Drains, and conform with the publication "Sewers for Adoption"- 7th Edition. Further information can be obtained via the Developer Services pages of www.dwrcymru.com

Some public sewers and lateral drains may not be recorded on our maps of public sewers because they were originally privately owned and were transferred into public ownership by nature of the Water Industry (Schemes for Adoption of Private Sewers) Regulations 2011. The presence of such assets may affect your proposal. In order to assist us in dealing with the proposal we request that you contact our Operations Contact Centre on 0800 085 3968 to establish the location and status of the sewer. Under the Water Industry Act 1991 Dwr Cymru Welsh Water has rights of access to its apparatus at all times.

SEWAGE TREATMENT

No problems are envisaged with the Waste Water Treatment Works for the treatment of domestic discharges from this site.

I trust the above information is helpful and will assist you in forming water and drainage strategies that should accompany any future planning application. I also attach copies of our water and sewer extract plans for the area, and a copy of our Planning Guidance Note which provides further information on our approach to the planning process, making connections to our systems and ensuring any existing public assets or infrastructure located within new development sites are protected.

Please note that our response is based on the information provided in your enquiry and should the information change we reserve the right to make a new representation. Should you have any queries or wish to discuss any aspect of our response please do not hesitate to contact our dedicated team of planning officers, either on 0800 917 2652 or via email at developer.services@dwrcymru.com

Please quote our reference number in all communications and correspondence.



Welsh Water is owned by Glas Cymru – a 'not-for-profit' company.
Mae Dwr Cymru yn eiddo i Glas Cymru – cwmni 'nid-er-elw'.

We welcome correspondence in
Welsh and English

Dŵr Cymru Cyf, a limited company registered in
Wales no 2366777. Registered office: Pentwyn Road,
Nelson, Treharris, Mid Glamorgan CF46 6LY

Rydym yn croesawu gohebiaeth yn y
Gymraeg neu yn Saesneg

Dŵr Cymru Cyf, cwmni cyfyngedig wedi'i gofrestru yng
Nghymru rhif 2366777. Swyddfa gofrestredig: Heol Pentwyn
Nelson, Treharris, Morgannwg Ganol CF46 6LY.

Yours faithfully,



Owain George
Planning Liaison Manager
Developer Services

Please Note that demands upon the water and sewerage systems change continually; consequently the information given above should be regarded as reliable for a maximum period of 12 months from the date of this letter.

Appendix F PFRA Maps

4. Historic/Past Flood Risk

All records of previous flooding incidents in WCBC were collected from the data sets listed in Chapter 3, methodology, within Table 2. These flood events came from a range of flood sources, and in many cases the source of flooding was unknown or not recorded. A summary of information specific to each source of flooding considered as part of the PFRA are included below. The locally agreed surface water information was determined by combining a number of data sets from a range of organisations as described in Table 2 Chapter 3. The figure within this Chapter show the data sets used to determine the impacts of historic flood risk.

4.1. Surface Water Flooding

Surface Water Flooding (SWF) occurs following intense rainfall which, due to the large volume of water exceeds the ability of the drainage systems to cope. Due to its sudden nature there is no lead time as is often the case with pluvial and fluvial flooding. This sudden rise in water levels can cause localised flooding, often affecting individual streets and/or properties as the drainage network is unable to cope.

Within the WCBC area this was the most prominent cause of flooding from the three sources the LLFA is required to assess. The main source of flooding was predominantly from surface water run off from paved surfaces frequently becoming an issue as the flooded property was below the level of the road surface. Insufficient drainage or blockages of the drainage system was also a major cause of this surface water runoff. Figure 3 below shows the results of both the external questionnaire, as well as the internal data collection.

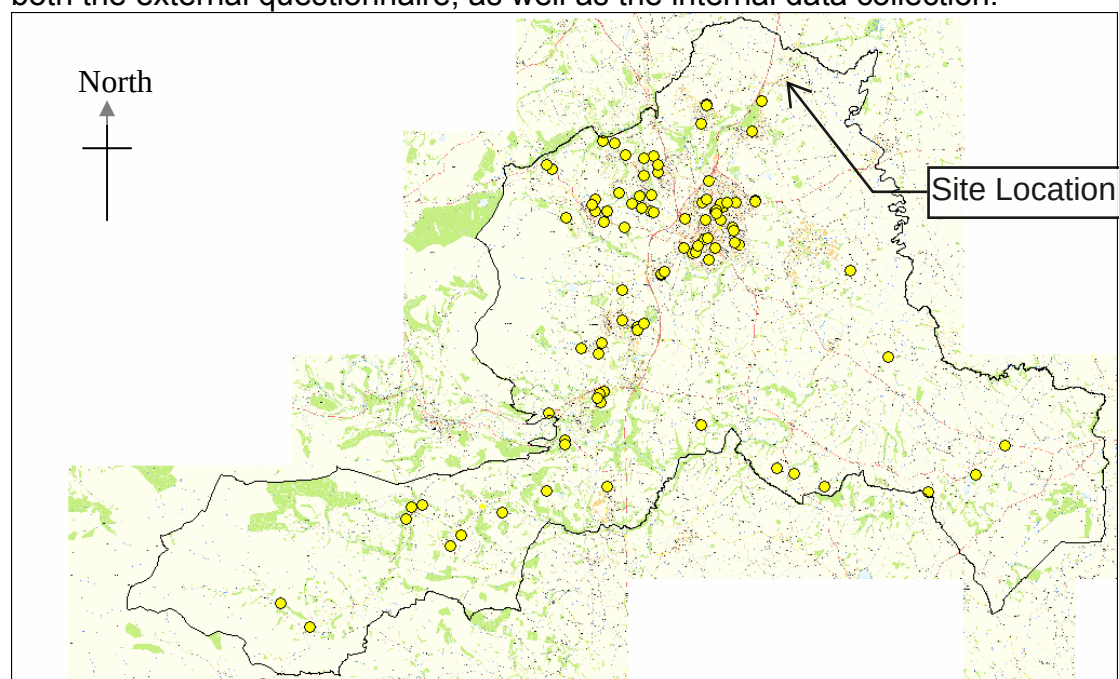


Figure 3 - Flooding Incidents within WCBC

still the case as with surface water none of the affected areas meet the requirements set by EA/WAG to be counted as an IFRA. Figure 4 below shows all sewer flooding incidents within the WCBC area over the last 10 years. This information was taken from the data set provided by WW/DC. Note that all flooding incidents in figure 4 are a combination of both internal and external flooding.

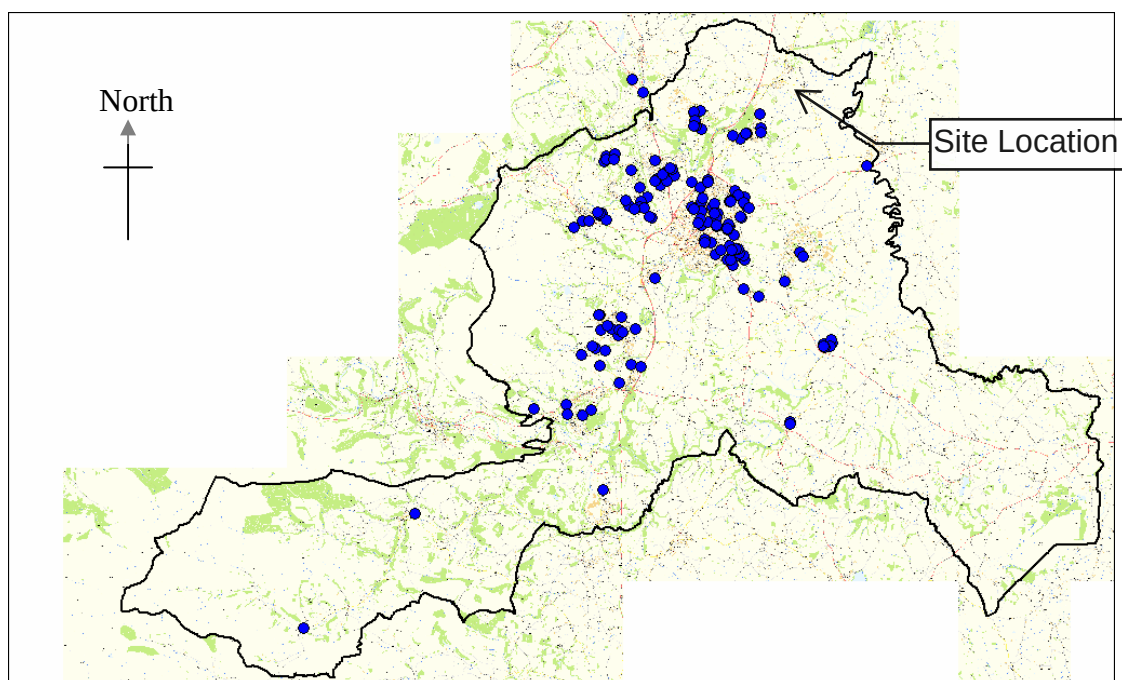


Figure 4 - Sewer Flooding Incident

4.4. Canal and Ordinary Watercourse Flooding

Information was obtained from British Waterways detailing the canal network throughout WCBC including the location of canals, weirs, sluices and locks. There are no historic records of canal overtopping or flooding issues from a canal within WCBC which meet the criteria for a significant flooding. There were a few events of canal breach/overtopping within the WCBC area which only affected rural areas and were caused by badgers burrowing under the canal in two cases. The first, in 2004, only flooded rural areas; the second in 2009 caused flooding and the evacuation of 1 property as well as causing water damage to a car. Both these incidents occurred around the village of Bettisfield. All incidents are shown on Figure 5 overleaf.

Appendix G Location of Waterlogged Area



RWB161 Rossett, Wrexham, Denbighshire
DWG 02 Magnetic Data

Orthographic Scale: 1:1500 @ A3 Spatial Units: Meter. Do not scale off this drawing
File: RWB161.map Copyright TigerGeo Limited 2016 OS OpenData Crown Copyright & Database Right 2016



Appendix H Infiltration Location Maps



Aerial Photograph

(Source: Google Maps)



NOTES

- ALL DIMENSIONS IN MILLIMETRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS SHOWN OTHERWISE.
- THIS DESIGN IS PROPOSED ON THE BASIS OF CLIENT BRIEF, SPECIFICATIONS, BEST PRACTICE AND RISK REDUCTION / ELIMINATION. THE DESIGNER MUST BE CONSULTED ON ANY PROPOSED CHANGES, BEFORE THEY ARE CONSIDERED FOR IMPLEMENTATION.

1	06-06-2018	-	HW	AW	VG
REV.	DATE	DESCRIPTION	DSGND	CHK'D	APP'D
CLIENT					
BELLIS BROTHERS LTD					
PRINCIPAL DESIGNER					
-					
					
Waterco Ltd., Eden Court, Lon Parcwr Business Park, Ruthin LL15 1NJ					
tel (+44) 1824 702220 www.waterco.co.uk					
SCHEME					
HOLT ROAD, ROSSETT					
TITLE					
TRIAL PIT DESIGNATIONS					
STATUS					
DESIGNED HW	CHECKED AW	APPROVED VG	SCALE / SHEET SIZE 1 : A3		
DRAWING NO. w10685					REV 1


Appendix I MicroDrainage Storage Estimates

Waterco Ltd			Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																				
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																				
Denbighshire LL15 1NJ		TP1 House Soakaway																																																																																																																																																																																																																				
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																				
File w10685-180523-TP1_House...		Checked by AW																																																																																																																																																																																																																				
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																				
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 98 minutes. <table><thead><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr></thead><tbody><tr><td>15 min Summer</td><td>9.535</td><td>0.535</td><td>0.2</td><td>1.5</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.677</td><td>0.677</td><td>0.2</td><td>1.9</td><td>O K</td></tr><tr><td>60 min Summer</td><td>9.779</td><td>0.779</td><td>0.3</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.816</td><td>0.816</td><td>0.3</td><td>2.3</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.818</td><td>0.818</td><td>0.3</td><td>2.3</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.805</td><td>0.805</td><td>0.3</td><td>2.3</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.763</td><td>0.763</td><td>0.3</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.715</td><td>0.715</td><td>0.3</td><td>2.0</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.669</td><td>0.669</td><td>0.2</td><td>1.9</td><td>O K</td></tr><tr><td>720 min Summer</td><td>9.628</td><td>0.628</td><td>0.2</td><td>1.8</td><td>O K</td></tr><tr><td>960 min Summer</td><td>9.560</td><td>0.560</td><td>0.2</td><td>1.6</td><td>O K</td></tr><tr><td>1440 min Summer</td><td>9.461</td><td>0.461</td><td>0.2</td><td>1.3</td><td>O K</td></tr><tr><td>2160 min Summer</td><td>9.365</td><td>0.365</td><td>0.1</td><td>1.0</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.304</td><td>0.304</td><td>0.1</td><td>0.9</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.229</td><td>0.229</td><td>0.1</td><td>0.7</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.186</td><td>0.186</td><td>0.1</td><td>0.5</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.161</td><td>0.161</td><td>0.1</td><td>0.5</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.144</td><td>0.144</td><td>0.1</td><td>0.4</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.133</td><td>0.133</td><td>0.0</td><td>0.4</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.599</td><td>0.599</td><td>0.2</td><td>1.7</td><td>O K</td></tr></tbody></table> <table><thead><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr></thead><tbody><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>30</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>56</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>86</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>120</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>154</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>222</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>288</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>354</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>418</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>540</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>792</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1164</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1528</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2248</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>2992</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3680</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4408</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5144</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>16</td></tr></tbody></table>					Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.535	0.535	0.2	1.5	O K	30 min Summer	9.677	0.677	0.2	1.9	O K	60 min Summer	9.779	0.779	0.3	2.2	Flood Risk	120 min Summer	9.816	0.816	0.3	2.3	Flood Risk	180 min Summer	9.818	0.818	0.3	2.3	Flood Risk	240 min Summer	9.805	0.805	0.3	2.3	Flood Risk	360 min Summer	9.763	0.763	0.3	2.2	Flood Risk	480 min Summer	9.715	0.715	0.3	2.0	Flood Risk	600 min Summer	9.669	0.669	0.2	1.9	O K	720 min Summer	9.628	0.628	0.2	1.8	O K	960 min Summer	9.560	0.560	0.2	1.6	O K	1440 min Summer	9.461	0.461	0.2	1.3	O K	2160 min Summer	9.365	0.365	0.1	1.0	O K	2880 min Summer	9.304	0.304	0.1	0.9	O K	4320 min Summer	9.229	0.229	0.1	0.7	O K	5760 min Summer	9.186	0.186	0.1	0.5	O K	7200 min Summer	9.161	0.161	0.1	0.5	O K	8640 min Summer	9.144	0.144	0.1	0.4	O K	10080 min Summer	9.133	0.133	0.0	0.4	O K	15 min Winter	9.599	0.599	0.2	1.7	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	30	60 min Summer	61.531	0.0	56	120 min Summer	36.920	0.0	86	180 min Summer	27.160	0.0	120	240 min Summer	21.763	0.0	154	360 min Summer	15.835	0.0	222	480 min Summer	12.539	0.0	288	600 min Summer	10.433	0.0	354	720 min Summer	8.964	0.0	418	960 min Summer	7.046	0.0	540	1440 min Summer	4.991	0.0	792	2160 min Summer	3.510	0.0	1164	2880 min Summer	2.731	0.0	1528	4320 min Summer	1.912	0.0	2248	5760 min Summer	1.496	0.0	2992	7200 min Summer	1.260	0.0	3680	8640 min Summer	1.110	0.0	4408	10080 min Summer	1.010	0.0	5144	15 min Winter	143.930	0.0	16
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																	
15 min Summer	9.535	0.535	0.2	1.5	O K																																																																																																																																																																																																																	
30 min Summer	9.677	0.677	0.2	1.9	O K																																																																																																																																																																																																																	
60 min Summer	9.779	0.779	0.3	2.2	Flood Risk																																																																																																																																																																																																																	
120 min Summer	9.816	0.816	0.3	2.3	Flood Risk																																																																																																																																																																																																																	
180 min Summer	9.818	0.818	0.3	2.3	Flood Risk																																																																																																																																																																																																																	
240 min Summer	9.805	0.805	0.3	2.3	Flood Risk																																																																																																																																																																																																																	
360 min Summer	9.763	0.763	0.3	2.2	Flood Risk																																																																																																																																																																																																																	
480 min Summer	9.715	0.715	0.3	2.0	Flood Risk																																																																																																																																																																																																																	
600 min Summer	9.669	0.669	0.2	1.9	O K																																																																																																																																																																																																																	
720 min Summer	9.628	0.628	0.2	1.8	O K																																																																																																																																																																																																																	
960 min Summer	9.560	0.560	0.2	1.6	O K																																																																																																																																																																																																																	
1440 min Summer	9.461	0.461	0.2	1.3	O K																																																																																																																																																																																																																	
2160 min Summer	9.365	0.365	0.1	1.0	O K																																																																																																																																																																																																																	
2880 min Summer	9.304	0.304	0.1	0.9	O K																																																																																																																																																																																																																	
4320 min Summer	9.229	0.229	0.1	0.7	O K																																																																																																																																																																																																																	
5760 min Summer	9.186	0.186	0.1	0.5	O K																																																																																																																																																																																																																	
7200 min Summer	9.161	0.161	0.1	0.5	O K																																																																																																																																																																																																																	
8640 min Summer	9.144	0.144	0.1	0.4	O K																																																																																																																																																																																																																	
10080 min Summer	9.133	0.133	0.0	0.4	O K																																																																																																																																																																																																																	
15 min Winter	9.599	0.599	0.2	1.7	O K																																																																																																																																																																																																																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																			
15 min Summer	143.930	0.0	16																																																																																																																																																																																																																			
30 min Summer	96.151	0.0	30																																																																																																																																																																																																																			
60 min Summer	61.531	0.0	56																																																																																																																																																																																																																			
120 min Summer	36.920	0.0	86																																																																																																																																																																																																																			
180 min Summer	27.160	0.0	120																																																																																																																																																																																																																			
240 min Summer	21.763	0.0	154																																																																																																																																																																																																																			
360 min Summer	15.835	0.0	222																																																																																																																																																																																																																			
480 min Summer	12.539	0.0	288																																																																																																																																																																																																																			
600 min Summer	10.433	0.0	354																																																																																																																																																																																																																			
720 min Summer	8.964	0.0	418																																																																																																																																																																																																																			
960 min Summer	7.046	0.0	540																																																																																																																																																																																																																			
1440 min Summer	4.991	0.0	792																																																																																																																																																																																																																			
2160 min Summer	3.510	0.0	1164																																																																																																																																																																																																																			
2880 min Summer	2.731	0.0	1528																																																																																																																																																																																																																			
4320 min Summer	1.912	0.0	2248																																																																																																																																																																																																																			
5760 min Summer	1.496	0.0	2992																																																																																																																																																																																																																			
7200 min Summer	1.260	0.0	3680																																																																																																																																																																																																																			
8640 min Summer	1.110	0.0	4408																																																																																																																																																																																																																			
10080 min Summer	1.010	0.0	5144																																																																																																																																																																																																																			
15 min Winter	143.930	0.0	16																																																																																																																																																																																																																			
©1982-2018 Innovyze																																																																																																																																																																																																																						


Waterco Ltd				Page 2	
Eden Court		w10685			
Lon Parcwr Business Park		Holt Road, Rossett			
Denbighshire LL15 1NJ		TP1 House Soakaway			
Date 23/05/2018		Designed by HW			
File w10685-180523-TP1_House...		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.761	0.761	0.3	2.2	Flood Risk
60 min Winter	9.879	0.879	0.3	2.5	Flood Risk
120 min Winter	9.909	0.909	0.3	2.6	Flood Risk
180 min Winter	9.897	0.897	0.3	2.6	Flood Risk
240 min Winter	9.869	0.869	0.3	2.5	Flood Risk
360 min Winter	9.801	0.801	0.3	2.3	Flood Risk
480 min Winter	9.732	0.732	0.3	2.1	Flood Risk
600 min Winter	9.670	0.670	0.2	1.9	O K
720 min Winter	9.617	0.617	0.2	1.8	O K
960 min Winter	9.533	0.533	0.2	1.5	O K
1440 min Winter	9.417	0.417	0.1	1.2	O K
2160 min Winter	9.314	0.314	0.1	0.9	O K
2880 min Winter	9.252	0.252	0.1	0.7	O K
4320 min Winter	9.182	0.182	0.1	0.5	O K
5760 min Winter	9.144	0.144	0.1	0.4	O K
7200 min Winter	9.122	0.122	0.0	0.3	O K
8640 min Winter	9.108	0.108	0.0	0.3	O K
10080 min Winter	9.099	0.099	0.0	0.3	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	30		
60 min Winter	61.531	0.0	58		
120 min Winter	36.920	0.0	90		
180 min Winter	27.160	0.0	128		
240 min Winter	21.763	0.0	166		
360 min Winter	15.835	0.0	236		
480 min Winter	12.539	0.0	304		
600 min Winter	10.433	0.0	372		
720 min Winter	8.964	0.0	438		
960 min Winter	7.046	0.0	566		
1440 min Winter	4.991	0.0	820		
2160 min Winter	3.510	0.0	1188		
2880 min Winter	2.731	0.0	1556		
4320 min Winter	1.912	0.0	2288		
5760 min Winter	1.496	0.0	3000		
7200 min Winter	1.260	0.0	3744		
8640 min Winter	1.110	0.0	4416		
10080 min Winter	1.010	0.0	5144		
©1982-2018 Innovyze					

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP1 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP1_House...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>1.5</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.37008</td> <td>Trench Length (m)</td> <td>2.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.000</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5	Infiltration Coefficient Side (m/hr)	0.37008	Trench Length (m)	2.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5																			
Infiltration Coefficient Side (m/hr)	0.37008	Trench Length (m)	2.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						


Waterco Ltd		Page 5
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP1 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP1_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

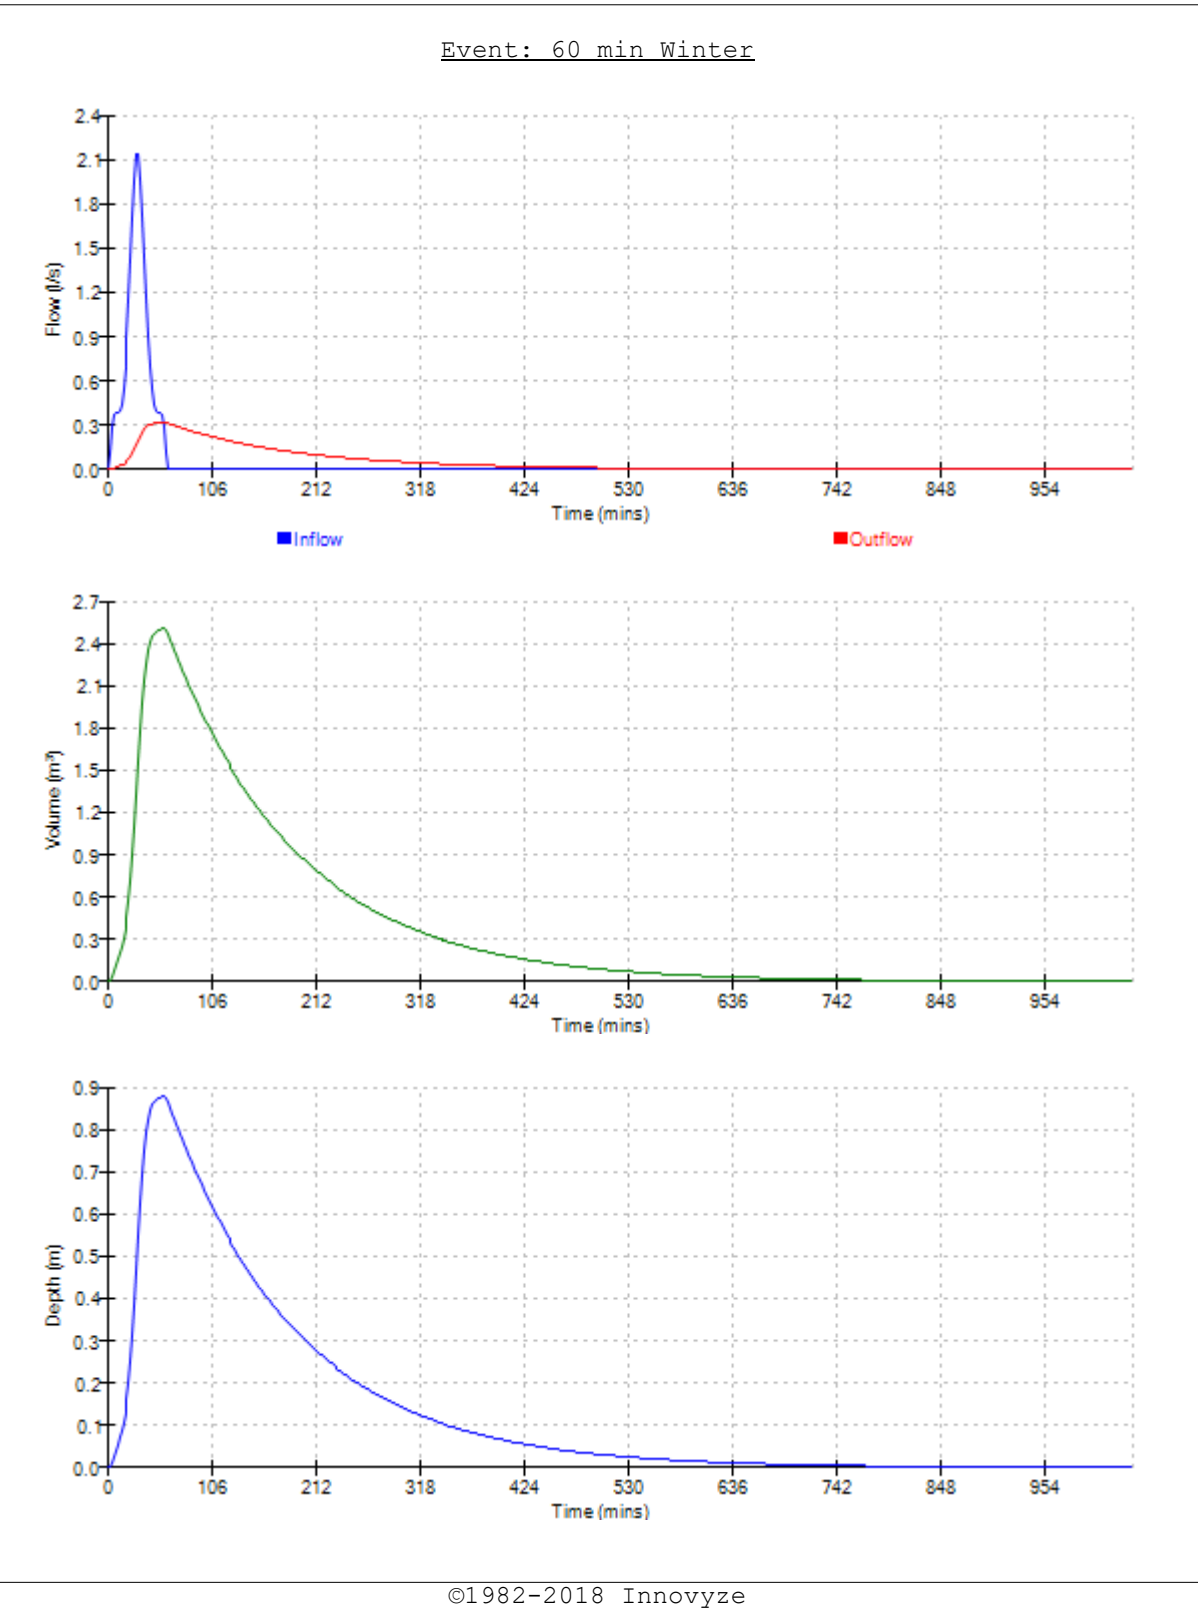

Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP1 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP1_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

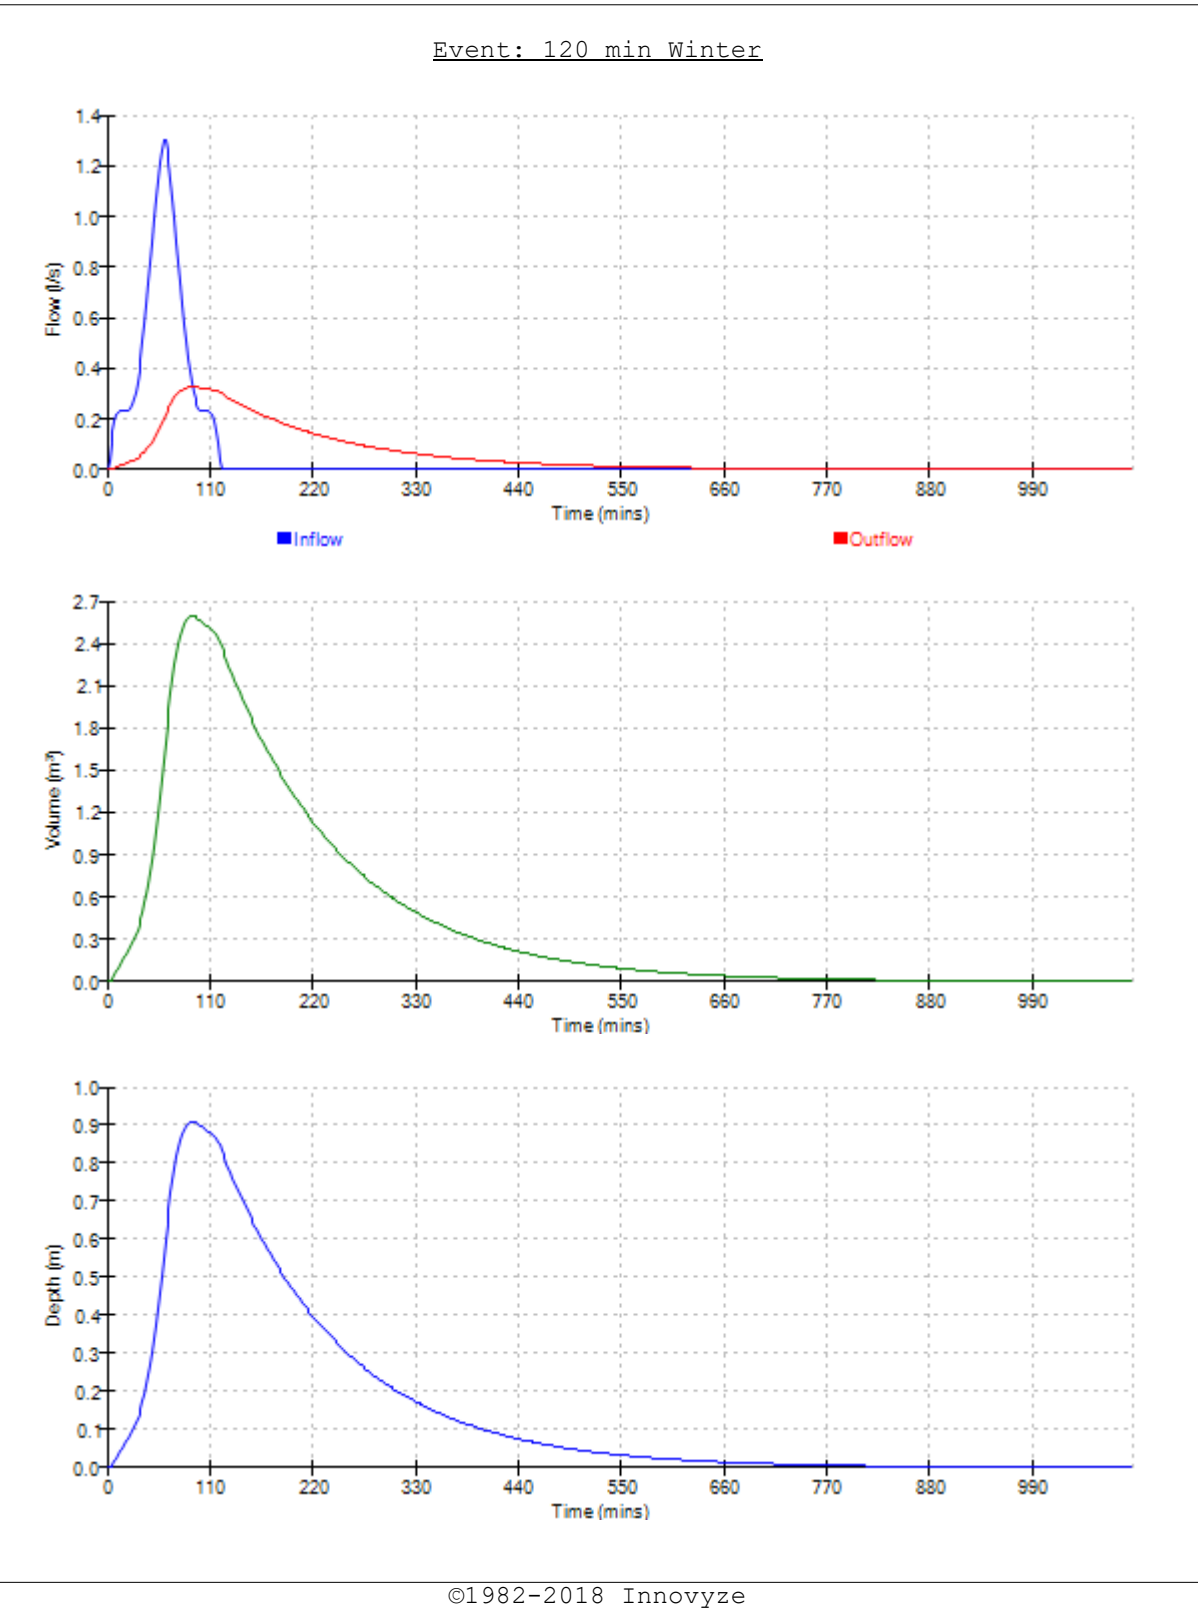

Waterco Ltd		Page 7
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP1 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP1_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

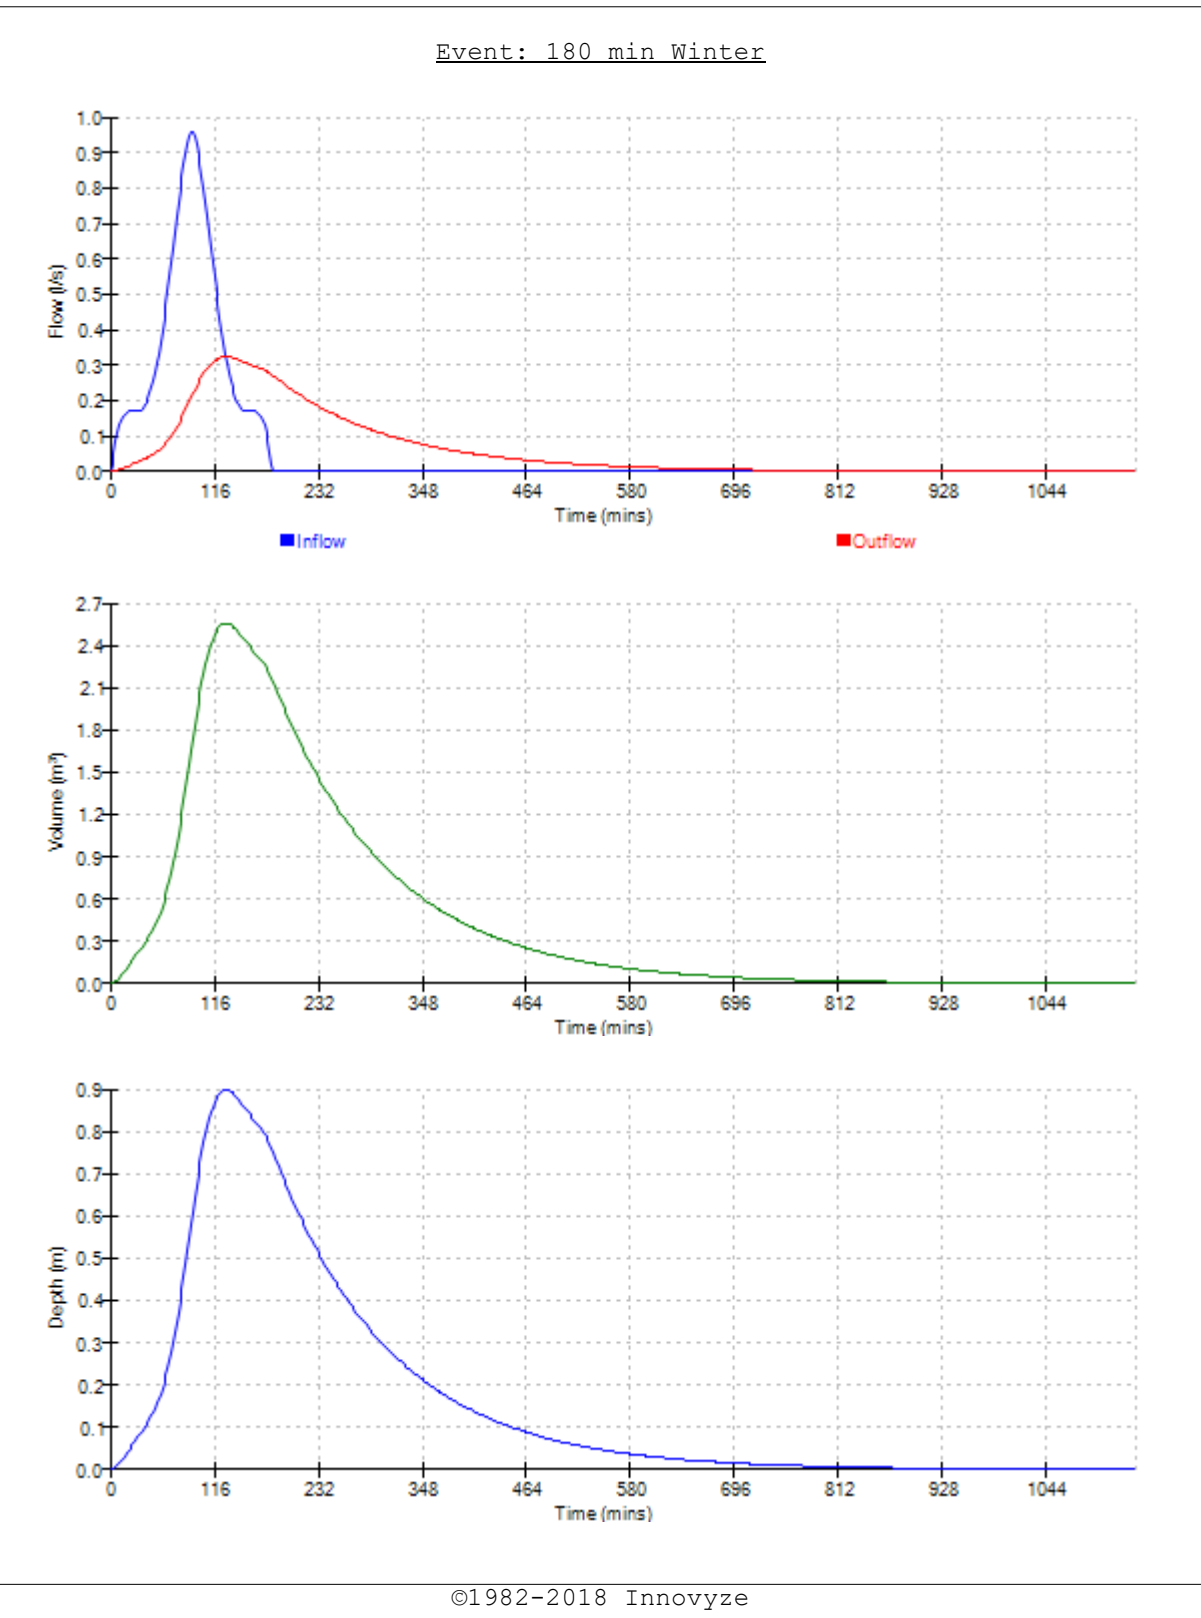


Waterco Ltd			Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																				
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																				
Denbighshire LL15 1NJ		TP2 House Soakaway																																																																																																																																																																																																																				
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																				
File w10685-180523-TP2_House...		Checked by AW																																																																																																																																																																																																																				
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																				
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 167 minutes. <table><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr><tr><td>15 min Summer</td><td>9.613</td><td>0.413</td><td>0.1</td><td>1.6</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.735</td><td>0.535</td><td>0.1</td><td>2.0</td><td>Flood Risk</td></tr><tr><td>60 min Summer</td><td>9.845</td><td>0.645</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.893</td><td>0.693</td><td>0.2</td><td>2.6</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.908</td><td>0.708</td><td>0.2</td><td>2.7</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.913</td><td>0.713</td><td>0.2</td><td>2.7</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.905</td><td>0.705</td><td>0.2</td><td>2.7</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.883</td><td>0.683</td><td>0.2</td><td>2.6</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.859</td><td>0.659</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>720 min Summer</td><td>9.834</td><td>0.634</td><td>0.2</td><td>2.4</td><td>Flood Risk</td></tr><tr><td>960 min Summer</td><td>9.787</td><td>0.587</td><td>0.1</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>1440 min Summer</td><td>9.708</td><td>0.508</td><td>0.1</td><td>1.9</td><td>Flood Risk</td></tr><tr><td>2160 min Summer</td><td>9.623</td><td>0.423</td><td>0.1</td><td>1.6</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.563</td><td>0.363</td><td>0.1</td><td>1.4</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.486</td><td>0.286</td><td>0.1</td><td>1.1</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.438</td><td>0.238</td><td>0.1</td><td>0.9</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.410</td><td>0.210</td><td>0.1</td><td>0.8</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.390</td><td>0.190</td><td>0.0</td><td>0.7</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.376</td><td>0.176</td><td>0.0</td><td>0.7</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.662</td><td>0.462</td><td>0.1</td><td>1.8</td><td>O K</td></tr></table> <table><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>31</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>60</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>106</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>136</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>168</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>236</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>306</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>374</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>440</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>576</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>834</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1208</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1584</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2296</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>3048</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3752</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4496</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5240</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>16</td></tr></table>					Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.613	0.413	0.1	1.6	O K	30 min Summer	9.735	0.535	0.1	2.0	Flood Risk	60 min Summer	9.845	0.645	0.2	2.5	Flood Risk	120 min Summer	9.893	0.693	0.2	2.6	Flood Risk	180 min Summer	9.908	0.708	0.2	2.7	Flood Risk	240 min Summer	9.913	0.713	0.2	2.7	Flood Risk	360 min Summer	9.905	0.705	0.2	2.7	Flood Risk	480 min Summer	9.883	0.683	0.2	2.6	Flood Risk	600 min Summer	9.859	0.659	0.2	2.5	Flood Risk	720 min Summer	9.834	0.634	0.2	2.4	Flood Risk	960 min Summer	9.787	0.587	0.1	2.2	Flood Risk	1440 min Summer	9.708	0.508	0.1	1.9	Flood Risk	2160 min Summer	9.623	0.423	0.1	1.6	O K	2880 min Summer	9.563	0.363	0.1	1.4	O K	4320 min Summer	9.486	0.286	0.1	1.1	O K	5760 min Summer	9.438	0.238	0.1	0.9	O K	7200 min Summer	9.410	0.210	0.1	0.8	O K	8640 min Summer	9.390	0.190	0.0	0.7	O K	10080 min Summer	9.376	0.176	0.0	0.7	O K	15 min Winter	9.662	0.462	0.1	1.8	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	31	60 min Summer	61.531	0.0	60	120 min Summer	36.920	0.0	106	180 min Summer	27.160	0.0	136	240 min Summer	21.763	0.0	168	360 min Summer	15.835	0.0	236	480 min Summer	12.539	0.0	306	600 min Summer	10.433	0.0	374	720 min Summer	8.964	0.0	440	960 min Summer	7.046	0.0	576	1440 min Summer	4.991	0.0	834	2160 min Summer	3.510	0.0	1208	2880 min Summer	2.731	0.0	1584	4320 min Summer	1.912	0.0	2296	5760 min Summer	1.496	0.0	3048	7200 min Summer	1.260	0.0	3752	8640 min Summer	1.110	0.0	4496	10080 min Summer	1.010	0.0	5240	15 min Winter	143.930	0.0	16
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																	
15 min Summer	9.613	0.413	0.1	1.6	O K																																																																																																																																																																																																																	
30 min Summer	9.735	0.535	0.1	2.0	Flood Risk																																																																																																																																																																																																																	
60 min Summer	9.845	0.645	0.2	2.5	Flood Risk																																																																																																																																																																																																																	
120 min Summer	9.893	0.693	0.2	2.6	Flood Risk																																																																																																																																																																																																																	
180 min Summer	9.908	0.708	0.2	2.7	Flood Risk																																																																																																																																																																																																																	
240 min Summer	9.913	0.713	0.2	2.7	Flood Risk																																																																																																																																																																																																																	
360 min Summer	9.905	0.705	0.2	2.7	Flood Risk																																																																																																																																																																																																																	
480 min Summer	9.883	0.683	0.2	2.6	Flood Risk																																																																																																																																																																																																																	
600 min Summer	9.859	0.659	0.2	2.5	Flood Risk																																																																																																																																																																																																																	
720 min Summer	9.834	0.634	0.2	2.4	Flood Risk																																																																																																																																																																																																																	
960 min Summer	9.787	0.587	0.1	2.2	Flood Risk																																																																																																																																																																																																																	
1440 min Summer	9.708	0.508	0.1	1.9	Flood Risk																																																																																																																																																																																																																	
2160 min Summer	9.623	0.423	0.1	1.6	O K																																																																																																																																																																																																																	
2880 min Summer	9.563	0.363	0.1	1.4	O K																																																																																																																																																																																																																	
4320 min Summer	9.486	0.286	0.1	1.1	O K																																																																																																																																																																																																																	
5760 min Summer	9.438	0.238	0.1	0.9	O K																																																																																																																																																																																																																	
7200 min Summer	9.410	0.210	0.1	0.8	O K																																																																																																																																																																																																																	
8640 min Summer	9.390	0.190	0.0	0.7	O K																																																																																																																																																																																																																	
10080 min Summer	9.376	0.176	0.0	0.7	O K																																																																																																																																																																																																																	
15 min Winter	9.662	0.462	0.1	1.8	O K																																																																																																																																																																																																																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																			
15 min Summer	143.930	0.0	16																																																																																																																																																																																																																			
30 min Summer	96.151	0.0	31																																																																																																																																																																																																																			
60 min Summer	61.531	0.0	60																																																																																																																																																																																																																			
120 min Summer	36.920	0.0	106																																																																																																																																																																																																																			
180 min Summer	27.160	0.0	136																																																																																																																																																																																																																			
240 min Summer	21.763	0.0	168																																																																																																																																																																																																																			
360 min Summer	15.835	0.0	236																																																																																																																																																																																																																			
480 min Summer	12.539	0.0	306																																																																																																																																																																																																																			
600 min Summer	10.433	0.0	374																																																																																																																																																																																																																			
720 min Summer	8.964	0.0	440																																																																																																																																																																																																																			
960 min Summer	7.046	0.0	576																																																																																																																																																																																																																			
1440 min Summer	4.991	0.0	834																																																																																																																																																																																																																			
2160 min Summer	3.510	0.0	1208																																																																																																																																																																																																																			
2880 min Summer	2.731	0.0	1584																																																																																																																																																																																																																			
4320 min Summer	1.912	0.0	2296																																																																																																																																																																																																																			
5760 min Summer	1.496	0.0	3048																																																																																																																																																																																																																			
7200 min Summer	1.260	0.0	3752																																																																																																																																																																																																																			
8640 min Summer	1.110	0.0	4496																																																																																																																																																																																																																			
10080 min Summer	1.010	0.0	5240																																																																																																																																																																																																																			
15 min Winter	143.930	0.0	16																																																																																																																																																																																																																			
©1982-2018 Innovyze																																																																																																																																																																																																																						


Waterco Ltd				Page 2	
Eden Court		w10685			
Lon Parcwr Business Park		Holt Road, Rossett			
Denbighshire LL15 1NJ		TP2 House Soakaway			
Date 23/05/2018		Designed by HW			
File w10685-180523-TP2_House...		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.800	0.600	0.2	2.3	Flood Risk
60 min Winter	9.925	0.725	0.2	2.8	Flood Risk
120 min Winter	9.983	0.783	0.2	3.0	Flood Risk
180 min Winter	9.993	0.793	0.2	3.0	Flood Risk
240 min Winter	9.993	0.793	0.2	3.0	Flood Risk
360 min Winter	9.971	0.771	0.2	2.9	Flood Risk
480 min Winter	9.935	0.735	0.2	2.8	Flood Risk
600 min Winter	9.897	0.697	0.2	2.7	Flood Risk
720 min Winter	9.861	0.661	0.2	2.5	Flood Risk
960 min Winter	9.797	0.597	0.2	2.3	Flood Risk
1440 min Winter	9.697	0.497	0.1	1.9	O K
2160 min Winter	9.594	0.394	0.1	1.5	O K
2880 min Winter	9.526	0.326	0.1	1.2	O K
4320 min Winter	9.444	0.244	0.1	0.9	O K
5760 min Winter	9.396	0.196	0.0	0.7	O K
7200 min Winter	9.368	0.168	0.0	0.6	O K
8640 min Winter	9.350	0.150	0.0	0.6	O K
10080 min Winter	9.337	0.137	0.0	0.5	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	30		
60 min Winter	61.531	0.0	60		
120 min Winter	36.920	0.0	114		
180 min Winter	27.160	0.0	140		
240 min Winter	21.763	0.0	180		
360 min Winter	15.835	0.0	254		
480 min Winter	12.539	0.0	328		
600 min Winter	10.433	0.0	398		
720 min Winter	8.964	0.0	468		
960 min Winter	7.046	0.0	606		
1440 min Winter	4.991	0.0	866		
2160 min Winter	3.510	0.0	1252		
2880 min Winter	2.731	0.0	1616		
4320 min Winter	1.912	0.0	2376		
5760 min Winter	1.496	0.0	3104		
7200 min Winter	1.260	0.0	3816		
8640 min Winter	1.110	0.0	4504		
10080 min Winter	1.010	0.0	5248		
©1982-2018 Innovyze					

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP2 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP2_House...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>2.0</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.22878</td> <td>Trench Length (m)</td> <td>2.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.200</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0	Infiltration Coefficient Side (m/hr)	0.22878	Trench Length (m)	2.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.200	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0																			
Infiltration Coefficient Side (m/hr)	0.22878	Trench Length (m)	2.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.200	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						


Waterco Ltd		Page 5
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP2 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP2_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

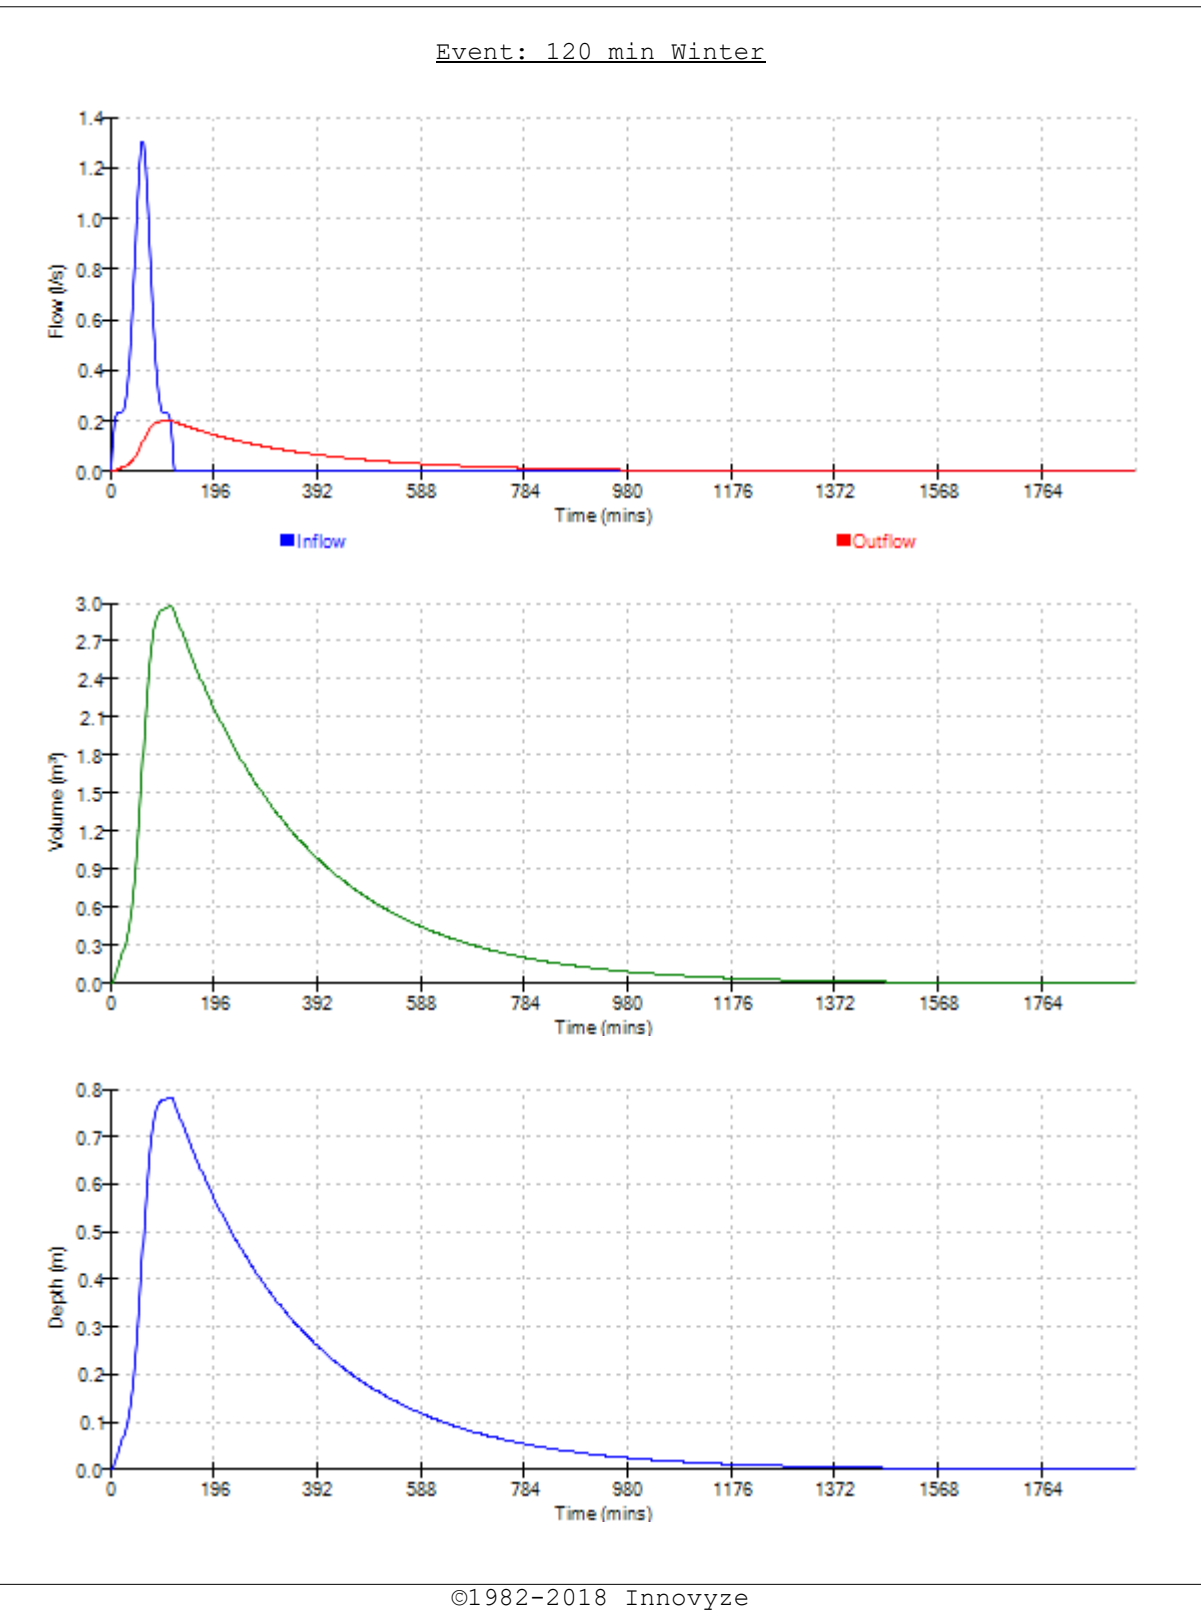

Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP2 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP2_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

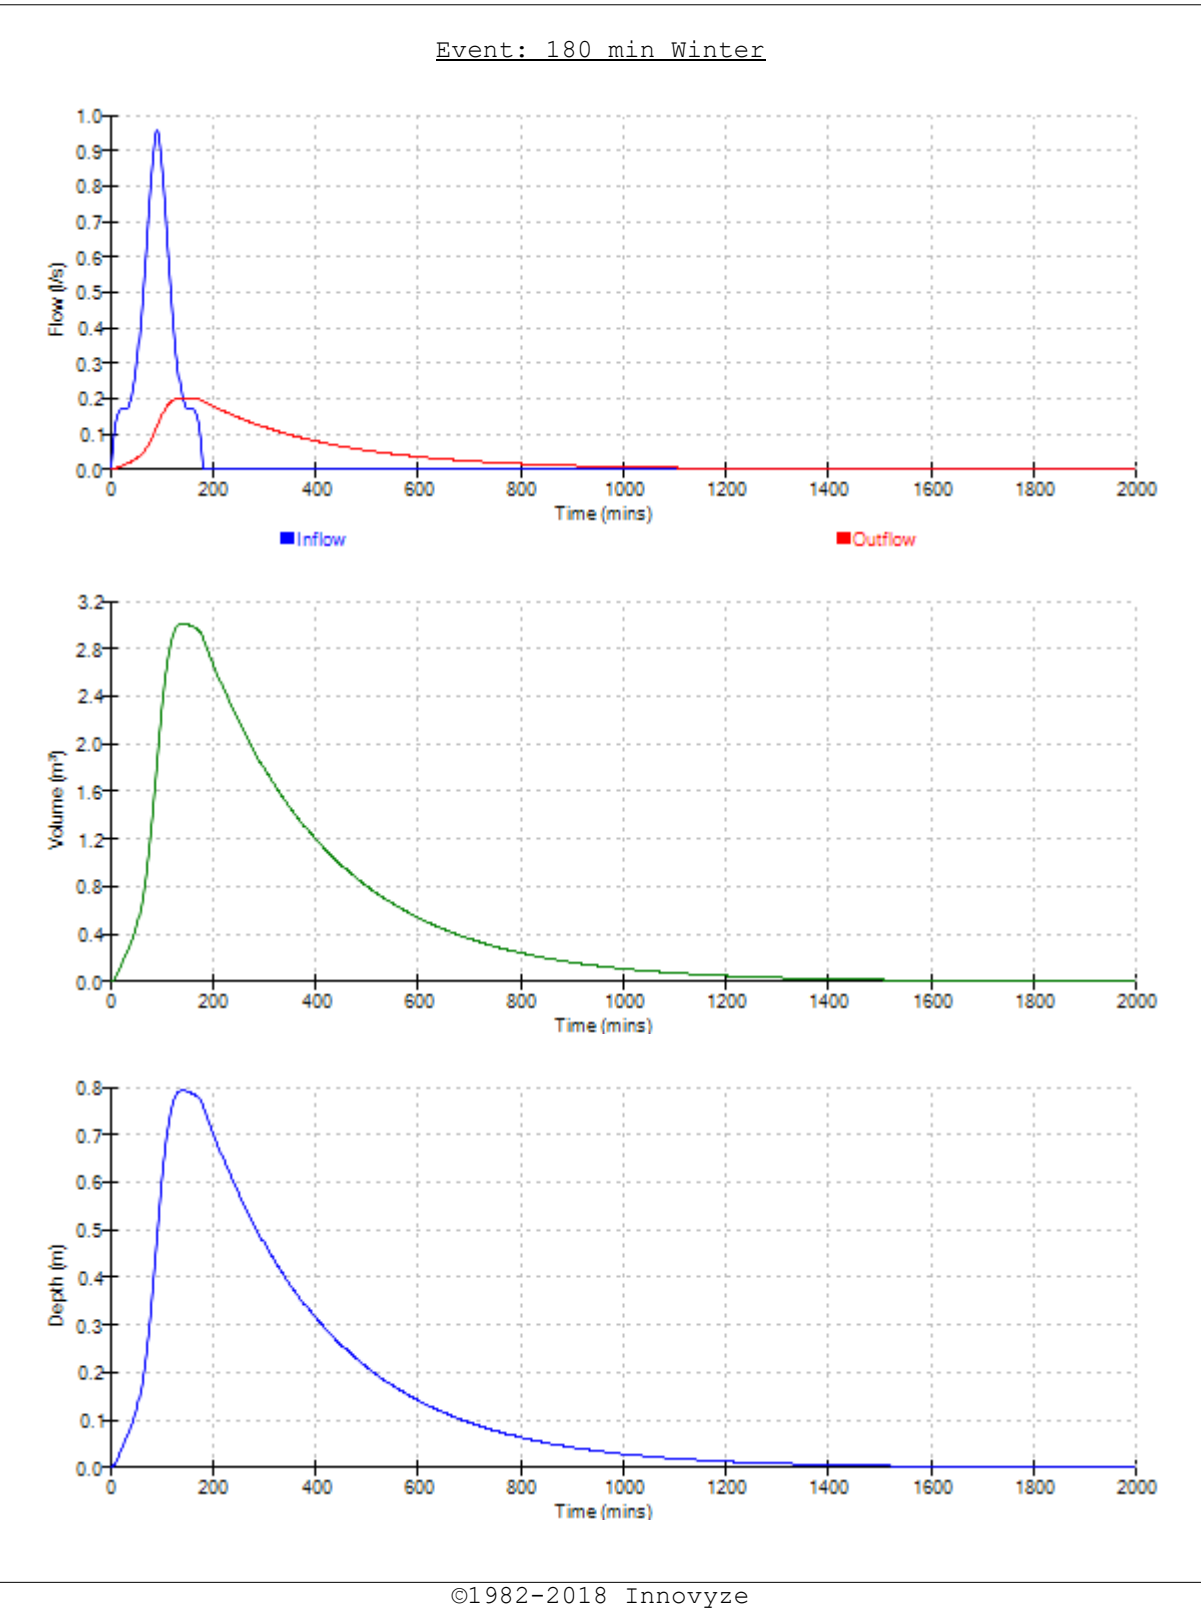

Waterco Ltd		Page 7
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP2 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP2_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

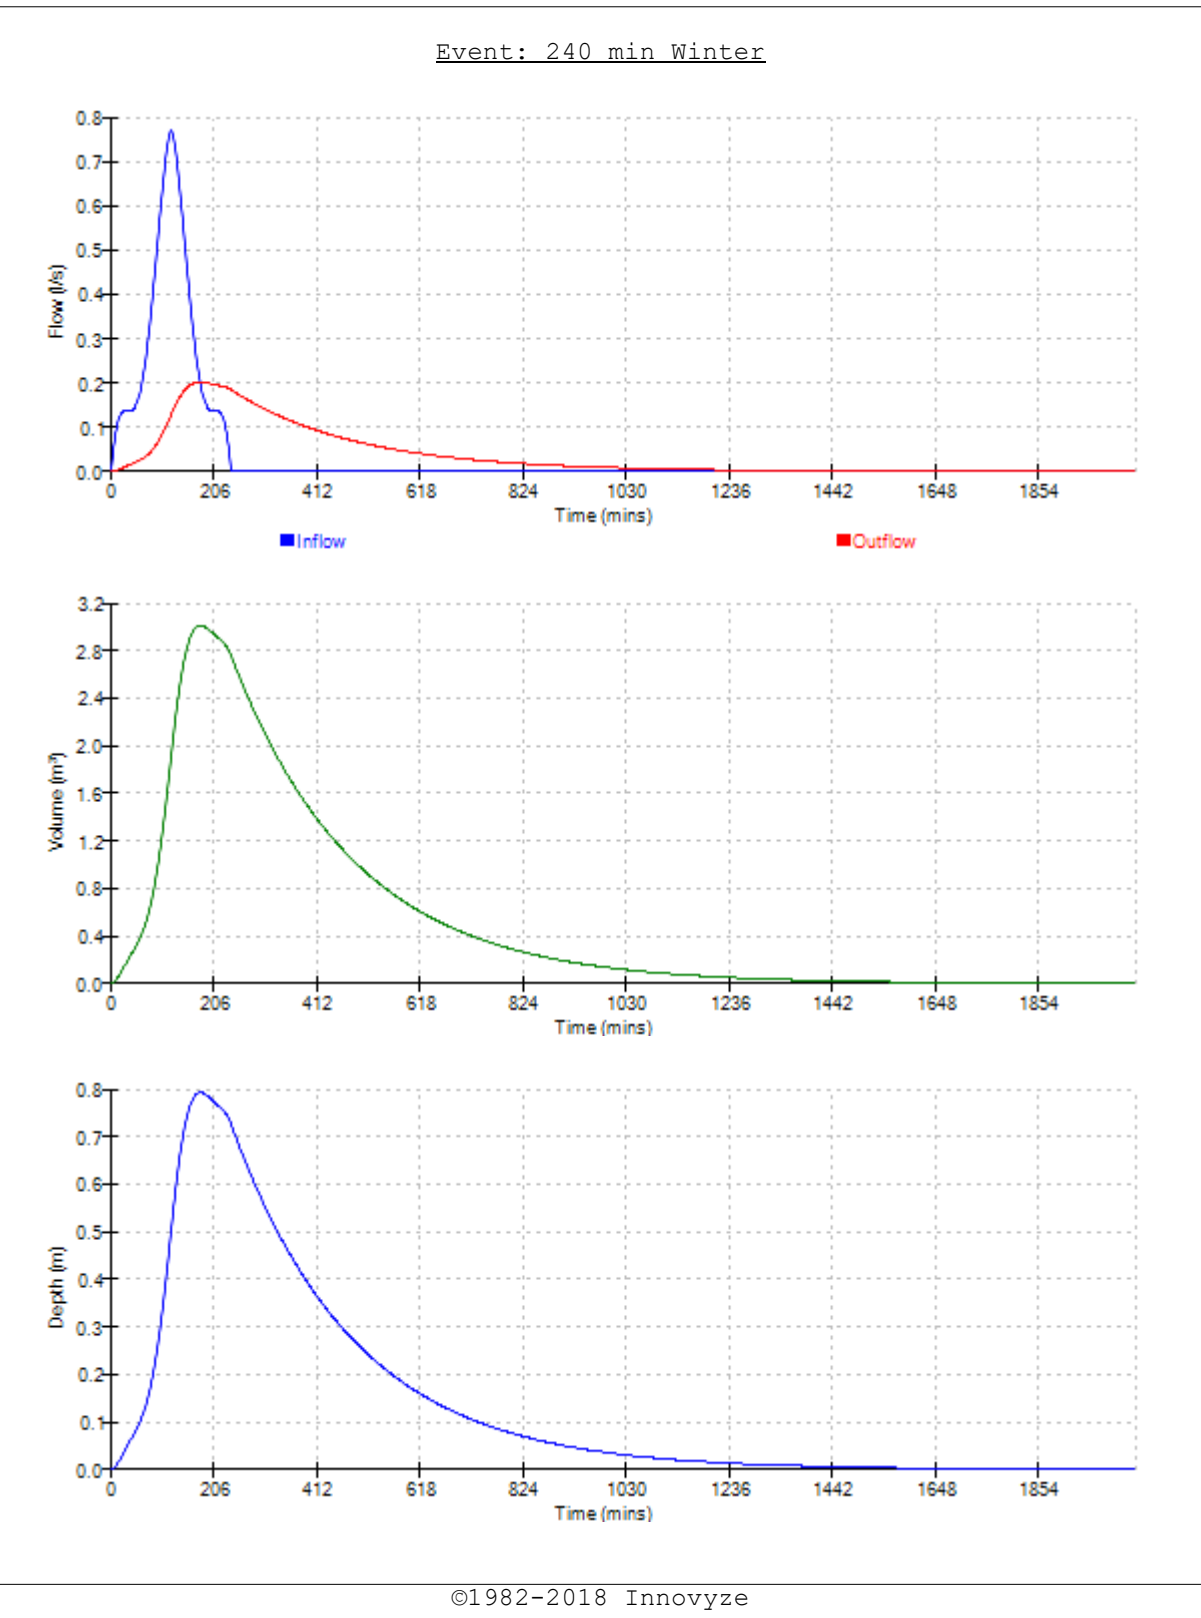

Waterco Ltd			Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																				
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																				
Denbighshire LL15 1NJ		TP3 House Soakaway																																																																																																																																																																																																																				
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																				
File w10685-180523-TP3_House...		Checked by AW																																																																																																																																																																																																																				
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																				
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 335 minutes. <table><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr><tr><td>15 min Summer</td><td>9.419</td><td>0.419</td><td>0.1</td><td>1.6</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.552</td><td>0.552</td><td>0.1</td><td>2.1</td><td>O K</td></tr><tr><td>60 min Summer</td><td>9.684</td><td>0.684</td><td>0.1</td><td>2.6</td><td>O K</td></tr><tr><td>120 min Summer</td><td>9.774</td><td>0.774</td><td>0.1</td><td>2.9</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.805</td><td>0.805</td><td>0.1</td><td>3.1</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.815</td><td>0.815</td><td>0.1</td><td>3.1</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.824</td><td>0.824</td><td>0.1</td><td>3.1</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.819</td><td>0.819</td><td>0.1</td><td>3.1</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.808</td><td>0.808</td><td>0.1</td><td>3.1</td><td>Flood Risk</td></tr><tr><td>720 min Summer</td><td>9.795</td><td>0.795</td><td>0.1</td><td>3.0</td><td>Flood Risk</td></tr><tr><td>960 min Summer</td><td>9.765</td><td>0.765</td><td>0.1</td><td>2.9</td><td>Flood Risk</td></tr><tr><td>1440 min Summer</td><td>9.702</td><td>0.702</td><td>0.1</td><td>2.7</td><td>Flood Risk</td></tr><tr><td>2160 min Summer</td><td>9.618</td><td>0.618</td><td>0.1</td><td>2.3</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.552</td><td>0.552</td><td>0.1</td><td>2.1</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.457</td><td>0.457</td><td>0.1</td><td>1.7</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.394</td><td>0.394</td><td>0.1</td><td>1.5</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.355</td><td>0.355</td><td>0.0</td><td>1.4</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.328</td><td>0.328</td><td>0.0</td><td>1.2</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.310</td><td>0.310</td><td>0.0</td><td>1.2</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.470</td><td>0.470</td><td>0.1</td><td>1.8</td><td>O K</td></tr></table> <table><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>31</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>62</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>120</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>180</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>210</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>270</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>336</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>404</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>470</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>608</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>880</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1276</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1648</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2420</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>3168</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3888</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4592</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5344</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>16</td></tr></table>					Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.419	0.419	0.1	1.6	O K	30 min Summer	9.552	0.552	0.1	2.1	O K	60 min Summer	9.684	0.684	0.1	2.6	O K	120 min Summer	9.774	0.774	0.1	2.9	Flood Risk	180 min Summer	9.805	0.805	0.1	3.1	Flood Risk	240 min Summer	9.815	0.815	0.1	3.1	Flood Risk	360 min Summer	9.824	0.824	0.1	3.1	Flood Risk	480 min Summer	9.819	0.819	0.1	3.1	Flood Risk	600 min Summer	9.808	0.808	0.1	3.1	Flood Risk	720 min Summer	9.795	0.795	0.1	3.0	Flood Risk	960 min Summer	9.765	0.765	0.1	2.9	Flood Risk	1440 min Summer	9.702	0.702	0.1	2.7	Flood Risk	2160 min Summer	9.618	0.618	0.1	2.3	O K	2880 min Summer	9.552	0.552	0.1	2.1	O K	4320 min Summer	9.457	0.457	0.1	1.7	O K	5760 min Summer	9.394	0.394	0.1	1.5	O K	7200 min Summer	9.355	0.355	0.0	1.4	O K	8640 min Summer	9.328	0.328	0.0	1.2	O K	10080 min Summer	9.310	0.310	0.0	1.2	O K	15 min Winter	9.470	0.470	0.1	1.8	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	31	60 min Summer	61.531	0.0	62	120 min Summer	36.920	0.0	120	180 min Summer	27.160	0.0	180	240 min Summer	21.763	0.0	210	360 min Summer	15.835	0.0	270	480 min Summer	12.539	0.0	336	600 min Summer	10.433	0.0	404	720 min Summer	8.964	0.0	470	960 min Summer	7.046	0.0	608	1440 min Summer	4.991	0.0	880	2160 min Summer	3.510	0.0	1276	2880 min Summer	2.731	0.0	1648	4320 min Summer	1.912	0.0	2420	5760 min Summer	1.496	0.0	3168	7200 min Summer	1.260	0.0	3888	8640 min Summer	1.110	0.0	4592	10080 min Summer	1.010	0.0	5344	15 min Winter	143.930	0.0	16
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																	
15 min Summer	9.419	0.419	0.1	1.6	O K																																																																																																																																																																																																																	
30 min Summer	9.552	0.552	0.1	2.1	O K																																																																																																																																																																																																																	
60 min Summer	9.684	0.684	0.1	2.6	O K																																																																																																																																																																																																																	
120 min Summer	9.774	0.774	0.1	2.9	Flood Risk																																																																																																																																																																																																																	
180 min Summer	9.805	0.805	0.1	3.1	Flood Risk																																																																																																																																																																																																																	
240 min Summer	9.815	0.815	0.1	3.1	Flood Risk																																																																																																																																																																																																																	
360 min Summer	9.824	0.824	0.1	3.1	Flood Risk																																																																																																																																																																																																																	
480 min Summer	9.819	0.819	0.1	3.1	Flood Risk																																																																																																																																																																																																																	
600 min Summer	9.808	0.808	0.1	3.1	Flood Risk																																																																																																																																																																																																																	
720 min Summer	9.795	0.795	0.1	3.0	Flood Risk																																																																																																																																																																																																																	
960 min Summer	9.765	0.765	0.1	2.9	Flood Risk																																																																																																																																																																																																																	
1440 min Summer	9.702	0.702	0.1	2.7	Flood Risk																																																																																																																																																																																																																	
2160 min Summer	9.618	0.618	0.1	2.3	O K																																																																																																																																																																																																																	
2880 min Summer	9.552	0.552	0.1	2.1	O K																																																																																																																																																																																																																	
4320 min Summer	9.457	0.457	0.1	1.7	O K																																																																																																																																																																																																																	
5760 min Summer	9.394	0.394	0.1	1.5	O K																																																																																																																																																																																																																	
7200 min Summer	9.355	0.355	0.0	1.4	O K																																																																																																																																																																																																																	
8640 min Summer	9.328	0.328	0.0	1.2	O K																																																																																																																																																																																																																	
10080 min Summer	9.310	0.310	0.0	1.2	O K																																																																																																																																																																																																																	
15 min Winter	9.470	0.470	0.1	1.8	O K																																																																																																																																																																																																																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																			
15 min Summer	143.930	0.0	16																																																																																																																																																																																																																			
30 min Summer	96.151	0.0	31																																																																																																																																																																																																																			
60 min Summer	61.531	0.0	62																																																																																																																																																																																																																			
120 min Summer	36.920	0.0	120																																																																																																																																																																																																																			
180 min Summer	27.160	0.0	180																																																																																																																																																																																																																			
240 min Summer	21.763	0.0	210																																																																																																																																																																																																																			
360 min Summer	15.835	0.0	270																																																																																																																																																																																																																			
480 min Summer	12.539	0.0	336																																																																																																																																																																																																																			
600 min Summer	10.433	0.0	404																																																																																																																																																																																																																			
720 min Summer	8.964	0.0	470																																																																																																																																																																																																																			
960 min Summer	7.046	0.0	608																																																																																																																																																																																																																			
1440 min Summer	4.991	0.0	880																																																																																																																																																																																																																			
2160 min Summer	3.510	0.0	1276																																																																																																																																																																																																																			
2880 min Summer	2.731	0.0	1648																																																																																																																																																																																																																			
4320 min Summer	1.912	0.0	2420																																																																																																																																																																																																																			
5760 min Summer	1.496	0.0	3168																																																																																																																																																																																																																			
7200 min Summer	1.260	0.0	3888																																																																																																																																																																																																																			
8640 min Summer	1.110	0.0	4592																																																																																																																																																																																																																			
10080 min Summer	1.010	0.0	5344																																																																																																																																																																																																																			
15 min Winter	143.930	0.0	16																																																																																																																																																																																																																			
©1982-2018 Innovyze																																																																																																																																																																																																																						

Waterco Ltd				Page 2	
Eden Court		w10685			
Lon Parcwr Business Park		Holt Road, Rossett			
Denbighshire LL15 1NJ		TP3 House Soakaway			
Date 23/05/2018		Designed by HW			
File w10685-180523-TP3_House...		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.618	0.618	0.1	2.3	O K
60 min Winter	9.768	0.768	0.1	2.9	Flood Risk
120 min Winter	9.870	0.870	0.1	3.3	Flood Risk
180 min Winter	9.908	0.908	0.1	3.5	Flood Risk
240 min Winter	9.920	0.920	0.1	3.5	Flood Risk
360 min Winter	9.922	0.922	0.1	3.5	Flood Risk
480 min Winter	9.910	0.910	0.1	3.5	Flood Risk
600 min Winter	9.891	0.891	0.1	3.4	Flood Risk
720 min Winter	9.868	0.868	0.1	3.3	Flood Risk
960 min Winter	9.821	0.821	0.1	3.1	Flood Risk
1440 min Winter	9.732	0.732	0.1	2.8	Flood Risk
2160 min Winter	9.621	0.621	0.1	2.4	O K
2880 min Winter	9.539	0.539	0.1	2.0	O K
4320 min Winter	9.425	0.425	0.1	1.6	O K
5760 min Winter	9.354	0.354	0.0	1.3	O K
7200 min Winter	9.309	0.309	0.0	1.2	O K
8640 min Winter	9.279	0.279	0.0	1.1	O K
10080 min Winter	9.259	0.259	0.0	1.0	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	31		
60 min Winter	61.531	0.0	60		
120 min Winter	36.920	0.0	118		
180 min Winter	27.160	0.0	174		
240 min Winter	21.763	0.0	226		
360 min Winter	15.835	0.0	280		
480 min Winter	12.539	0.0	356		
600 min Winter	10.433	0.0	432		
720 min Winter	8.964	0.0	506		
960 min Winter	7.046	0.0	654		
1440 min Winter	4.991	0.0	936		
2160 min Winter	3.510	0.0	1340		
2880 min Winter	2.731	0.0	1732		
4320 min Winter	1.912	0.0	2504		
5760 min Winter	1.496	0.0	3232		
7200 min Winter	1.260	0.0	3968		
8640 min Winter	1.110	0.0	4752		
10080 min Winter	1.010	0.0	5448		
©1982-2018 Innovyze					

Waterco Ltd		Page 3
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP3 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP3_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

Rainfall Details

Rainfall Model	FEH	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
FEH Rainfall Version	2013	Cv (Winter)	0.840
Site Location	GB 337309 357277	Shortest Storm (mins)	15
Data Type	Point	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+30


Time Area Diagram

Total Area (ha) 0.006


Time (mins)	Area
From:	To: (ha)
0	1 0.006

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP3 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP3_House...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>2.0</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.11599</td> <td>Trench Length (m)</td> <td>2.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.000</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0	Infiltration Coefficient Side (m/hr)	0.11599	Trench Length (m)	2.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0																			
Infiltration Coefficient Side (m/hr)	0.11599	Trench Length (m)	2.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						


Waterco Ltd		Page 5
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP3 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP3_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

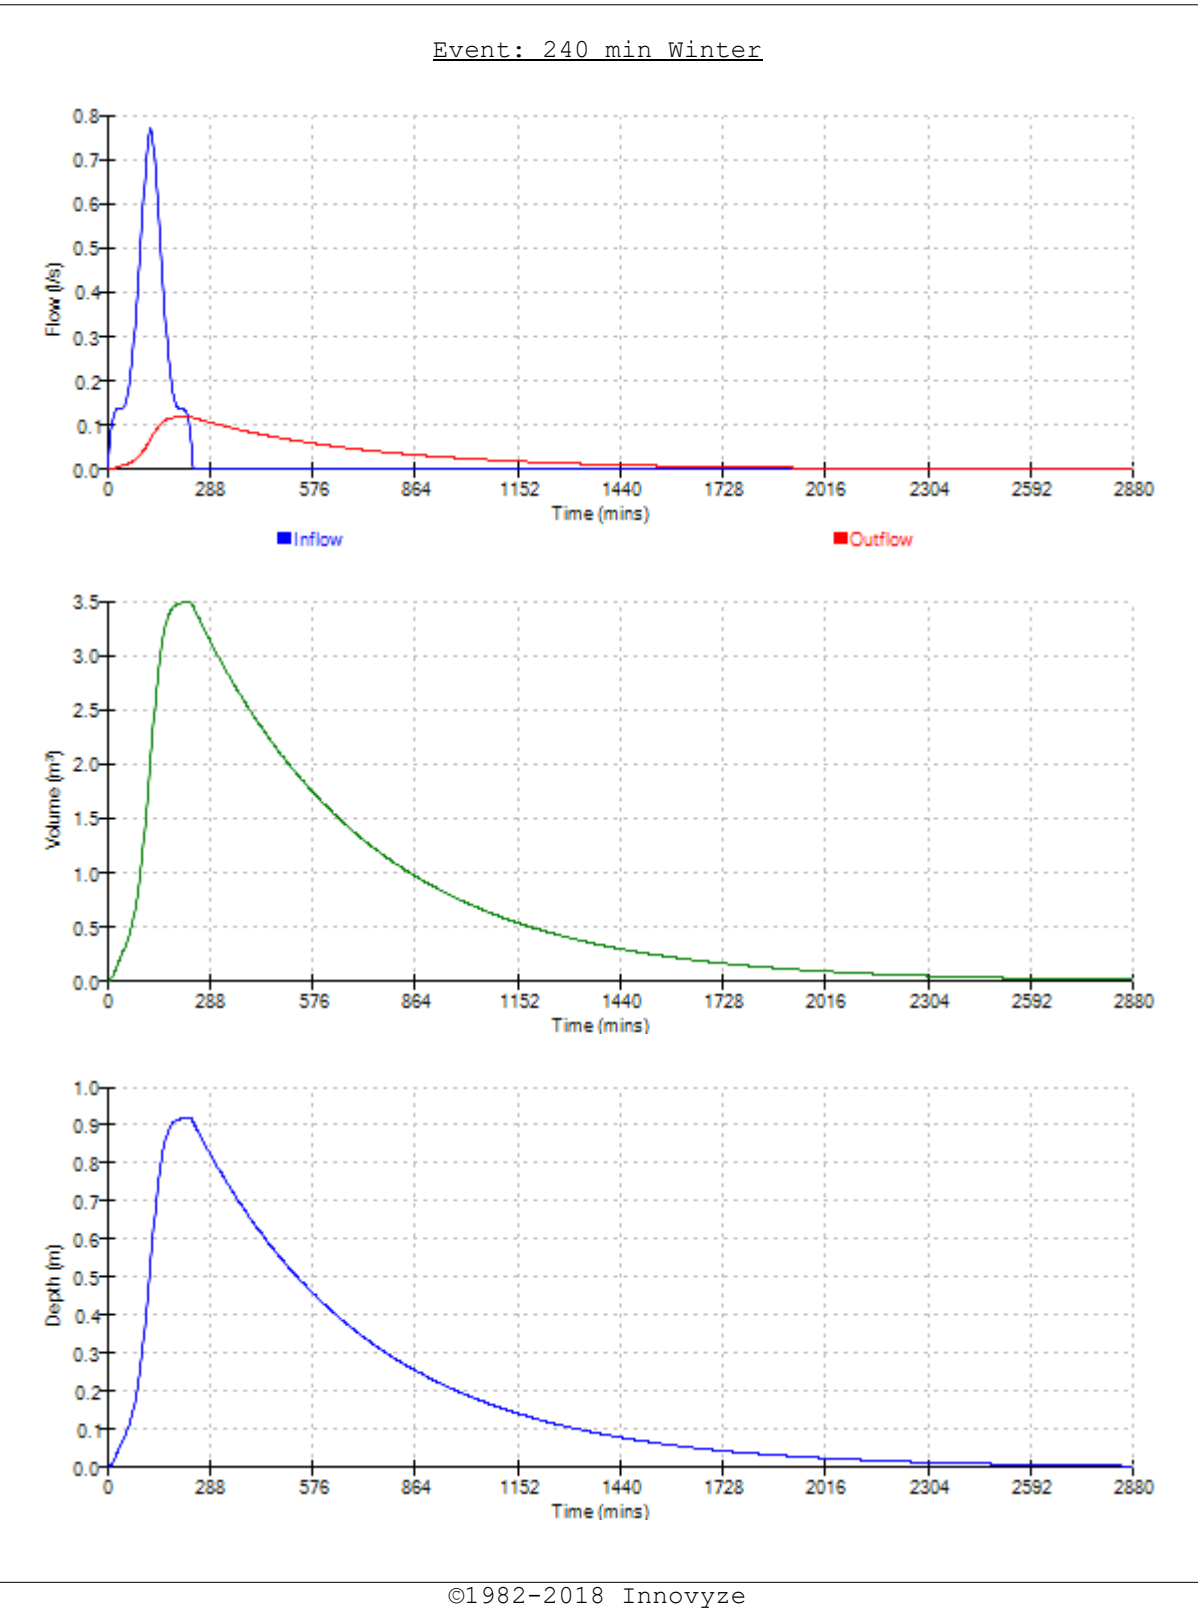

Waterco Ltd		Page 6
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP3 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP3_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

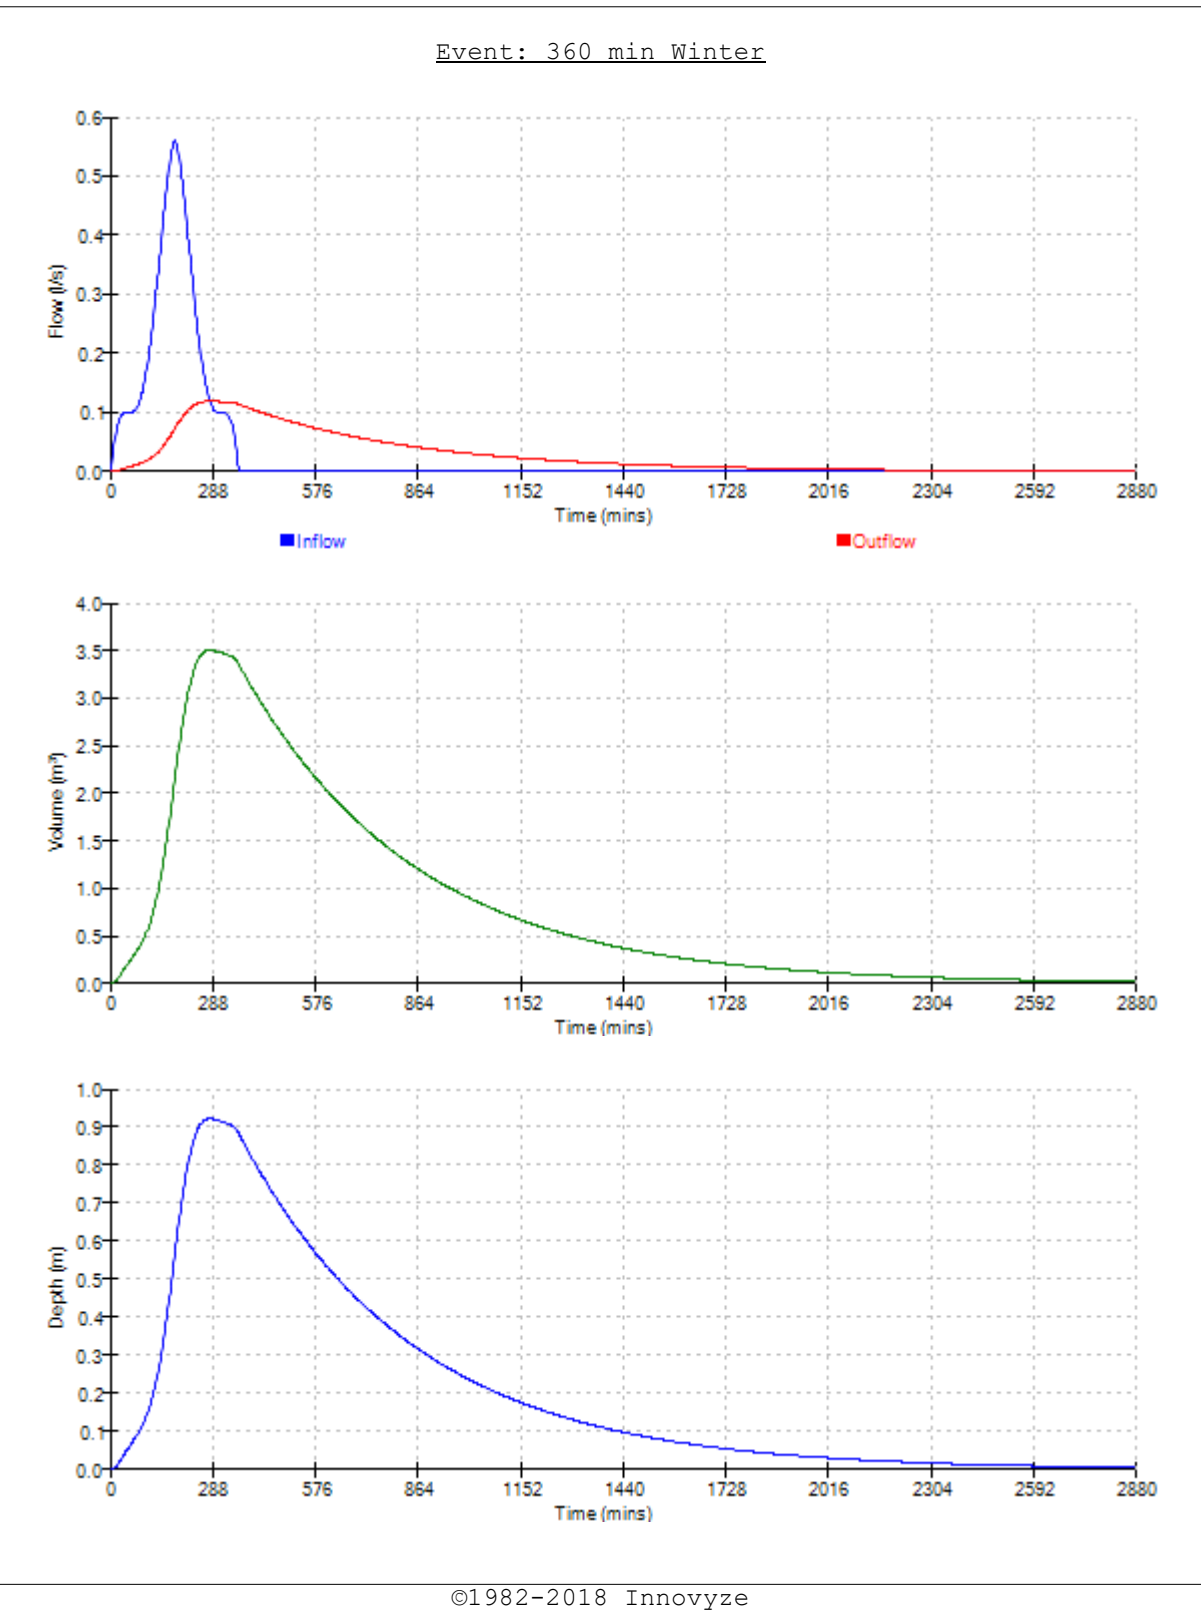

Waterco Ltd		Page 7
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP3 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP3_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

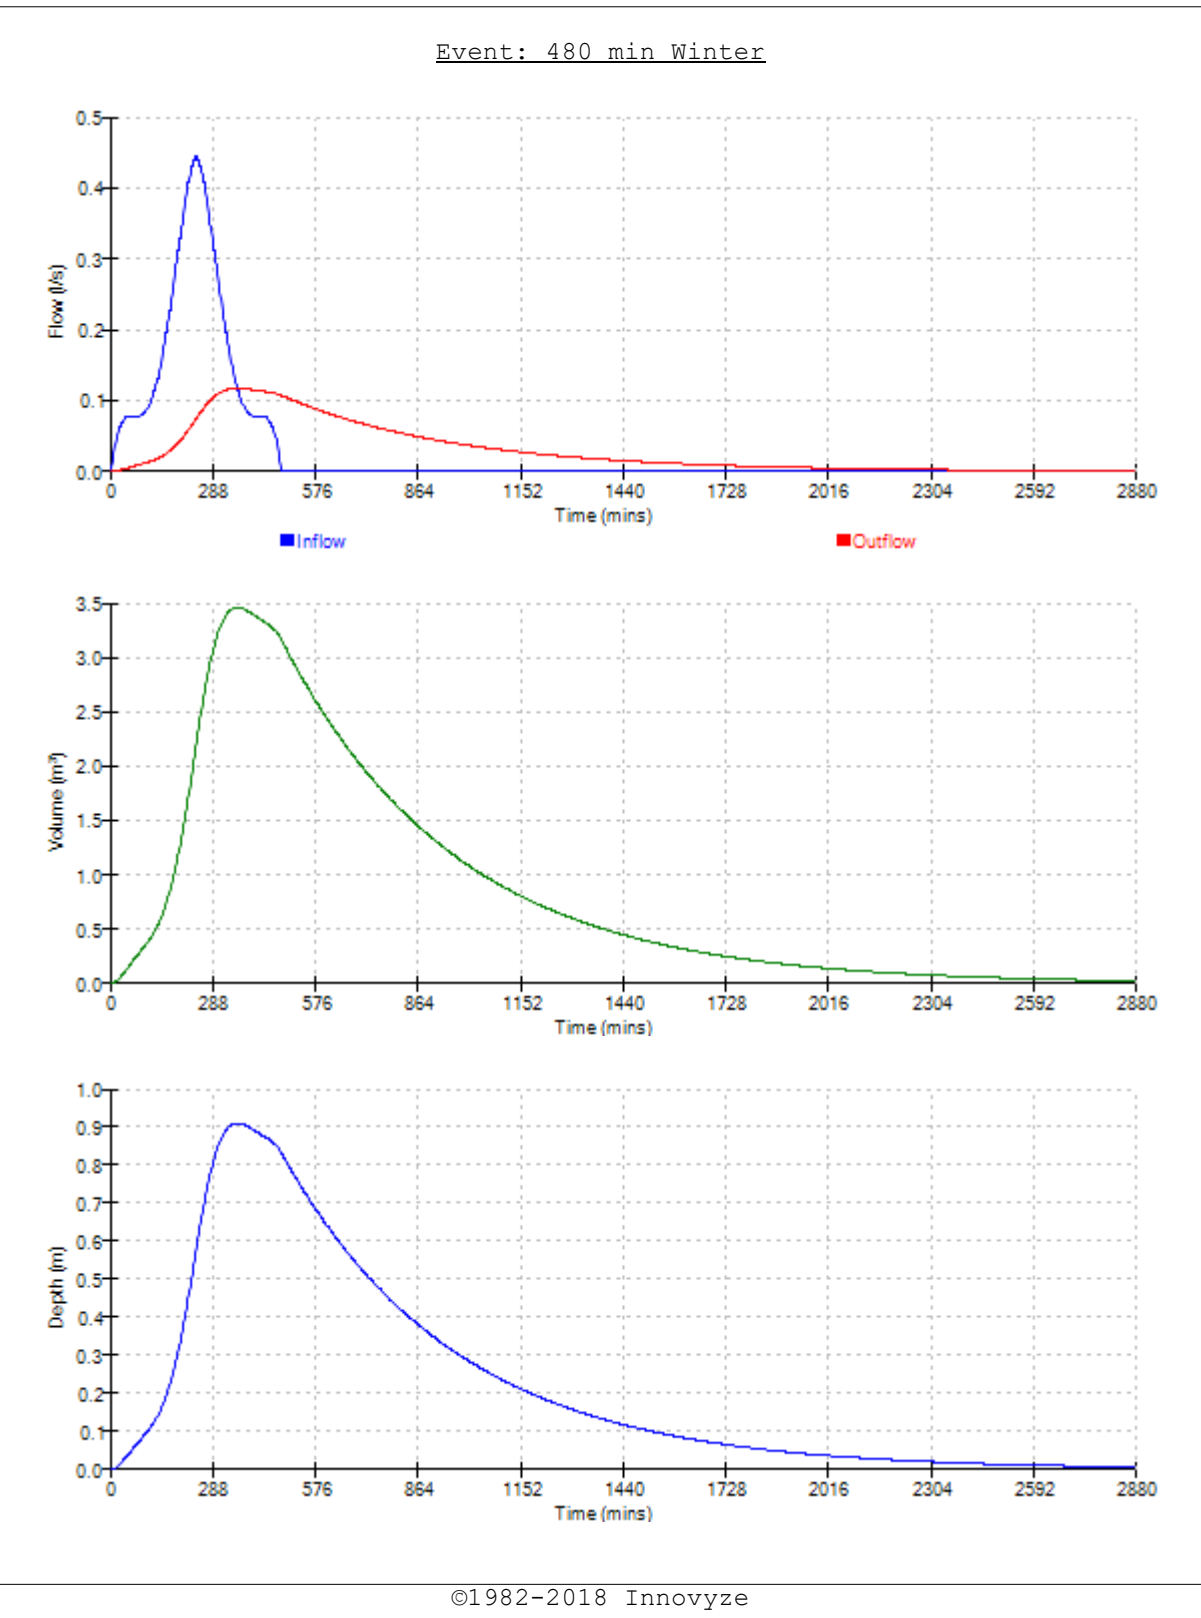

Waterco Ltd				Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																					
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																					
Denbighshire LL15 1NJ		TP4 House Soakaway																																																																																																																																																																																																																					
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																					
File w10685-180523-TP4_House...		Checked by AW																																																																																																																																																																																																																					
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																					
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 132 minutes. <table><thead><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr></thead><tbody><tr><td>15 min Summer</td><td>9.545</td><td>0.545</td><td>0.1</td><td>1.6</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.700</td><td>0.700</td><td>0.2</td><td>2.0</td><td>O K</td></tr><tr><td>60 min Summer</td><td>9.830</td><td>0.830</td><td>0.2</td><td>2.4</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.878</td><td>0.878</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.893</td><td>0.893</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.891</td><td>0.891</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.867</td><td>0.867</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.830</td><td>0.830</td><td>0.2</td><td>2.4</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.790</td><td>0.790</td><td>0.2</td><td>2.3</td><td>Flood Risk</td></tr><tr><td>720 min Summer</td><td>9.752</td><td>0.752</td><td>0.2</td><td>2.1</td><td>Flood Risk</td></tr><tr><td>960 min Summer</td><td>9.685</td><td>0.685</td><td>0.2</td><td>2.0</td><td>O K</td></tr><tr><td>1440 min Summer</td><td>9.580</td><td>0.580</td><td>0.1</td><td>1.7</td><td>O K</td></tr><tr><td>2160 min Summer</td><td>9.472</td><td>0.472</td><td>0.1</td><td>1.3</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.400</td><td>0.400</td><td>0.1</td><td>1.1</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.309</td><td>0.309</td><td>0.1</td><td>0.9</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.255</td><td>0.255</td><td>0.1</td><td>0.7</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.222</td><td>0.222</td><td>0.1</td><td>0.6</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.199</td><td>0.199</td><td>0.0</td><td>0.6</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.185</td><td>0.185</td><td>0.0</td><td>0.5</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.610</td><td>0.610</td><td>0.2</td><td>1.7</td><td>O K</td></tr></tbody></table> <table><thead><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr></thead><tbody><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>31</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>60</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>96</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>128</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>162</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>230</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>298</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>366</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>432</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>558</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>808</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1188</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1556</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2288</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>3000</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3744</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4416</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5152</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>16</td></tr></tbody></table>						Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.545	0.545	0.1	1.6	O K	30 min Summer	9.700	0.700	0.2	2.0	O K	60 min Summer	9.830	0.830	0.2	2.4	Flood Risk	120 min Summer	9.878	0.878	0.2	2.5	Flood Risk	180 min Summer	9.893	0.893	0.2	2.5	Flood Risk	240 min Summer	9.891	0.891	0.2	2.5	Flood Risk	360 min Summer	9.867	0.867	0.2	2.5	Flood Risk	480 min Summer	9.830	0.830	0.2	2.4	Flood Risk	600 min Summer	9.790	0.790	0.2	2.3	Flood Risk	720 min Summer	9.752	0.752	0.2	2.1	Flood Risk	960 min Summer	9.685	0.685	0.2	2.0	O K	1440 min Summer	9.580	0.580	0.1	1.7	O K	2160 min Summer	9.472	0.472	0.1	1.3	O K	2880 min Summer	9.400	0.400	0.1	1.1	O K	4320 min Summer	9.309	0.309	0.1	0.9	O K	5760 min Summer	9.255	0.255	0.1	0.7	O K	7200 min Summer	9.222	0.222	0.1	0.6	O K	8640 min Summer	9.199	0.199	0.0	0.6	O K	10080 min Summer	9.185	0.185	0.0	0.5	O K	15 min Winter	9.610	0.610	0.2	1.7	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	31	60 min Summer	61.531	0.0	60	120 min Summer	36.920	0.0	96	180 min Summer	27.160	0.0	128	240 min Summer	21.763	0.0	162	360 min Summer	15.835	0.0	230	480 min Summer	12.539	0.0	298	600 min Summer	10.433	0.0	366	720 min Summer	8.964	0.0	432	960 min Summer	7.046	0.0	558	1440 min Summer	4.991	0.0	808	2160 min Summer	3.510	0.0	1188	2880 min Summer	2.731	0.0	1556	4320 min Summer	1.912	0.0	2288	5760 min Summer	1.496	0.0	3000	7200 min Summer	1.260	0.0	3744	8640 min Summer	1.110	0.0	4416	10080 min Summer	1.010	0.0	5152	15 min Winter	143.930	0.0	16
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																		
15 min Summer	9.545	0.545	0.1	1.6	O K																																																																																																																																																																																																																		
30 min Summer	9.700	0.700	0.2	2.0	O K																																																																																																																																																																																																																		
60 min Summer	9.830	0.830	0.2	2.4	Flood Risk																																																																																																																																																																																																																		
120 min Summer	9.878	0.878	0.2	2.5	Flood Risk																																																																																																																																																																																																																		
180 min Summer	9.893	0.893	0.2	2.5	Flood Risk																																																																																																																																																																																																																		
240 min Summer	9.891	0.891	0.2	2.5	Flood Risk																																																																																																																																																																																																																		
360 min Summer	9.867	0.867	0.2	2.5	Flood Risk																																																																																																																																																																																																																		
480 min Summer	9.830	0.830	0.2	2.4	Flood Risk																																																																																																																																																																																																																		
600 min Summer	9.790	0.790	0.2	2.3	Flood Risk																																																																																																																																																																																																																		
720 min Summer	9.752	0.752	0.2	2.1	Flood Risk																																																																																																																																																																																																																		
960 min Summer	9.685	0.685	0.2	2.0	O K																																																																																																																																																																																																																		
1440 min Summer	9.580	0.580	0.1	1.7	O K																																																																																																																																																																																																																		
2160 min Summer	9.472	0.472	0.1	1.3	O K																																																																																																																																																																																																																		
2880 min Summer	9.400	0.400	0.1	1.1	O K																																																																																																																																																																																																																		
4320 min Summer	9.309	0.309	0.1	0.9	O K																																																																																																																																																																																																																		
5760 min Summer	9.255	0.255	0.1	0.7	O K																																																																																																																																																																																																																		
7200 min Summer	9.222	0.222	0.1	0.6	O K																																																																																																																																																																																																																		
8640 min Summer	9.199	0.199	0.0	0.6	O K																																																																																																																																																																																																																		
10080 min Summer	9.185	0.185	0.0	0.5	O K																																																																																																																																																																																																																		
15 min Winter	9.610	0.610	0.2	1.7	O K																																																																																																																																																																																																																		
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																				
15 min Summer	143.930	0.0	16																																																																																																																																																																																																																				
30 min Summer	96.151	0.0	31																																																																																																																																																																																																																				
60 min Summer	61.531	0.0	60																																																																																																																																																																																																																				
120 min Summer	36.920	0.0	96																																																																																																																																																																																																																				
180 min Summer	27.160	0.0	128																																																																																																																																																																																																																				
240 min Summer	21.763	0.0	162																																																																																																																																																																																																																				
360 min Summer	15.835	0.0	230																																																																																																																																																																																																																				
480 min Summer	12.539	0.0	298																																																																																																																																																																																																																				
600 min Summer	10.433	0.0	366																																																																																																																																																																																																																				
720 min Summer	8.964	0.0	432																																																																																																																																																																																																																				
960 min Summer	7.046	0.0	558																																																																																																																																																																																																																				
1440 min Summer	4.991	0.0	808																																																																																																																																																																																																																				
2160 min Summer	3.510	0.0	1188																																																																																																																																																																																																																				
2880 min Summer	2.731	0.0	1556																																																																																																																																																																																																																				
4320 min Summer	1.912	0.0	2288																																																																																																																																																																																																																				
5760 min Summer	1.496	0.0	3000																																																																																																																																																																																																																				
7200 min Summer	1.260	0.0	3744																																																																																																																																																																																																																				
8640 min Summer	1.110	0.0	4416																																																																																																																																																																																																																				
10080 min Summer	1.010	0.0	5152																																																																																																																																																																																																																				
15 min Winter	143.930	0.0	16																																																																																																																																																																																																																				
©1982-2018 Innovyze																																																																																																																																																																																																																							

Waterco Ltd				Page 2	
Eden Court		w10685			
Lon Parcwr Business Park		Holt Road, Rossett			
Denbighshire LL15 1NJ		TP4 House Soakaway			
Date 23/05/2018		Designed by HW			
File w10685-180523-TP4_House...		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.786	0.786	0.2	2.2	Flood Risk
60 min Winter	9.934	0.934	0.2	2.7	Flood Risk
120 min Winter	9.985	0.985	0.2	2.8	Flood Risk
180 min Winter	9.993	0.993	0.2	2.8	Flood Risk
240 min Winter	9.981	0.981	0.2	2.8	Flood Risk
360 min Winter	9.934	0.934	0.2	2.7	Flood Risk
480 min Winter	9.875	0.875	0.2	2.5	Flood Risk
600 min Winter	9.818	0.818	0.2	2.3	Flood Risk
720 min Winter	9.767	0.767	0.2	2.2	Flood Risk
960 min Winter	9.679	0.679	0.2	1.9	O K
1440 min Winter	9.549	0.549	0.1	1.6	O K
2160 min Winter	9.425	0.425	0.1	1.2	O K
2880 min Winter	9.347	0.347	0.1	1.0	O K
4320 min Winter	9.255	0.255	0.1	0.7	O K
5760 min Winter	9.204	0.204	0.1	0.6	O K
7200 min Winter	9.174	0.174	0.0	0.5	O K
8640 min Winter	9.154	0.154	0.0	0.4	O K
10080 min Winter	9.141	0.141	0.0	0.4	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	30		
60 min Winter	61.531	0.0	58		
120 min Winter	36.920	0.0	98		
180 min Winter	27.160	0.0	134		
240 min Winter	21.763	0.0	172		
360 min Winter	15.835	0.0	246		
480 min Winter	12.539	0.0	318		
600 min Winter	10.433	0.0	386		
720 min Winter	8.964	0.0	454		
960 min Winter	7.046	0.0	586		
1440 min Winter	4.991	0.0	848		
2160 min Winter	3.510	0.0	1216		
2880 min Winter	2.731	0.0	1588		
4320 min Winter	1.912	0.0	2332		
5760 min Winter	1.496	0.0	3048		
7200 min Winter	1.260	0.0	3752		
8640 min Winter	1.110	0.0	4496		
10080 min Winter	1.010	0.0	5240		
©1982-2018 Innovyze					

Waterco Ltd		Page 3
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP4 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP4_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

Rainfall Details

Rainfall Model	FEH	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
FEH Rainfall Version	2013	Cv (Winter)	0.840
Site Location	GB 337309 357277	Shortest Storm (mins)	15
Data Type	Point	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+30

Time Area Diagram


Total Area (ha) 0.006

Time (mins)	Area
From:	To: (ha)


0	1 0.006
---	---------

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP4 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP4_House...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>1.5</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.25740</td> <td>Trench Length (m)</td> <td>2.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.000</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5	Infiltration Coefficient Side (m/hr)	0.25740	Trench Length (m)	2.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5																			
Infiltration Coefficient Side (m/hr)	0.25740	Trench Length (m)	2.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						

Waterco Ltd		Page 5
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP4 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP4_House...	Checked by AW	
XP Solutions	Source Control 2018.1	



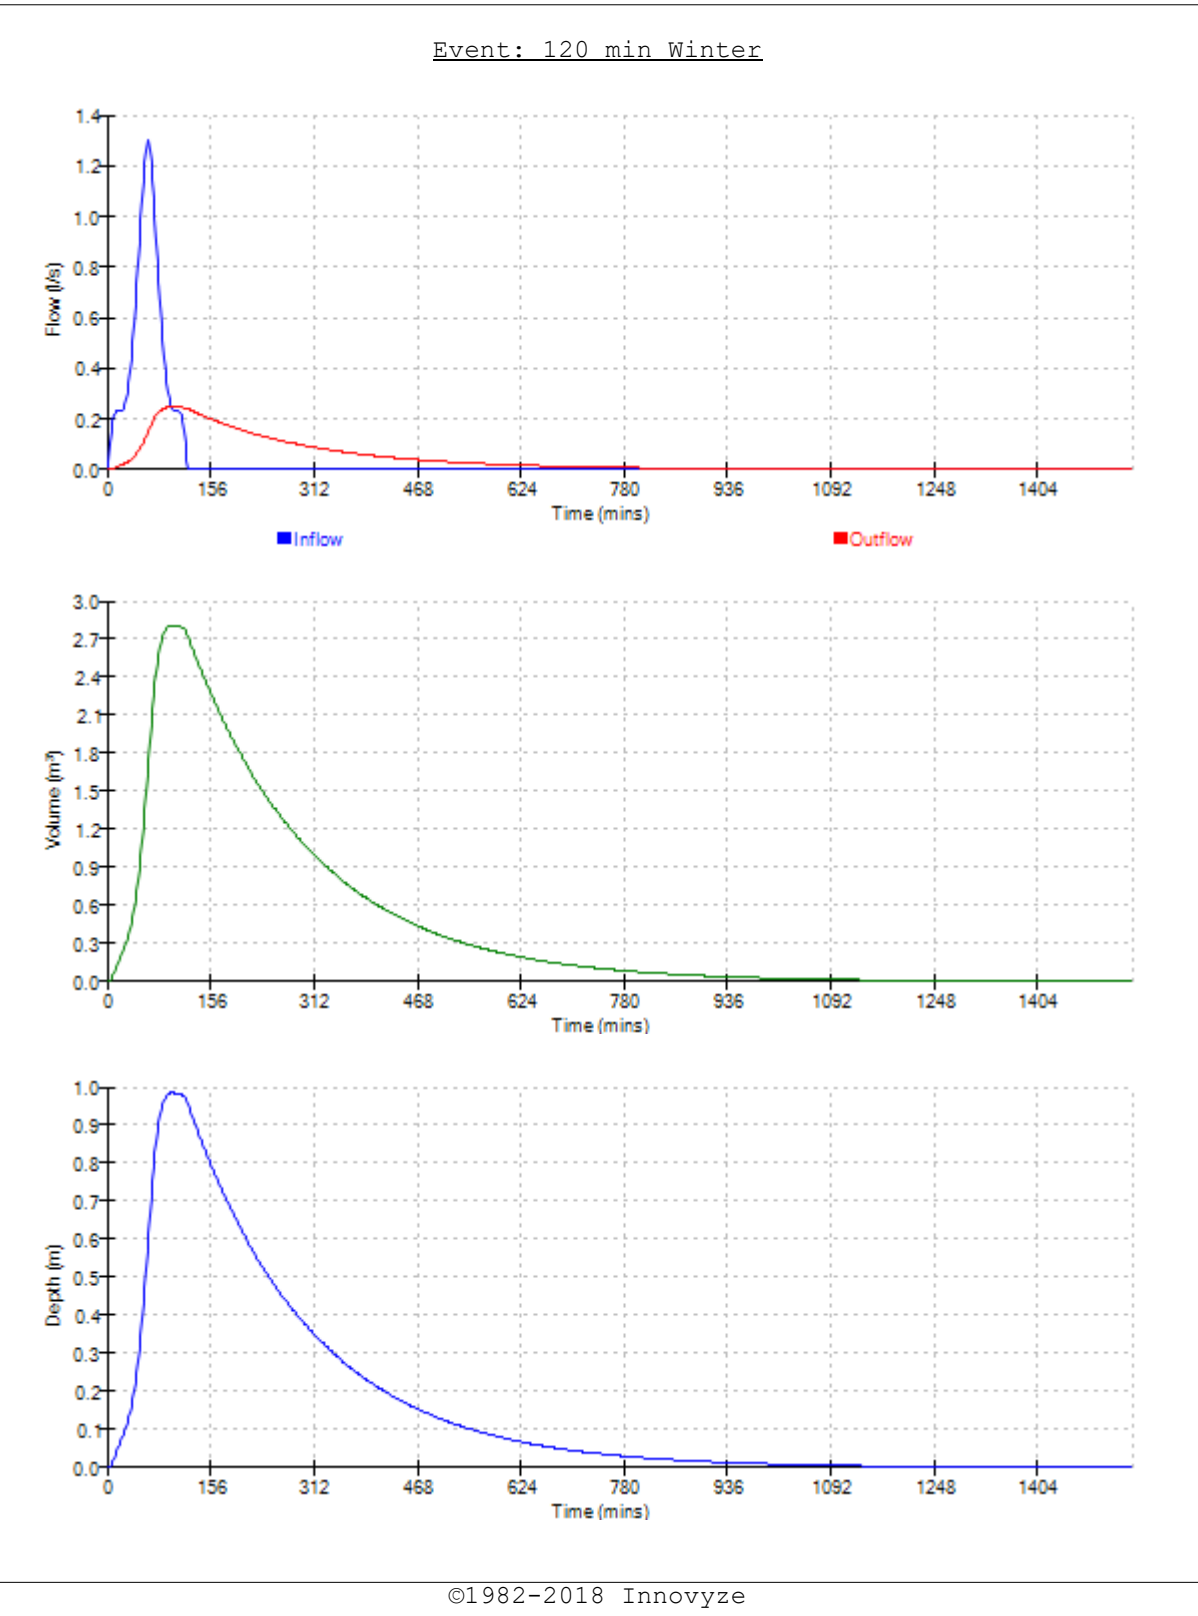


Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP4 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP4_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

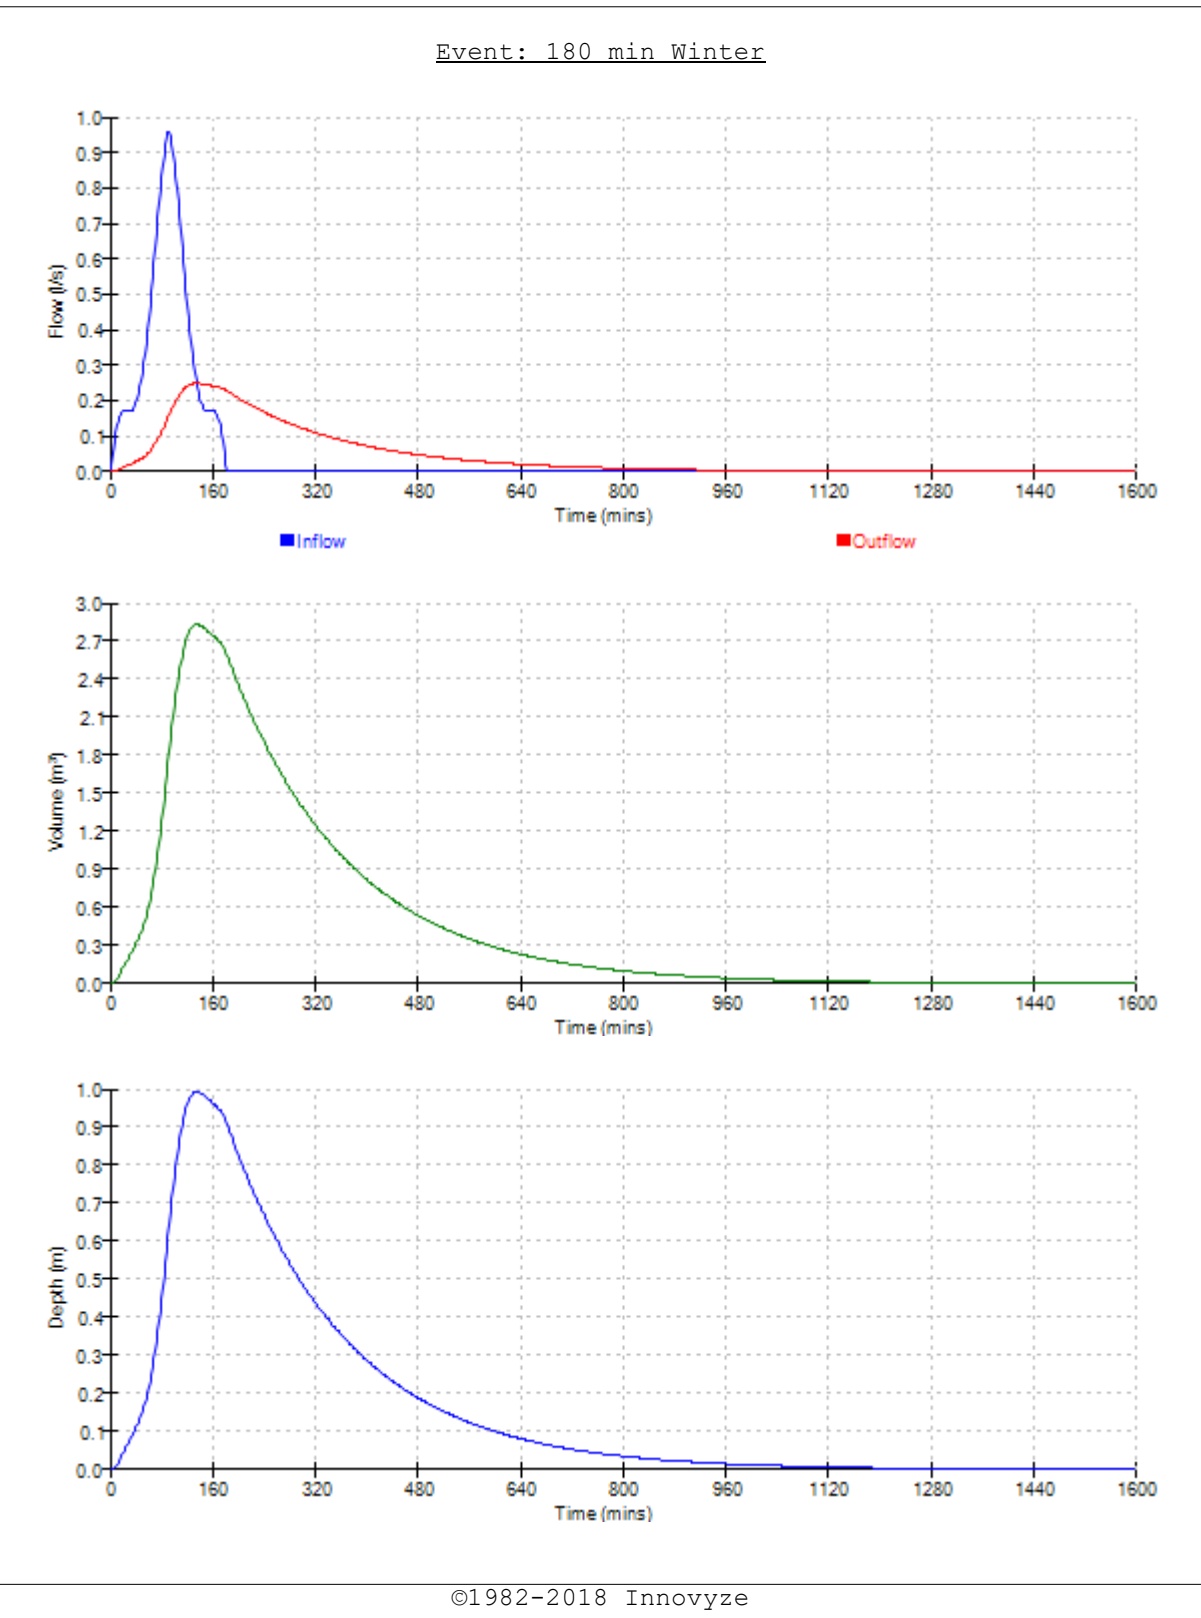

Waterco Ltd		Page 7
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP4 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP4_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

Event: 240 min Winter

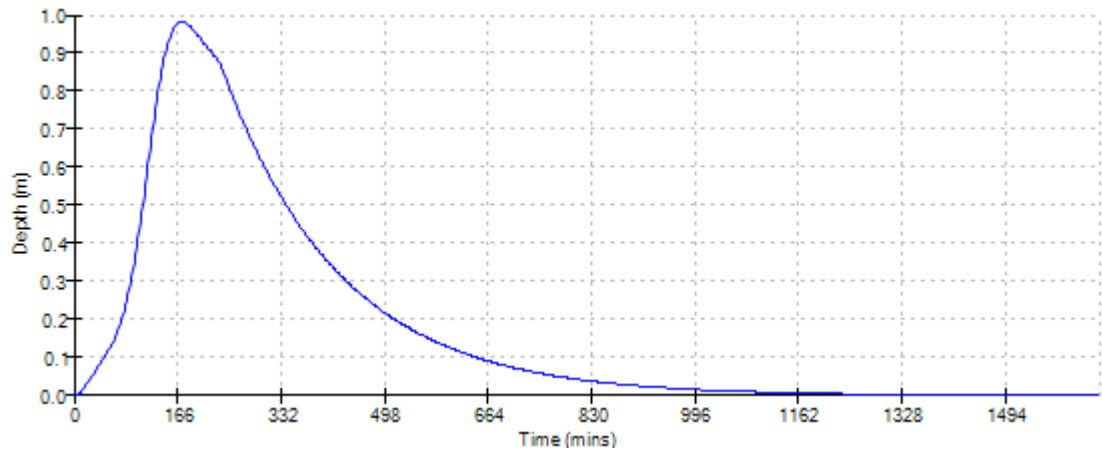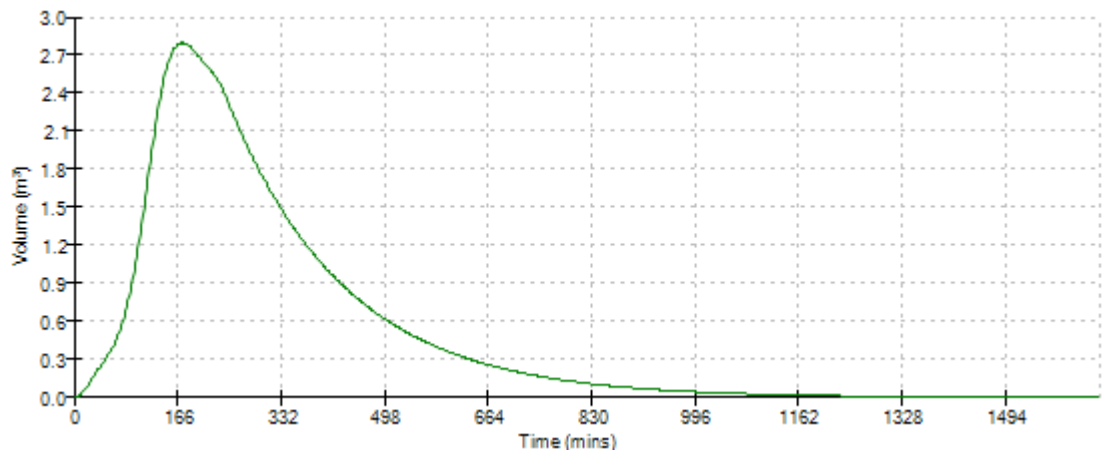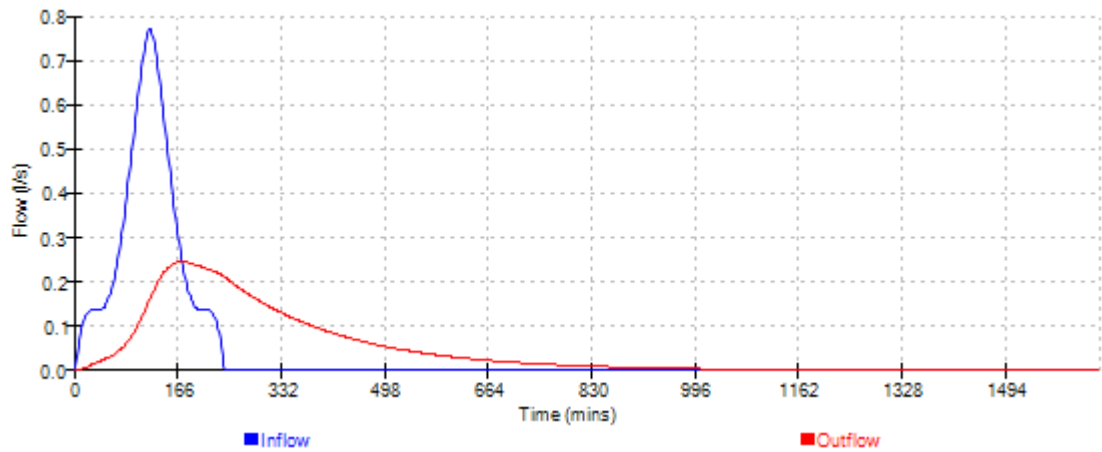


Waterco Ltd				Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																					
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																					
Denbighshire LL15 1NJ		TP7 House Soakaway																																																																																																																																																																																																																					
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																					
File w10685-180523-TP5_House...		Checked by AW																																																																																																																																																																																																																					
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																					
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 119 minutes. <table><thead><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr></thead><tbody><tr><td>15 min Summer</td><td>9.543</td><td>0.543</td><td>0.1</td><td>1.5</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.695</td><td>0.695</td><td>0.2</td><td>2.0</td><td>O K</td></tr><tr><td>60 min Summer</td><td>9.818</td><td>0.818</td><td>0.2</td><td>2.3</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.863</td><td>0.863</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.875</td><td>0.875</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.871</td><td>0.871</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.842</td><td>0.842</td><td>0.2</td><td>2.4</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.801</td><td>0.801</td><td>0.2</td><td>2.3</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.760</td><td>0.760</td><td>0.2</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>720 min Summer</td><td>9.721</td><td>0.721</td><td>0.2</td><td>2.1</td><td>Flood Risk</td></tr><tr><td>960 min Summer</td><td>9.653</td><td>0.653</td><td>0.2</td><td>1.9</td><td>O K</td></tr><tr><td>1440 min Summer</td><td>9.549</td><td>0.549</td><td>0.2</td><td>1.6</td><td>O K</td></tr><tr><td>2160 min Summer</td><td>9.444</td><td>0.444</td><td>0.1</td><td>1.3</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.374</td><td>0.374</td><td>0.1</td><td>1.1</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.287</td><td>0.287</td><td>0.1</td><td>0.8</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.236</td><td>0.236</td><td>0.1</td><td>0.7</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.205</td><td>0.205</td><td>0.1</td><td>0.6</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.184</td><td>0.184</td><td>0.1</td><td>0.5</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.170</td><td>0.170</td><td>0.0</td><td>0.5</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.608</td><td>0.608</td><td>0.2</td><td>1.7</td><td>O K</td></tr></tbody></table> <table><thead><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr></thead><tbody><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>31</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>60</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>92</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>126</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>160</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>228</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>294</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>362</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>426</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>556</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>808</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1172</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1532</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2252</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>3000</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3744</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4416</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5144</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>16</td></tr></tbody></table>						Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.543	0.543	0.1	1.5	O K	30 min Summer	9.695	0.695	0.2	2.0	O K	60 min Summer	9.818	0.818	0.2	2.3	Flood Risk	120 min Summer	9.863	0.863	0.2	2.5	Flood Risk	180 min Summer	9.875	0.875	0.2	2.5	Flood Risk	240 min Summer	9.871	0.871	0.2	2.5	Flood Risk	360 min Summer	9.842	0.842	0.2	2.4	Flood Risk	480 min Summer	9.801	0.801	0.2	2.3	Flood Risk	600 min Summer	9.760	0.760	0.2	2.2	Flood Risk	720 min Summer	9.721	0.721	0.2	2.1	Flood Risk	960 min Summer	9.653	0.653	0.2	1.9	O K	1440 min Summer	9.549	0.549	0.2	1.6	O K	2160 min Summer	9.444	0.444	0.1	1.3	O K	2880 min Summer	9.374	0.374	0.1	1.1	O K	4320 min Summer	9.287	0.287	0.1	0.8	O K	5760 min Summer	9.236	0.236	0.1	0.7	O K	7200 min Summer	9.205	0.205	0.1	0.6	O K	8640 min Summer	9.184	0.184	0.1	0.5	O K	10080 min Summer	9.170	0.170	0.0	0.5	O K	15 min Winter	9.608	0.608	0.2	1.7	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	31	60 min Summer	61.531	0.0	60	120 min Summer	36.920	0.0	92	180 min Summer	27.160	0.0	126	240 min Summer	21.763	0.0	160	360 min Summer	15.835	0.0	228	480 min Summer	12.539	0.0	294	600 min Summer	10.433	0.0	362	720 min Summer	8.964	0.0	426	960 min Summer	7.046	0.0	556	1440 min Summer	4.991	0.0	808	2160 min Summer	3.510	0.0	1172	2880 min Summer	2.731	0.0	1532	4320 min Summer	1.912	0.0	2252	5760 min Summer	1.496	0.0	3000	7200 min Summer	1.260	0.0	3744	8640 min Summer	1.110	0.0	4416	10080 min Summer	1.010	0.0	5144	15 min Winter	143.930	0.0	16
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																		
15 min Summer	9.543	0.543	0.1	1.5	O K																																																																																																																																																																																																																		
30 min Summer	9.695	0.695	0.2	2.0	O K																																																																																																																																																																																																																		
60 min Summer	9.818	0.818	0.2	2.3	Flood Risk																																																																																																																																																																																																																		
120 min Summer	9.863	0.863	0.2	2.5	Flood Risk																																																																																																																																																																																																																		
180 min Summer	9.875	0.875	0.2	2.5	Flood Risk																																																																																																																																																																																																																		
240 min Summer	9.871	0.871	0.2	2.5	Flood Risk																																																																																																																																																																																																																		
360 min Summer	9.842	0.842	0.2	2.4	Flood Risk																																																																																																																																																																																																																		
480 min Summer	9.801	0.801	0.2	2.3	Flood Risk																																																																																																																																																																																																																		
600 min Summer	9.760	0.760	0.2	2.2	Flood Risk																																																																																																																																																																																																																		
720 min Summer	9.721	0.721	0.2	2.1	Flood Risk																																																																																																																																																																																																																		
960 min Summer	9.653	0.653	0.2	1.9	O K																																																																																																																																																																																																																		
1440 min Summer	9.549	0.549	0.2	1.6	O K																																																																																																																																																																																																																		
2160 min Summer	9.444	0.444	0.1	1.3	O K																																																																																																																																																																																																																		
2880 min Summer	9.374	0.374	0.1	1.1	O K																																																																																																																																																																																																																		
4320 min Summer	9.287	0.287	0.1	0.8	O K																																																																																																																																																																																																																		
5760 min Summer	9.236	0.236	0.1	0.7	O K																																																																																																																																																																																																																		
7200 min Summer	9.205	0.205	0.1	0.6	O K																																																																																																																																																																																																																		
8640 min Summer	9.184	0.184	0.1	0.5	O K																																																																																																																																																																																																																		
10080 min Summer	9.170	0.170	0.0	0.5	O K																																																																																																																																																																																																																		
15 min Winter	9.608	0.608	0.2	1.7	O K																																																																																																																																																																																																																		
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																				
15 min Summer	143.930	0.0	16																																																																																																																																																																																																																				
30 min Summer	96.151	0.0	31																																																																																																																																																																																																																				
60 min Summer	61.531	0.0	60																																																																																																																																																																																																																				
120 min Summer	36.920	0.0	92																																																																																																																																																																																																																				
180 min Summer	27.160	0.0	126																																																																																																																																																																																																																				
240 min Summer	21.763	0.0	160																																																																																																																																																																																																																				
360 min Summer	15.835	0.0	228																																																																																																																																																																																																																				
480 min Summer	12.539	0.0	294																																																																																																																																																																																																																				
600 min Summer	10.433	0.0	362																																																																																																																																																																																																																				
720 min Summer	8.964	0.0	426																																																																																																																																																																																																																				
960 min Summer	7.046	0.0	556																																																																																																																																																																																																																				
1440 min Summer	4.991	0.0	808																																																																																																																																																																																																																				
2160 min Summer	3.510	0.0	1172																																																																																																																																																																																																																				
2880 min Summer	2.731	0.0	1532																																																																																																																																																																																																																				
4320 min Summer	1.912	0.0	2252																																																																																																																																																																																																																				
5760 min Summer	1.496	0.0	3000																																																																																																																																																																																																																				
7200 min Summer	1.260	0.0	3744																																																																																																																																																																																																																				
8640 min Summer	1.110	0.0	4416																																																																																																																																																																																																																				
10080 min Summer	1.010	0.0	5144																																																																																																																																																																																																																				
15 min Winter	143.930	0.0	16																																																																																																																																																																																																																				
©1982-2018 Innovyze																																																																																																																																																																																																																							


Waterco Ltd				Page 2	
Eden Court		w10685			
Lon Parcwr Business Park		Holt Road, Rossett			
Denbighshire LL15 1NJ		TP7 House Soakaway			
Date 23/05/2018		Designed by HW			
File w10685-180523-TP5_House...		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.780	0.780	0.2	2.2	Flood Risk
60 min Winter	9.922	0.922	0.3	2.6	Flood Risk
120 min Winter	9.967	0.967	0.3	2.8	Flood Risk
180 min Winter	9.970	0.970	0.3	2.8	Flood Risk
240 min Winter	9.954	0.954	0.3	2.7	Flood Risk
360 min Winter	9.901	0.901	0.2	2.6	Flood Risk
480 min Winter	9.839	0.839	0.2	2.4	Flood Risk
600 min Winter	9.781	0.781	0.2	2.2	Flood Risk
720 min Winter	9.728	0.728	0.2	2.1	Flood Risk
960 min Winter	9.641	0.641	0.2	1.8	O K
1440 min Winter	9.514	0.514	0.1	1.5	O K
2160 min Winter	9.395	0.395	0.1	1.1	O K
2880 min Winter	9.321	0.321	0.1	0.9	O K
4320 min Winter	9.234	0.234	0.1	0.7	O K
5760 min Winter	9.187	0.187	0.1	0.5	O K
7200 min Winter	9.159	0.159	0.0	0.5	O K
8640 min Winter	9.141	0.141	0.0	0.4	O K
10080 min Winter	9.129	0.129	0.0	0.4	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	30		
60 min Winter	61.531	0.0	58		
120 min Winter	36.920	0.0	96		
180 min Winter	27.160	0.0	134		
240 min Winter	21.763	0.0	170		
360 min Winter	15.835	0.0	244		
480 min Winter	12.539	0.0	314		
600 min Winter	10.433	0.0	384		
720 min Winter	8.964	0.0	450		
960 min Winter	7.046	0.0	578		
1440 min Winter	4.991	0.0	836		
2160 min Winter	3.510	0.0	1212		
2880 min Winter	2.731	0.0	1584		
4320 min Winter	1.912	0.0	2296		
5760 min Winter	1.496	0.0	3048		
7200 min Winter	1.260	0.0	3744		
8640 min Winter	1.110	0.0	4488		
10080 min Winter	1.010	0.0	5152		
©1982-2018 Innovyze					

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP7 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP5_House...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>1.5</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.28188</td> <td>Trench Length (m)</td> <td>2.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.000</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5	Infiltration Coefficient Side (m/hr)	0.28188	Trench Length (m)	2.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5																			
Infiltration Coefficient Side (m/hr)	0.28188	Trench Length (m)	2.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						


Waterco Ltd		Page 5
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP7 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP5_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

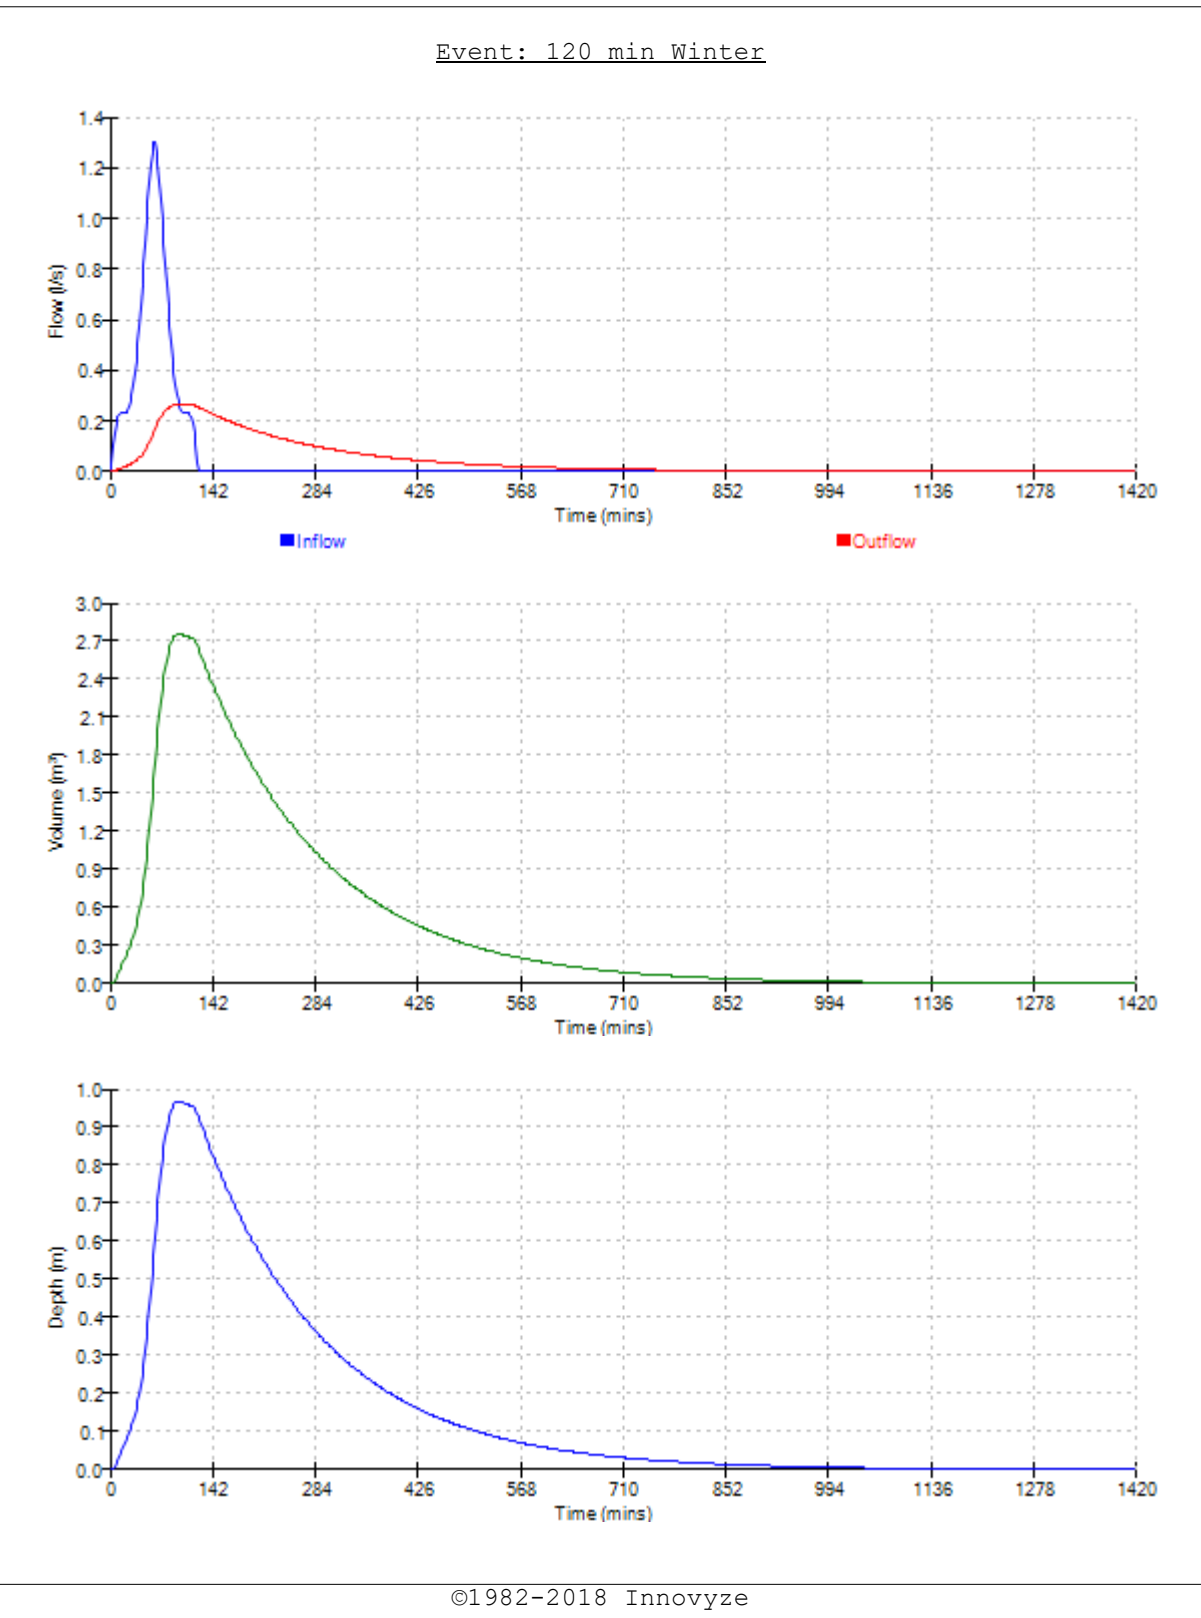

Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP7 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP5_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

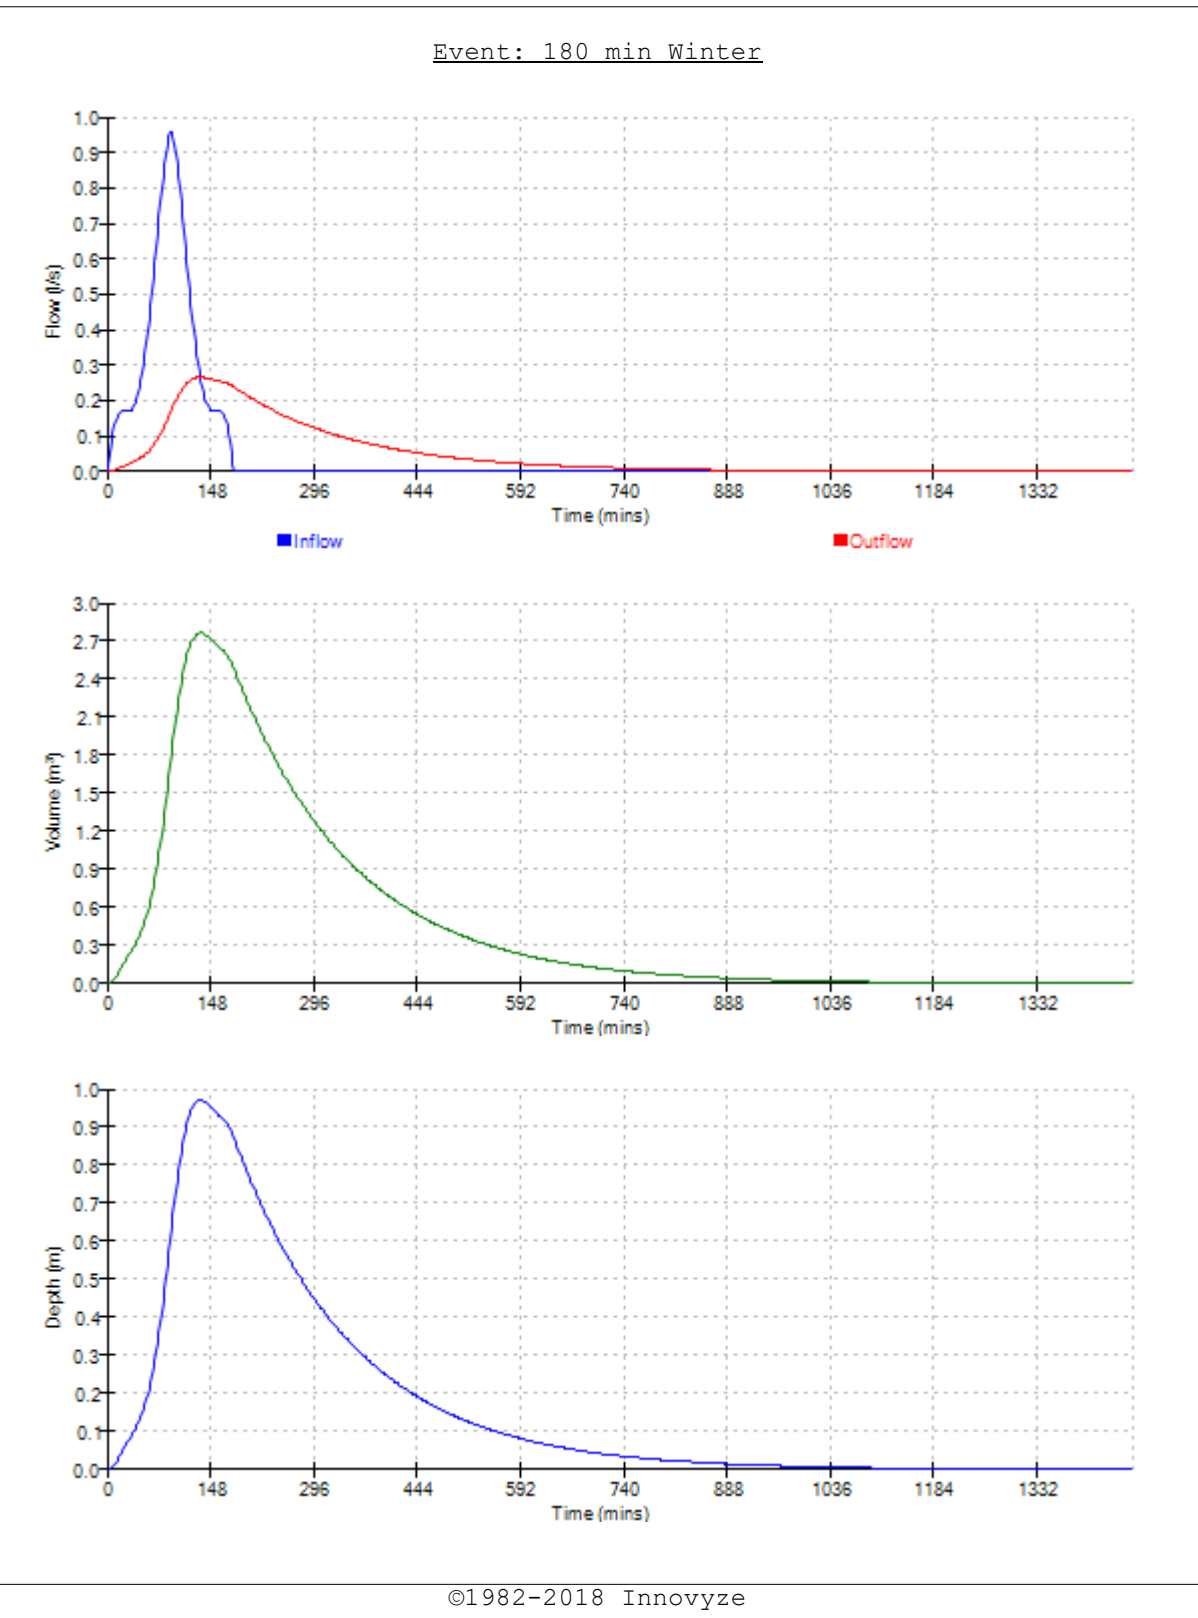

Waterco Ltd		Page 7
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP7 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP5_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

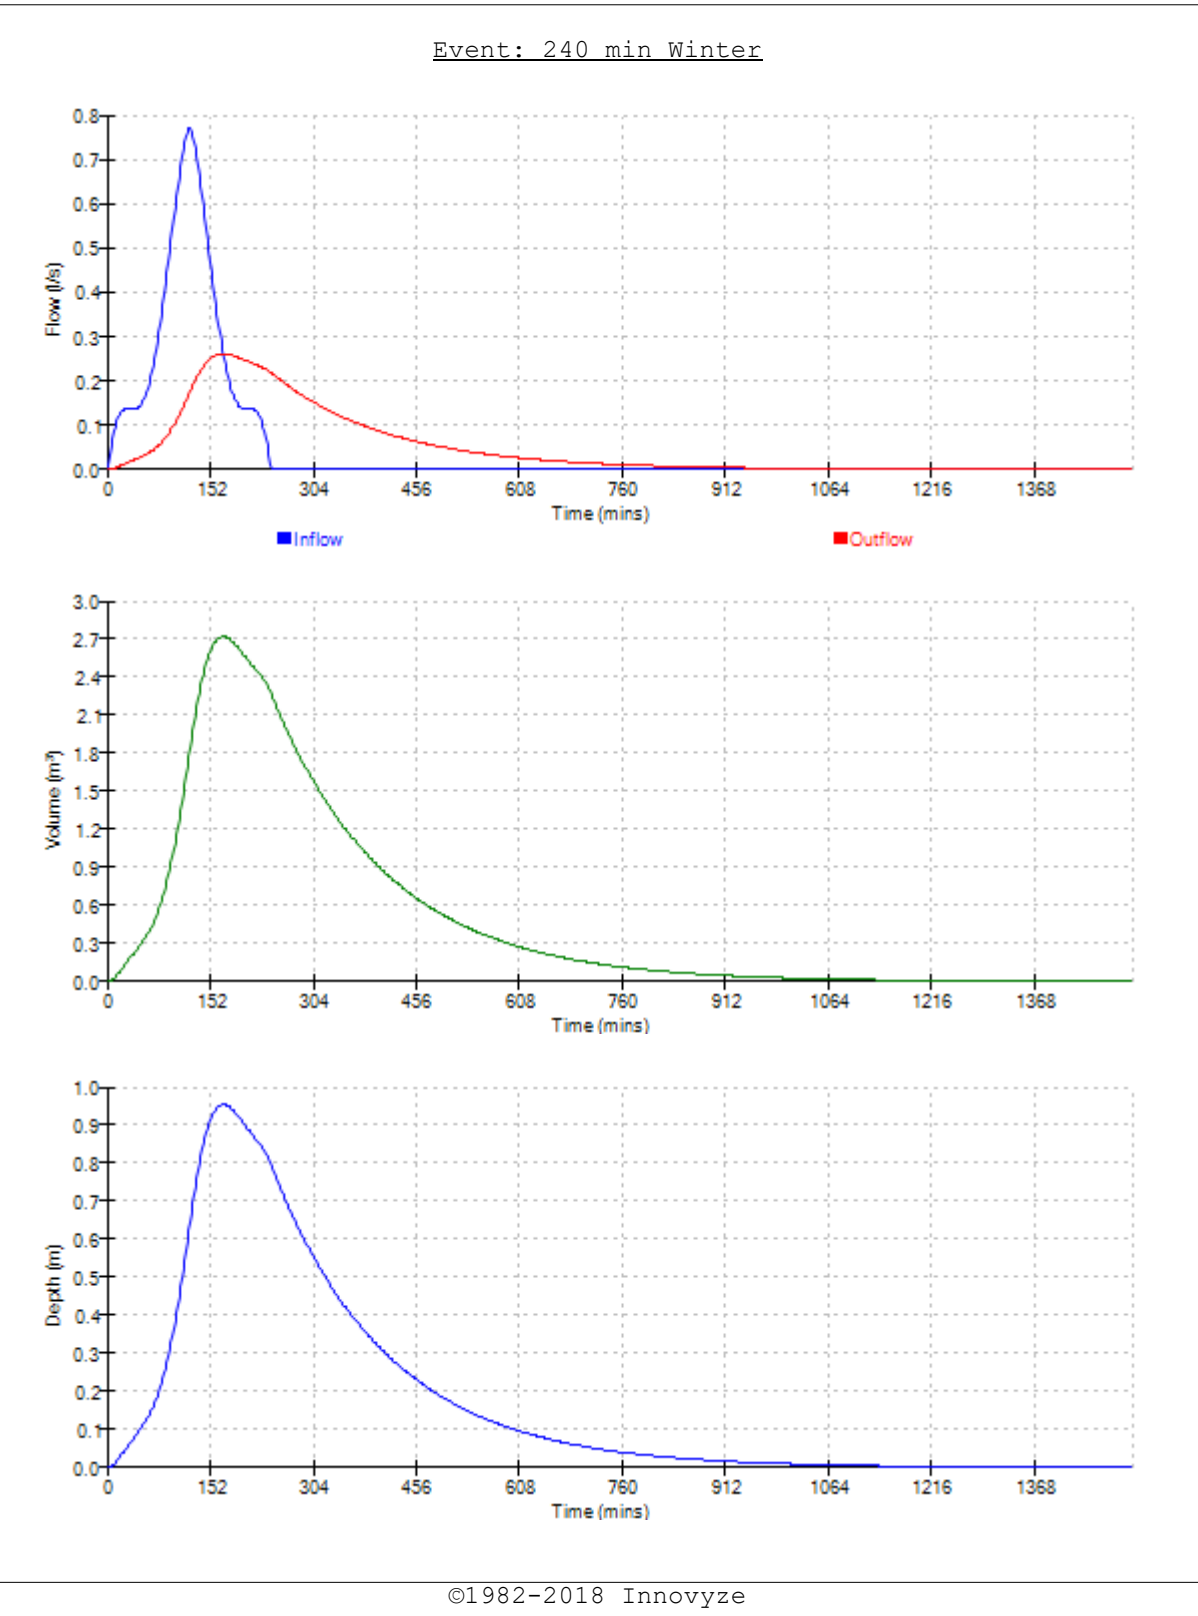


Waterco Ltd				Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																					
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																					
Denbighshire LL15 1NJ		TP8 House Soakaway																																																																																																																																																																																																																					
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																					
File w10685-180523-TP8_House...		Checked by AW																																																																																																																																																																																																																					
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																					
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 12 minutes. <table><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr><tr><td>15 min Summer</td><td>9.777</td><td>0.777</td><td>1.2</td><td>1.1</td><td>Flood Risk</td></tr><tr><td>30 min Summer</td><td>9.859</td><td>0.859</td><td>1.4</td><td>1.2</td><td>Flood Risk</td></tr><tr><td>60 min Summer</td><td>9.833</td><td>0.833</td><td>1.3</td><td>1.2</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.691</td><td>0.691</td><td>1.1</td><td>1.0</td><td>O K</td></tr><tr><td>180 min Summer</td><td>9.586</td><td>0.586</td><td>0.9</td><td>0.8</td><td>O K</td></tr><tr><td>240 min Summer</td><td>9.511</td><td>0.511</td><td>0.8</td><td>0.7</td><td>O K</td></tr><tr><td>360 min Summer</td><td>9.408</td><td>0.408</td><td>0.6</td><td>0.6</td><td>O K</td></tr><tr><td>480 min Summer</td><td>9.340</td><td>0.340</td><td>0.5</td><td>0.5</td><td>O K</td></tr><tr><td>600 min Summer</td><td>9.292</td><td>0.292</td><td>0.5</td><td>0.4</td><td>O K</td></tr><tr><td>720 min Summer</td><td>9.256</td><td>0.256</td><td>0.4</td><td>0.4</td><td>O K</td></tr><tr><td>960 min Summer</td><td>9.207</td><td>0.207</td><td>0.3</td><td>0.3</td><td>O K</td></tr><tr><td>1440 min Summer</td><td>9.151</td><td>0.151</td><td>0.2</td><td>0.2</td><td>O K</td></tr><tr><td>2160 min Summer</td><td>9.108</td><td>0.108</td><td>0.2</td><td>0.2</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.084</td><td>0.084</td><td>0.1</td><td>0.1</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.059</td><td>0.059</td><td>0.1</td><td>0.1</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.046</td><td>0.046</td><td>0.1</td><td>0.1</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.039</td><td>0.039</td><td>0.1</td><td>0.1</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.035</td><td>0.035</td><td>0.1</td><td>0.0</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.031</td><td>0.031</td><td>0.0</td><td>0.0</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.862</td><td>0.862</td><td>1.4</td><td>1.2</td><td>Flood Risk</td></tr></table> <table><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>11</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>20</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>36</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>68</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>100</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>130</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>190</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>250</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>312</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>370</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>490</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>734</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1100</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1468</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2196</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>2936</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3616</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4352</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5136</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>12</td></tr></table>						Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.777	0.777	1.2	1.1	Flood Risk	30 min Summer	9.859	0.859	1.4	1.2	Flood Risk	60 min Summer	9.833	0.833	1.3	1.2	Flood Risk	120 min Summer	9.691	0.691	1.1	1.0	O K	180 min Summer	9.586	0.586	0.9	0.8	O K	240 min Summer	9.511	0.511	0.8	0.7	O K	360 min Summer	9.408	0.408	0.6	0.6	O K	480 min Summer	9.340	0.340	0.5	0.5	O K	600 min Summer	9.292	0.292	0.5	0.4	O K	720 min Summer	9.256	0.256	0.4	0.4	O K	960 min Summer	9.207	0.207	0.3	0.3	O K	1440 min Summer	9.151	0.151	0.2	0.2	O K	2160 min Summer	9.108	0.108	0.2	0.2	O K	2880 min Summer	9.084	0.084	0.1	0.1	O K	4320 min Summer	9.059	0.059	0.1	0.1	O K	5760 min Summer	9.046	0.046	0.1	0.1	O K	7200 min Summer	9.039	0.039	0.1	0.1	O K	8640 min Summer	9.035	0.035	0.1	0.0	O K	10080 min Summer	9.031	0.031	0.0	0.0	O K	15 min Winter	9.862	0.862	1.4	1.2	Flood Risk	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	11	30 min Summer	96.151	0.0	20	60 min Summer	61.531	0.0	36	120 min Summer	36.920	0.0	68	180 min Summer	27.160	0.0	100	240 min Summer	21.763	0.0	130	360 min Summer	15.835	0.0	190	480 min Summer	12.539	0.0	250	600 min Summer	10.433	0.0	312	720 min Summer	8.964	0.0	370	960 min Summer	7.046	0.0	490	1440 min Summer	4.991	0.0	734	2160 min Summer	3.510	0.0	1100	2880 min Summer	2.731	0.0	1468	4320 min Summer	1.912	0.0	2196	5760 min Summer	1.496	0.0	2936	7200 min Summer	1.260	0.0	3616	8640 min Summer	1.110	0.0	4352	10080 min Summer	1.010	0.0	5136	15 min Winter	143.930	0.0	12
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																		
15 min Summer	9.777	0.777	1.2	1.1	Flood Risk																																																																																																																																																																																																																		
30 min Summer	9.859	0.859	1.4	1.2	Flood Risk																																																																																																																																																																																																																		
60 min Summer	9.833	0.833	1.3	1.2	Flood Risk																																																																																																																																																																																																																		
120 min Summer	9.691	0.691	1.1	1.0	O K																																																																																																																																																																																																																		
180 min Summer	9.586	0.586	0.9	0.8	O K																																																																																																																																																																																																																		
240 min Summer	9.511	0.511	0.8	0.7	O K																																																																																																																																																																																																																		
360 min Summer	9.408	0.408	0.6	0.6	O K																																																																																																																																																																																																																		
480 min Summer	9.340	0.340	0.5	0.5	O K																																																																																																																																																																																																																		
600 min Summer	9.292	0.292	0.5	0.4	O K																																																																																																																																																																																																																		
720 min Summer	9.256	0.256	0.4	0.4	O K																																																																																																																																																																																																																		
960 min Summer	9.207	0.207	0.3	0.3	O K																																																																																																																																																																																																																		
1440 min Summer	9.151	0.151	0.2	0.2	O K																																																																																																																																																																																																																		
2160 min Summer	9.108	0.108	0.2	0.2	O K																																																																																																																																																																																																																		
2880 min Summer	9.084	0.084	0.1	0.1	O K																																																																																																																																																																																																																		
4320 min Summer	9.059	0.059	0.1	0.1	O K																																																																																																																																																																																																																		
5760 min Summer	9.046	0.046	0.1	0.1	O K																																																																																																																																																																																																																		
7200 min Summer	9.039	0.039	0.1	0.1	O K																																																																																																																																																																																																																		
8640 min Summer	9.035	0.035	0.1	0.0	O K																																																																																																																																																																																																																		
10080 min Summer	9.031	0.031	0.0	0.0	O K																																																																																																																																																																																																																		
15 min Winter	9.862	0.862	1.4	1.2	Flood Risk																																																																																																																																																																																																																		
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																				
15 min Summer	143.930	0.0	11																																																																																																																																																																																																																				
30 min Summer	96.151	0.0	20																																																																																																																																																																																																																				
60 min Summer	61.531	0.0	36																																																																																																																																																																																																																				
120 min Summer	36.920	0.0	68																																																																																																																																																																																																																				
180 min Summer	27.160	0.0	100																																																																																																																																																																																																																				
240 min Summer	21.763	0.0	130																																																																																																																																																																																																																				
360 min Summer	15.835	0.0	190																																																																																																																																																																																																																				
480 min Summer	12.539	0.0	250																																																																																																																																																																																																																				
600 min Summer	10.433	0.0	312																																																																																																																																																																																																																				
720 min Summer	8.964	0.0	370																																																																																																																																																																																																																				
960 min Summer	7.046	0.0	490																																																																																																																																																																																																																				
1440 min Summer	4.991	0.0	734																																																																																																																																																																																																																				
2160 min Summer	3.510	0.0	1100																																																																																																																																																																																																																				
2880 min Summer	2.731	0.0	1468																																																																																																																																																																																																																				
4320 min Summer	1.912	0.0	2196																																																																																																																																																																																																																				
5760 min Summer	1.496	0.0	2936																																																																																																																																																																																																																				
7200 min Summer	1.260	0.0	3616																																																																																																																																																																																																																				
8640 min Summer	1.110	0.0	4352																																																																																																																																																																																																																				
10080 min Summer	1.010	0.0	5136																																																																																																																																																																																																																				
15 min Winter	143.930	0.0	12																																																																																																																																																																																																																				
©1982-2018 Innovyze																																																																																																																																																																																																																							


Waterco Ltd					Page 2
Eden Court		w10685			
Lon Parcwr Business Park		Holt Road, Rossett			
Denbighshire LL15 1NJ		TP8 House Soakaway			
Date 23/05/2018		Designed by HW			
File w10685-180523-TP8_House...		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.924	0.924	1.5	1.3	Flood Risk
60 min Winter	9.848	0.848	1.3	1.2	Flood Risk
120 min Winter	9.650	0.650	1.0	0.9	O K
180 min Winter	9.525	0.525	0.8	0.7	O K
240 min Winter	9.440	0.440	0.7	0.6	O K
360 min Winter	9.335	0.335	0.5	0.5	O K
480 min Winter	9.271	0.271	0.4	0.4	O K
600 min Winter	9.228	0.228	0.4	0.3	O K
720 min Winter	9.197	0.197	0.3	0.3	O K
960 min Winter	9.156	0.156	0.2	0.2	O K
1440 min Winter	9.111	0.111	0.2	0.2	O K
2160 min Winter	9.078	0.078	0.1	0.1	O K
2880 min Winter	9.061	0.061	0.1	0.1	O K
4320 min Winter	9.043	0.043	0.1	0.1	O K
5760 min Winter	9.034	0.034	0.1	0.0	O K
7200 min Winter	9.028	0.028	0.0	0.0	O K
8640 min Winter	9.025	0.025	0.0	0.0	O K
10080 min Winter	9.023	0.023	0.0	0.0	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	21		
60 min Winter	61.531	0.0	38		
120 min Winter	36.920	0.0	72		
180 min Winter	27.160	0.0	102		
240 min Winter	21.763	0.0	132		
360 min Winter	15.835	0.0	194		
480 min Winter	12.539	0.0	254		
600 min Winter	10.433	0.0	314		
720 min Winter	8.964	0.0	374		
960 min Winter	7.046	0.0	492		
1440 min Winter	4.991	0.0	734		
2160 min Winter	3.510	0.0	1100		
2880 min Winter	2.731	0.0	1468		
4320 min Winter	1.912	0.0	2200		
5760 min Winter	1.496	0.0	2864		
7200 min Winter	1.260	0.0	3656		
8640 min Winter	1.110	0.0	4304		
10080 min Winter	1.010	0.0	5128		
©1982-2018 Innovyze					


Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP8 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP8_House...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>1.5</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>2.27880</td> <td>Trench Length (m)</td> <td>1.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.000</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5	Infiltration Coefficient Side (m/hr)	2.27880	Trench Length (m)	1.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5																			
Infiltration Coefficient Side (m/hr)	2.27880	Trench Length (m)	1.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						

Waterco Ltd		Page 5
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP8 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP8_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

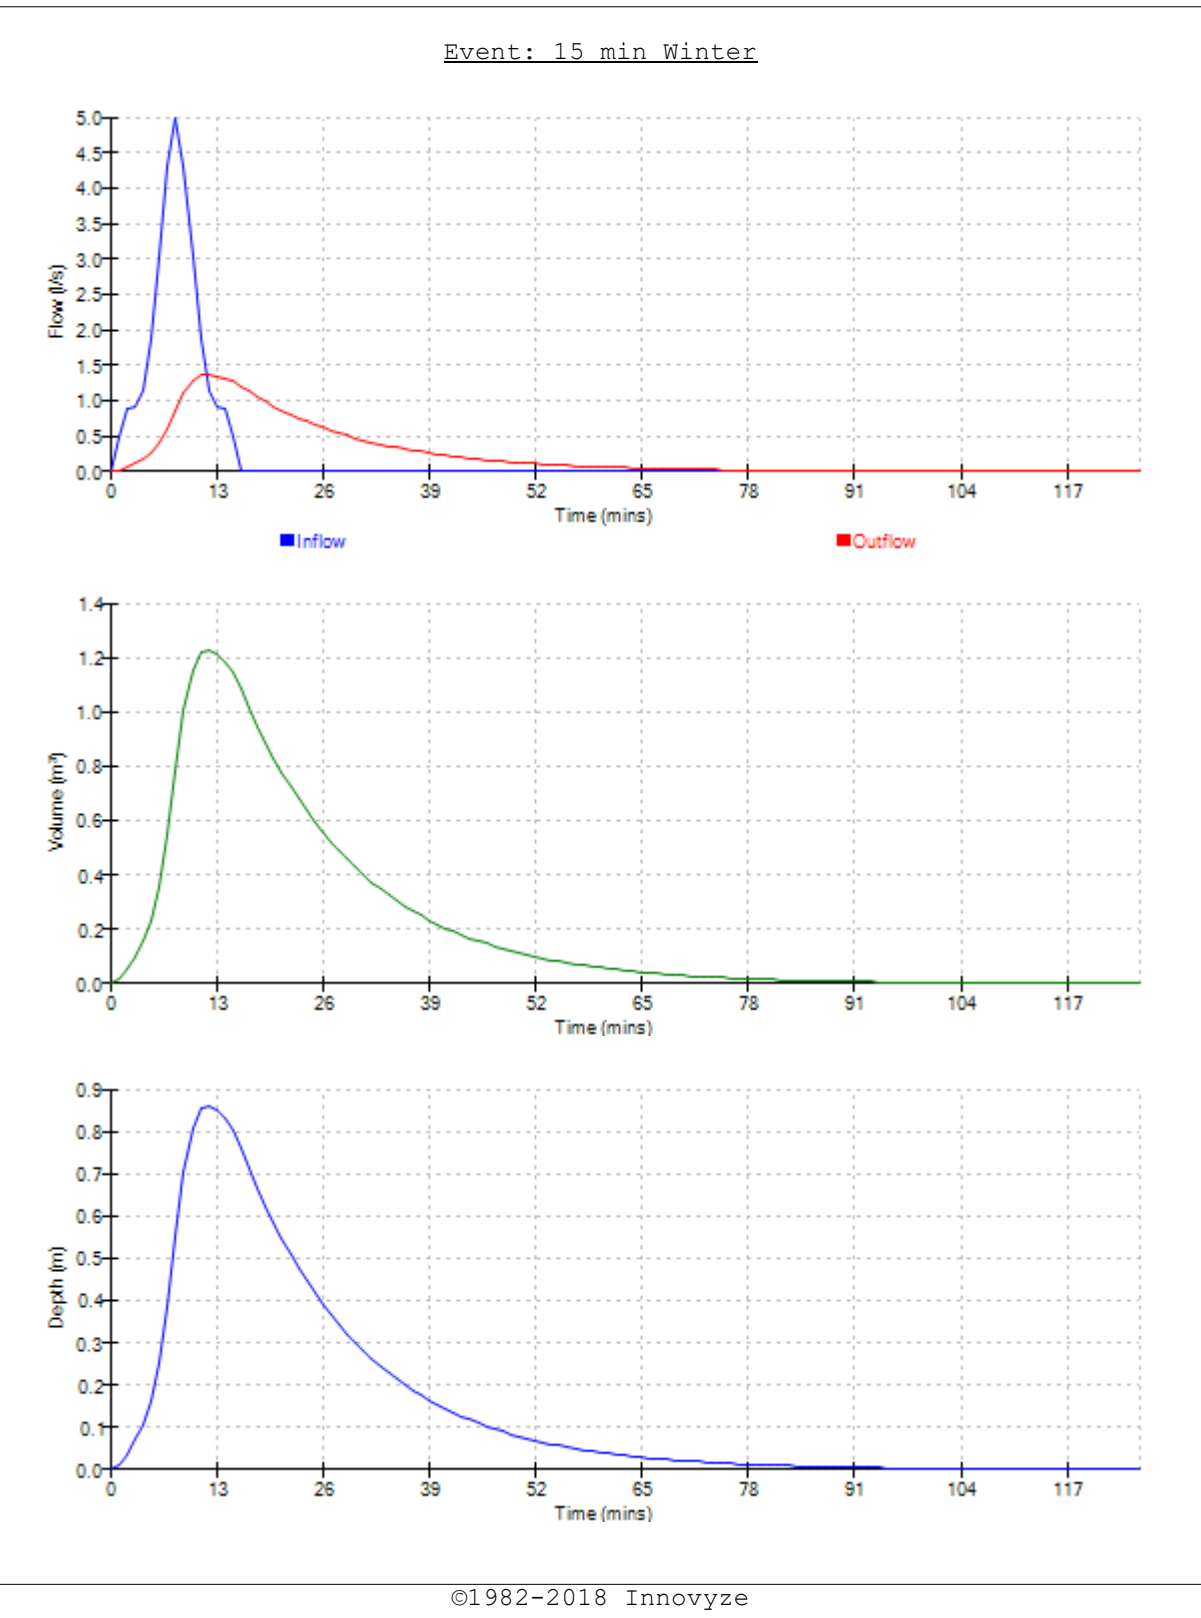

Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP8 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP8_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

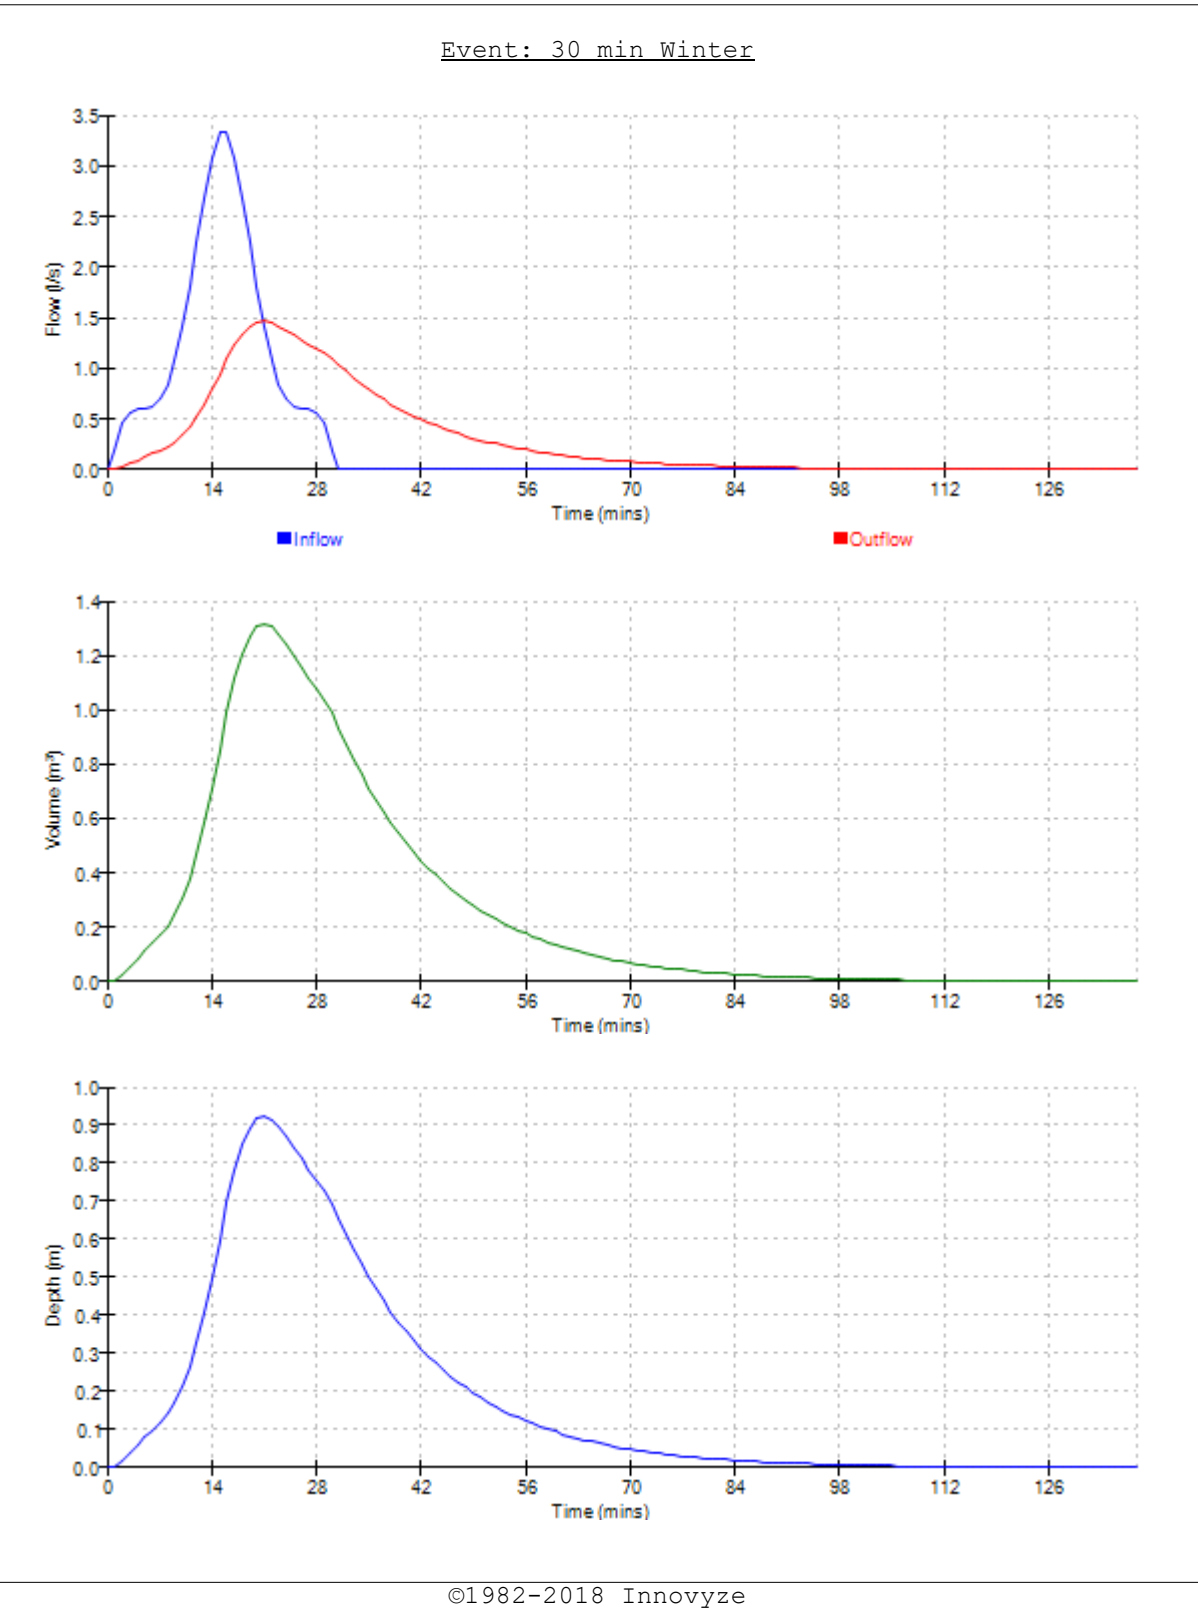

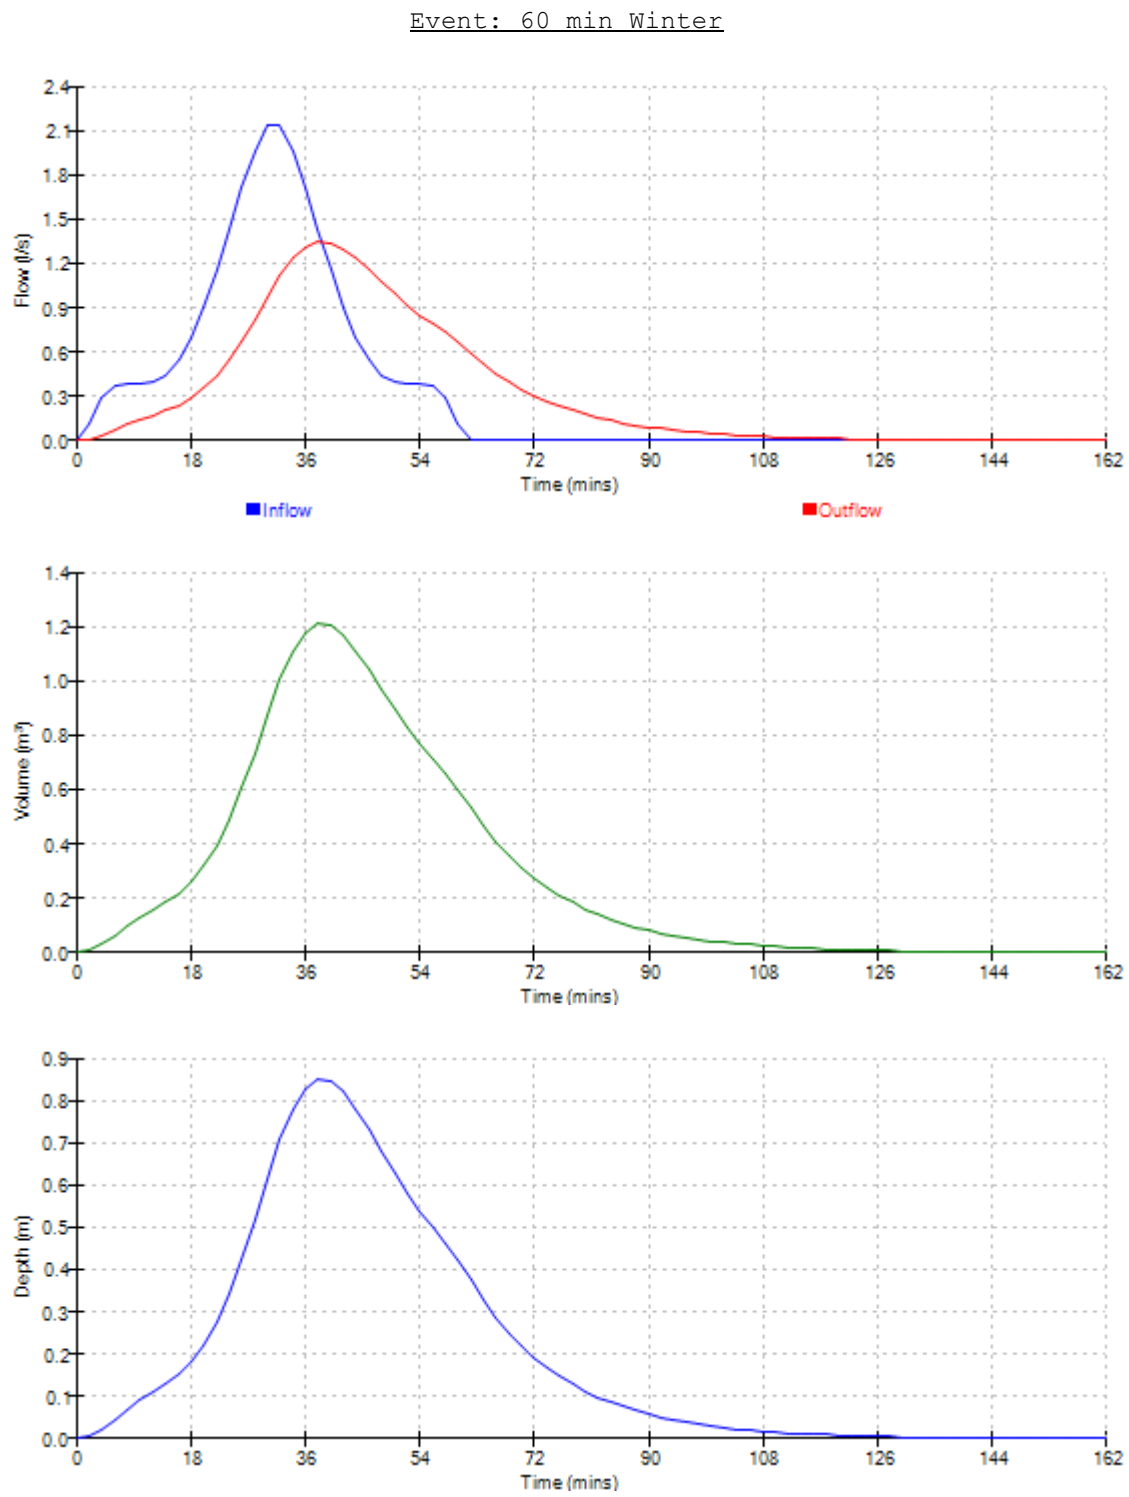

Waterco Ltd			Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																				
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																				
Denbighshire LL15 1NJ		TP9 House Soakaway																																																																																																																																																																																																																				
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																				
File w10685-180523-TP9_House...		Checked by AW																																																																																																																																																																																																																				
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																				
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 81 minutes. <table><thead><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr></thead><tbody><tr><td>15 min Summer</td><td>9.529</td><td>0.529</td><td>0.2</td><td>1.5</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.663</td><td>0.663</td><td>0.3</td><td>1.9</td><td>O K</td></tr><tr><td>60 min Summer</td><td>9.755</td><td>0.755</td><td>0.3</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.786</td><td>0.786</td><td>0.3</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.781</td><td>0.781</td><td>0.3</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.762</td><td>0.762</td><td>0.3</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.713</td><td>0.713</td><td>0.3</td><td>2.0</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.661</td><td>0.661</td><td>0.3</td><td>1.9</td><td>O K</td></tr><tr><td>600 min Summer</td><td>9.614</td><td>0.614</td><td>0.3</td><td>1.7</td><td>O K</td></tr><tr><td>720 min Summer</td><td>9.572</td><td>0.572</td><td>0.2</td><td>1.6</td><td>O K</td></tr><tr><td>960 min Summer</td><td>9.505</td><td>0.505</td><td>0.2</td><td>1.4</td><td>O K</td></tr><tr><td>1440 min Summer</td><td>9.410</td><td>0.410</td><td>0.2</td><td>1.2</td><td>O K</td></tr><tr><td>2160 min Summer</td><td>9.321</td><td>0.321</td><td>0.1</td><td>0.9</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.265</td><td>0.265</td><td>0.1</td><td>0.8</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.198</td><td>0.198</td><td>0.1</td><td>0.6</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.160</td><td>0.160</td><td>0.1</td><td>0.5</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.138</td><td>0.138</td><td>0.1</td><td>0.4</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.124</td><td>0.124</td><td>0.1</td><td>0.4</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.113</td><td>0.113</td><td>0.0</td><td>0.3</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.593</td><td>0.593</td><td>0.3</td><td>1.7</td><td>O K</td></tr></tbody></table> <table><thead><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr></thead><tbody><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>30</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>52</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>84</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>118</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>152</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>218</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>284</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>348</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>412</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>538</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>780</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1148</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1504</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2244</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>2944</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3680</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4408</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5144</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>15</td></tr></tbody></table>					Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.529	0.529	0.2	1.5	O K	30 min Summer	9.663	0.663	0.3	1.9	O K	60 min Summer	9.755	0.755	0.3	2.2	Flood Risk	120 min Summer	9.786	0.786	0.3	2.2	Flood Risk	180 min Summer	9.781	0.781	0.3	2.2	Flood Risk	240 min Summer	9.762	0.762	0.3	2.2	Flood Risk	360 min Summer	9.713	0.713	0.3	2.0	Flood Risk	480 min Summer	9.661	0.661	0.3	1.9	O K	600 min Summer	9.614	0.614	0.3	1.7	O K	720 min Summer	9.572	0.572	0.2	1.6	O K	960 min Summer	9.505	0.505	0.2	1.4	O K	1440 min Summer	9.410	0.410	0.2	1.2	O K	2160 min Summer	9.321	0.321	0.1	0.9	O K	2880 min Summer	9.265	0.265	0.1	0.8	O K	4320 min Summer	9.198	0.198	0.1	0.6	O K	5760 min Summer	9.160	0.160	0.1	0.5	O K	7200 min Summer	9.138	0.138	0.1	0.4	O K	8640 min Summer	9.124	0.124	0.1	0.4	O K	10080 min Summer	9.113	0.113	0.0	0.3	O K	15 min Winter	9.593	0.593	0.3	1.7	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	30	60 min Summer	61.531	0.0	52	120 min Summer	36.920	0.0	84	180 min Summer	27.160	0.0	118	240 min Summer	21.763	0.0	152	360 min Summer	15.835	0.0	218	480 min Summer	12.539	0.0	284	600 min Summer	10.433	0.0	348	720 min Summer	8.964	0.0	412	960 min Summer	7.046	0.0	538	1440 min Summer	4.991	0.0	780	2160 min Summer	3.510	0.0	1148	2880 min Summer	2.731	0.0	1504	4320 min Summer	1.912	0.0	2244	5760 min Summer	1.496	0.0	2944	7200 min Summer	1.260	0.0	3680	8640 min Summer	1.110	0.0	4408	10080 min Summer	1.010	0.0	5144	15 min Winter	143.930	0.0	15
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																	
15 min Summer	9.529	0.529	0.2	1.5	O K																																																																																																																																																																																																																	
30 min Summer	9.663	0.663	0.3	1.9	O K																																																																																																																																																																																																																	
60 min Summer	9.755	0.755	0.3	2.2	Flood Risk																																																																																																																																																																																																																	
120 min Summer	9.786	0.786	0.3	2.2	Flood Risk																																																																																																																																																																																																																	
180 min Summer	9.781	0.781	0.3	2.2	Flood Risk																																																																																																																																																																																																																	
240 min Summer	9.762	0.762	0.3	2.2	Flood Risk																																																																																																																																																																																																																	
360 min Summer	9.713	0.713	0.3	2.0	Flood Risk																																																																																																																																																																																																																	
480 min Summer	9.661	0.661	0.3	1.9	O K																																																																																																																																																																																																																	
600 min Summer	9.614	0.614	0.3	1.7	O K																																																																																																																																																																																																																	
720 min Summer	9.572	0.572	0.2	1.6	O K																																																																																																																																																																																																																	
960 min Summer	9.505	0.505	0.2	1.4	O K																																																																																																																																																																																																																	
1440 min Summer	9.410	0.410	0.2	1.2	O K																																																																																																																																																																																																																	
2160 min Summer	9.321	0.321	0.1	0.9	O K																																																																																																																																																																																																																	
2880 min Summer	9.265	0.265	0.1	0.8	O K																																																																																																																																																																																																																	
4320 min Summer	9.198	0.198	0.1	0.6	O K																																																																																																																																																																																																																	
5760 min Summer	9.160	0.160	0.1	0.5	O K																																																																																																																																																																																																																	
7200 min Summer	9.138	0.138	0.1	0.4	O K																																																																																																																																																																																																																	
8640 min Summer	9.124	0.124	0.1	0.4	O K																																																																																																																																																																																																																	
10080 min Summer	9.113	0.113	0.0	0.3	O K																																																																																																																																																																																																																	
15 min Winter	9.593	0.593	0.3	1.7	O K																																																																																																																																																																																																																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																			
15 min Summer	143.930	0.0	16																																																																																																																																																																																																																			
30 min Summer	96.151	0.0	30																																																																																																																																																																																																																			
60 min Summer	61.531	0.0	52																																																																																																																																																																																																																			
120 min Summer	36.920	0.0	84																																																																																																																																																																																																																			
180 min Summer	27.160	0.0	118																																																																																																																																																																																																																			
240 min Summer	21.763	0.0	152																																																																																																																																																																																																																			
360 min Summer	15.835	0.0	218																																																																																																																																																																																																																			
480 min Summer	12.539	0.0	284																																																																																																																																																																																																																			
600 min Summer	10.433	0.0	348																																																																																																																																																																																																																			
720 min Summer	8.964	0.0	412																																																																																																																																																																																																																			
960 min Summer	7.046	0.0	538																																																																																																																																																																																																																			
1440 min Summer	4.991	0.0	780																																																																																																																																																																																																																			
2160 min Summer	3.510	0.0	1148																																																																																																																																																																																																																			
2880 min Summer	2.731	0.0	1504																																																																																																																																																																																																																			
4320 min Summer	1.912	0.0	2244																																																																																																																																																																																																																			
5760 min Summer	1.496	0.0	2944																																																																																																																																																																																																																			
7200 min Summer	1.260	0.0	3680																																																																																																																																																																																																																			
8640 min Summer	1.110	0.0	4408																																																																																																																																																																																																																			
10080 min Summer	1.010	0.0	5144																																																																																																																																																																																																																			
15 min Winter	143.930	0.0	15																																																																																																																																																																																																																			
©1982-2018 Innovyze																																																																																																																																																																																																																						

Waterco Ltd		Page 2
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 Holt Road, Rossett TP9 House Soakaway	
Date 23/05/2018 File w10685-180523-TP9_House...	Designed by HW Checked by AW	
XP Solutions	Source Control 2018.1	


Summary of Results for 100 year Return Period (+30%)

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
30 min Winter	9.746	0.746	0.3	2.1	Flood Risk
60 min Winter	9.849	0.849	0.4	2.4	Flood Risk
120 min Winter	9.871	0.871	0.4	2.5	Flood Risk
180 min Winter	9.849	0.849	0.4	2.4	Flood Risk
240 min Winter	9.814	0.814	0.3	2.3	Flood Risk
360 min Winter	9.737	0.737	0.3	2.1	Flood Risk
480 min Winter	9.665	0.665	0.3	1.9	O K
600 min Winter	9.604	0.604	0.3	1.7	O K
720 min Winter	9.552	0.552	0.2	1.6	O K
960 min Winter	9.471	0.471	0.2	1.3	O K
1440 min Winter	9.363	0.363	0.2	1.0	O K
2160 min Winter	9.270	0.270	0.1	0.8	O K
2880 min Winter	9.216	0.216	0.1	0.6	O K
4320 min Winter	9.155	0.155	0.1	0.4	O K
5760 min Winter	9.122	0.122	0.1	0.3	O K
7200 min Winter	9.104	0.104	0.0	0.3	O K
8640 min Winter	9.092	0.092	0.0	0.3	O K
10080 min Winter	9.084	0.084	0.0	0.2	O K


Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
30 min Winter	96.151	0.0	30
60 min Winter	61.531	0.0	56
120 min Winter	36.920	0.0	88
180 min Winter	27.160	0.0	126
240 min Winter	21.763	0.0	162
360 min Winter	15.835	0.0	232
480 min Winter	12.539	0.0	300
600 min Winter	10.433	0.0	366
720 min Winter	8.964	0.0	432
960 min Winter	7.046	0.0	558
1440 min Winter	4.991	0.0	806
2160 min Winter	3.510	0.0	1168
2880 min Winter	2.731	0.0	1532
4320 min Winter	1.912	0.0	2248
5760 min Winter	1.496	0.0	2992
7200 min Winter	1.260	0.0	3680
8640 min Winter	1.110	0.0	4408
10080 min Winter	1.010	0.0	5136

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP9 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP9_House...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>1.5</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.43812</td> <td>Trench Length (m)</td> <td>2.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.000</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5	Infiltration Coefficient Side (m/hr)	0.43812	Trench Length (m)	2.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	1.5																			
Infiltration Coefficient Side (m/hr)	0.43812	Trench Length (m)	2.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						


Waterco Ltd		Page 5
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP9 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP9_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

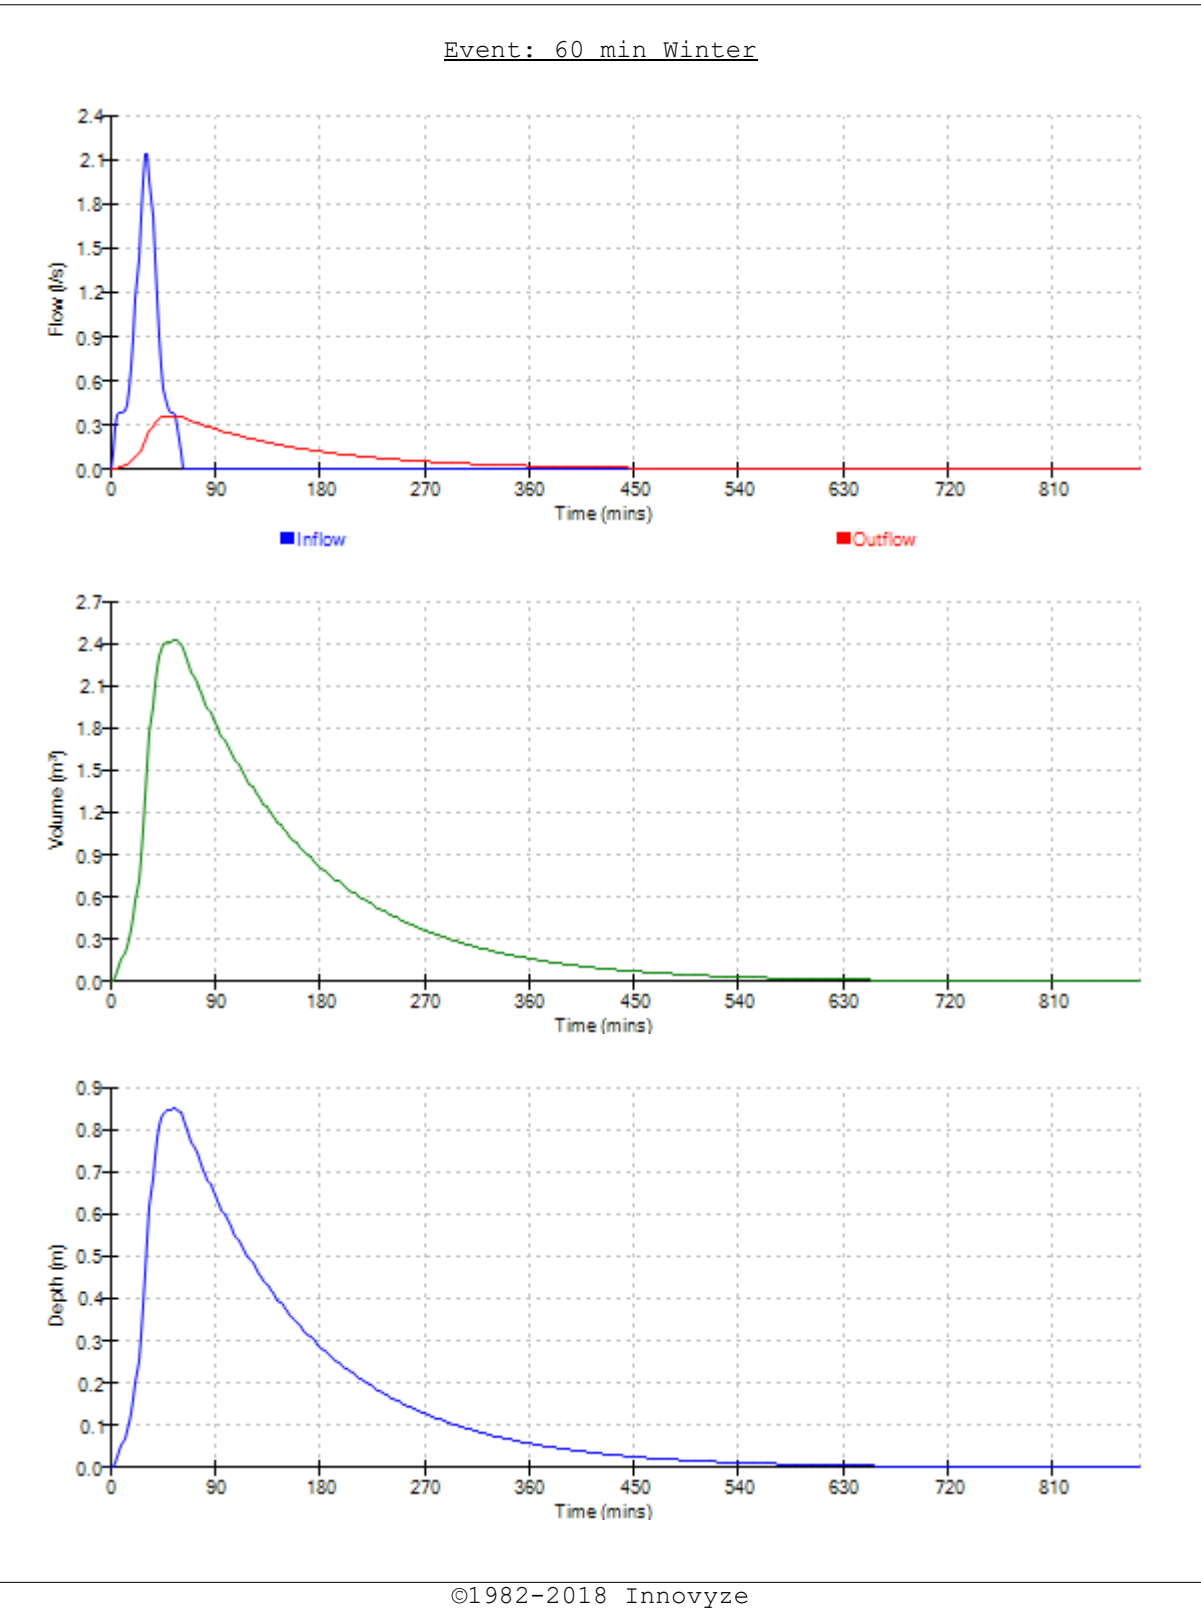

Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP9 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP9_House...	Checked by AW	
XP Solutions	Source Control 2018.1	

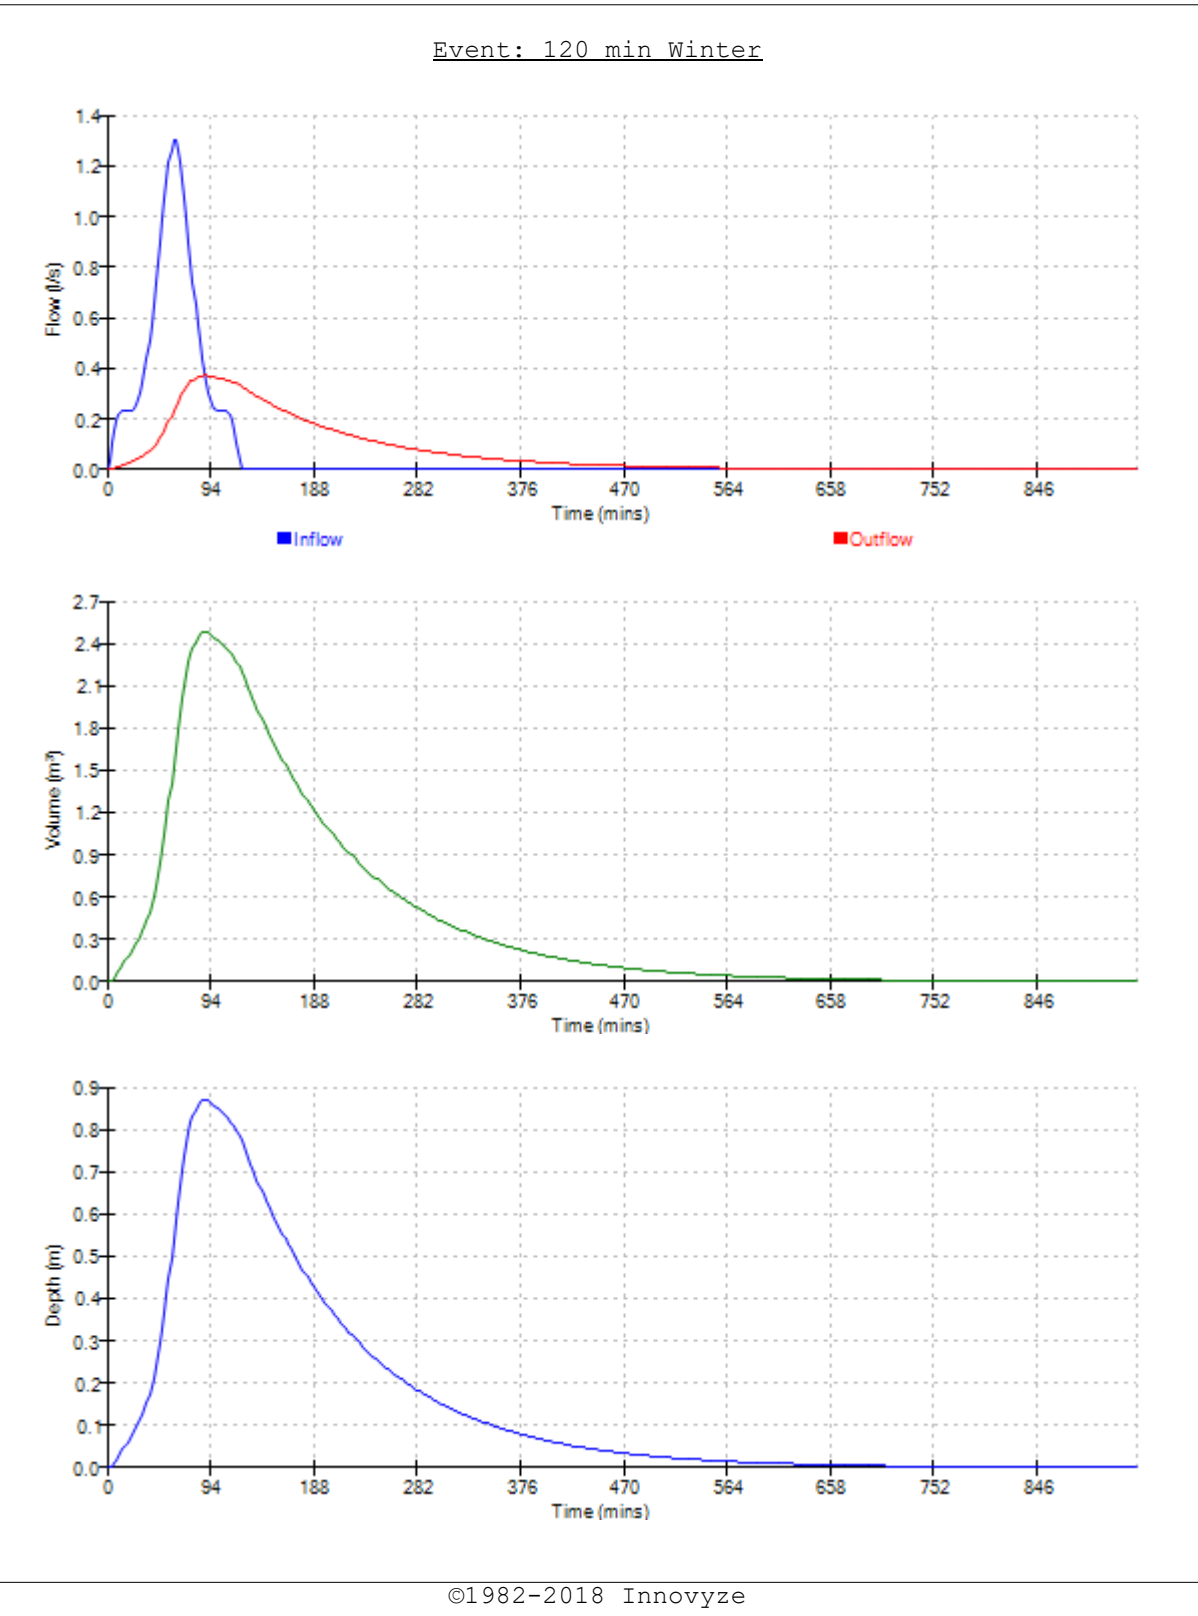

Waterco Ltd		Page 7
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP9 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP9_House...	Checked by AW	
XP Solutions	Source Control 2018.1	



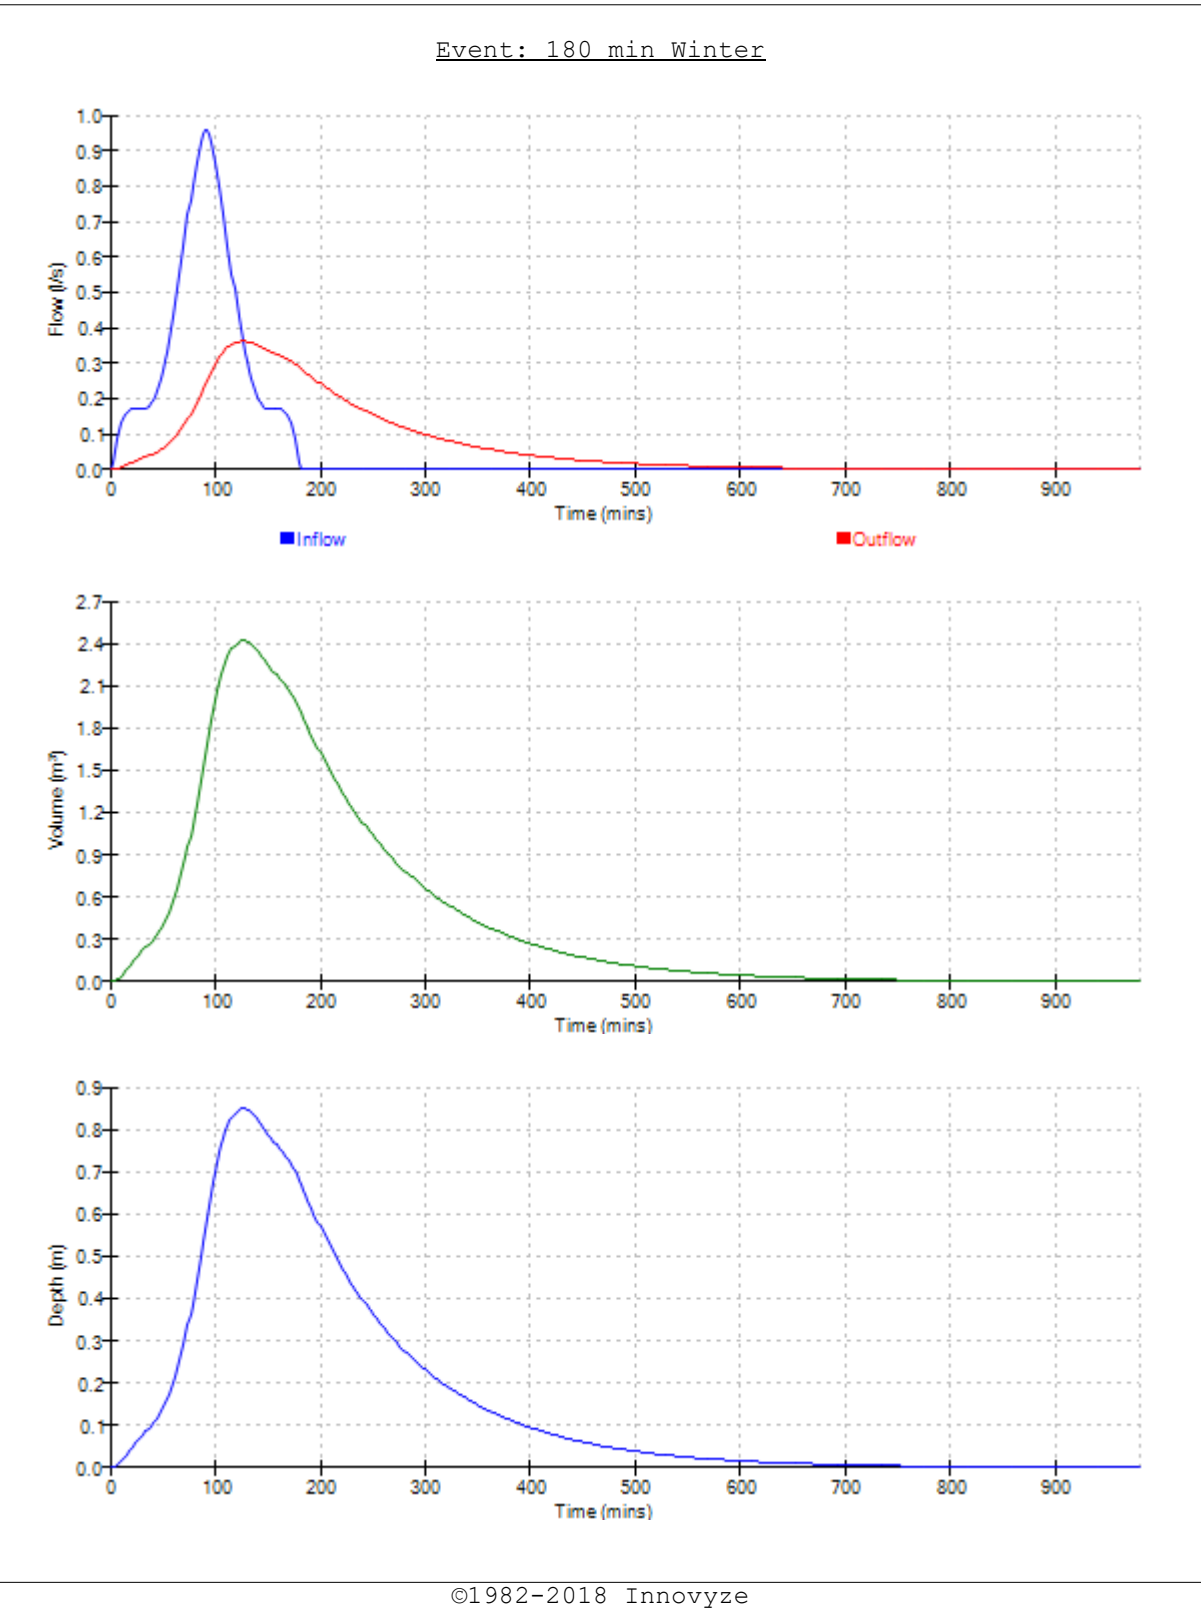


Waterco Ltd			Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																				
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																				
Denbighshire LL15 1NJ		TP10 House Soakaway																																																																																																																																																																																																																				
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																				
File w10685-180523-TP10_Hous...		Checked by AW																																																																																																																																																																																																																				
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																				
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 846 minutes. <table><thead><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr></thead><tbody><tr><td>15 min Summer</td><td>9.339</td><td>0.339</td><td>0.0</td><td>1.6</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.450</td><td>0.450</td><td>0.0</td><td>2.1</td><td>O K</td></tr><tr><td>60 min Summer</td><td>9.569</td><td>0.569</td><td>0.0</td><td>2.7</td><td>O K</td></tr><tr><td>120 min Summer</td><td>9.666</td><td>0.666</td><td>0.0</td><td>3.2</td><td>O K</td></tr><tr><td>180 min Summer</td><td>9.718</td><td>0.718</td><td>0.0</td><td>3.4</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.749</td><td>0.749</td><td>0.0</td><td>3.6</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.780</td><td>0.780</td><td>0.0</td><td>3.7</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.785</td><td>0.785</td><td>0.1</td><td>3.7</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.783</td><td>0.783</td><td>0.0</td><td>3.7</td><td>Flood Risk</td></tr><tr><td>720 min Summer</td><td>9.781</td><td>0.781</td><td>0.0</td><td>3.7</td><td>Flood Risk</td></tr><tr><td>960 min Summer</td><td>9.773</td><td>0.773</td><td>0.0</td><td>3.7</td><td>Flood Risk</td></tr><tr><td>1440 min Summer</td><td>9.752</td><td>0.752</td><td>0.0</td><td>3.6</td><td>Flood Risk</td></tr><tr><td>2160 min Summer</td><td>9.711</td><td>0.711</td><td>0.0</td><td>3.4</td><td>Flood Risk</td></tr><tr><td>2880 min Summer</td><td>9.671</td><td>0.671</td><td>0.0</td><td>3.2</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.601</td><td>0.601</td><td>0.0</td><td>2.9</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.547</td><td>0.547</td><td>0.0</td><td>2.6</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.513</td><td>0.513</td><td>0.0</td><td>2.4</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.489</td><td>0.489</td><td>0.0</td><td>2.3</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.473</td><td>0.473</td><td>0.0</td><td>2.2</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.379</td><td>0.379</td><td>0.0</td><td>1.8</td><td>O K</td></tr></tbody></table> <table><thead><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr></thead><tbody><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>31</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>62</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>122</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>182</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>240</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>360</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>480</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>524</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>584</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>710</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>978</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1384</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1792</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2596</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>3392</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>4176</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4920</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5648</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>16</td></tr></tbody></table>					Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.339	0.339	0.0	1.6	O K	30 min Summer	9.450	0.450	0.0	2.1	O K	60 min Summer	9.569	0.569	0.0	2.7	O K	120 min Summer	9.666	0.666	0.0	3.2	O K	180 min Summer	9.718	0.718	0.0	3.4	Flood Risk	240 min Summer	9.749	0.749	0.0	3.6	Flood Risk	360 min Summer	9.780	0.780	0.0	3.7	Flood Risk	480 min Summer	9.785	0.785	0.1	3.7	Flood Risk	600 min Summer	9.783	0.783	0.0	3.7	Flood Risk	720 min Summer	9.781	0.781	0.0	3.7	Flood Risk	960 min Summer	9.773	0.773	0.0	3.7	Flood Risk	1440 min Summer	9.752	0.752	0.0	3.6	Flood Risk	2160 min Summer	9.711	0.711	0.0	3.4	Flood Risk	2880 min Summer	9.671	0.671	0.0	3.2	O K	4320 min Summer	9.601	0.601	0.0	2.9	O K	5760 min Summer	9.547	0.547	0.0	2.6	O K	7200 min Summer	9.513	0.513	0.0	2.4	O K	8640 min Summer	9.489	0.489	0.0	2.3	O K	10080 min Summer	9.473	0.473	0.0	2.2	O K	15 min Winter	9.379	0.379	0.0	1.8	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	31	60 min Summer	61.531	0.0	62	120 min Summer	36.920	0.0	122	180 min Summer	27.160	0.0	182	240 min Summer	21.763	0.0	240	360 min Summer	15.835	0.0	360	480 min Summer	12.539	0.0	480	600 min Summer	10.433	0.0	524	720 min Summer	8.964	0.0	584	960 min Summer	7.046	0.0	710	1440 min Summer	4.991	0.0	978	2160 min Summer	3.510	0.0	1384	2880 min Summer	2.731	0.0	1792	4320 min Summer	1.912	0.0	2596	5760 min Summer	1.496	0.0	3392	7200 min Summer	1.260	0.0	4176	8640 min Summer	1.110	0.0	4920	10080 min Summer	1.010	0.0	5648	15 min Winter	143.930	0.0	16
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																	
15 min Summer	9.339	0.339	0.0	1.6	O K																																																																																																																																																																																																																	
30 min Summer	9.450	0.450	0.0	2.1	O K																																																																																																																																																																																																																	
60 min Summer	9.569	0.569	0.0	2.7	O K																																																																																																																																																																																																																	
120 min Summer	9.666	0.666	0.0	3.2	O K																																																																																																																																																																																																																	
180 min Summer	9.718	0.718	0.0	3.4	Flood Risk																																																																																																																																																																																																																	
240 min Summer	9.749	0.749	0.0	3.6	Flood Risk																																																																																																																																																																																																																	
360 min Summer	9.780	0.780	0.0	3.7	Flood Risk																																																																																																																																																																																																																	
480 min Summer	9.785	0.785	0.1	3.7	Flood Risk																																																																																																																																																																																																																	
600 min Summer	9.783	0.783	0.0	3.7	Flood Risk																																																																																																																																																																																																																	
720 min Summer	9.781	0.781	0.0	3.7	Flood Risk																																																																																																																																																																																																																	
960 min Summer	9.773	0.773	0.0	3.7	Flood Risk																																																																																																																																																																																																																	
1440 min Summer	9.752	0.752	0.0	3.6	Flood Risk																																																																																																																																																																																																																	
2160 min Summer	9.711	0.711	0.0	3.4	Flood Risk																																																																																																																																																																																																																	
2880 min Summer	9.671	0.671	0.0	3.2	O K																																																																																																																																																																																																																	
4320 min Summer	9.601	0.601	0.0	2.9	O K																																																																																																																																																																																																																	
5760 min Summer	9.547	0.547	0.0	2.6	O K																																																																																																																																																																																																																	
7200 min Summer	9.513	0.513	0.0	2.4	O K																																																																																																																																																																																																																	
8640 min Summer	9.489	0.489	0.0	2.3	O K																																																																																																																																																																																																																	
10080 min Summer	9.473	0.473	0.0	2.2	O K																																																																																																																																																																																																																	
15 min Winter	9.379	0.379	0.0	1.8	O K																																																																																																																																																																																																																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																			
15 min Summer	143.930	0.0	16																																																																																																																																																																																																																			
30 min Summer	96.151	0.0	31																																																																																																																																																																																																																			
60 min Summer	61.531	0.0	62																																																																																																																																																																																																																			
120 min Summer	36.920	0.0	122																																																																																																																																																																																																																			
180 min Summer	27.160	0.0	182																																																																																																																																																																																																																			
240 min Summer	21.763	0.0	240																																																																																																																																																																																																																			
360 min Summer	15.835	0.0	360																																																																																																																																																																																																																			
480 min Summer	12.539	0.0	480																																																																																																																																																																																																																			
600 min Summer	10.433	0.0	524																																																																																																																																																																																																																			
720 min Summer	8.964	0.0	584																																																																																																																																																																																																																			
960 min Summer	7.046	0.0	710																																																																																																																																																																																																																			
1440 min Summer	4.991	0.0	978																																																																																																																																																																																																																			
2160 min Summer	3.510	0.0	1384																																																																																																																																																																																																																			
2880 min Summer	2.731	0.0	1792																																																																																																																																																																																																																			
4320 min Summer	1.912	0.0	2596																																																																																																																																																																																																																			
5760 min Summer	1.496	0.0	3392																																																																																																																																																																																																																			
7200 min Summer	1.260	0.0	4176																																																																																																																																																																																																																			
8640 min Summer	1.110	0.0	4920																																																																																																																																																																																																																			
10080 min Summer	1.010	0.0	5648																																																																																																																																																																																																																			
15 min Winter	143.930	0.0	16																																																																																																																																																																																																																			
©1982-2018 Innovyze																																																																																																																																																																																																																						


Waterco Ltd				Page 2	
Eden Court		w10685			
Lon Parcwr Business Park		Holt Road, Rossett			
Denbighshire LL15 1NJ		TP10 House Soakaway			
Date 23/05/2018		Designed by HW			
File w10685-180523-TP10_Hous...		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.504	0.504	0.0	2.4	O K
60 min Winter	9.637	0.637	0.0	3.0	O K
120 min Winter	9.747	0.747	0.0	3.5	Flood Risk
180 min Winter	9.805	0.805	0.1	3.8	Flood Risk
240 min Winter	9.841	0.841	0.1	4.0	Flood Risk
360 min Winter	9.877	0.877	0.1	4.2	Flood Risk
480 min Winter	9.887	0.887	0.1	4.2	Flood Risk
600 min Winter	9.884	0.884	0.1	4.2	Flood Risk
720 min Winter	9.876	0.876	0.1	4.2	Flood Risk
960 min Winter	9.865	0.865	0.1	4.1	Flood Risk
1440 min Winter	9.831	0.831	0.1	3.9	Flood Risk
2160 min Winter	9.769	0.769	0.0	3.7	Flood Risk
2880 min Winter	9.713	0.713	0.0	3.4	Flood Risk
4320 min Winter	9.617	0.617	0.0	2.9	O K
5760 min Winter	9.547	0.547	0.0	2.6	O K
7200 min Winter	9.501	0.501	0.0	2.4	O K
8640 min Winter	9.468	0.468	0.0	2.2	O K
10080 min Winter	9.444	0.444	0.0	2.1	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	31		
60 min Winter	61.531	0.0	62		
120 min Winter	36.920	0.0	120		
180 min Winter	27.160	0.0	178		
240 min Winter	21.763	0.0	236		
360 min Winter	15.835	0.0	350		
480 min Winter	12.539	0.0	460		
600 min Winter	10.433	0.0	564		
720 min Winter	8.964	0.0	642		
960 min Winter	7.046	0.0	740		
1440 min Winter	4.991	0.0	1040		
2160 min Winter	3.510	0.0	1492		
2880 min Winter	2.731	0.0	1928		
4320 min Winter	1.912	0.0	2764		
5760 min Winter	1.496	0.0	3568		
7200 min Winter	1.260	0.0	4328		
8640 min Winter	1.110	0.0	5104		
10080 min Winter	1.010	0.0	5856		
©1982-2018 Innovyze					

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP10 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP10_Hous...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>2.0</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.05101</td> <td>Trench Length (m)</td> <td>2.5</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.000</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0	Infiltration Coefficient Side (m/hr)	0.05101	Trench Length (m)	2.5	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0																			
Infiltration Coefficient Side (m/hr)	0.05101	Trench Length (m)	2.5																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						


Event: 360 min Winter

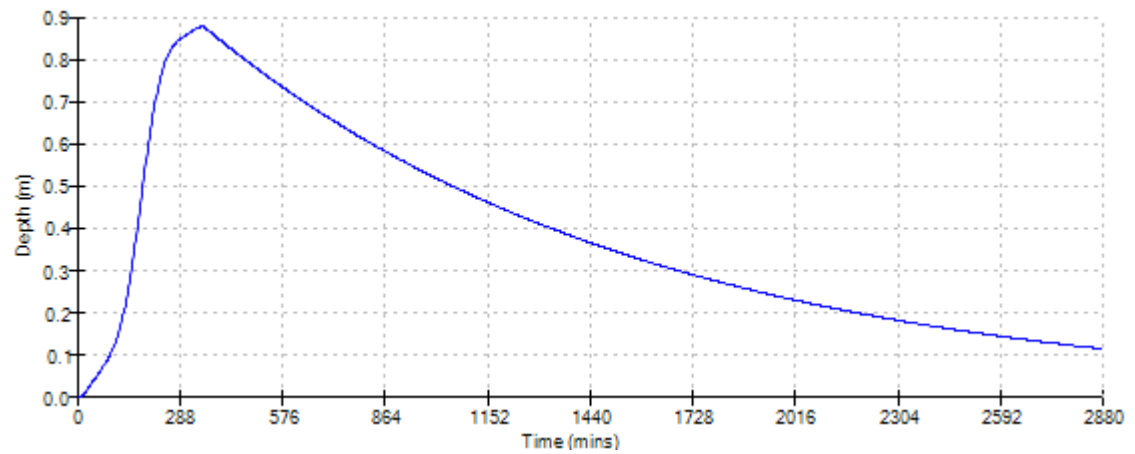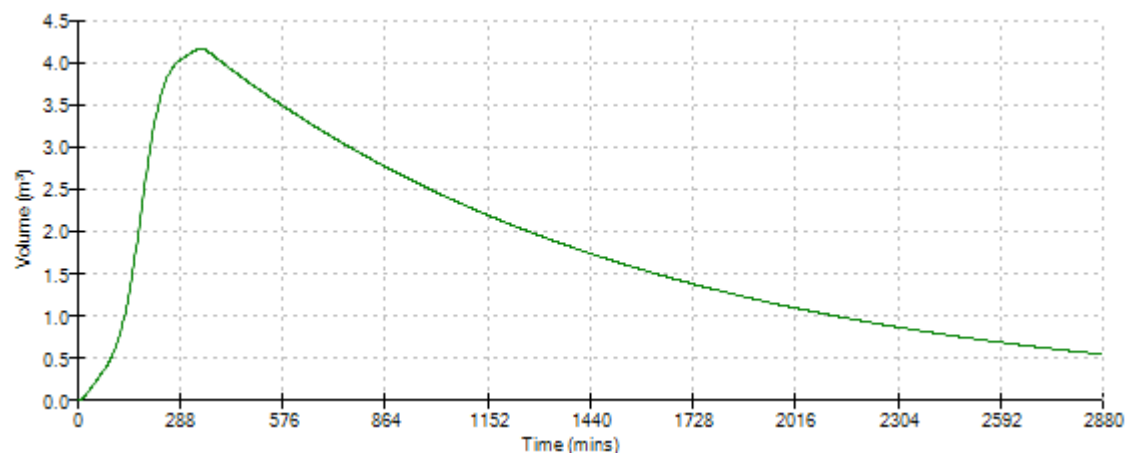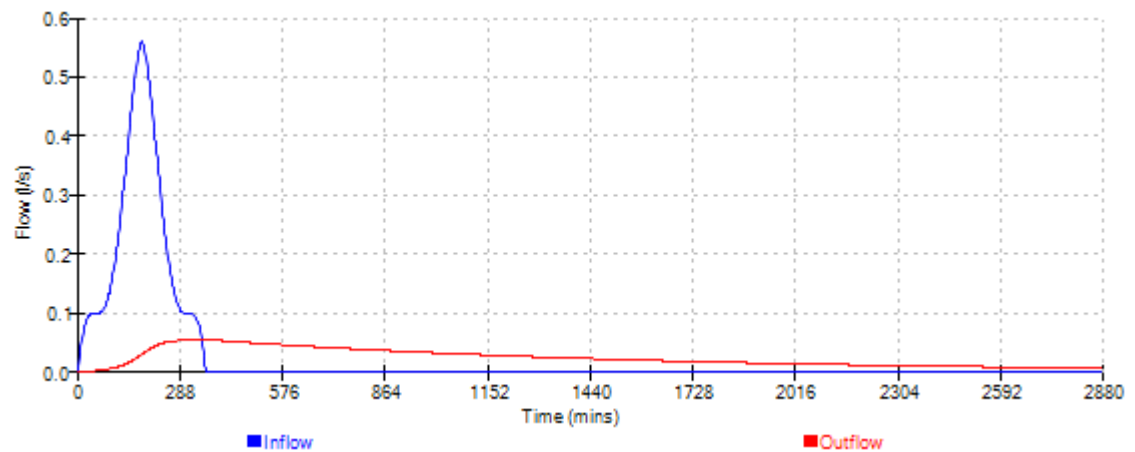

Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP10 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP10_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

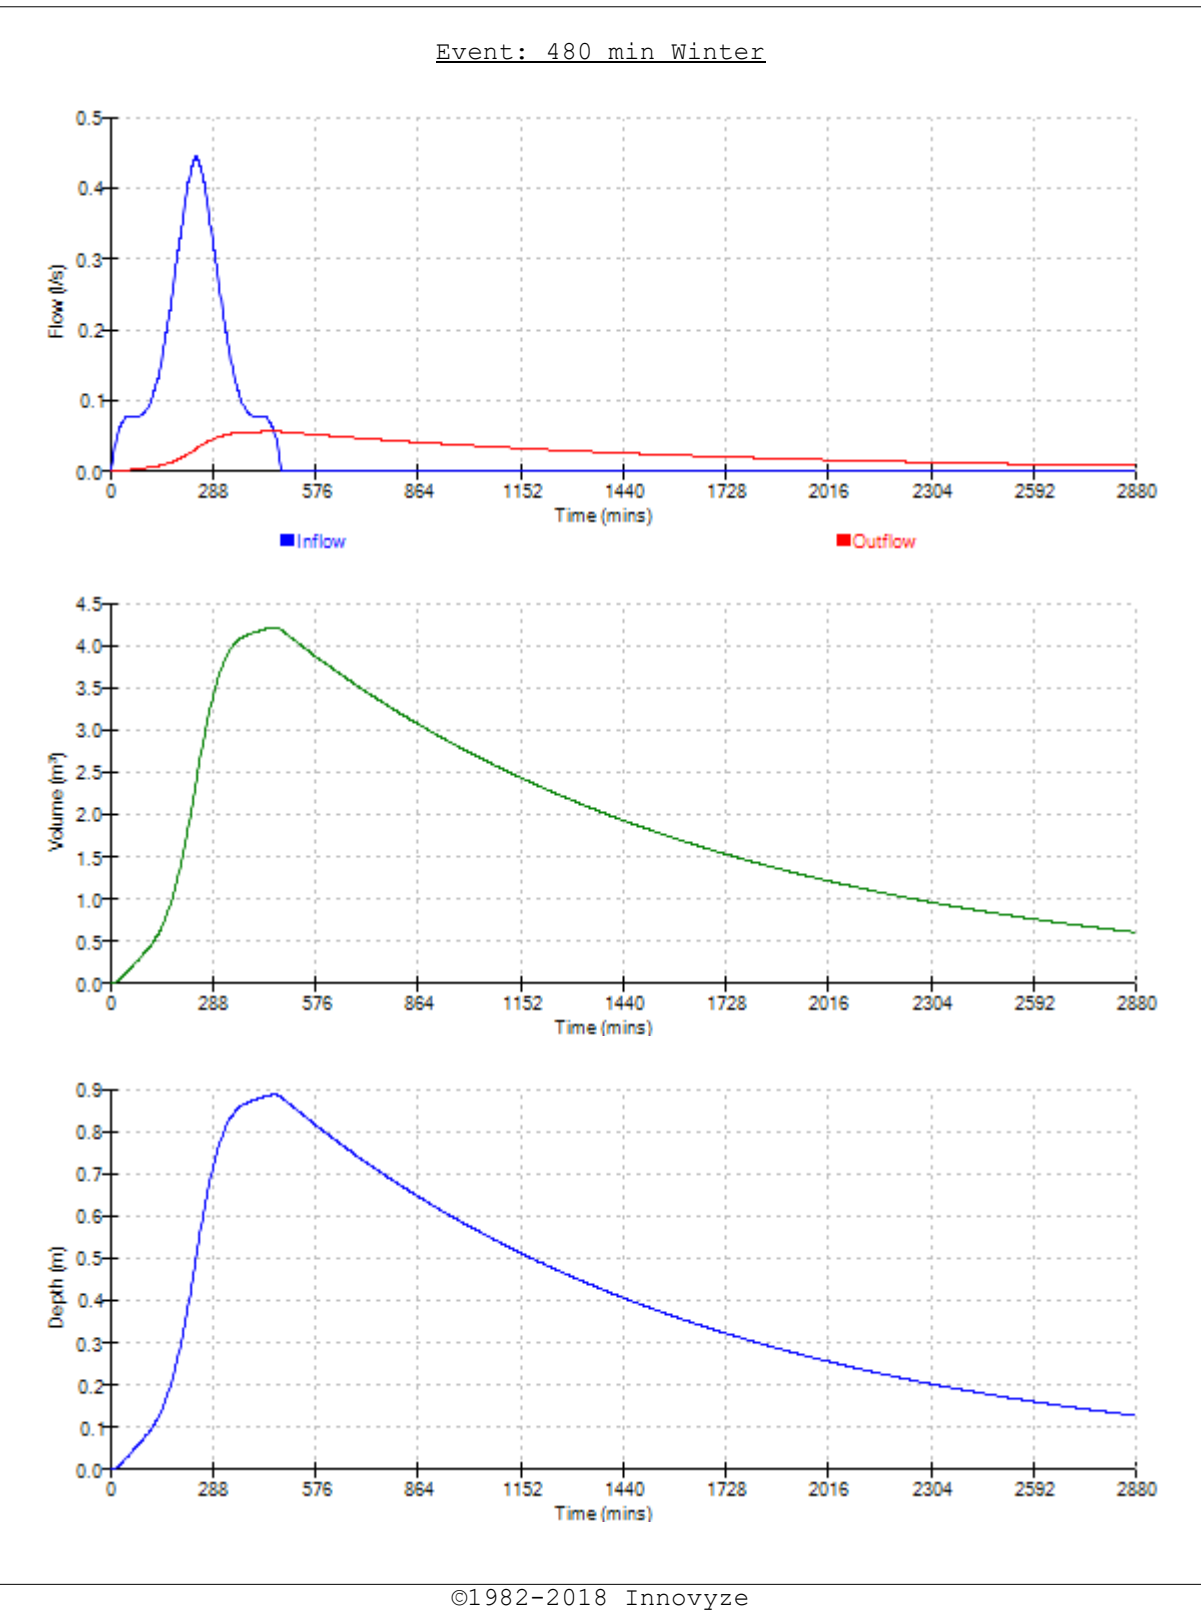

Waterco Ltd		Page 7
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP10 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP10_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

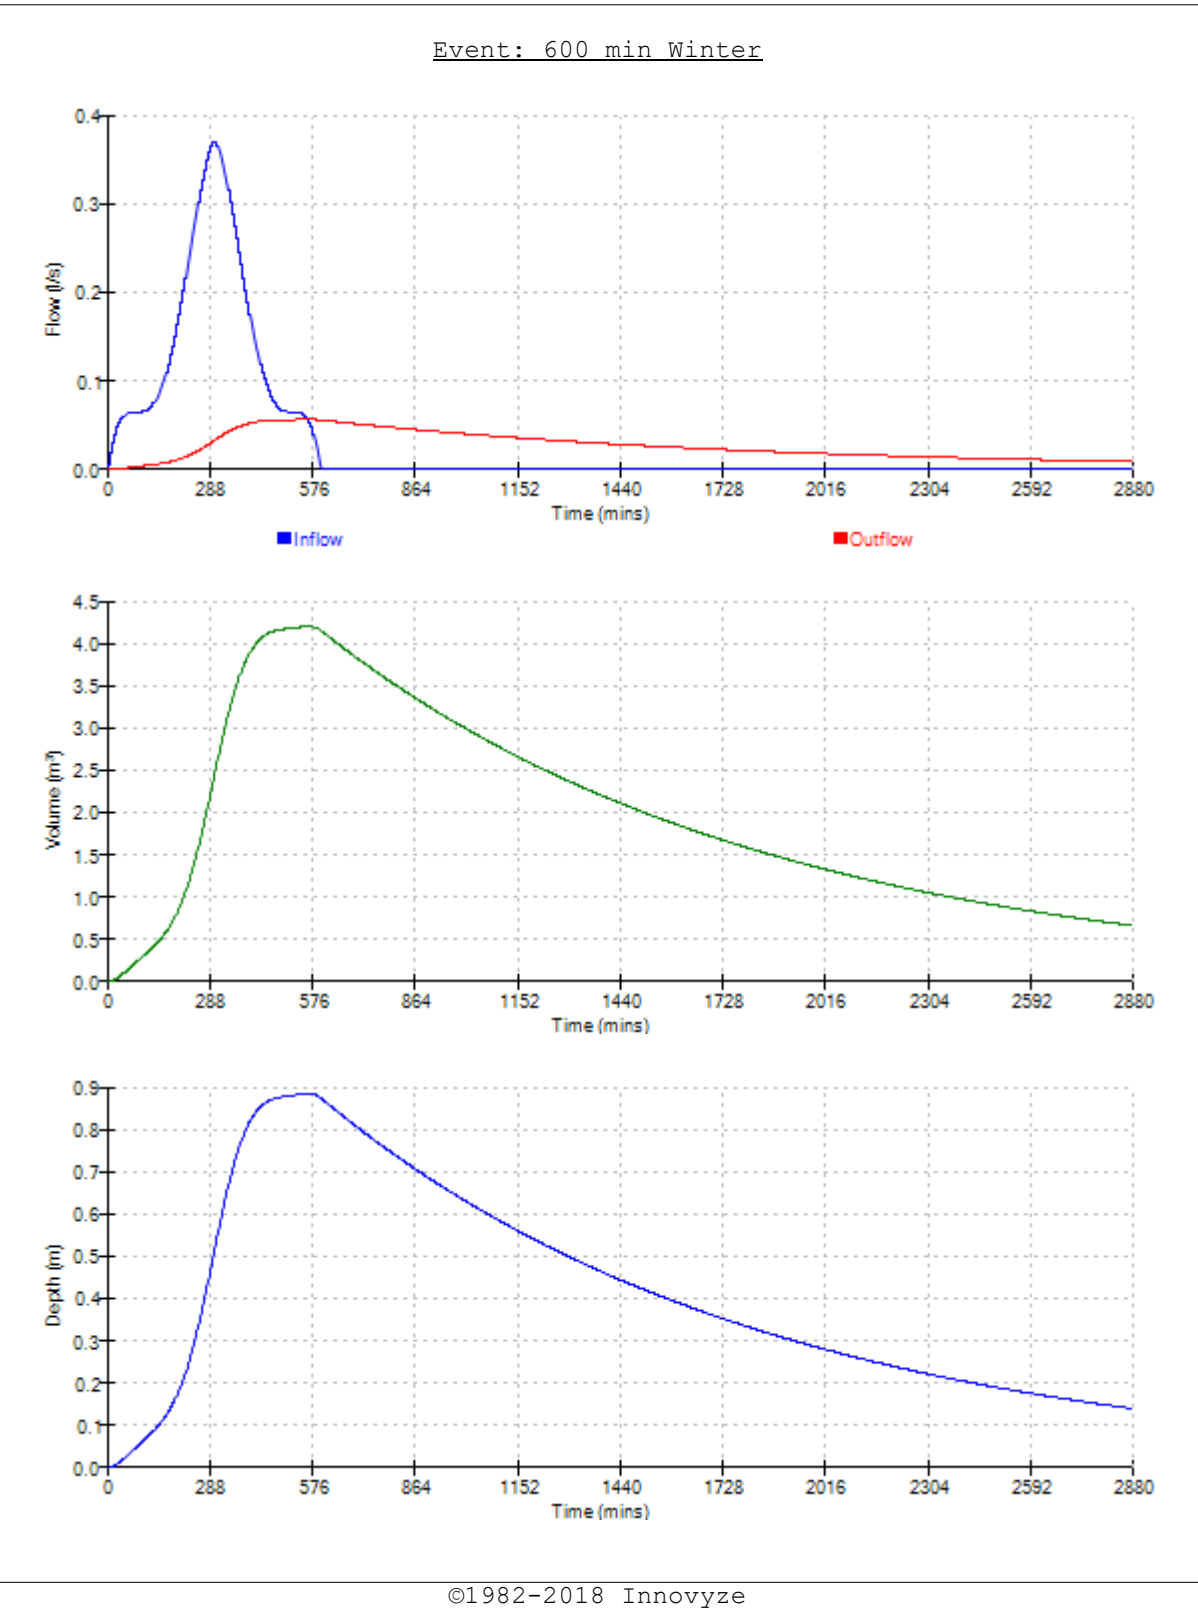

Waterco Ltd		Page 1
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP11 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP11_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

Summary of Results for 100 year Return Period (+30%)

Half Drain Time : 283 minutes.


Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
15 min Summer	9.418	0.418	0.1	1.6	O K
30 min Summer	9.548	0.548	0.1	2.1	O K
60 min Summer	9.676	0.676	0.1	2.6	O K
120 min Summer	9.756	0.756	0.1	2.9	Flood Risk
180 min Summer	9.779	0.779	0.1	3.0	Flood Risk
240 min Summer	9.788	0.788	0.1	3.0	Flood Risk
360 min Summer	9.794	0.794	0.1	3.0	Flood Risk
480 min Summer	9.785	0.785	0.1	3.0	Flood Risk
600 min Summer	9.771	0.771	0.1	2.9	Flood Risk
720 min Summer	9.754	0.754	0.1	2.9	Flood Risk
960 min Summer	9.719	0.719	0.1	2.7	Flood Risk
1440 min Summer	9.651	0.651	0.1	2.5	O K
2160 min Summer	9.564	0.564	0.1	2.1	O K
2880 min Summer	9.498	0.498	0.1	1.9	O K
4320 min Summer	9.407	0.407	0.1	1.5	O K
5760 min Summer	9.348	0.348	0.1	1.3	O K
7200 min Summer	9.311	0.311	0.0	1.2	O K
8640 min Summer	9.286	0.286	0.0	1.1	O K
10080 min Summer	9.268	0.268	0.0	1.0	O K
15 min Winter	9.468	0.468	0.1	1.8	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
15 min Summer	143.930	0.0	16
30 min Summer	96.151	0.0	31
60 min Summer	61.531	0.0	62
120 min Summer	36.920	0.0	120
180 min Summer	27.160	0.0	168
240 min Summer	21.763	0.0	194
360 min Summer	15.835	0.0	258
480 min Summer	12.539	0.0	326
600 min Summer	10.433	0.0	392
720 min Summer	8.964	0.0	462
960 min Summer	7.046	0.0	598
1440 min Summer	4.991	0.0	864
2160 min Summer	3.510	0.0	1256
2880 min Summer	2.731	0.0	1640
4320 min Summer	1.912	0.0	2376
5760 min Summer	1.496	0.0	3112
7200 min Summer	1.260	0.0	3824
8640 min Summer	1.110	0.0	4584
10080 min Summer	1.010	0.0	5336
15 min Winter	143.930	0.0	16


Waterco Ltd				Page 2	
Eden Court		w10685			
Lon Parcwr Business Park		Holt Road, Rossett			
Denbighshire LL15 1NJ		TP11 House Soakaway			
Date 23/05/2018		Designed by HW			
File w10685-180523-TP11_Hous...		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.614	0.614	0.1	2.3	O K
60 min Winter	9.759	0.759	0.1	2.9	Flood Risk
120 min Winter	9.851	0.851	0.1	3.2	Flood Risk
180 min Winter	9.880	0.880	0.1	3.3	Flood Risk
240 min Winter	9.884	0.884	0.1	3.4	Flood Risk
360 min Winter	9.885	0.885	0.1	3.4	Flood Risk
480 min Winter	9.867	0.867	0.1	3.3	Flood Risk
600 min Winter	9.843	0.843	0.1	3.2	Flood Risk
720 min Winter	9.816	0.816	0.1	3.1	Flood Risk
960 min Winter	9.763	0.763	0.1	2.9	Flood Risk
1440 min Winter	9.668	0.668	0.1	2.5	O K
2160 min Winter	9.556	0.556	0.1	2.1	O K
2880 min Winter	9.476	0.476	0.1	1.8	O K
4320 min Winter	9.369	0.369	0.1	1.4	O K
5760 min Winter	9.304	0.304	0.0	1.2	O K
7200 min Winter	9.265	0.265	0.0	1.0	O K
8640 min Winter	9.238	0.238	0.0	0.9	O K
10080 min Winter	9.219	0.219	0.0	0.8	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	30		
60 min Winter	61.531	0.0	60		
120 min Winter	36.920	0.0	116		
180 min Winter	27.160	0.0	172		
240 min Winter	21.763	0.0	202		
360 min Winter	15.835	0.0	272		
480 min Winter	12.539	0.0	348		
600 min Winter	10.433	0.0	422		
720 min Winter	8.964	0.0	498		
960 min Winter	7.046	0.0	642		
1440 min Winter	4.991	0.0	920		
2160 min Winter	3.510	0.0	1320		
2880 min Winter	2.731	0.0	1700		
4320 min Winter	1.912	0.0	2464		
5760 min Winter	1.496	0.0	3176		
7200 min Winter	1.260	0.0	3960		
8640 min Winter	1.110	0.0	4664		
10080 min Winter	1.010	0.0	5352		
©1982-2018 Innovyze					

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP11 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP11_Hous...	Checked by AW																					
XP Solutions		Source Control 2018.1																				
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>2.0</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.13896</td> <td>Trench Length (m)</td> <td>2.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.000</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0	Infiltration Coefficient Side (m/hr)	0.13896	Trench Length (m)	2.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0																			
Infiltration Coefficient Side (m/hr)	0.13896	Trench Length (m)	2.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						


Waterco Ltd		Page 5
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP11 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP11_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

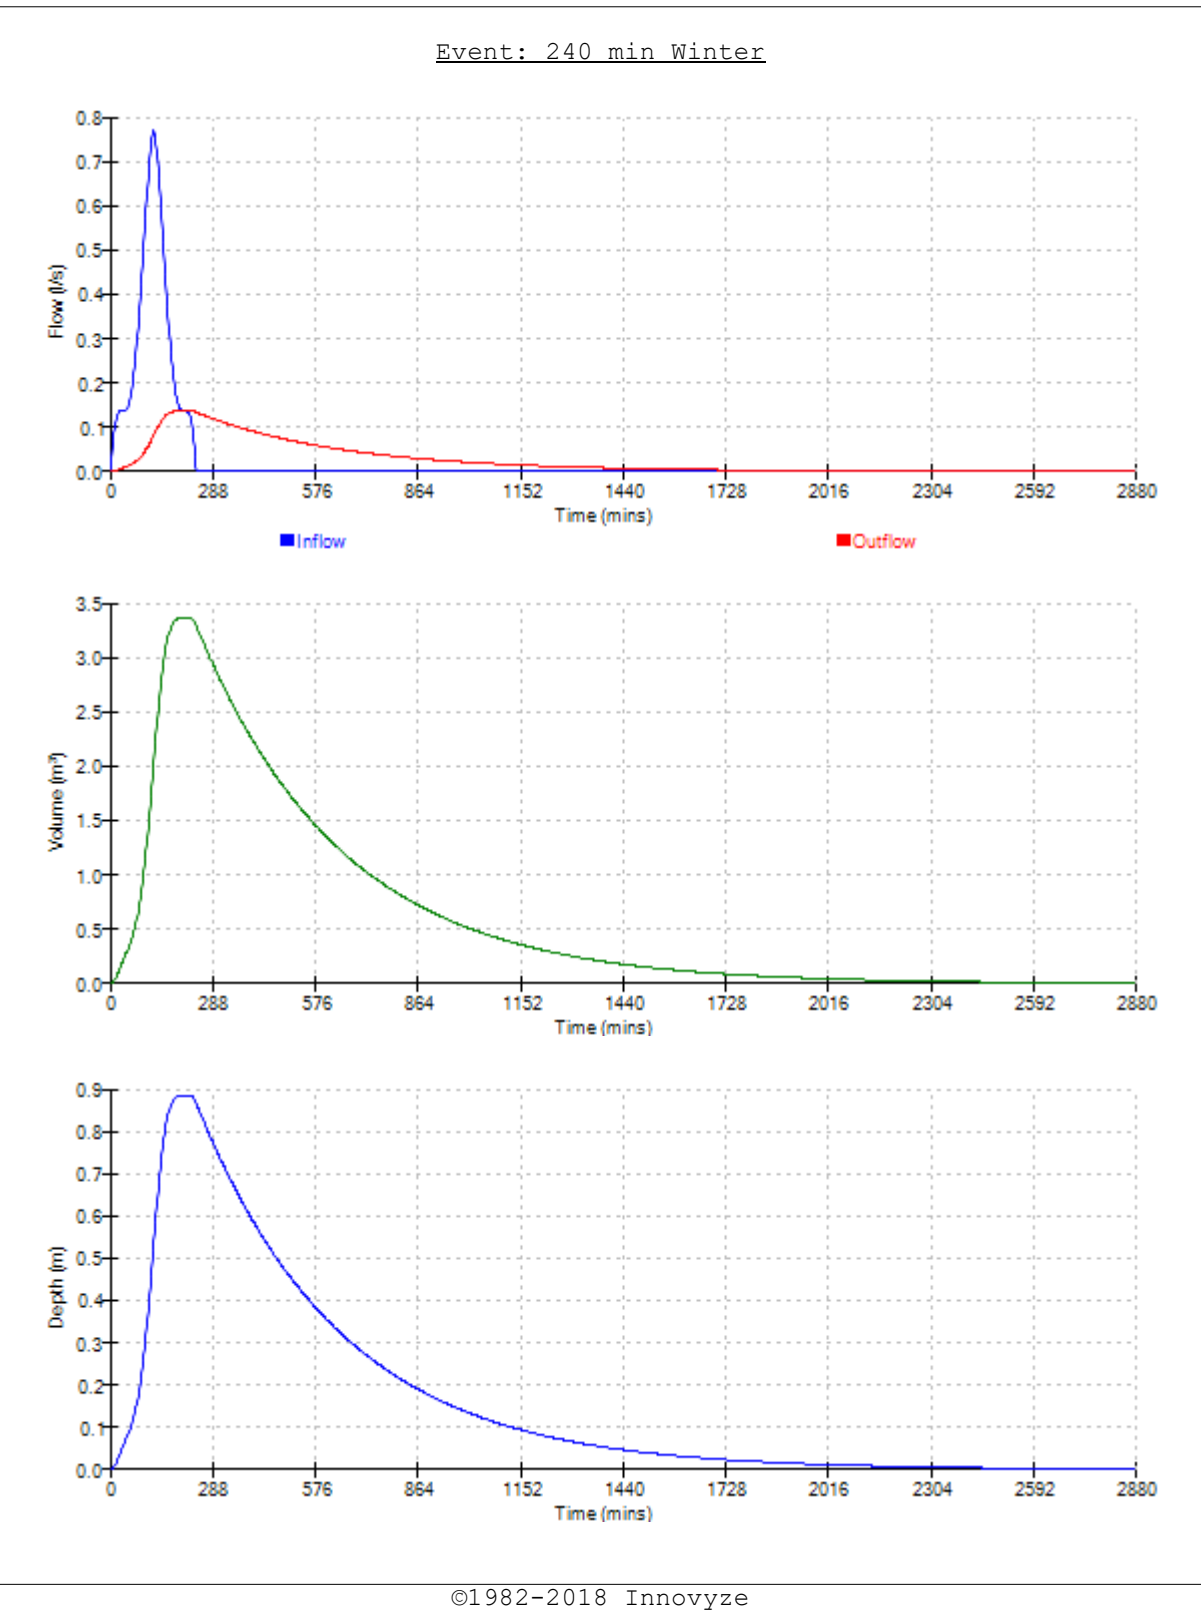

Waterco Ltd		Page 6
Eden Court	w10685	
Lon Parcwr Business Park	Holt Road, Rossett	
Denbighshire LL15 1NJ	TP11 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP11_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

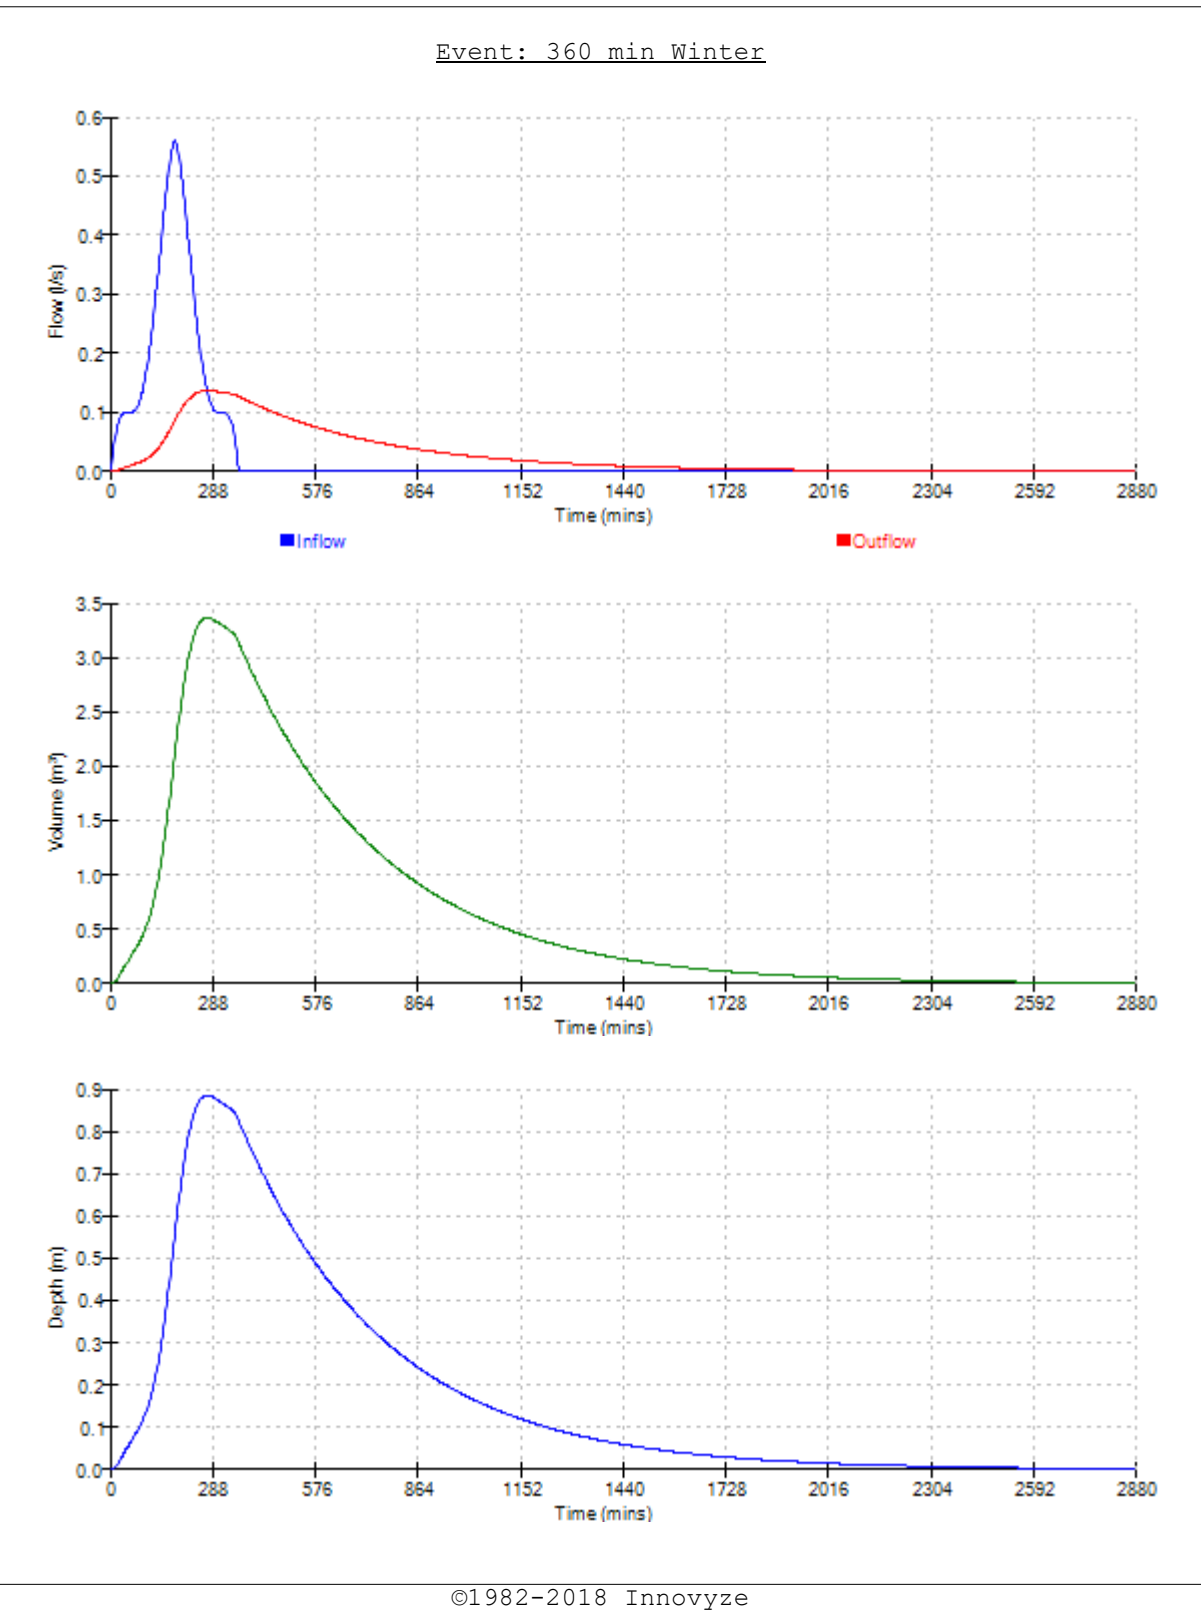

Waterco Ltd		Page 7
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP11 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP11_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

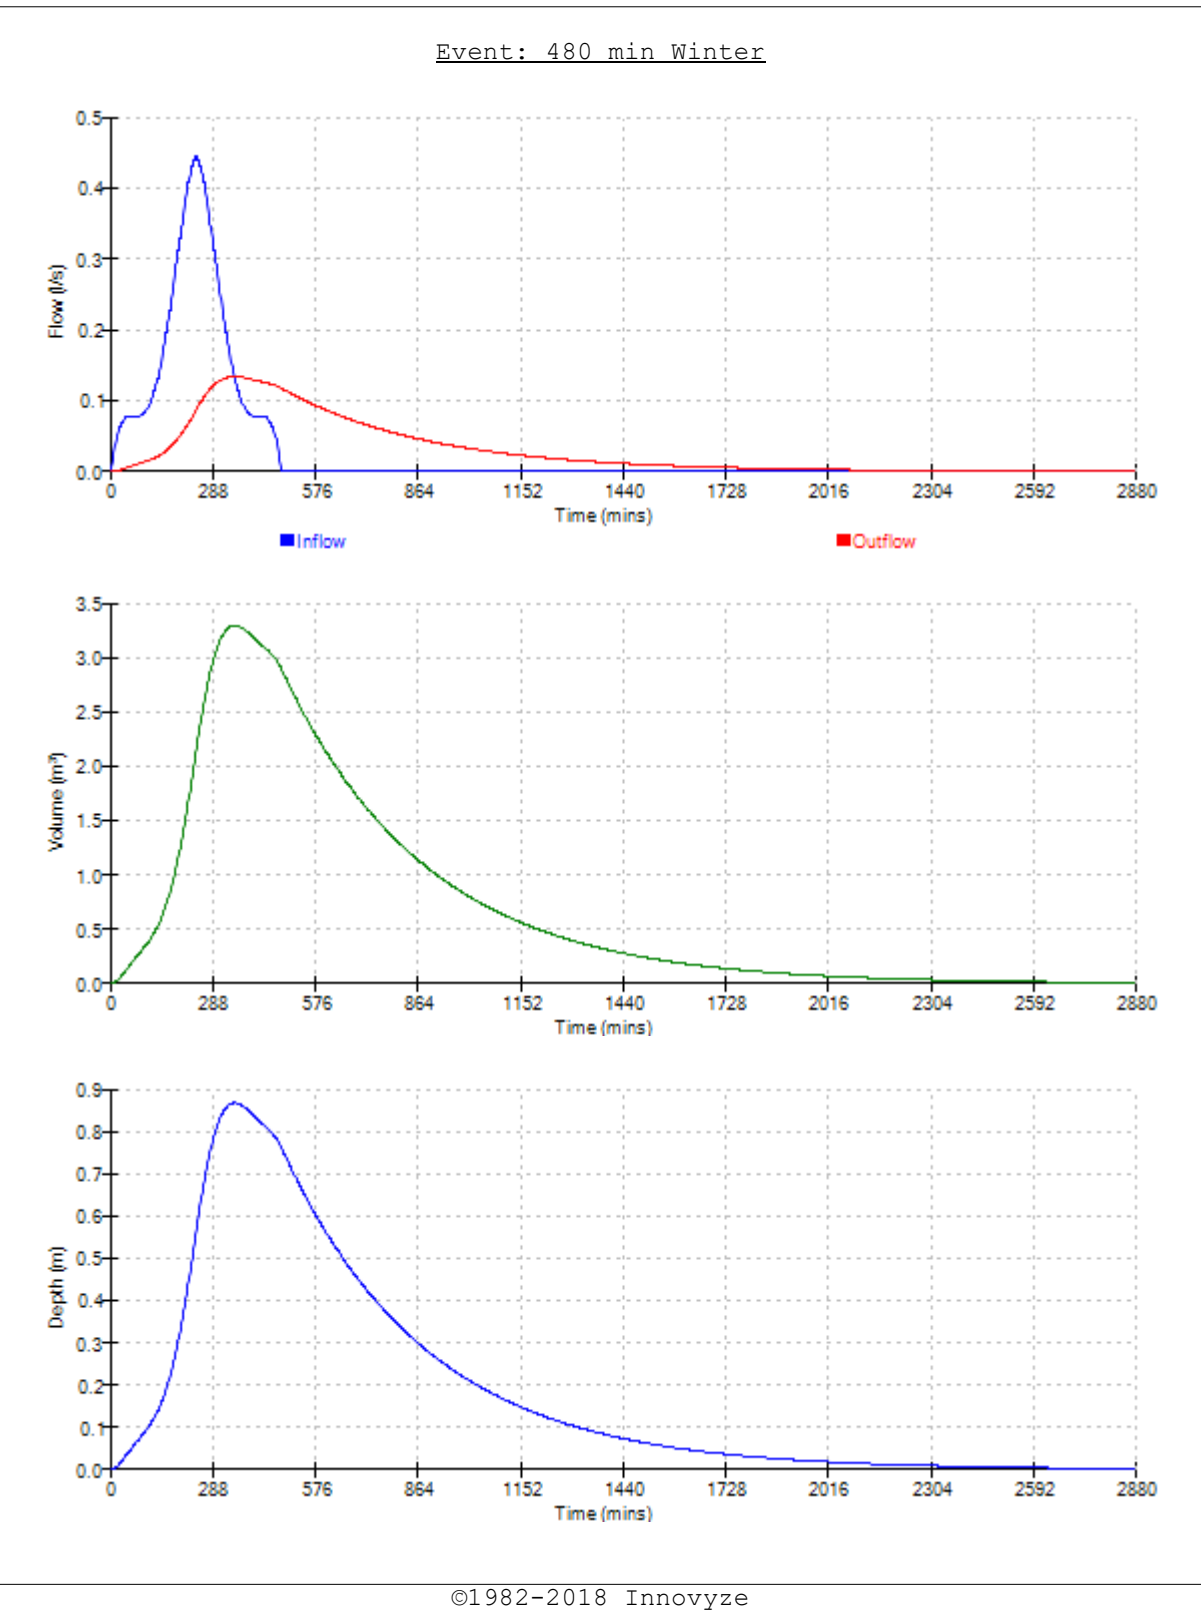

Waterco Ltd			Page 1																																																																																																																																																																																																																			
Eden Court		w10685																																																																																																																																																																																																																				
Lon Parcwr Business Park		Holt Road, Rossett																																																																																																																																																																																																																				
Denbighshire LL15 1NJ		TP12 House Soakaway																																																																																																																																																																																																																				
Date 23/05/2018		Designed by HW																																																																																																																																																																																																																				
File w10685-180523-TP12_Hous...		Checked by AW																																																																																																																																																																																																																				
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																				
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 173 minutes. <table><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr><tr><td>15 min Summer</td><td>9.613</td><td>0.413</td><td>0.1</td><td>1.6</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.736</td><td>0.536</td><td>0.1</td><td>2.0</td><td>Flood Risk</td></tr><tr><td>60 min Summer</td><td>9.847</td><td>0.647</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.897</td><td>0.697</td><td>0.2</td><td>2.6</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.912</td><td>0.712</td><td>0.2</td><td>2.7</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.917</td><td>0.717</td><td>0.2</td><td>2.7</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.910</td><td>0.710</td><td>0.2</td><td>2.7</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.890</td><td>0.690</td><td>0.2</td><td>2.6</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.865</td><td>0.665</td><td>0.2</td><td>2.5</td><td>Flood Risk</td></tr><tr><td>720 min Summer</td><td>9.841</td><td>0.641</td><td>0.2</td><td>2.4</td><td>Flood Risk</td></tr><tr><td>960 min Summer</td><td>9.795</td><td>0.595</td><td>0.1</td><td>2.3</td><td>Flood Risk</td></tr><tr><td>1440 min Summer</td><td>9.716</td><td>0.516</td><td>0.1</td><td>2.0</td><td>Flood Risk</td></tr><tr><td>2160 min Summer</td><td>9.630</td><td>0.430</td><td>0.1</td><td>1.6</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.571</td><td>0.371</td><td>0.1</td><td>1.4</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.491</td><td>0.291</td><td>0.1</td><td>1.1</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.444</td><td>0.244</td><td>0.1</td><td>0.9</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.414</td><td>0.214</td><td>0.1</td><td>0.8</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.395</td><td>0.195</td><td>0.0</td><td>0.7</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.381</td><td>0.181</td><td>0.0</td><td>0.7</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.663</td><td>0.463</td><td>0.1</td><td>1.8</td><td>O K</td></tr></table> <table><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>31</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>60</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>108</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>138</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>170</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>238</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>306</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>374</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>440</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>576</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>834</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1212</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1584</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2296</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>3056</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3752</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4496</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5240</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>16</td></tr></table>					Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.613	0.413	0.1	1.6	O K	30 min Summer	9.736	0.536	0.1	2.0	Flood Risk	60 min Summer	9.847	0.647	0.2	2.5	Flood Risk	120 min Summer	9.897	0.697	0.2	2.6	Flood Risk	180 min Summer	9.912	0.712	0.2	2.7	Flood Risk	240 min Summer	9.917	0.717	0.2	2.7	Flood Risk	360 min Summer	9.910	0.710	0.2	2.7	Flood Risk	480 min Summer	9.890	0.690	0.2	2.6	Flood Risk	600 min Summer	9.865	0.665	0.2	2.5	Flood Risk	720 min Summer	9.841	0.641	0.2	2.4	Flood Risk	960 min Summer	9.795	0.595	0.1	2.3	Flood Risk	1440 min Summer	9.716	0.516	0.1	2.0	Flood Risk	2160 min Summer	9.630	0.430	0.1	1.6	O K	2880 min Summer	9.571	0.371	0.1	1.4	O K	4320 min Summer	9.491	0.291	0.1	1.1	O K	5760 min Summer	9.444	0.244	0.1	0.9	O K	7200 min Summer	9.414	0.214	0.1	0.8	O K	8640 min Summer	9.395	0.195	0.0	0.7	O K	10080 min Summer	9.381	0.181	0.0	0.7	O K	15 min Winter	9.663	0.463	0.1	1.8	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	31	60 min Summer	61.531	0.0	60	120 min Summer	36.920	0.0	108	180 min Summer	27.160	0.0	138	240 min Summer	21.763	0.0	170	360 min Summer	15.835	0.0	238	480 min Summer	12.539	0.0	306	600 min Summer	10.433	0.0	374	720 min Summer	8.964	0.0	440	960 min Summer	7.046	0.0	576	1440 min Summer	4.991	0.0	834	2160 min Summer	3.510	0.0	1212	2880 min Summer	2.731	0.0	1584	4320 min Summer	1.912	0.0	2296	5760 min Summer	1.496	0.0	3056	7200 min Summer	1.260	0.0	3752	8640 min Summer	1.110	0.0	4496	10080 min Summer	1.010	0.0	5240	15 min Winter	143.930	0.0	16
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																	
15 min Summer	9.613	0.413	0.1	1.6	O K																																																																																																																																																																																																																	
30 min Summer	9.736	0.536	0.1	2.0	Flood Risk																																																																																																																																																																																																																	
60 min Summer	9.847	0.647	0.2	2.5	Flood Risk																																																																																																																																																																																																																	
120 min Summer	9.897	0.697	0.2	2.6	Flood Risk																																																																																																																																																																																																																	
180 min Summer	9.912	0.712	0.2	2.7	Flood Risk																																																																																																																																																																																																																	
240 min Summer	9.917	0.717	0.2	2.7	Flood Risk																																																																																																																																																																																																																	
360 min Summer	9.910	0.710	0.2	2.7	Flood Risk																																																																																																																																																																																																																	
480 min Summer	9.890	0.690	0.2	2.6	Flood Risk																																																																																																																																																																																																																	
600 min Summer	9.865	0.665	0.2	2.5	Flood Risk																																																																																																																																																																																																																	
720 min Summer	9.841	0.641	0.2	2.4	Flood Risk																																																																																																																																																																																																																	
960 min Summer	9.795	0.595	0.1	2.3	Flood Risk																																																																																																																																																																																																																	
1440 min Summer	9.716	0.516	0.1	2.0	Flood Risk																																																																																																																																																																																																																	
2160 min Summer	9.630	0.430	0.1	1.6	O K																																																																																																																																																																																																																	
2880 min Summer	9.571	0.371	0.1	1.4	O K																																																																																																																																																																																																																	
4320 min Summer	9.491	0.291	0.1	1.1	O K																																																																																																																																																																																																																	
5760 min Summer	9.444	0.244	0.1	0.9	O K																																																																																																																																																																																																																	
7200 min Summer	9.414	0.214	0.1	0.8	O K																																																																																																																																																																																																																	
8640 min Summer	9.395	0.195	0.0	0.7	O K																																																																																																																																																																																																																	
10080 min Summer	9.381	0.181	0.0	0.7	O K																																																																																																																																																																																																																	
15 min Winter	9.663	0.463	0.1	1.8	O K																																																																																																																																																																																																																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																			
15 min Summer	143.930	0.0	16																																																																																																																																																																																																																			
30 min Summer	96.151	0.0	31																																																																																																																																																																																																																			
60 min Summer	61.531	0.0	60																																																																																																																																																																																																																			
120 min Summer	36.920	0.0	108																																																																																																																																																																																																																			
180 min Summer	27.160	0.0	138																																																																																																																																																																																																																			
240 min Summer	21.763	0.0	170																																																																																																																																																																																																																			
360 min Summer	15.835	0.0	238																																																																																																																																																																																																																			
480 min Summer	12.539	0.0	306																																																																																																																																																																																																																			
600 min Summer	10.433	0.0	374																																																																																																																																																																																																																			
720 min Summer	8.964	0.0	440																																																																																																																																																																																																																			
960 min Summer	7.046	0.0	576																																																																																																																																																																																																																			
1440 min Summer	4.991	0.0	834																																																																																																																																																																																																																			
2160 min Summer	3.510	0.0	1212																																																																																																																																																																																																																			
2880 min Summer	2.731	0.0	1584																																																																																																																																																																																																																			
4320 min Summer	1.912	0.0	2296																																																																																																																																																																																																																			
5760 min Summer	1.496	0.0	3056																																																																																																																																																																																																																			
7200 min Summer	1.260	0.0	3752																																																																																																																																																																																																																			
8640 min Summer	1.110	0.0	4496																																																																																																																																																																																																																			
10080 min Summer	1.010	0.0	5240																																																																																																																																																																																																																			
15 min Winter	143.930	0.0	16																																																																																																																																																																																																																			
©1982-2018 Innovyze																																																																																																																																																																																																																						

Waterco Ltd		Page 2
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 Holt Road, Rossett TP12 House Soakaway	
Date 23/05/2018 File w10685-180523-TP12_Hous...	Designed by HW Checked by AW	
XP Solutions	Source Control 2018.1	


Summary of Results for 100 year Return Period (+30%)

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
30 min Winter	9.801	0.601	0.1	2.3	Flood Risk
60 min Winter	9.928	0.728	0.2	2.8	Flood Risk
120 min Winter	9.987	0.787	0.2	3.0	Flood Risk
180 min Winter	9.998	0.798	0.2	3.0	Flood Risk
240 min Winter	9.998	0.798	0.2	3.0	Flood Risk
360 min Winter	9.978	0.778	0.2	3.0	Flood Risk
480 min Winter	9.943	0.743	0.2	2.8	Flood Risk
600 min Winter	9.906	0.706	0.2	2.7	Flood Risk
720 min Winter	9.870	0.670	0.2	2.5	Flood Risk
960 min Winter	9.807	0.607	0.1	2.3	Flood Risk
1440 min Winter	9.706	0.506	0.1	1.9	Flood Risk
2160 min Winter	9.602	0.402	0.1	1.5	O K
2880 min Winter	9.534	0.334	0.1	1.3	O K
4320 min Winter	9.450	0.250	0.1	0.9	O K
5760 min Winter	9.401	0.201	0.0	0.8	O K
7200 min Winter	9.373	0.173	0.0	0.7	O K
8640 min Winter	9.354	0.154	0.0	0.6	O K
10080 min Winter	9.341	0.141	0.0	0.5	O K


Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
30 min Winter	96.151	0.0	30
60 min Winter	61.531	0.0	60
120 min Winter	36.920	0.0	114
180 min Winter	27.160	0.0	142
240 min Winter	21.763	0.0	180
360 min Winter	15.835	0.0	256
480 min Winter	12.539	0.0	328
600 min Winter	10.433	0.0	402
720 min Winter	8.964	0.0	470
960 min Winter	7.046	0.0	606
1440 min Winter	4.991	0.0	866
2160 min Winter	3.510	0.0	1256
2880 min Winter	2.731	0.0	1640
4320 min Winter	1.912	0.0	2376
5760 min Winter	1.496	0.0	3112
7200 min Winter	1.260	0.0	3816
8640 min Winter	1.110	0.0	4576
10080 min Winter	1.010	0.0	5248

Waterco Ltd		Page 4																				
Eden Court	w10685																					
Lon Parcwr Business Park	Holt Road, Rossett																					
Denbighshire LL15 1NJ	TP12 House Soakaway																					
Date 23/05/2018	Designed by HW																					
File w10685-180523-TP12_Hous...	Checked by AW																					
XP Solutions	Source Control 2018.1																					
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Trench Soakaway Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00000</td> <td>Trench Width (m)</td> <td>2.0</td> </tr> <tr> <td>Infiltration Coefficient Side (m/hr)</td> <td>0.22244</td> <td>Trench Length (m)</td> <td>2.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>0.0</td> </tr> <tr> <td>Porosity</td> <td>0.95</td> <td>Cap Volume Depth (m)</td> <td>0.000</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.200</td> <td>Cap Infiltration Depth (m)</td> <td>0.000</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0	Infiltration Coefficient Side (m/hr)	0.22244	Trench Length (m)	2.0	Safety Factor	2.0	Slope (1:X)	0.0	Porosity	0.95	Cap Volume Depth (m)	0.000	Invert Level (m)	9.200	Cap Infiltration Depth (m)	0.000
Infiltration Coefficient Base (m/hr)	0.00000	Trench Width (m)	2.0																			
Infiltration Coefficient Side (m/hr)	0.22244	Trench Length (m)	2.0																			
Safety Factor	2.0	Slope (1:X)	0.0																			
Porosity	0.95	Cap Volume Depth (m)	0.000																			
Invert Level (m)	9.200	Cap Infiltration Depth (m)	0.000																			
©1982-2018 Innovyze																						


Waterco Ltd		Page 5
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP12 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP12_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

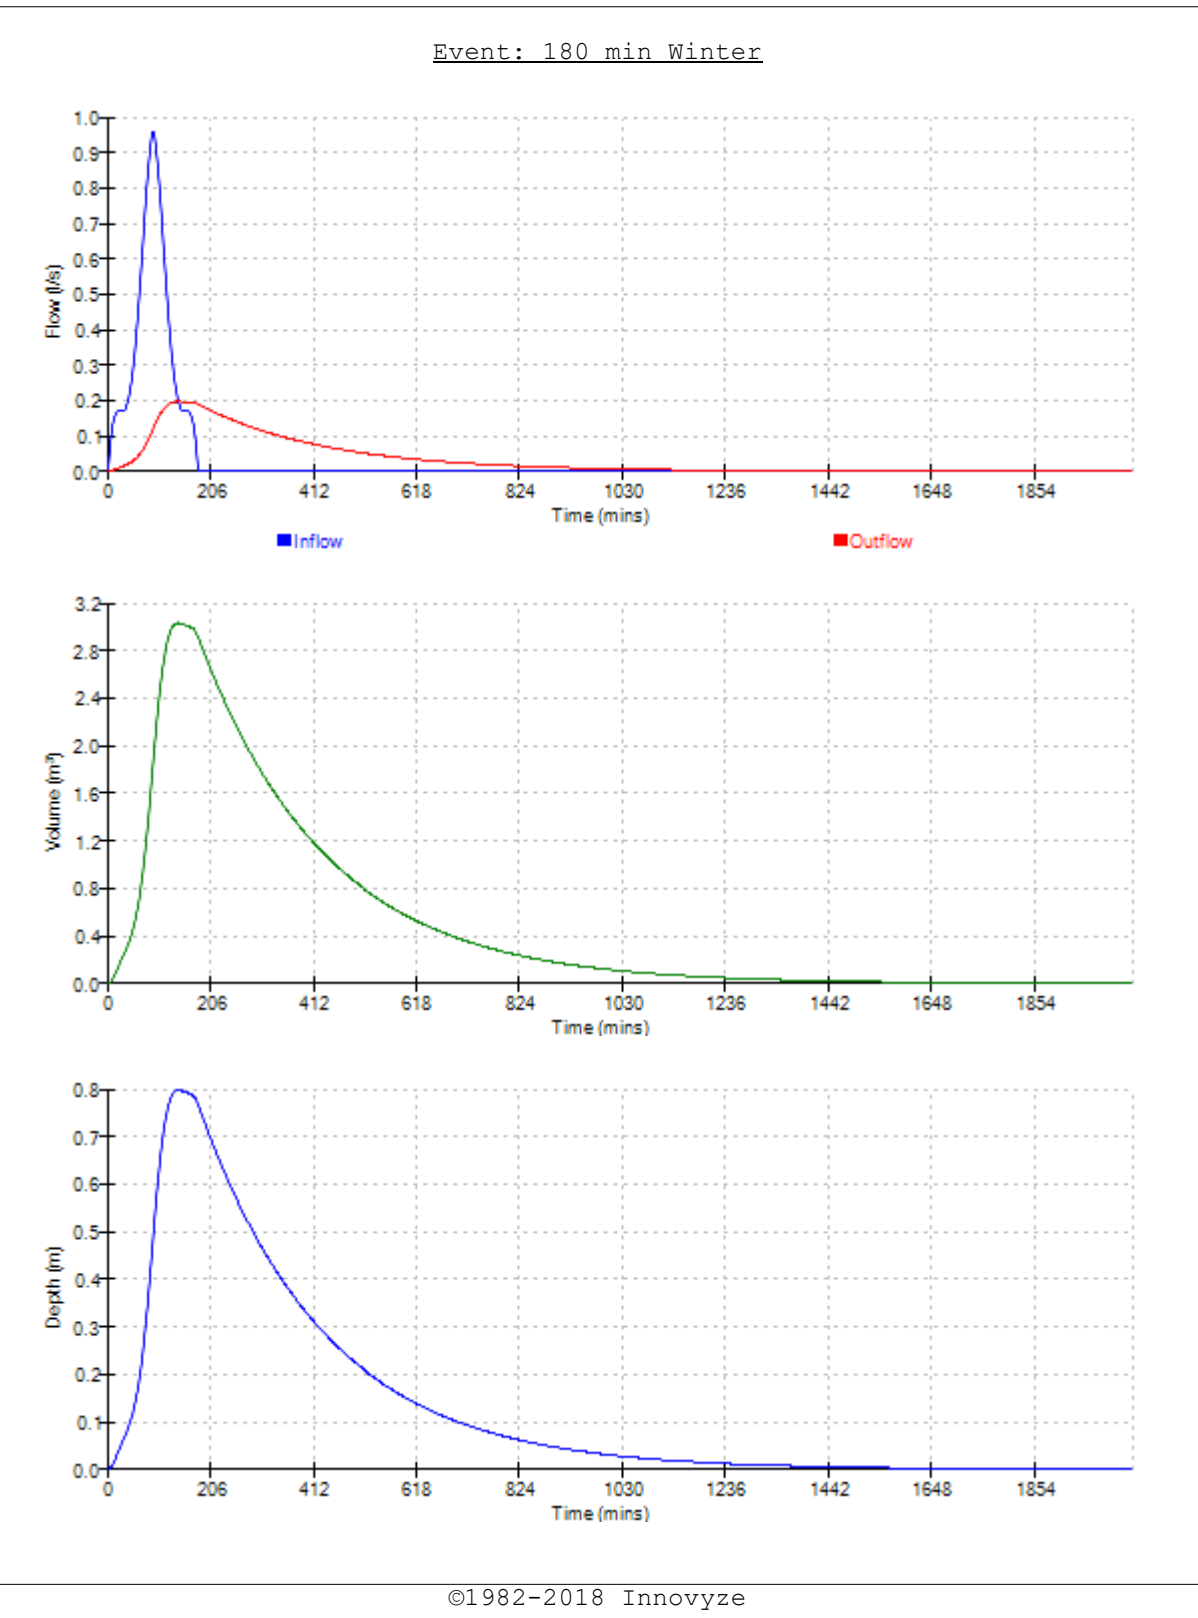

Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP12 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP12_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

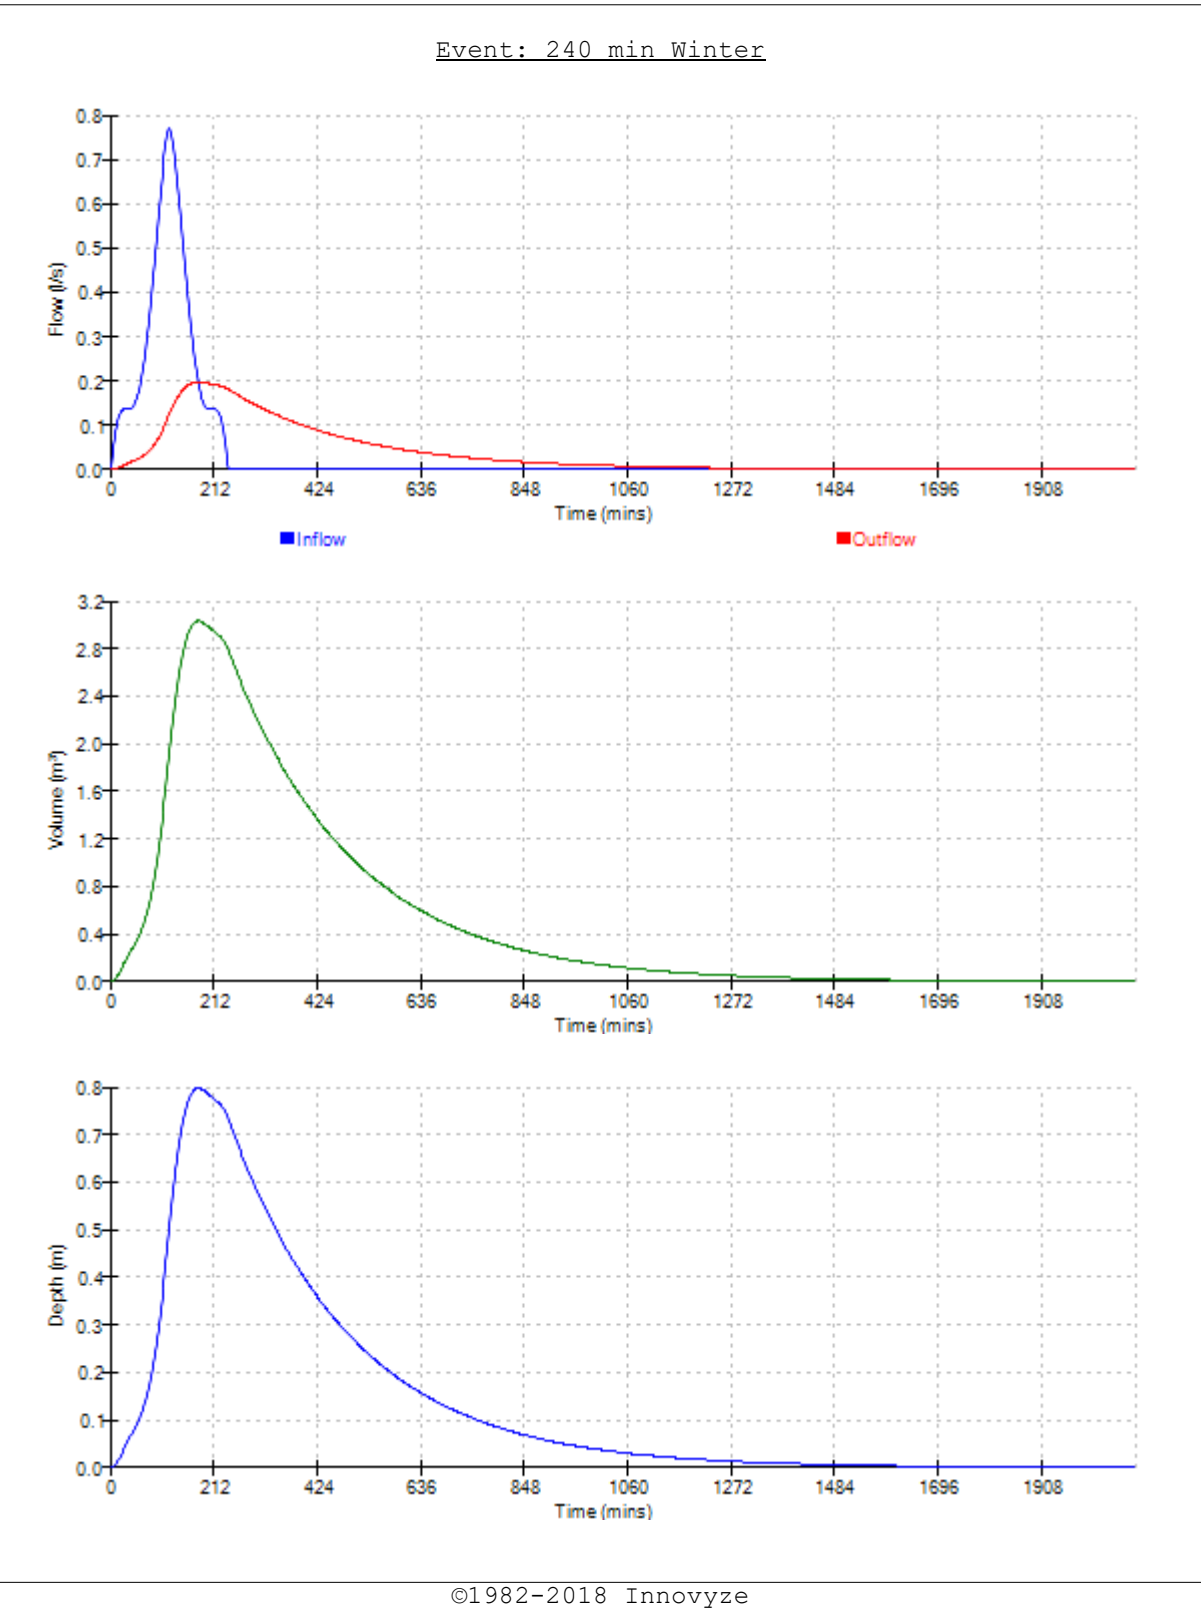

Waterco Ltd		Page 7
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685	
	Holt Road, Rossett TP12 House Soakaway	
Date 23/05/2018	Designed by HW	
File w10685-180523-TP12_Hous...	Checked by AW	
XP Solutions	Source Control 2018.1	

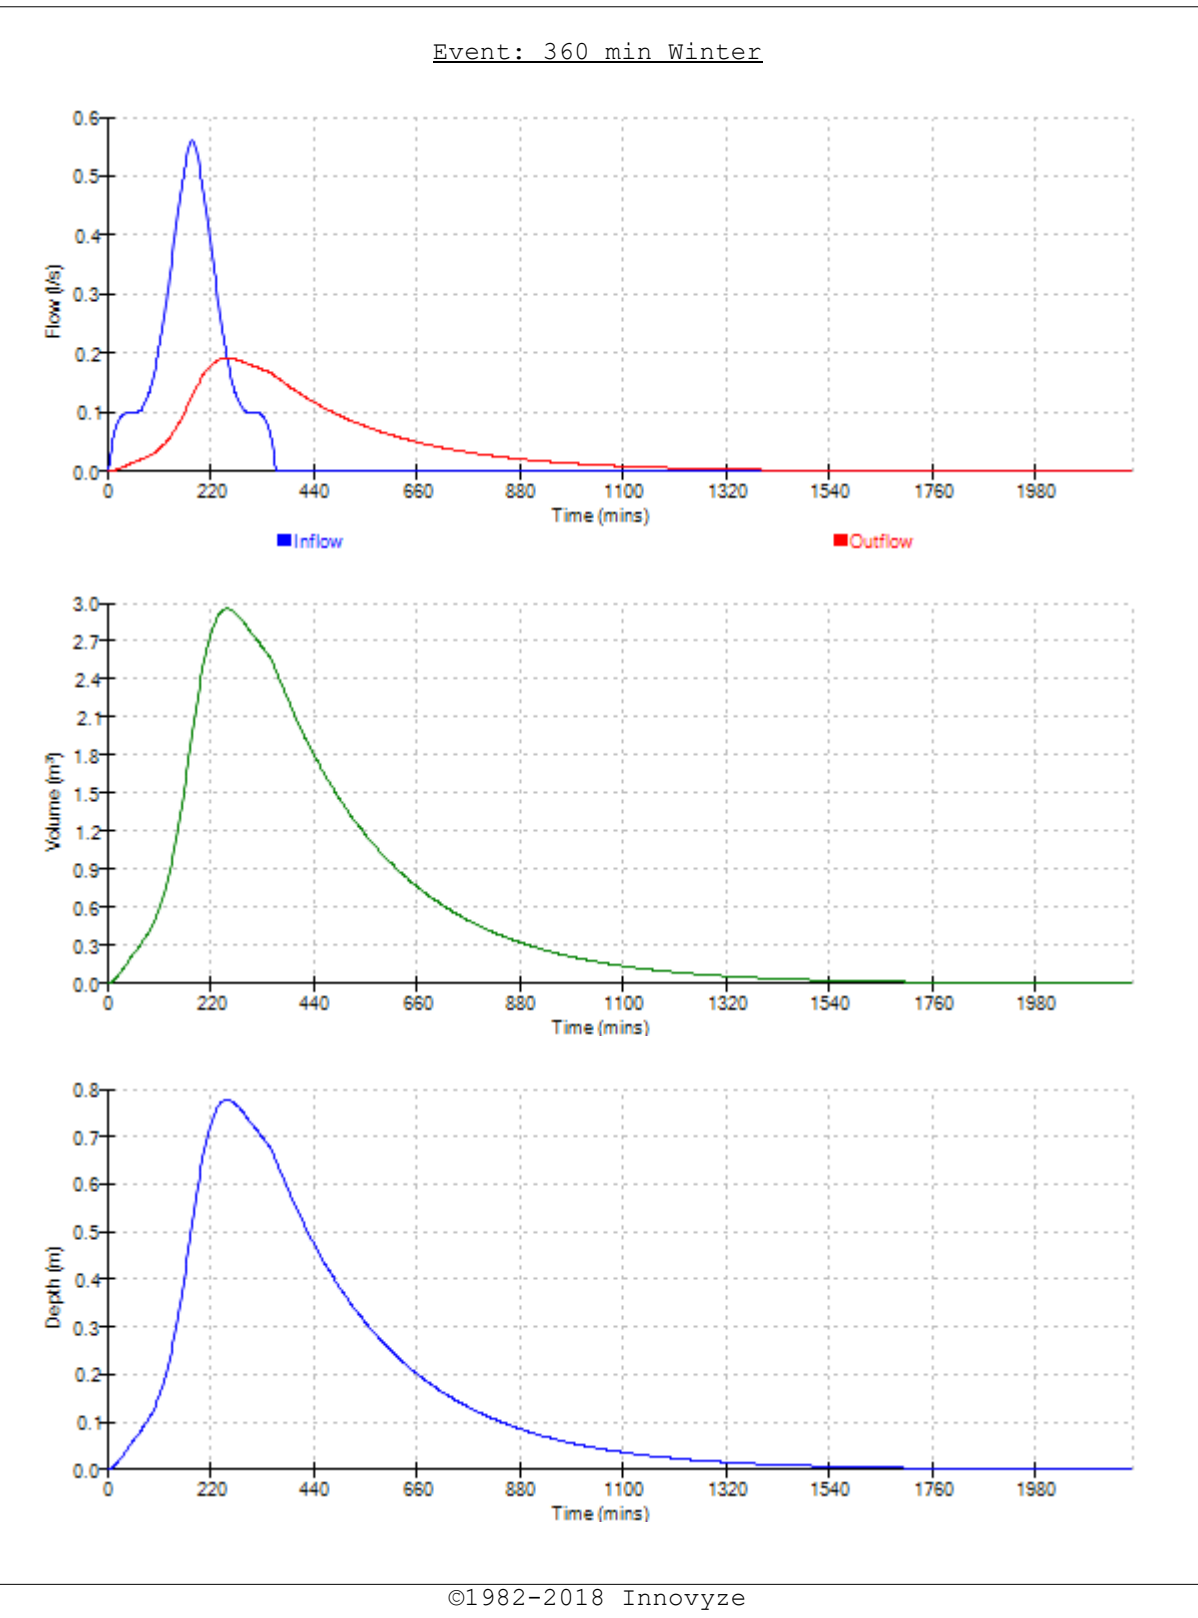




Waterco Ltd				Page 1																																																																																																																																																																																																																			
Eden Court		w10685 - CS1																																																																																																																																																																																																																					
Lon Parcwr Business Park		Holt Road																																																																																																																																																																																																																					
Denbighshire LL15 1NJ		Rossett																																																																																																																																																																																																																					
Date 31/05/2018		Designed by HW																																																																																																																																																																																																																					
File w10685-CS1.SRCX		Checked by AW																																																																																																																																																																																																																					
XP Solutions		Source Control 2018.1																																																																																																																																																																																																																					
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 12 minutes. <table><thead><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr></thead><tbody><tr><td>15 min Summer</td><td>9.888</td><td>0.388</td><td>31.8</td><td>33.5</td><td>Flood Risk</td></tr><tr><td>30 min Summer</td><td>9.916</td><td>0.416</td><td>31.8</td><td>36.1</td><td>Flood Risk</td></tr><tr><td>60 min Summer</td><td>9.881</td><td>0.381</td><td>31.8</td><td>33.0</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.744</td><td>0.244</td><td>31.8</td><td>20.6</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.638</td><td>0.138</td><td>31.8</td><td>11.0</td><td>O K</td></tr><tr><td>240 min Summer</td><td>9.573</td><td>0.073</td><td>31.8</td><td>5.2</td><td>O K</td></tr><tr><td>360 min Summer</td><td>9.543</td><td>0.043</td><td>27.2</td><td>2.5</td><td>O K</td></tr><tr><td>480 min Summer</td><td>9.534</td><td>0.034</td><td>21.4</td><td>1.7</td><td>O K</td></tr><tr><td>600 min Summer</td><td>9.529</td><td>0.029</td><td>18.1</td><td>1.3</td><td>O K</td></tr><tr><td>720 min Summer</td><td>9.527</td><td>0.027</td><td>15.7</td><td>1.1</td><td>O K</td></tr><tr><td>960 min Summer</td><td>9.524</td><td>0.024</td><td>12.5</td><td>0.9</td><td>O K</td></tr><tr><td>1440 min Summer</td><td>9.520</td><td>0.020</td><td>8.7</td><td>0.6</td><td>O K</td></tr><tr><td>2160 min Summer</td><td>9.517</td><td>0.017</td><td>6.3</td><td>0.4</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.515</td><td>0.015</td><td>4.9</td><td>0.4</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.513</td><td>0.013</td><td>3.4</td><td>0.2</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.511</td><td>0.011</td><td>2.7</td><td>0.2</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.510</td><td>0.010</td><td>2.2</td><td>0.2</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.510</td><td>0.010</td><td>2.0</td><td>0.2</td><td>O K</td></tr><tr><td>10080 min Summer</td><td>9.509</td><td>0.009</td><td>1.8</td><td>0.1</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.951</td><td>0.451</td><td>31.8</td><td>39.2</td><td>Flood Risk</td></tr></tbody></table> <table><thead><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr></thead><tbody><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>12</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>21</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>38</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>70</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>100</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>126</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>184</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>244</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>304</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>356</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>478</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>710</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1068</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1440</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2200</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>2800</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3592</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4368</td></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>4992</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>13</td></tr></tbody></table>						Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.888	0.388	31.8	33.5	Flood Risk	30 min Summer	9.916	0.416	31.8	36.1	Flood Risk	60 min Summer	9.881	0.381	31.8	33.0	Flood Risk	120 min Summer	9.744	0.244	31.8	20.6	Flood Risk	180 min Summer	9.638	0.138	31.8	11.0	O K	240 min Summer	9.573	0.073	31.8	5.2	O K	360 min Summer	9.543	0.043	27.2	2.5	O K	480 min Summer	9.534	0.034	21.4	1.7	O K	600 min Summer	9.529	0.029	18.1	1.3	O K	720 min Summer	9.527	0.027	15.7	1.1	O K	960 min Summer	9.524	0.024	12.5	0.9	O K	1440 min Summer	9.520	0.020	8.7	0.6	O K	2160 min Summer	9.517	0.017	6.3	0.4	O K	2880 min Summer	9.515	0.015	4.9	0.4	O K	4320 min Summer	9.513	0.013	3.4	0.2	O K	5760 min Summer	9.511	0.011	2.7	0.2	O K	7200 min Summer	9.510	0.010	2.2	0.2	O K	8640 min Summer	9.510	0.010	2.0	0.2	O K	10080 min Summer	9.509	0.009	1.8	0.1	O K	15 min Winter	9.951	0.451	31.8	39.2	Flood Risk	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	12	30 min Summer	96.151	0.0	21	60 min Summer	61.531	0.0	38	120 min Summer	36.920	0.0	70	180 min Summer	27.160	0.0	100	240 min Summer	21.763	0.0	126	360 min Summer	15.835	0.0	184	480 min Summer	12.539	0.0	244	600 min Summer	10.433	0.0	304	720 min Summer	8.964	0.0	356	960 min Summer	7.046	0.0	478	1440 min Summer	4.991	0.0	710	2160 min Summer	3.510	0.0	1068	2880 min Summer	2.731	0.0	1440	4320 min Summer	1.912	0.0	2200	5760 min Summer	1.496	0.0	2800	7200 min Summer	1.260	0.0	3592	8640 min Summer	1.110	0.0	4368	10080 min Summer	1.010	0.0	4992	15 min Winter	143.930	0.0	13
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																																		
15 min Summer	9.888	0.388	31.8	33.5	Flood Risk																																																																																																																																																																																																																		
30 min Summer	9.916	0.416	31.8	36.1	Flood Risk																																																																																																																																																																																																																		
60 min Summer	9.881	0.381	31.8	33.0	Flood Risk																																																																																																																																																																																																																		
120 min Summer	9.744	0.244	31.8	20.6	Flood Risk																																																																																																																																																																																																																		
180 min Summer	9.638	0.138	31.8	11.0	O K																																																																																																																																																																																																																		
240 min Summer	9.573	0.073	31.8	5.2	O K																																																																																																																																																																																																																		
360 min Summer	9.543	0.043	27.2	2.5	O K																																																																																																																																																																																																																		
480 min Summer	9.534	0.034	21.4	1.7	O K																																																																																																																																																																																																																		
600 min Summer	9.529	0.029	18.1	1.3	O K																																																																																																																																																																																																																		
720 min Summer	9.527	0.027	15.7	1.1	O K																																																																																																																																																																																																																		
960 min Summer	9.524	0.024	12.5	0.9	O K																																																																																																																																																																																																																		
1440 min Summer	9.520	0.020	8.7	0.6	O K																																																																																																																																																																																																																		
2160 min Summer	9.517	0.017	6.3	0.4	O K																																																																																																																																																																																																																		
2880 min Summer	9.515	0.015	4.9	0.4	O K																																																																																																																																																																																																																		
4320 min Summer	9.513	0.013	3.4	0.2	O K																																																																																																																																																																																																																		
5760 min Summer	9.511	0.011	2.7	0.2	O K																																																																																																																																																																																																																		
7200 min Summer	9.510	0.010	2.2	0.2	O K																																																																																																																																																																																																																		
8640 min Summer	9.510	0.010	2.0	0.2	O K																																																																																																																																																																																																																		
10080 min Summer	9.509	0.009	1.8	0.1	O K																																																																																																																																																																																																																		
15 min Winter	9.951	0.451	31.8	39.2	Flood Risk																																																																																																																																																																																																																		
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																				
15 min Summer	143.930	0.0	12																																																																																																																																																																																																																				
30 min Summer	96.151	0.0	21																																																																																																																																																																																																																				
60 min Summer	61.531	0.0	38																																																																																																																																																																																																																				
120 min Summer	36.920	0.0	70																																																																																																																																																																																																																				
180 min Summer	27.160	0.0	100																																																																																																																																																																																																																				
240 min Summer	21.763	0.0	126																																																																																																																																																																																																																				
360 min Summer	15.835	0.0	184																																																																																																																																																																																																																				
480 min Summer	12.539	0.0	244																																																																																																																																																																																																																				
600 min Summer	10.433	0.0	304																																																																																																																																																																																																																				
720 min Summer	8.964	0.0	356																																																																																																																																																																																																																				
960 min Summer	7.046	0.0	478																																																																																																																																																																																																																				
1440 min Summer	4.991	0.0	710																																																																																																																																																																																																																				
2160 min Summer	3.510	0.0	1068																																																																																																																																																																																																																				
2880 min Summer	2.731	0.0	1440																																																																																																																																																																																																																				
4320 min Summer	1.912	0.0	2200																																																																																																																																																																																																																				
5760 min Summer	1.496	0.0	2800																																																																																																																																																																																																																				
7200 min Summer	1.260	0.0	3592																																																																																																																																																																																																																				
8640 min Summer	1.110	0.0	4368																																																																																																																																																																																																																				
10080 min Summer	1.010	0.0	4992																																																																																																																																																																																																																				
15 min Winter	143.930	0.0	13																																																																																																																																																																																																																				
©1982-2018 Innovyze																																																																																																																																																																																																																							

Waterco Ltd				Page 2	
Eden Court		w10685 - CS1			
Lon Parcwr Business Park		Holt Road			
Denbighshire LL15 1NJ		Rossett			
Date 31/05/2018		Designed by HW			
File w10685-CS1.SRCX		Checked by AW			
XP Solutions		Source Control 2018.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.977	0.477	31.8	41.6	Flood Risk
60 min Winter	9.908	0.408	31.8	35.4	Flood Risk
120 min Winter	9.693	0.193	31.8	16.0	O K
180 min Winter	9.560	0.060	31.8	4.1	O K
240 min Winter	9.542	0.042	26.8	2.5	O K
360 min Winter	9.531	0.031	19.9	1.4	O K
480 min Winter	9.527	0.027	15.7	1.1	O K
600 min Winter	9.525	0.025	13.0	0.9	O K
720 min Winter	9.523	0.023	11.4	0.8	O K
960 min Winter	9.521	0.021	9.1	0.6	O K
1440 min Winter	9.517	0.017	6.3	0.5	O K
2160 min Winter	9.515	0.015	4.6	0.3	O K
2880 min Winter	9.513	0.013	3.4	0.3	O K
4320 min Winter	9.511	0.011	2.4	0.2	O K
5760 min Winter	9.510	0.010	2.0	0.2	O K
7200 min Winter	9.509	0.009	1.6	0.1	O K
8640 min Winter	9.508	0.008	1.4	0.1	O K
10080 min Winter	9.508	0.008	1.4	0.1	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
30 min Winter	96.151	0.0	23		
60 min Winter	61.531	0.0	42		
120 min Winter	36.920	0.0	74		
180 min Winter	27.160	0.0	98		
240 min Winter	21.763	0.0	124		
360 min Winter	15.835	0.0	182		
480 min Winter	12.539	0.0	246		
600 min Winter	10.433	0.0	294		
720 min Winter	8.964	0.0	356		
960 min Winter	7.046	0.0	482		
1440 min Winter	4.991	0.0	716		
2160 min Winter	3.510	0.0	1072		
2880 min Winter	2.731	0.0	1464		
4320 min Winter	1.912	0.0	2192		
5760 min Winter	1.496	0.0	2608		
7200 min Winter	1.260	0.0	3560		
8640 min Winter	1.110	0.0	4400		
10080 min Winter	1.010	0.0	4936		
©1982-2018 Innovyze					




Waterco Ltd		Page 3																																	
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS1 Holt Road Rossett																																		
Date 31/05/2018 File w10685-CS1.SRCX	Designed by HW Checked by AW																																		
XP Solutions		Source Control 2018.1																																	
<u>Rainfall Details</u> <table> <tr> <td>Rainfall Model</td> <td>FEH</td> <td>Winter Storms</td> <td>Yes</td> </tr> <tr> <td>Return Period (years)</td> <td>100</td> <td>Cv (Summer)</td> <td>0.750</td> </tr> <tr> <td>FEH Rainfall Version</td> <td>2013</td> <td>Cv (Winter)</td> <td>0.840</td> </tr> <tr> <td>Site Location</td> <td>GB 337309 357277</td> <td>Shortest Storm (mins)</td> <td>15</td> </tr> <tr> <td>Data Type</td> <td>Point</td> <td>Longest Storm (mins)</td> <td>10080</td> </tr> <tr> <td>Summer Storms</td> <td>Yes</td> <td>Climate Change %</td> <td>+30</td> </tr> </table> <u>Time Area Diagram</u> Total Area (ha) 0.211 <table> <thead> <tr> <th colspan="2">Time (mins)</th> <th>Area</th> </tr> <tr> <th>From:</th> <th>To:</th> <th>(ha)</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>1</td> <td>0.211</td> </tr> </tbody> </table>			Rainfall Model	FEH	Winter Storms	Yes	Return Period (years)	100	Cv (Summer)	0.750	FEH Rainfall Version	2013	Cv (Winter)	0.840	Site Location	GB 337309 357277	Shortest Storm (mins)	15	Data Type	Point	Longest Storm (mins)	10080	Summer Storms	Yes	Climate Change %	+30	Time (mins)		Area	From:	To:	(ha)	0	1	0.211
Rainfall Model	FEH	Winter Storms	Yes																																
Return Period (years)	100	Cv (Summer)	0.750																																
FEH Rainfall Version	2013	Cv (Winter)	0.840																																
Site Location	GB 337309 357277	Shortest Storm (mins)	15																																
Data Type	Point	Longest Storm (mins)	10080																																
Summer Storms	Yes	Climate Change %	+30																																
Time (mins)		Area																																	
From:	To:	(ha)																																	
0	1	0.211																																	
©1982-2018 Innovyze																																			

Waterco Ltd		Page 4																								
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS1 Holt Road Rossett																									
Date 31/05/2018 File w10685-CS1.SRCX	Designed by HW Checked by AW																									
XP Solutions		Source Control 2018.1																								
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Porous Car Park Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.76245</td> <td>Width (m)</td> <td>10.0</td> </tr> <tr> <td>Membrane Percolation (mm/hr)</td> <td>1000</td> <td>Length (m)</td> <td>30.0</td> </tr> <tr> <td>Max Percolation (l/s)</td> <td>83.3</td> <td>Slope (1:X)</td> <td>1000.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Depression Storage (mm)</td> <td>5</td> </tr> <tr> <td>Porosity</td> <td>0.30</td> <td>Evaporation (mm/day)</td> <td>3</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.500</td> <td>Membrane Depth (m)</td> <td>0</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.76245	Width (m)	10.0	Membrane Percolation (mm/hr)	1000	Length (m)	30.0	Max Percolation (l/s)	83.3	Slope (1:X)	1000.0	Safety Factor	2.0	Depression Storage (mm)	5	Porosity	0.30	Evaporation (mm/day)	3	Invert Level (m)	9.500	Membrane Depth (m)	0
Infiltration Coefficient Base (m/hr)	0.76245	Width (m)	10.0																							
Membrane Percolation (mm/hr)	1000	Length (m)	30.0																							
Max Percolation (l/s)	83.3	Slope (1:X)	1000.0																							
Safety Factor	2.0	Depression Storage (mm)	5																							
Porosity	0.30	Evaporation (mm/day)	3																							
Invert Level (m)	9.500	Membrane Depth (m)	0																							
©1982-2018 Innovyze																										




Event: 15 min Summer

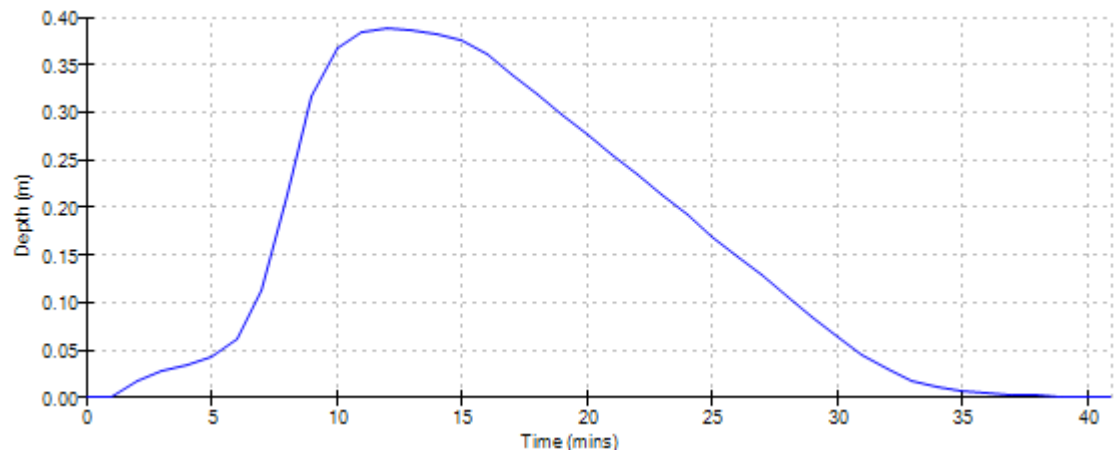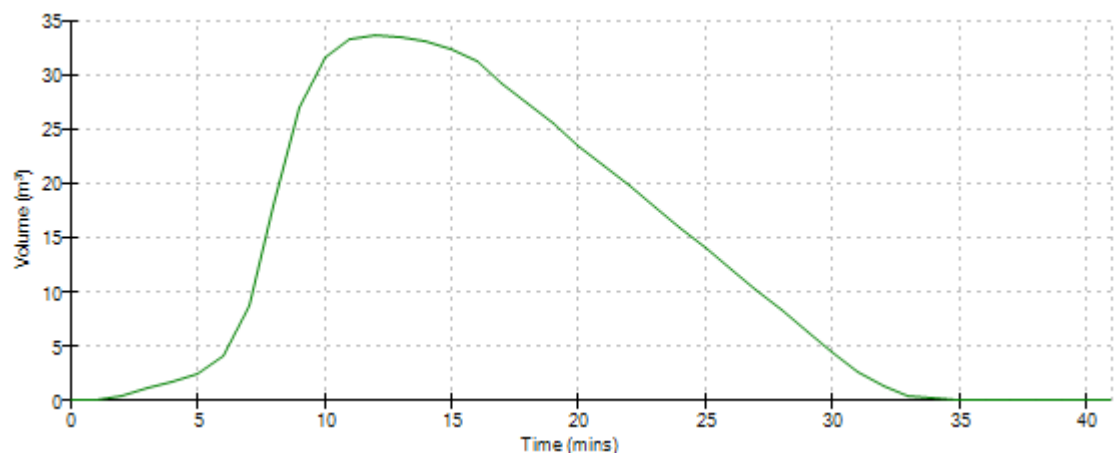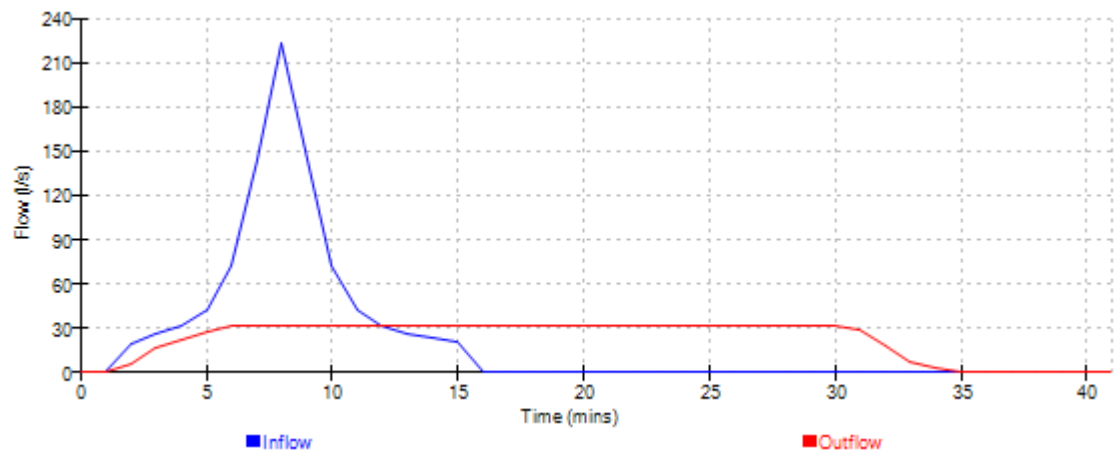

Event: 30 min Summer

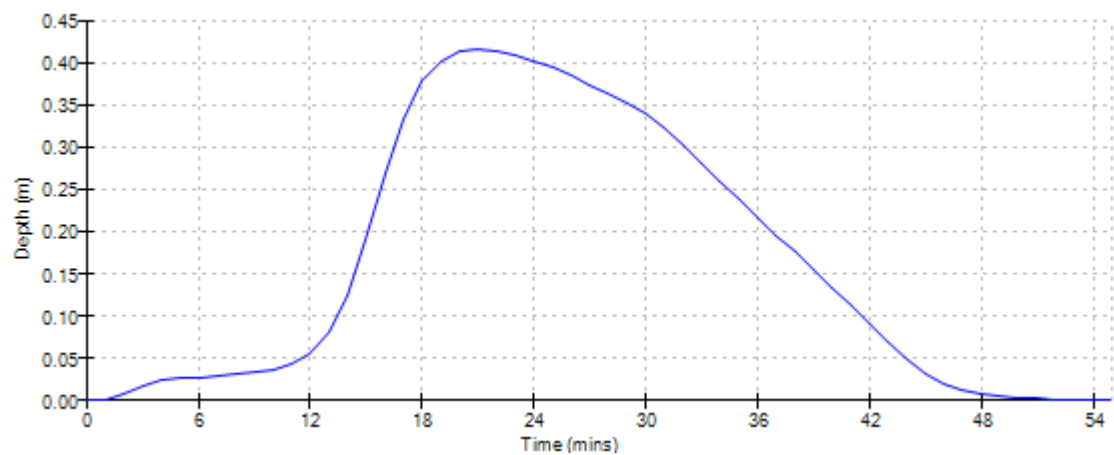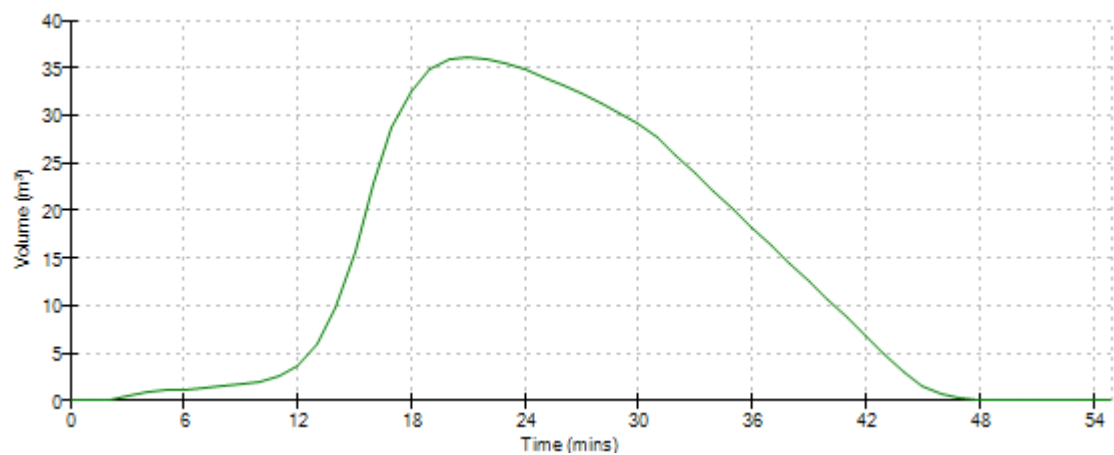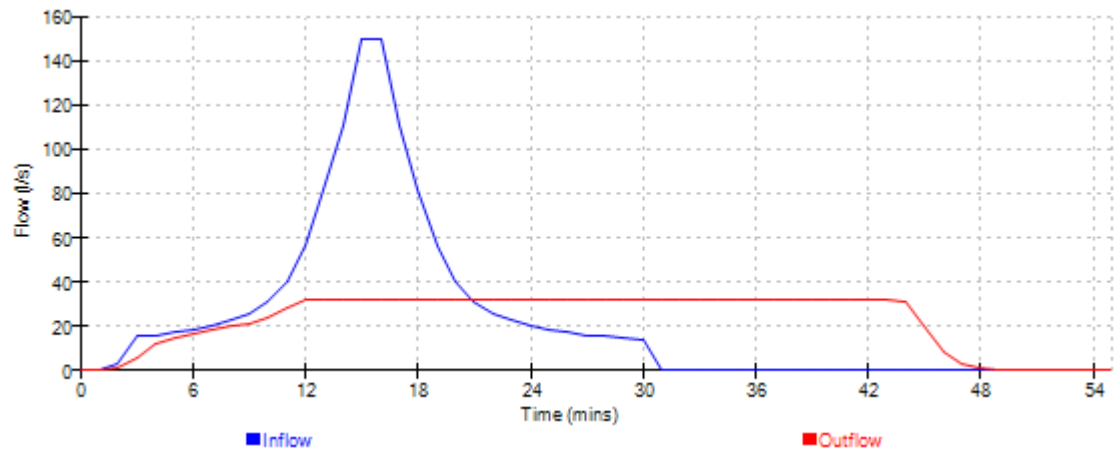

Event: 60 min Summer

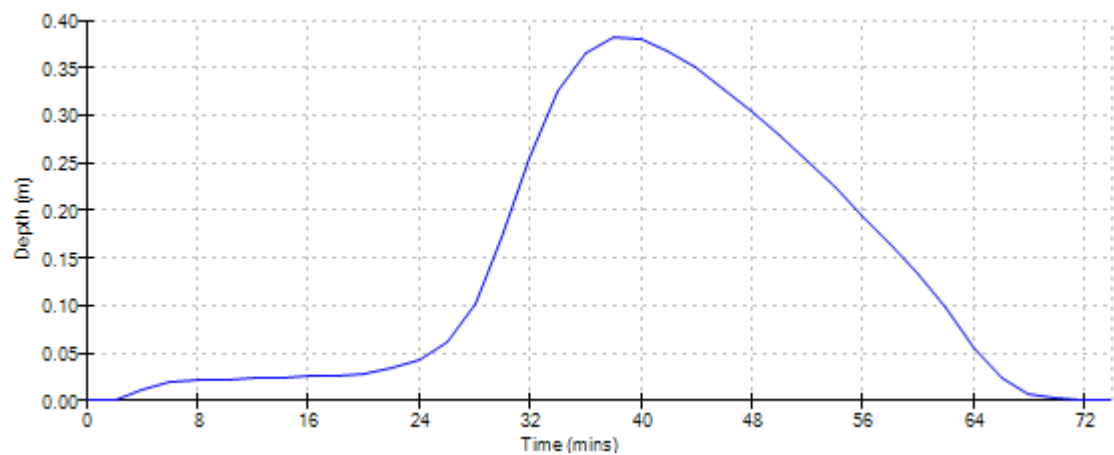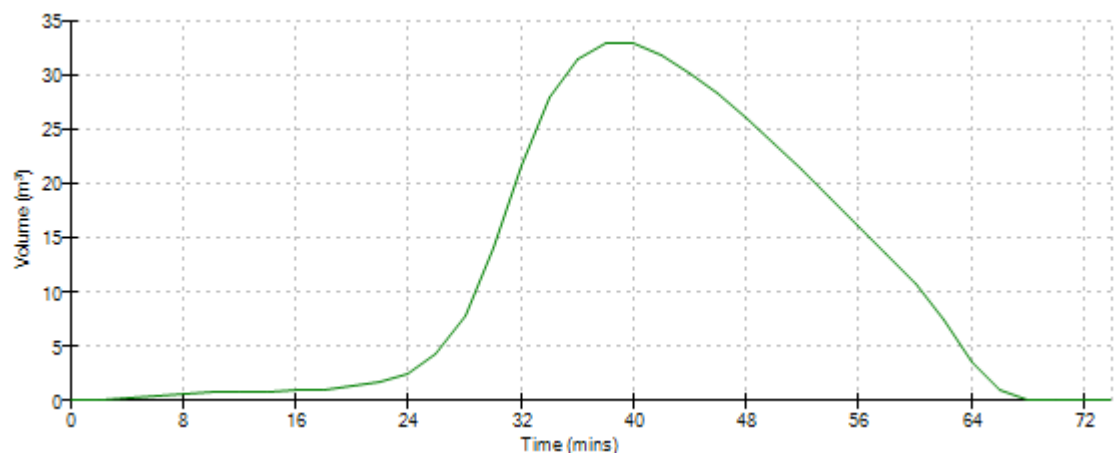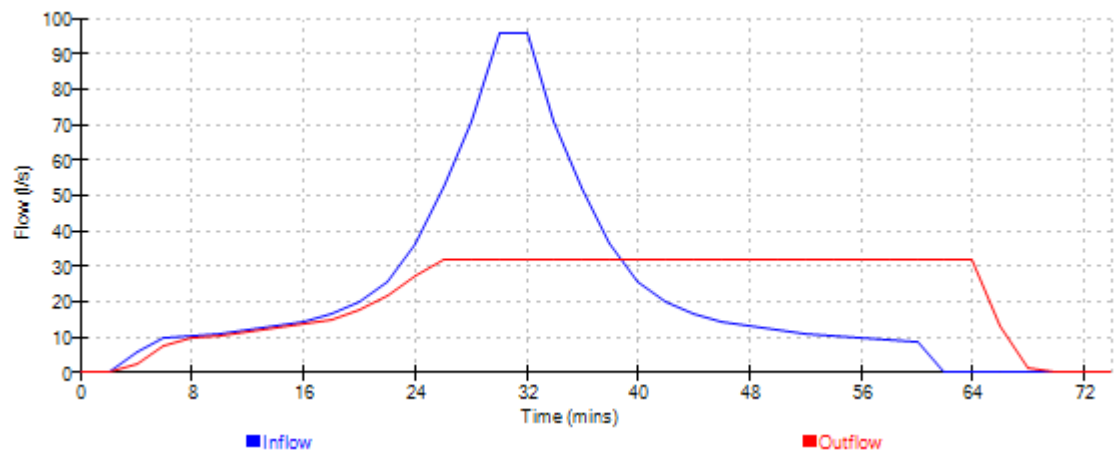

Waterco Ltd		Page 1
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS2 Holt Road Rossett	
Date 31/05/2018 File W10685-CS2.SRCX	Designed by HW Checked by AW	
XP Solutions		Source Control 2018.1

Summary of Results for 100 year Return Period (+30%)

Half Drain Time : 6 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	9.898	0.298	34.7	17.3	Flood Risk
30 min Summer	9.890	0.290	34.7	16.8	Flood Risk
60 min Summer	9.811	0.211	34.7	12.0	Flood Risk
120 min Summer	9.674	0.074	34.7	3.8	0 K
180 min Summer	9.644	0.044	30.4	2.0	0 K
240 min Summer	9.635	0.035	24.5	1.5	0 K
360 min Summer	9.626	0.026	17.9	1.0	0 K
480 min Summer	9.621	0.021	14.4	0.6	0 K
600 min Summer	9.619	0.019	12.2	0.5	0 K
720 min Summer	9.617	0.017	10.3	0.5	0 K
960 min Summer	9.615	0.015	8.1	0.4	0 K
1440 min Summer	9.613	0.013	6.1	0.3	0 K
2160 min Summer	9.611	0.011	4.4	0.2	0 K
2880 min Summer	9.610	0.010	3.3	0.2	0 K
4320 min Summer	9.608	0.008	2.4	0.1	0 K
5760 min Summer	9.607	0.007	1.8	0.1	0 K
7200 min Summer	9.607	0.007	1.8	0.1	0 K
8640 min Summer	9.607	0.007	1.6	0.1	0 K
10080 min Summer	9.606	0.006	1.4	0.1	0 K
15 min Winter	9.938	0.338	34.7	19.7	Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	143.930	0.0	11
30 min Summer	96.151	0.0	19
60 min Summer	61.531	0.0	36
120 min Summer	36.920	0.0	64
180 min Summer	27.160	0.0	92
240 min Summer	21.763	0.0	122
360 min Summer	15.835	0.0	184
480 min Summer	12.539	0.0	244
600 min Summer	10.433	0.0	306
720 min Summer	8.964	0.0	362
960 min Summer	7.046	0.0	474
1440 min Summer	4.991	0.0	732
2160 min Summer	3.510	0.0	1084
2880 min Summer	2.731	0.0	1452
4320 min Summer	1.912	0.0	2128
5760 min Summer	1.496	0.0	2888
7200 min Summer	1.260	0.0	3592
8640 min Summer	1.110	0.0	4264
10080 min Summer	1.010	0.0	4984
15 min Winter	143.930	0.0	12

Waterco Ltd		Page 2
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS2 Holt Road Rossett	
Date 31/05/2018 File W10685-CS2.SRCX	Designed by HW Checked by AW	
XP Solutions		Source Control 2018.1

Summary of Results for 100 year Return Period (+30%)




Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.907	0.307	34.7	17.8	Flood Risk
60 min Winter	9.770	0.170	34.7	9.6	Flood Risk
120 min Winter	9.644	0.044	30.4	2.0	0 K
180 min Winter	9.632	0.032	22.4	1.3	0 K
240 min Winter	9.626	0.026	17.9	1.0	0 K
360 min Winter	9.620	0.020	13.6	0.6	0 K
480 min Winter	9.617	0.017	10.3	0.4	0 K
600 min Winter	9.616	0.016	8.6	0.4	0 K
720 min Winter	9.615	0.015	7.6	0.3	0 K
960 min Winter	9.613	0.013	6.1	0.3	0 K
1440 min Winter	9.611	0.011	4.4	0.2	0 K
2160 min Winter	9.609	0.009	3.0	0.1	0 K
2880 min Winter	9.608	0.008	2.4	0.1	0 K
4320 min Winter	9.607	0.007	1.8	0.1	0 K
5760 min Winter	9.607	0.007	1.6	0.1	0 K
7200 min Winter	9.606	0.006	1.4	0.1	0 K
8640 min Winter	9.606	0.006	1.1	0.1	0 K
10080 min Winter	9.605	0.005	1.0	0.1	0 K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
30 min Winter	96.151	0.0	21
60 min Winter	61.531	0.0	38
120 min Winter	36.920	0.0	62
180 min Winter	27.160	0.0	92
240 min Winter	21.763	0.0	122
360 min Winter	15.835	0.0	180
480 min Winter	12.539	0.0	234
600 min Winter	10.433	0.0	296
720 min Winter	8.964	0.0	360
960 min Winter	7.046	0.0	456
1440 min Winter	4.991	0.0	718
2160 min Winter	3.510	0.0	1076
2880 min Winter	2.731	0.0	1444
4320 min Winter	1.912	0.0	2076
5760 min Winter	1.496	0.0	2808
7200 min Winter	1.260	0.0	3752
8640 min Winter	1.110	0.0	4720
10080 min Winter	1.010	0.0	5080




Waterco Ltd		Page 3																																	
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS2 Holt Road Rossett																																		
Date 31/05/2018 File W10685-CS2.SRCX	Designed by HW Checked by AW																																		
XP Solutions																																			
Source Control 2018.1																																			
<u>Rainfall Details</u> <table> <tr> <td>Rainfall Model</td> <td>FEH</td> <td>Winter Storms</td> <td>Yes</td> </tr> <tr> <td>Return Period (years)</td> <td>100</td> <td>Cv (Summer)</td> <td>0.750</td> </tr> <tr> <td>FEH Rainfall Version</td> <td>2013</td> <td>Cv (Winter)</td> <td>0.840</td> </tr> <tr> <td>Site Location</td> <td>GB 337309 357277</td> <td>Shortest Storm (mins)</td> <td>15</td> </tr> <tr> <td>Data Type</td> <td>Point</td> <td>Longest Storm (mins)</td> <td>10080</td> </tr> <tr> <td>Summer Storms</td> <td>Yes</td> <td>Climate Change %</td> <td>+30</td> </tr> </table> <u>Time Area Diagram</u> Total Area (ha) 0.140 <table> <tr> <th colspan="2">Time (mins)</th> <th>Area</th> </tr> <tr> <th>From:</th> <th>To:</th> <th>(ha)</th> </tr> <tr> <td>0</td> <td>1</td> <td>0.140</td> </tr> </table>			Rainfall Model	FEH	Winter Storms	Yes	Return Period (years)	100	Cv (Summer)	0.750	FEH Rainfall Version	2013	Cv (Winter)	0.840	Site Location	GB 337309 357277	Shortest Storm (mins)	15	Data Type	Point	Longest Storm (mins)	10080	Summer Storms	Yes	Climate Change %	+30	Time (mins)		Area	From:	To:	(ha)	0	1	0.140
Rainfall Model	FEH	Winter Storms	Yes																																
Return Period (years)	100	Cv (Summer)	0.750																																
FEH Rainfall Version	2013	Cv (Winter)	0.840																																
Site Location	GB 337309 357277	Shortest Storm (mins)	15																																
Data Type	Point	Longest Storm (mins)	10080																																
Summer Storms	Yes	Climate Change %	+30																																
Time (mins)		Area																																	
From:	To:	(ha)																																	
0	1	0.140																																	
©1982-2018 Innovyze																																			

Waterco Ltd		Page 4																								
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS2 Holt Road Rossett																									
Date 31/05/2018 File W10685-CS2.SRCX	Designed by HW Checked by AW																									
XP Solutions																										
Source Control 2018.1																										
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Porous Car Park Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>1.25062</td> <td>Width (m)</td> <td>10.0</td> </tr> <tr> <td>Membrane Percolation (mm/hr)</td> <td>1000</td> <td>Length (m)</td> <td>20.0</td> </tr> <tr> <td>Max Percolation (l/s)</td> <td>55.6</td> <td>Slope (1:X)</td> <td>1000.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Depression Storage (mm)</td> <td>5</td> </tr> <tr> <td>Porosity</td> <td>0.30</td> <td>Evaporation (mm/day)</td> <td>3</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.600</td> <td>Membrane Depth (m)</td> <td>0</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	1.25062	Width (m)	10.0	Membrane Percolation (mm/hr)	1000	Length (m)	20.0	Max Percolation (l/s)	55.6	Slope (1:X)	1000.0	Safety Factor	2.0	Depression Storage (mm)	5	Porosity	0.30	Evaporation (mm/day)	3	Invert Level (m)	9.600	Membrane Depth (m)	0
Infiltration Coefficient Base (m/hr)	1.25062	Width (m)	10.0																							
Membrane Percolation (mm/hr)	1000	Length (m)	20.0																							
Max Percolation (l/s)	55.6	Slope (1:X)	1000.0																							
Safety Factor	2.0	Depression Storage (mm)	5																							
Porosity	0.30	Evaporation (mm/day)	3																							
Invert Level (m)	9.600	Membrane Depth (m)	0																							
©1982-2018 Innovyze																										




Event: 15 min Summer

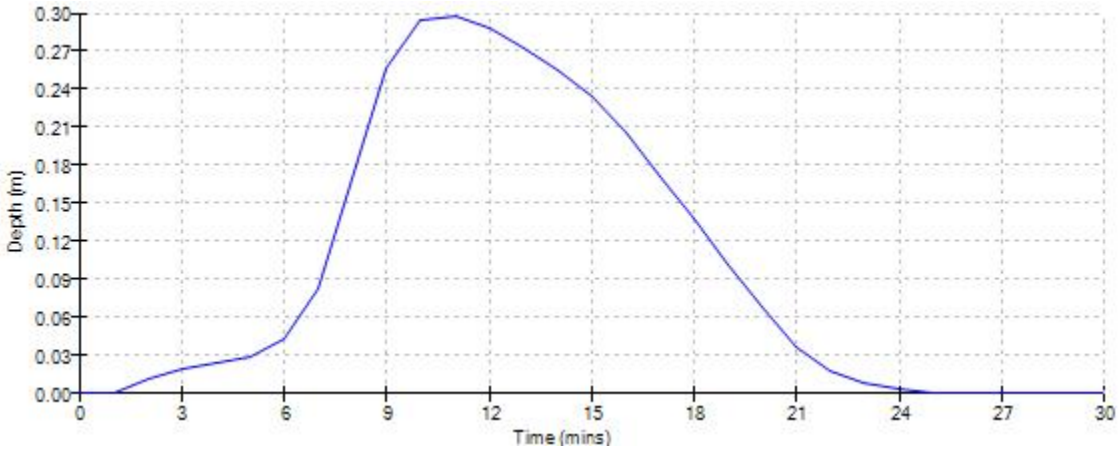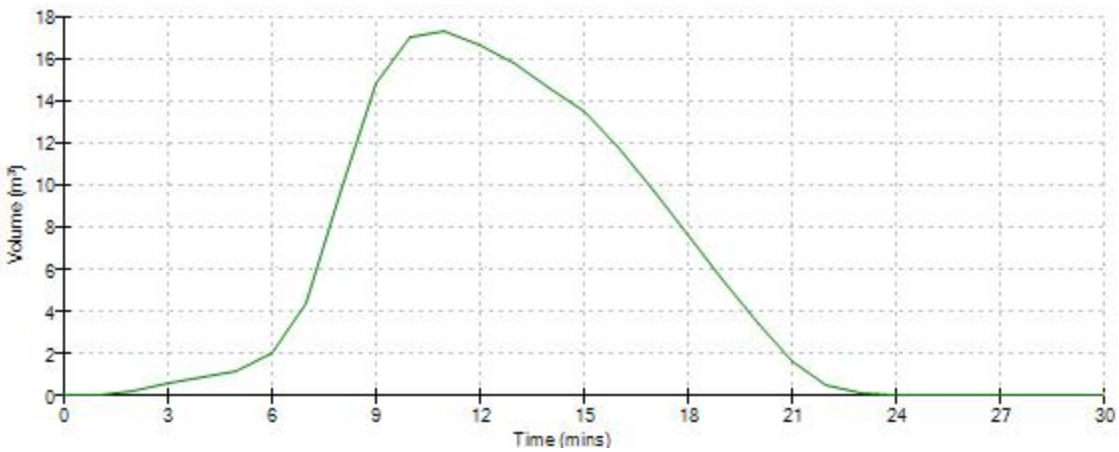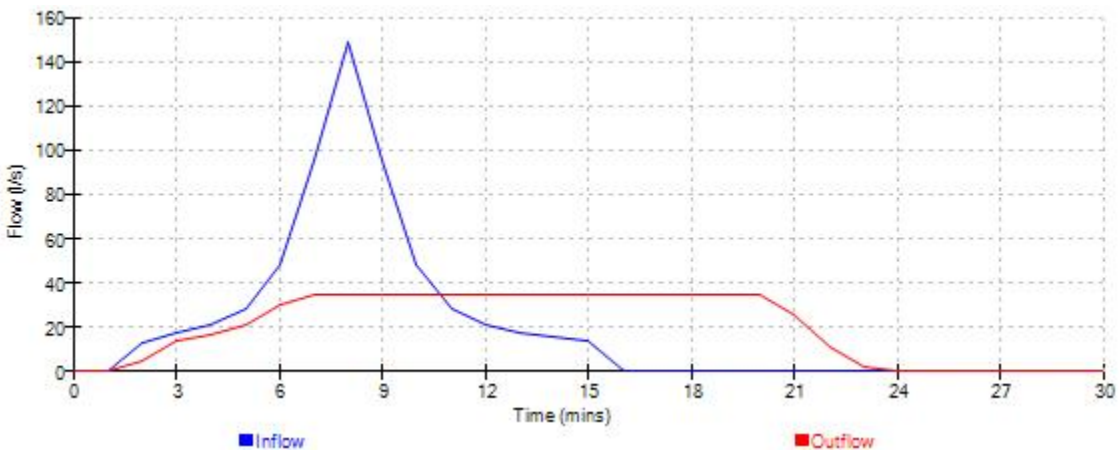

Event: 30 min Summer

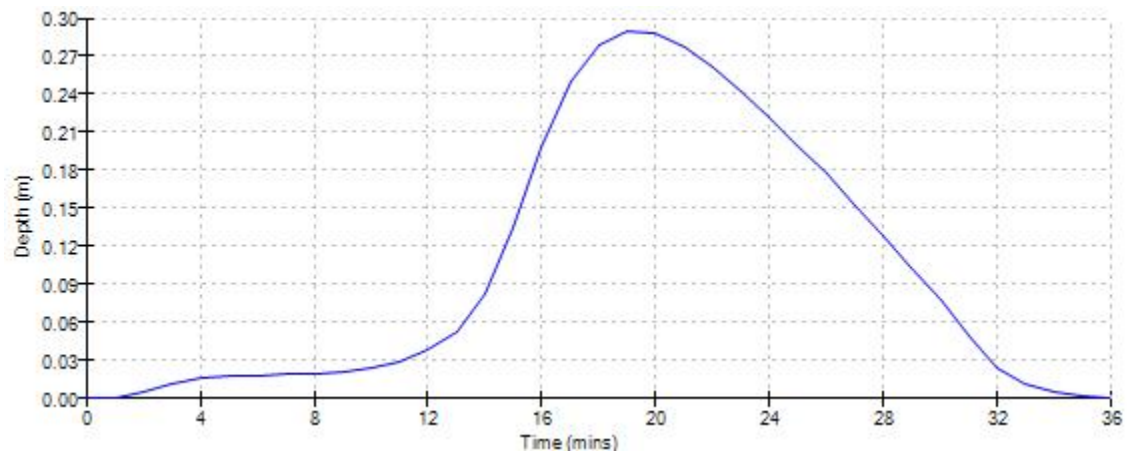
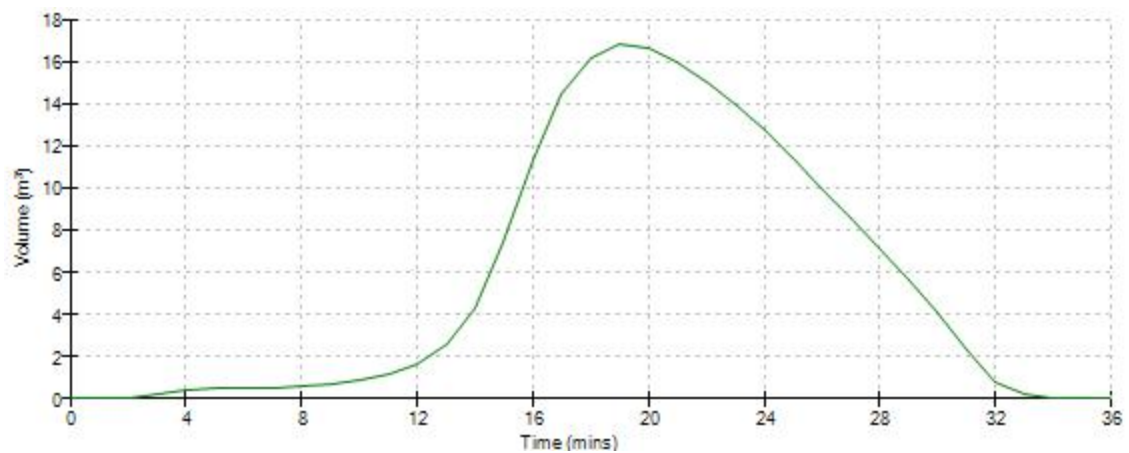
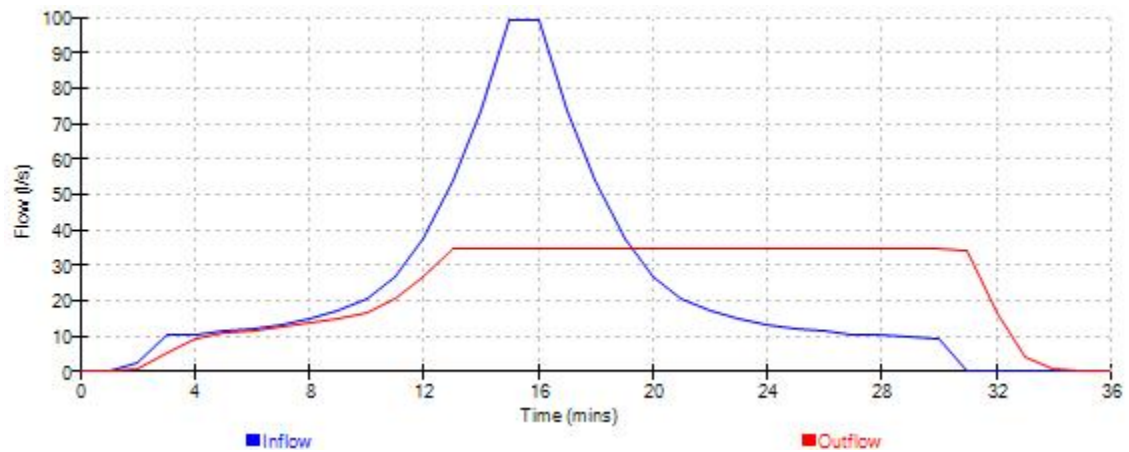


Event: 60 min Summer

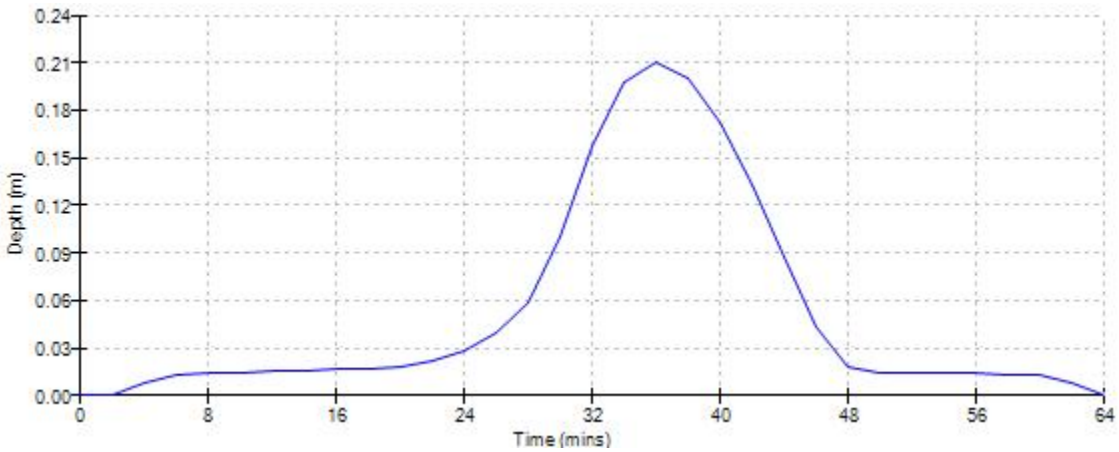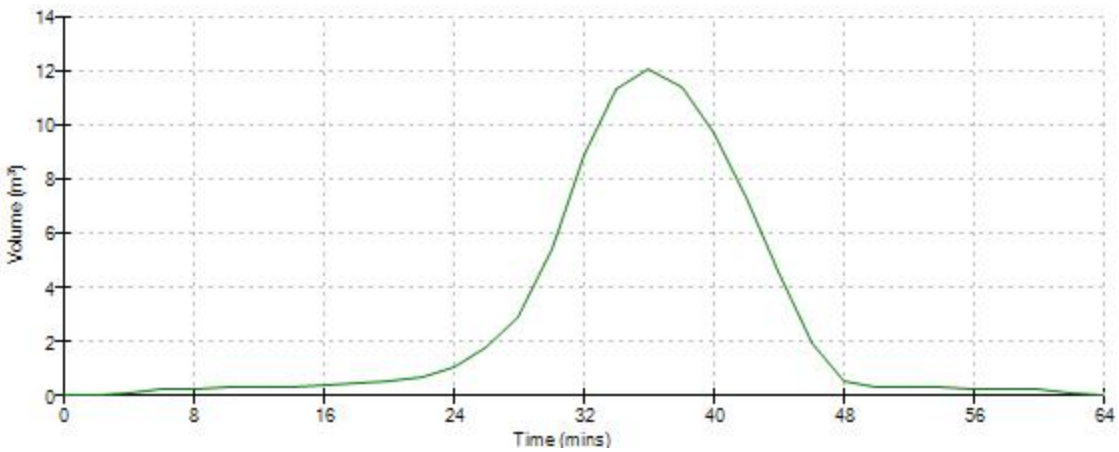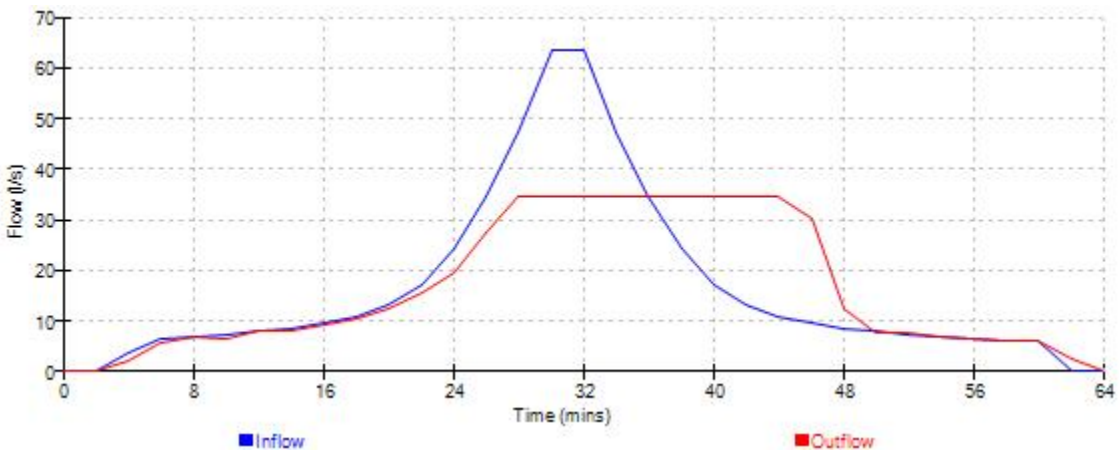

Waterco Ltd		Page 8
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS2	
	Holt Road Rossett	
Date 31/05/2018	Designed by HW	
File W10685-CS2.SRCX	Checked by AW	
XP Solutions	Source Control 2018.1	

Event: 120 min Summer

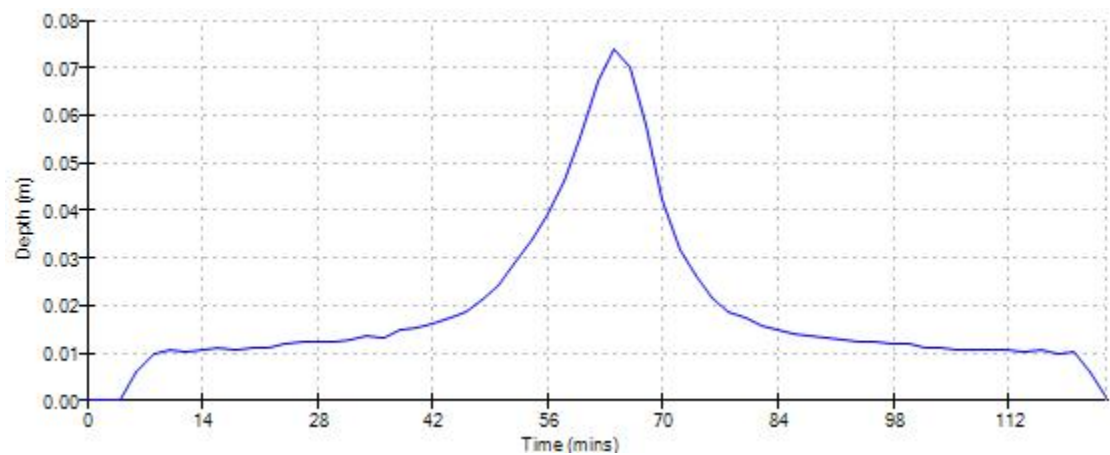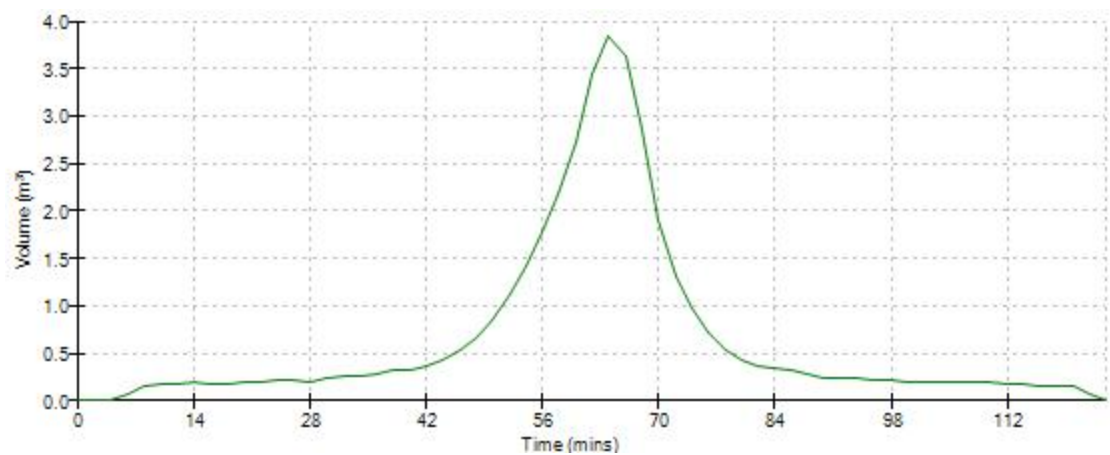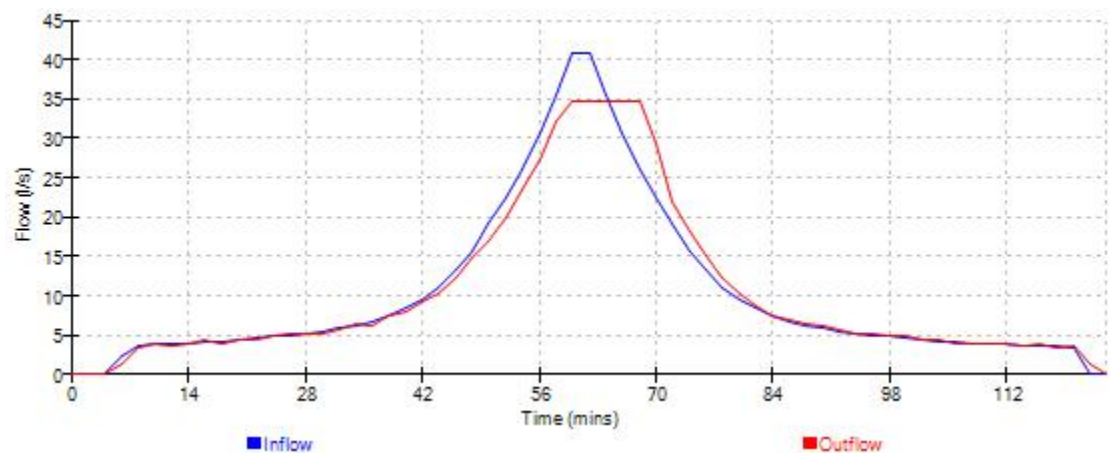

Waterco Ltd		Page 1
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS3 Holt Road Rossett	
Date 31/05/2018 File W10685-CS3.SRCX	Designed by HW Checked by AW	
XP Solutions		Source Control 2018.1

Summary of Results for 100 year Return Period (+30%)

Half Drain Time : 35 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
15 min Summer	9.798	0.298	7.7	21.4	Flood Risk
30 min Summer	9.849	0.349	7.7	25.2	Flood Risk
60 min Summer	9.867	0.367	7.7	26.6	Flood Risk
120 min Summer	9.827	0.327	7.7	23.6	Flood Risk
180 min Summer	9.780	0.280	7.7	20.1	Flood Risk
240 min Summer	9.734	0.234	7.7	16.6	Flood Risk
360 min Summer	9.654	0.154	7.7	10.6	0 K
480 min Summer	9.596	0.096	7.7	6.3	0 K
600 min Summer	9.561	0.061	7.7	3.6	0 K
720 min Summer	9.548	0.048	7.4	2.7	0 K
960 min Summer	9.538	0.038	5.9	1.9	0 K
1440 min Summer	9.527	0.027	4.2	1.1	0 K
2160 min Summer	9.522	0.022	3.1	0.7	0 K
2880 min Summer	9.520	0.020	2.4	0.6	0 K
4320 min Summer	9.516	0.016	1.6	0.4	0 K
5760 min Summer	9.515	0.015	1.3	0.3	0 K
7200 min Summer	9.513	0.013	1.1	0.3	0 K
8640 min Summer	9.513	0.013	1.0	0.2	0 K
10080 min Summer	9.512	0.012	0.9	0.2	0 K
15 min Winter	9.841	0.341	7.7	24.6	Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
15 min Summer	143.930	0.0	15
30 min Summer	96.151	0.0	27
60 min Summer	61.531	0.0	44
120 min Summer	36.920	0.0	78
180 min Summer	27.160	0.0	112
240 min Summer	21.763	0.0	144
360 min Summer	15.835	0.0	204
480 min Summer	12.539	0.0	260
600 min Summer	10.433	0.0	314
720 min Summer	8.964	0.0	368
960 min Summer	7.046	0.0	490
1440 min Summer	4.991	0.0	734
2160 min Summer	3.510	0.0	1096
2880 min Summer	2.731	0.0	1468
4320 min Summer	1.912	0.0	2192
5760 min Summer	1.496	0.0	2888
7200 min Summer	1.260	0.0	3560
8640 min Summer	1.110	0.0	4344
10080 min Summer	1.010	0.0	5024
15 min Winter	143.930	0.0	15

Waterco Ltd		Page 2
Eden Court	w10685 - CS3	
Lon Parcwr Business Park	Holt Road	
Denbighshire LL15 1NJ	Rossett	
Date 31/05/2018	Designed by HW	
File W10685-CS3.SRCX	Checked by AW	
XP Solutions	Source Control 2018.1	

Summary of Results for 100 year Return Period (+30%)


Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
30 min Winter	9.907	0.407	7.7	29.6	Flood Risk
60 min Winter	9.926	0.426	7.7	31.0	Flood Risk
120 min Winter	9.864	0.364	7.7	26.3	Flood Risk
180 min Winter	9.789	0.289	7.7	20.7	Flood Risk
240 min Winter	9.718	0.218	7.7	15.4	Flood Risk
360 min Winter	9.603	0.103	7.7	6.8	0 K
480 min Winter	9.549	0.049	7.6	2.7	0 K
600 min Winter	9.541	0.041	6.4	2.1	0 K
720 min Winter	9.535	0.035	5.4	1.7	0 K
960 min Winter	9.528	0.028	4.3	1.2	0 K
1440 min Winter	9.522	0.022	3.1	0.7	0 K
2160 min Winter	9.519	0.019	2.2	0.5	0 K
2880 min Winter	9.517	0.017	1.7	0.4	0 K
4320 min Winter	9.514	0.014	1.2	0.3	0 K
5760 min Winter	9.512	0.012	0.9	0.2	0 K
7200 min Winter	9.511	0.011	0.8	0.2	0 K
8640 min Winter	9.511	0.011	0.7	0.2	0 K
10080 min Winter	9.510	0.010	0.6	0.2	0 K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)
30 min Winter	96.151	0.0	29
60 min Winter	61.531	0.0	48
120 min Winter	36.920	0.0	86
180 min Winter	27.160	0.0	122
240 min Winter	21.763	0.0	154
360 min Winter	15.835	0.0	210
480 min Winter	12.539	0.0	246
600 min Winter	10.433	0.0	306
720 min Winter	8.964	0.0	368
960 min Winter	7.046	0.0	490
1440 min Winter	4.991	0.0	708
2160 min Winter	3.510	0.0	1084
2880 min Winter	2.731	0.0	1472
4320 min Winter	1.912	0.0	2196
5760 min Winter	1.496	0.0	2928
7200 min Winter	1.260	0.0	3536
8640 min Winter	1.110	0.0	4112
10080 min Winter	1.010	0.0	5264


Waterco Ltd		Page 3																																	
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS3 Holt Road Rossett																																		
Date 31/05/2018 File W10685-CS3.SRCX	Designed by HW Checked by AW																																		
XP Solutions																																			
Source Control 2018.1																																			
<u>Rainfall Details</u> <table> <tr> <td>Rainfall Model</td> <td>FEH</td> <td>Winter Storms</td> <td>Yes</td> </tr> <tr> <td>Return Period (years)</td> <td>100</td> <td>Cv (Summer)</td> <td>0.750</td> </tr> <tr> <td>FEH Rainfall Version</td> <td>2013</td> <td>Cv (Winter)</td> <td>0.840</td> </tr> <tr> <td>Site Location</td> <td>GB 337309 357277</td> <td>Shortest Storm (mins)</td> <td>15</td> </tr> <tr> <td>Data Type</td> <td>Point</td> <td>Longest Storm (mins)</td> <td>10080</td> </tr> <tr> <td>Summer Storms</td> <td>Yes</td> <td>Climate Change %</td> <td>+30</td> </tr> </table> <u>Time Area Diagram</u> Total Area (ha) 0.104 <table> <tr> <th colspan="2">Time (mins)</th> <th>Area</th> </tr> <tr> <th>From:</th> <th>To:</th> <th>(ha)</th> </tr> <tr> <td>0</td> <td>1</td> <td>0.104</td> </tr> </table>			Rainfall Model	FEH	Winter Storms	Yes	Return Period (years)	100	Cv (Summer)	0.750	FEH Rainfall Version	2013	Cv (Winter)	0.840	Site Location	GB 337309 357277	Shortest Storm (mins)	15	Data Type	Point	Longest Storm (mins)	10080	Summer Storms	Yes	Climate Change %	+30	Time (mins)		Area	From:	To:	(ha)	0	1	0.104
Rainfall Model	FEH	Winter Storms	Yes																																
Return Period (years)	100	Cv (Summer)	0.750																																
FEH Rainfall Version	2013	Cv (Winter)	0.840																																
Site Location	GB 337309 357277	Shortest Storm (mins)	15																																
Data Type	Point	Longest Storm (mins)	10080																																
Summer Storms	Yes	Climate Change %	+30																																
Time (mins)		Area																																	
From:	To:	(ha)																																	
0	1	0.104																																	
©1982-2018 Innovyze																																			

Waterco Ltd		Page 4																								
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS3 Holt Road Rossett																									
Date 31/05/2018 File W10685-CS3.SRCX	Designed by HW Checked by AW																									
XP Solutions																										
Source Control 2018.1																										
<u>Model Details</u> Storage is Online Cover Level (m) 10.000 <u>Porous Car Park Structure</u> <table> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.22244</td> <td>Width (m)</td> <td>10.0</td> </tr> <tr> <td>Membrane Percolation (mm/hr)</td> <td>1000</td> <td>Length (m)</td> <td>25.0</td> </tr> <tr> <td>Max Percolation (l/s)</td> <td>69.4</td> <td>Slope (1:X)</td> <td>1000.0</td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Depression Storage (mm)</td> <td>5</td> </tr> <tr> <td>Porosity</td> <td>0.30</td> <td>Evaporation (mm/day)</td> <td>3</td> </tr> <tr> <td>Invert Level (m)</td> <td>9.500</td> <td>Membrane Depth (m)</td> <td>0</td> </tr> </table>			Infiltration Coefficient Base (m/hr)	0.22244	Width (m)	10.0	Membrane Percolation (mm/hr)	1000	Length (m)	25.0	Max Percolation (l/s)	69.4	Slope (1:X)	1000.0	Safety Factor	2.0	Depression Storage (mm)	5	Porosity	0.30	Evaporation (mm/day)	3	Invert Level (m)	9.500	Membrane Depth (m)	0
Infiltration Coefficient Base (m/hr)	0.22244	Width (m)	10.0																							
Membrane Percolation (mm/hr)	1000	Length (m)	25.0																							
Max Percolation (l/s)	69.4	Slope (1:X)	1000.0																							
Safety Factor	2.0	Depression Storage (mm)	5																							
Porosity	0.30	Evaporation (mm/day)	3																							
Invert Level (m)	9.500	Membrane Depth (m)	0																							
©1982-2018 Innovyze																										

Waterco Ltd		Page 5
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS3	
	Holt Road Rossett	
Date 31/05/2018	Designed by HW	
File W10685-CS3.SRCX	Checked by AW	
XP Solutions	Source Control 2018.1	



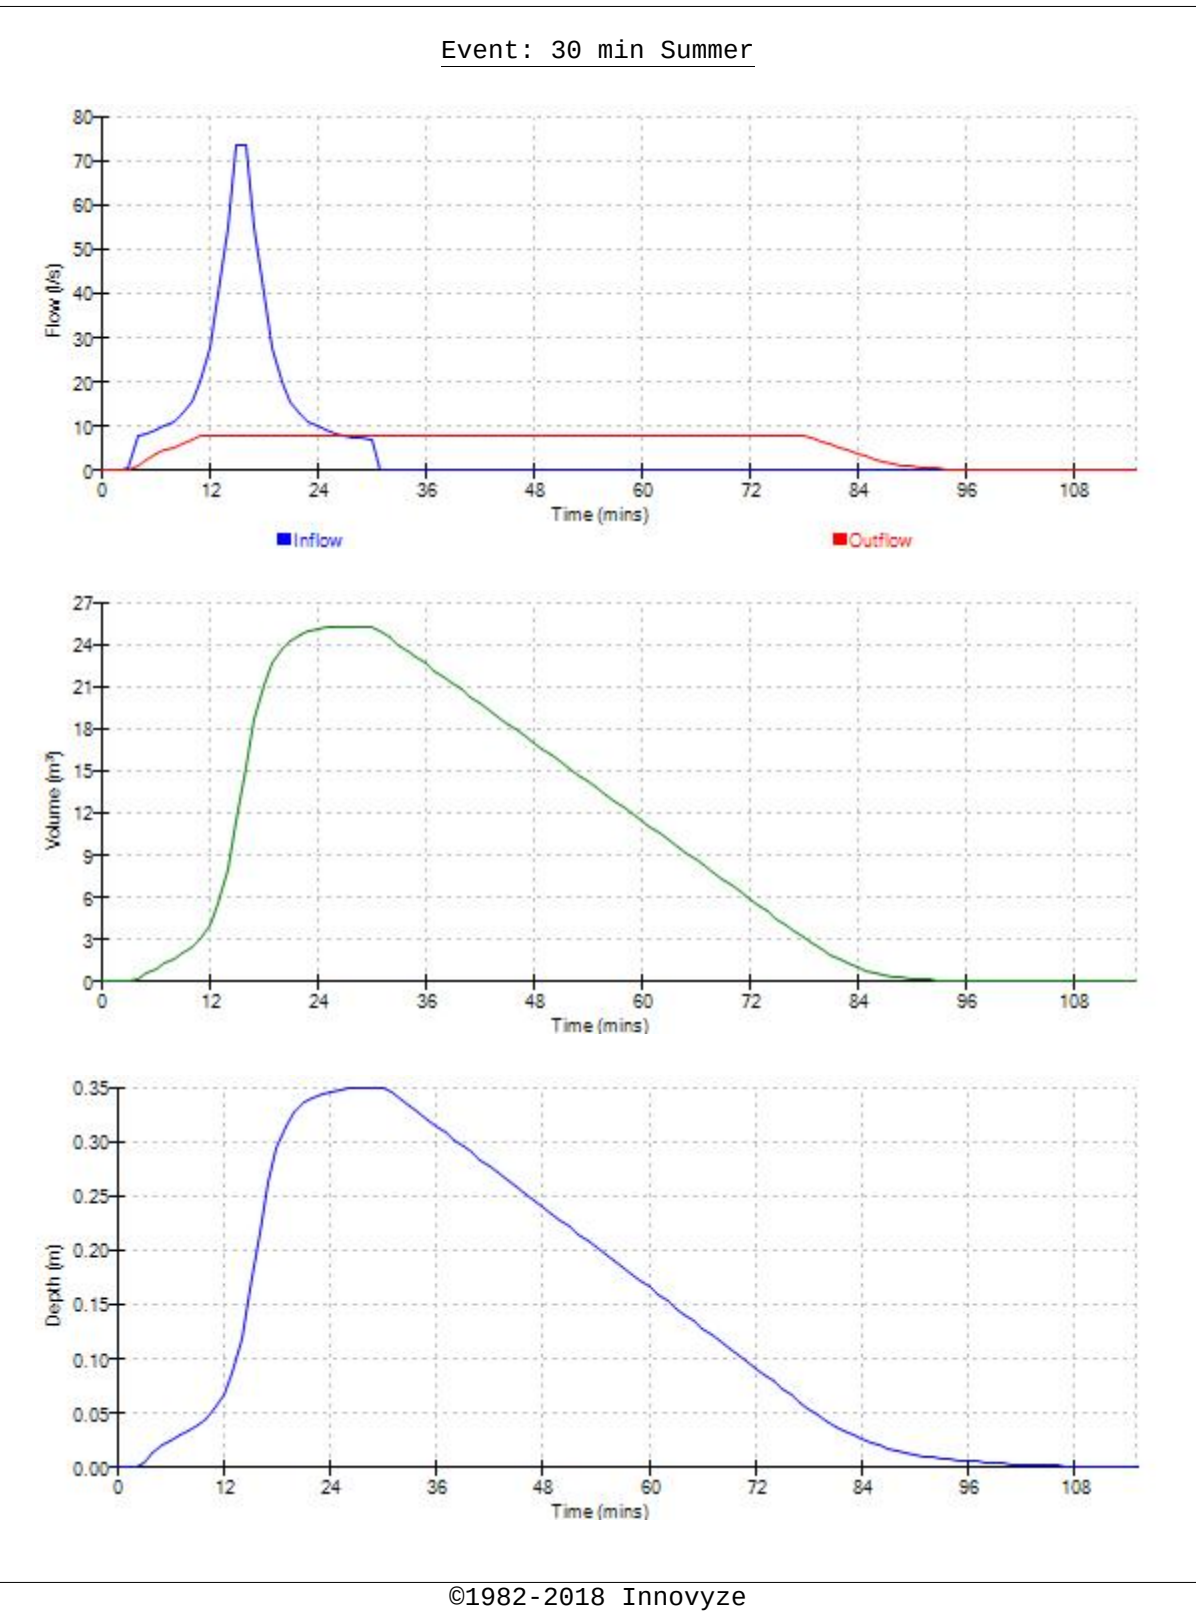


Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS3 Holt Road Rossett	
Date 31/05/2018	Designed by HW	
File W10685-CS3.SRCX	Checked by AW	
XP Solutions	Source Control 2018.1	

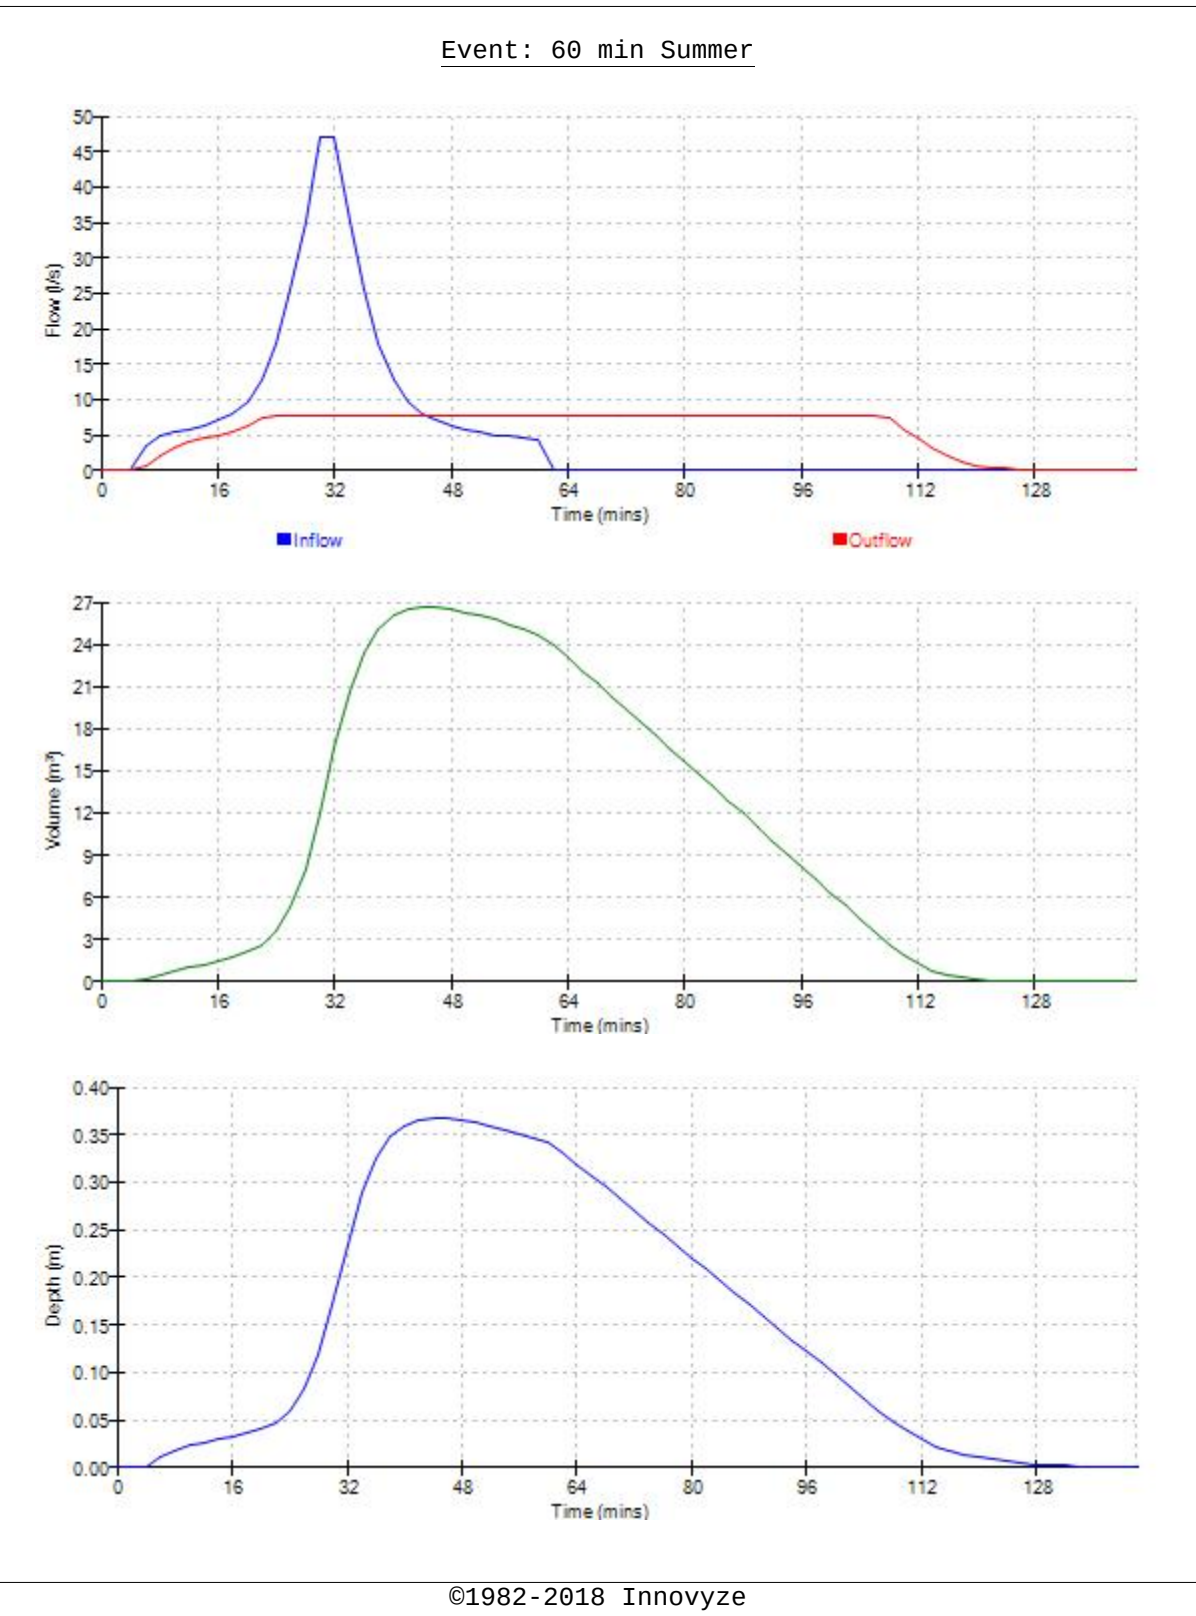

Waterco Ltd		Page 7
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS3	
	Holt Road Rossett	
Date 31/05/2018	Designed by HW	
File W10685-CS3.SRCX	Checked by AW	
XP Solutions	Source Control 2018.1	

Event: 120 min Summer

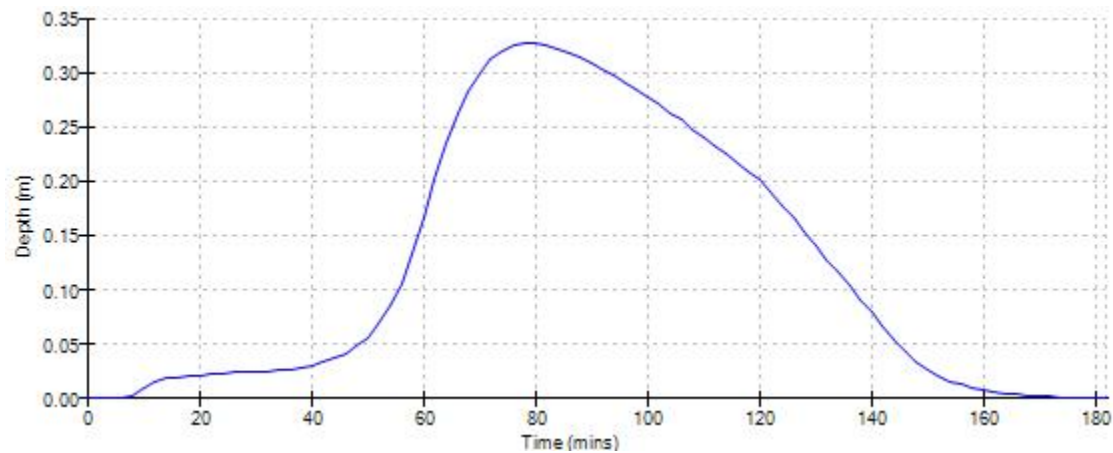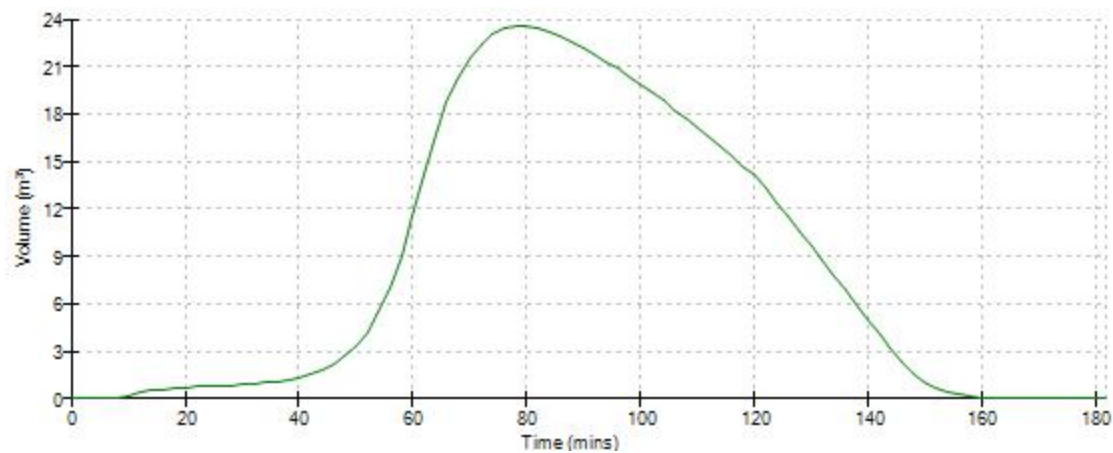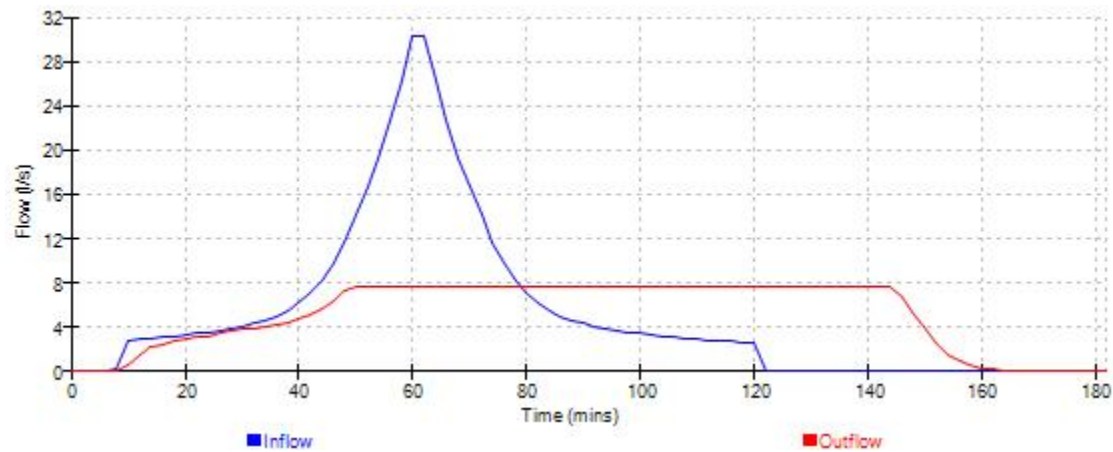

Waterco Ltd				Page 1																																																																																																																																																																																															
Eden Court		w10685 - CS4																																																																																																																																																																																																	
Lon Parcwr Business Park		Permeable Paving																																																																																																																																																																																																	
Denbighshire LL15 1NJ		Holt Road, Rossett																																																																																																																																																																																																	
Date 29/08/2019		Designed by HW																																																																																																																																																																																																	
File w10685-CS4_conflict-201...		Checked by AW																																																																																																																																																																																																	
XP Solutions		Source Control 2019.1																																																																																																																																																																																																	
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 22 minutes. <table><thead><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr></thead><tbody><tr><td>15 min Summer</td><td>9.810</td><td>0.310</td><td>23.9</td><td>45.8</td><td>Flood Risk</td></tr><tr><td>30 min Summer</td><td>9.854</td><td>0.354</td><td>23.9</td><td>52.4</td><td>Flood Risk</td></tr><tr><td>60 min Summer</td><td>9.859</td><td>0.359</td><td>23.9</td><td>53.2</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.794</td><td>0.294</td><td>23.9</td><td>43.3</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.727</td><td>0.227</td><td>23.9</td><td>33.2</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.668</td><td>0.168</td><td>23.9</td><td>24.4</td><td>O K</td></tr><tr><td>360 min Summer</td><td>9.586</td><td>0.086</td><td>23.9</td><td>12.1</td><td>O K</td></tr><tr><td>480 min Summer</td><td>9.550</td><td>0.050</td><td>23.8</td><td>6.7</td><td>O K</td></tr><tr><td>600 min Summer</td><td>9.542</td><td>0.042</td><td>20.2</td><td>5.6</td><td>O K</td></tr><tr><td>720 min Summer</td><td>9.536</td><td>0.036</td><td>17.4</td><td>4.7</td><td>O K</td></tr><tr><td>960 min Summer</td><td>9.529</td><td>0.029</td><td>13.8</td><td>3.5</td><td>O K</td></tr><tr><td>1440 min Summer</td><td>9.520</td><td>0.020</td><td>9.7</td><td>2.3</td><td>O K</td></tr><tr><td>2160 min Summer</td><td>9.514</td><td>0.014</td><td>6.8</td><td>1.4</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.511</td><td>0.011</td><td>5.4</td><td>0.9</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.509</td><td>0.009</td><td>4.1</td><td>0.6</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.508</td><td>0.008</td><td>3.3</td><td>0.5</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.507</td><td>0.007</td><td>2.5</td><td>0.5</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.507</td><td>0.007</td><td>2.5</td><td>0.4</td><td>O K</td></tr></tbody></table> <table><thead><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr></thead><tbody><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>15</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>24</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>42</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>76</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>108</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>138</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>194</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>246</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>306</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>366</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>488</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>734</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1100</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1436</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2128</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>2888</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3648</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4312</td></tr></tbody></table>						Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.810	0.310	23.9	45.8	Flood Risk	30 min Summer	9.854	0.354	23.9	52.4	Flood Risk	60 min Summer	9.859	0.359	23.9	53.2	Flood Risk	120 min Summer	9.794	0.294	23.9	43.3	Flood Risk	180 min Summer	9.727	0.227	23.9	33.2	Flood Risk	240 min Summer	9.668	0.168	23.9	24.4	O K	360 min Summer	9.586	0.086	23.9	12.1	O K	480 min Summer	9.550	0.050	23.8	6.7	O K	600 min Summer	9.542	0.042	20.2	5.6	O K	720 min Summer	9.536	0.036	17.4	4.7	O K	960 min Summer	9.529	0.029	13.8	3.5	O K	1440 min Summer	9.520	0.020	9.7	2.3	O K	2160 min Summer	9.514	0.014	6.8	1.4	O K	2880 min Summer	9.511	0.011	5.4	0.9	O K	4320 min Summer	9.509	0.009	4.1	0.6	O K	5760 min Summer	9.508	0.008	3.3	0.5	O K	7200 min Summer	9.507	0.007	2.5	0.5	O K	8640 min Summer	9.507	0.007	2.5	0.4	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	15	30 min Summer	96.151	0.0	24	60 min Summer	61.531	0.0	42	120 min Summer	36.920	0.0	76	180 min Summer	27.160	0.0	108	240 min Summer	21.763	0.0	138	360 min Summer	15.835	0.0	194	480 min Summer	12.539	0.0	246	600 min Summer	10.433	0.0	306	720 min Summer	8.964	0.0	366	960 min Summer	7.046	0.0	488	1440 min Summer	4.991	0.0	734	2160 min Summer	3.510	0.0	1100	2880 min Summer	2.731	0.0	1436	4320 min Summer	1.912	0.0	2128	5760 min Summer	1.496	0.0	2888	7200 min Summer	1.260	0.0	3648	8640 min Summer	1.110	0.0	4312
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																														
15 min Summer	9.810	0.310	23.9	45.8	Flood Risk																																																																																																																																																																																														
30 min Summer	9.854	0.354	23.9	52.4	Flood Risk																																																																																																																																																																																														
60 min Summer	9.859	0.359	23.9	53.2	Flood Risk																																																																																																																																																																																														
120 min Summer	9.794	0.294	23.9	43.3	Flood Risk																																																																																																																																																																																														
180 min Summer	9.727	0.227	23.9	33.2	Flood Risk																																																																																																																																																																																														
240 min Summer	9.668	0.168	23.9	24.4	O K																																																																																																																																																																																														
360 min Summer	9.586	0.086	23.9	12.1	O K																																																																																																																																																																																														
480 min Summer	9.550	0.050	23.8	6.7	O K																																																																																																																																																																																														
600 min Summer	9.542	0.042	20.2	5.6	O K																																																																																																																																																																																														
720 min Summer	9.536	0.036	17.4	4.7	O K																																																																																																																																																																																														
960 min Summer	9.529	0.029	13.8	3.5	O K																																																																																																																																																																																														
1440 min Summer	9.520	0.020	9.7	2.3	O K																																																																																																																																																																																														
2160 min Summer	9.514	0.014	6.8	1.4	O K																																																																																																																																																																																														
2880 min Summer	9.511	0.011	5.4	0.9	O K																																																																																																																																																																																														
4320 min Summer	9.509	0.009	4.1	0.6	O K																																																																																																																																																																																														
5760 min Summer	9.508	0.008	3.3	0.5	O K																																																																																																																																																																																														
7200 min Summer	9.507	0.007	2.5	0.5	O K																																																																																																																																																																																														
8640 min Summer	9.507	0.007	2.5	0.4	O K																																																																																																																																																																																														
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																
15 min Summer	143.930	0.0	15																																																																																																																																																																																																
30 min Summer	96.151	0.0	24																																																																																																																																																																																																
60 min Summer	61.531	0.0	42																																																																																																																																																																																																
120 min Summer	36.920	0.0	76																																																																																																																																																																																																
180 min Summer	27.160	0.0	108																																																																																																																																																																																																
240 min Summer	21.763	0.0	138																																																																																																																																																																																																
360 min Summer	15.835	0.0	194																																																																																																																																																																																																
480 min Summer	12.539	0.0	246																																																																																																																																																																																																
600 min Summer	10.433	0.0	306																																																																																																																																																																																																
720 min Summer	8.964	0.0	366																																																																																																																																																																																																
960 min Summer	7.046	0.0	488																																																																																																																																																																																																
1440 min Summer	4.991	0.0	734																																																																																																																																																																																																
2160 min Summer	3.510	0.0	1100																																																																																																																																																																																																
2880 min Summer	2.731	0.0	1436																																																																																																																																																																																																
4320 min Summer	1.912	0.0	2128																																																																																																																																																																																																
5760 min Summer	1.496	0.0	2888																																																																																																																																																																																																
7200 min Summer	1.260	0.0	3648																																																																																																																																																																																																
8640 min Summer	1.110	0.0	4312																																																																																																																																																																																																
©1982-2019 Innovyze																																																																																																																																																																																																			

Waterco Ltd				Page 2	
Eden Court		w10685 - CS4			
Lon Parcwr Business Park		Permeable Paving			
Denbighshire LL15 1NJ		Holt Road, Rossett			
Date 29/08/2019		Designed by HW			
File w10685-CS4_conflict-201...		Checked by AW			
XP Solutions		Source Control 2019.1			
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
10080 min Summer	9.507	0.007	2.2	0.4	O K
15 min Winter	9.859	0.359	23.9	53.2	Flood Risk
30 min Winter	9.911	0.411	23.9	61.0	Flood Risk
60 min Winter	9.910	0.410	23.9	60.8	Flood Risk
120 min Winter	9.805	0.305	23.9	45.0	Flood Risk
180 min Winter	9.700	0.200	23.9	29.3	Flood Risk
240 min Winter	9.616	0.116	23.9	16.6	O K
360 min Winter	9.546	0.046	22.1	6.2	O K
480 min Winter	9.537	0.037	17.6	4.8	O K
600 min Winter	9.531	0.031	14.7	3.8	O K
720 min Winter	9.527	0.027	12.8	3.2	O K
960 min Winter	9.521	0.021	9.9	2.4	O K
1440 min Winter	9.515	0.015	7.1	1.4	O K
2160 min Winter	9.511	0.011	5.1	0.8	O K
2880 min Winter	9.509	0.009	4.1	0.6	O K
4320 min Winter	9.508	0.008	2.9	0.4	O K
5760 min Winter	9.507	0.007	2.2	0.4	O K
7200 min Winter	9.506	0.006	1.9	0.3	O K
8640 min Winter	9.506	0.006	1.9	0.3	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
10080 min Summer	1.010	0.0	5144		
15 min Winter	143.930	0.0	15		
30 min Winter	96.151	0.0	27		
60 min Winter	61.531	0.0	46		
120 min Winter	36.920	0.0	82		
180 min Winter	27.160	0.0	114		
240 min Winter	21.763	0.0	142		
360 min Winter	15.835	0.0	186		
480 min Winter	12.539	0.0	246		
600 min Winter	10.433	0.0	306		
720 min Winter	8.964	0.0	366		
960 min Winter	7.046	0.0	490		
1440 min Winter	4.991	0.0	714		
2160 min Winter	3.510	0.0	1080		
2880 min Winter	2.731	0.0	1516		
4320 min Winter	1.912	0.0	2260		
5760 min Winter	1.496	0.0	2832		
7200 min Winter	1.260	0.0	3680		
8640 min Winter	1.110	0.0	4320		
©1982-2019 Innovyze					

Waterco Ltd		Page 3																				
Eden Court	w10685 - CS4																					
Lon Parcwr Business Park	Permeable Paving																					
Denbighshire LL15 1NJ	Holt Road, Rossett																					
Date 29/08/2019	Designed by HW																					
File w10685-CS4_conflict-201...	Checked by AW																					
XP Solutions	Source Control 2019.1																					
<u>Summary of Results for 100 year Return Period (+30%)</u> <table><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr><tr><td>10080 min Winter</td><td>9.506</td><td>0.006</td><td>1.6</td><td>0.3</td><td>O K</td></tr></table> <table><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr><tr><td>10080 min Winter</td><td>1.010</td><td>0.0</td><td>5448</td></tr></table>			Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	10080 min Winter	9.506	0.006	1.6	0.3	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	10080 min Winter	1.010	0.0	5448
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																	
10080 min Winter	9.506	0.006	1.6	0.3	O K																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																			
10080 min Winter	1.010	0.0	5448																			
©1982-2019 Innovyze																						

Waterco Ltd		Page 4
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS4 Permeable Paving Holt Road, Rossett	
Date 29/08/2019 File w10685-CS4_conflict-201...	Designed by HW Checked by AW	
XP Solutions Source Control 2019.1		

Rainfall Details

Rainfall Model	FEH	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
FEH Rainfall Version	2013	Cv (Winter)	0.840
Site Location	GB 337309 357277	Shortest Storm (mins)	15
Data Type	Point	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+30

Time Area Diagram


Total Area (ha) 0.240

Time (mins)	Area
From: To:	(ha)
0 1	0.240


©1982-2019 Innovyze


Waterco Ltd		Page 5																								
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS4 Permeable Paving Holt Road, Rossett																									
Date 29/08/2019 File w10685-CS4_conflict-201...	Designed by HW Checked by AW																									
XP Solutions	Source Control 2019.1																									
Model Details Storage is Online Cover Level (m) 10.000 Porous Car Park Structure <table><tr><td>Infiltration Coefficient Base (m/hr)</td><td>0.34477</td><td>Width (m)</td><td>50.0</td></tr><tr><td>Membrane Percolation (mm/hr)</td><td>1000</td><td>Length (m)</td><td>10.0</td></tr><tr><td>Max Percolation (l/s)</td><td>138.9</td><td>Slope (1:X)</td><td>1000.0</td></tr><tr><td>Safety Factor</td><td>2.0</td><td>Depression Storage (mm)</td><td>5</td></tr><tr><td>Porosity</td><td>0.30</td><td>Evaporation (mm/day)</td><td>3</td></tr><tr><td>Invert Level (m)</td><td>9.500</td><td>Membrane Depth (m)</td><td>0</td></tr></table>			Infiltration Coefficient Base (m/hr)	0.34477	Width (m)	50.0	Membrane Percolation (mm/hr)	1000	Length (m)	10.0	Max Percolation (l/s)	138.9	Slope (1:X)	1000.0	Safety Factor	2.0	Depression Storage (mm)	5	Porosity	0.30	Evaporation (mm/day)	3	Invert Level (m)	9.500	Membrane Depth (m)	0
Infiltration Coefficient Base (m/hr)	0.34477	Width (m)	50.0																							
Membrane Percolation (mm/hr)	1000	Length (m)	10.0																							
Max Percolation (l/s)	138.9	Slope (1:X)	1000.0																							
Safety Factor	2.0	Depression Storage (mm)	5																							
Porosity	0.30	Evaporation (mm/day)	3																							
Invert Level (m)	9.500	Membrane Depth (m)	0																							
©1982-2019 Innovyze																										

Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS4	
	Permeable Paving Holt Road, Rossett	
Date 29/08/2019	Designed by HW	
File w10685-CS4_conflict-201...	Checked by AW	
XP Solutions	Source Control 2019.1	

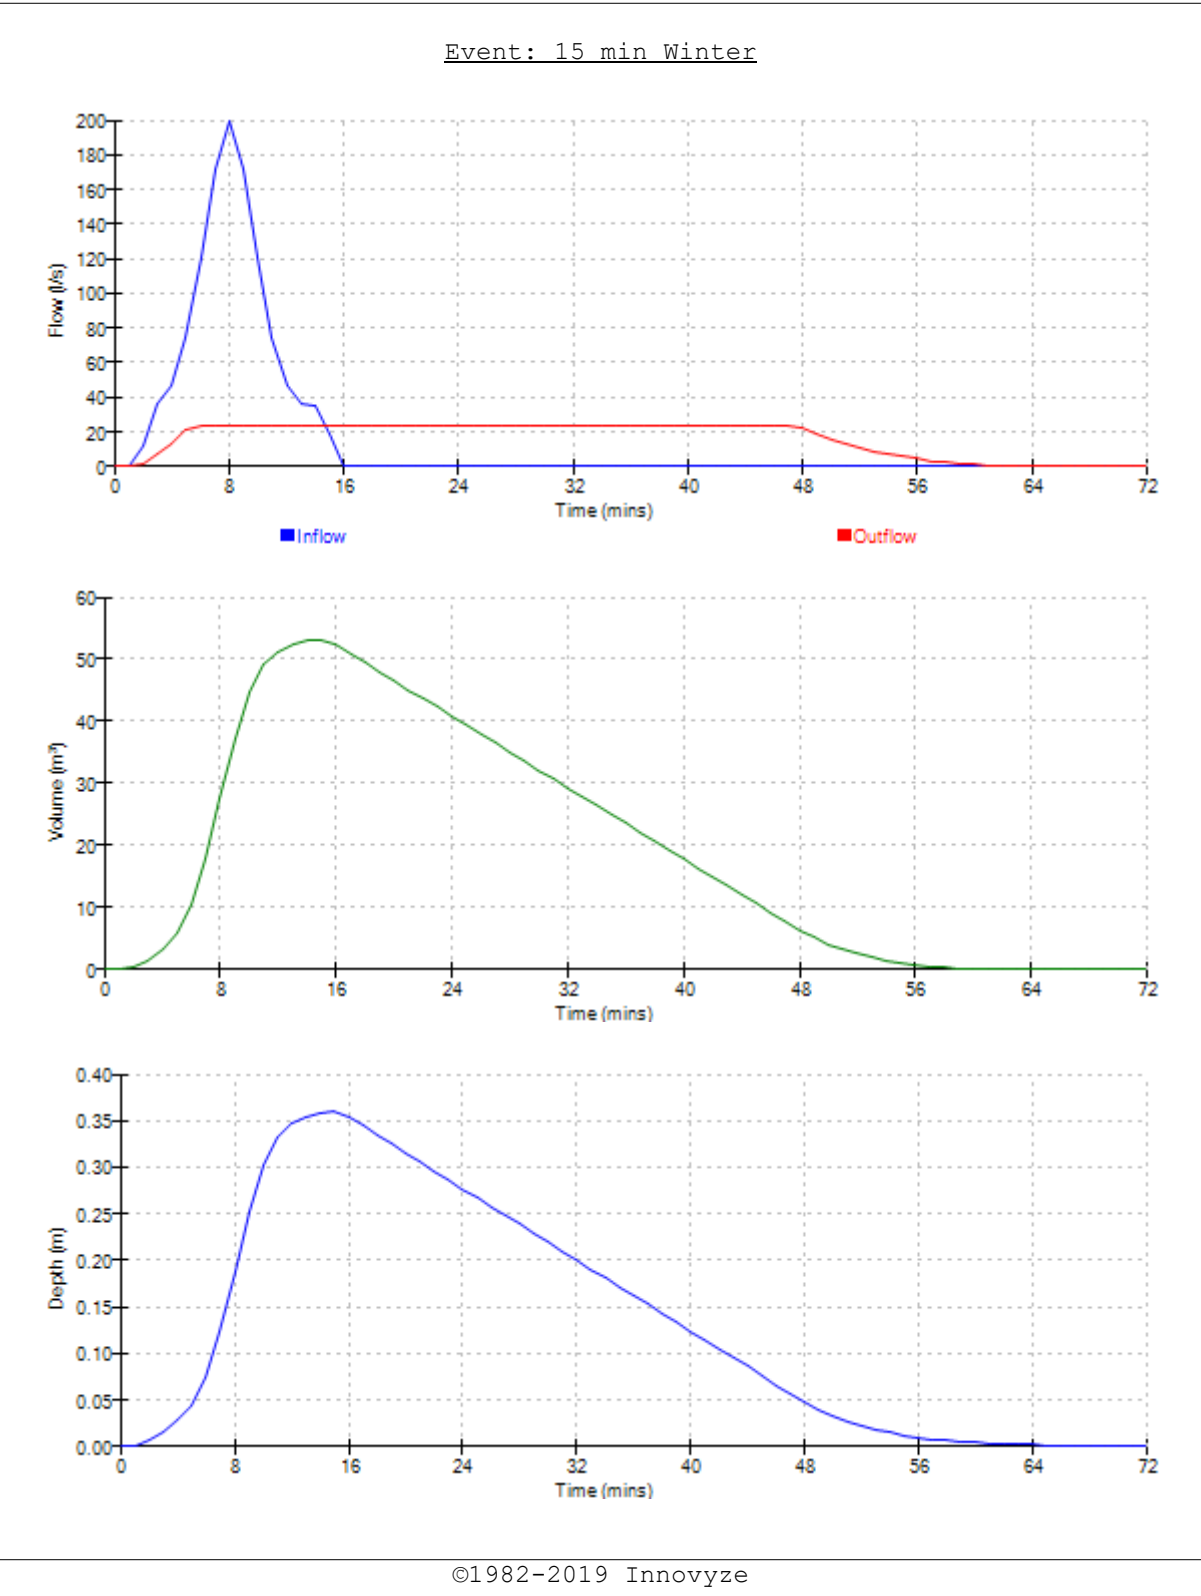

Waterco Ltd		Page 7
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS4	
	Permeable Paving Holt Road, Rossett	
Date 29/08/2019	Designed by HW	
File w10685-CS4_conflict-201...	Checked by AW	
XP Solutions	Source Control 2019.1	

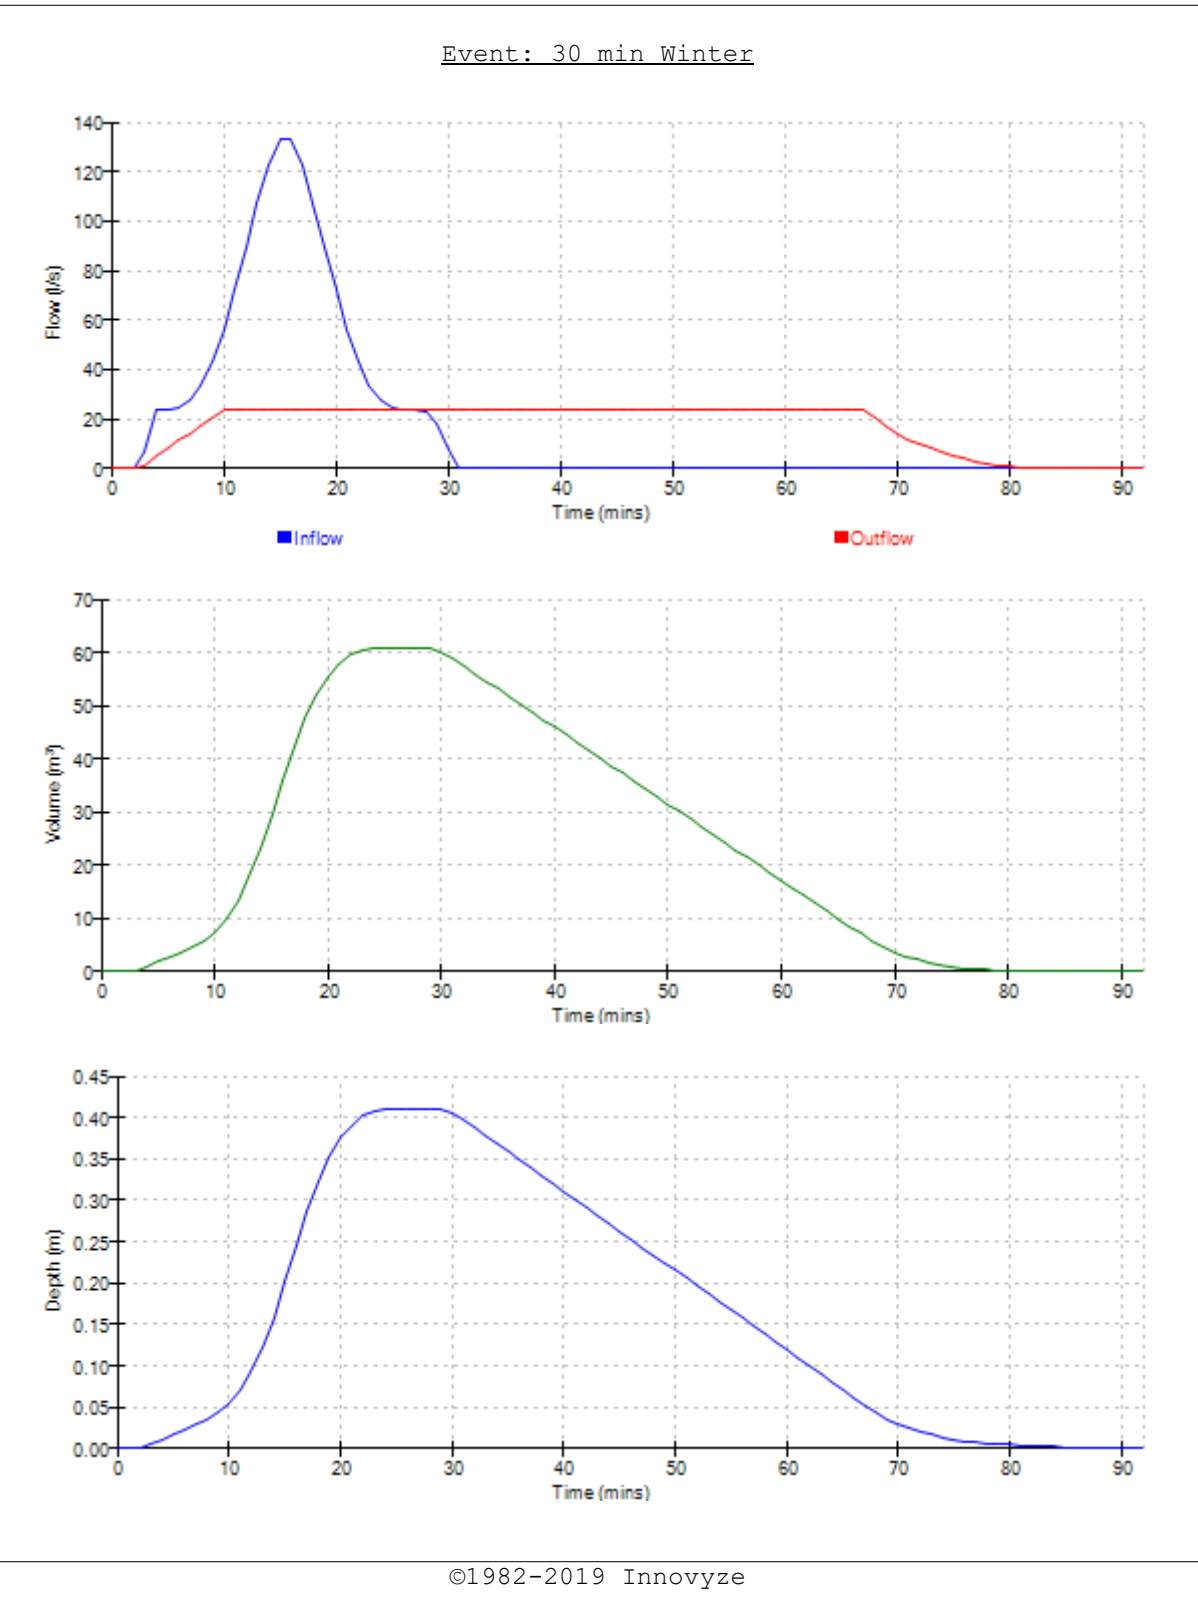

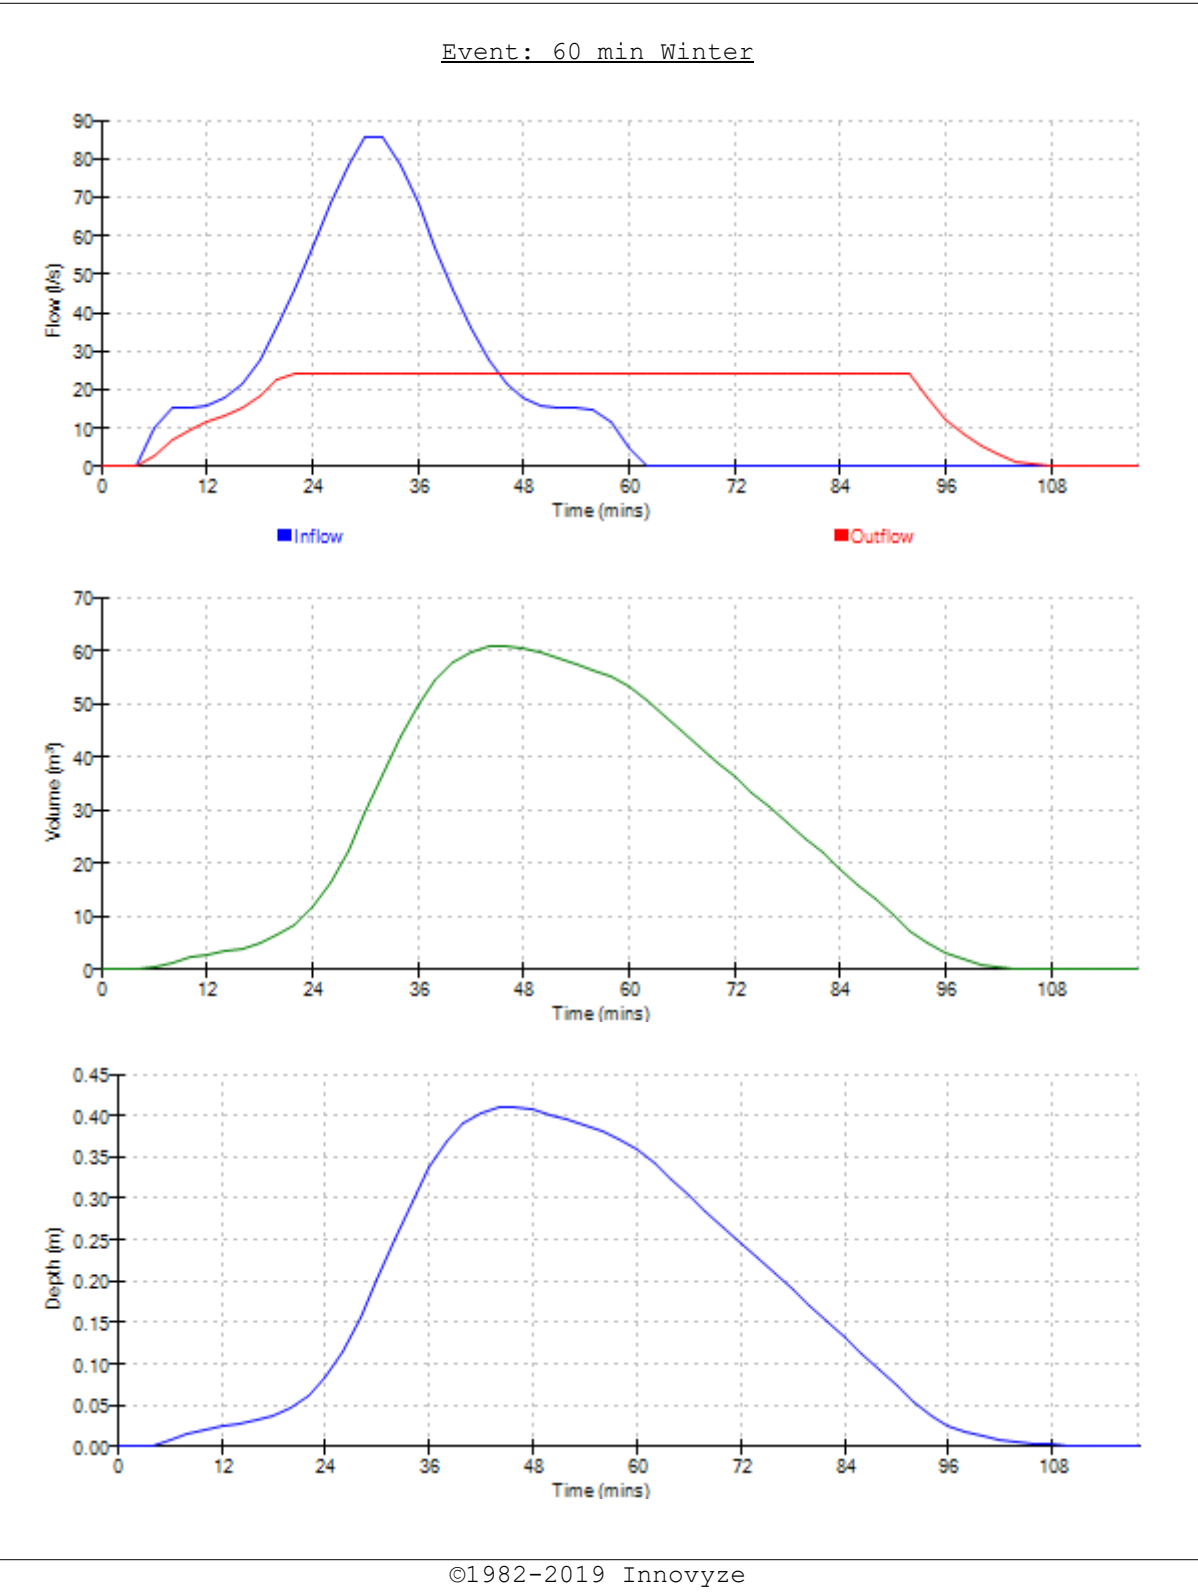

Waterco Ltd				Page 1																																																																																																																																																																																															
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ		w10685 - CS5 (Basin) Holt Road, Rossett 1 in 100 plus 30% CC																																																																																																																																																																																																	
Date 05/06/2018 File w10685-CS5 - Infiltrati...		Designed by HW Checked by AW																																																																																																																																																																																																	
XP Solutions		Source Control 2019.1																																																																																																																																																																																																	
<u>Summary of Results for 100 year Return Period (+30%)</u> Half Drain Time : 63 minutes. <table><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr><tr><td>15 min Summer</td><td>9.669</td><td>0.469</td><td>12.8</td><td>61.0</td><td>O K</td></tr><tr><td>30 min Summer</td><td>9.775</td><td>0.575</td><td>13.1</td><td>74.8</td><td>Flood Risk</td></tr><tr><td>60 min Summer</td><td>9.830</td><td>0.630</td><td>13.3</td><td>81.8</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.801</td><td>0.601</td><td>13.2</td><td>78.2</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.759</td><td>0.559</td><td>13.1</td><td>72.7</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.714</td><td>0.514</td><td>12.9</td><td>66.9</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.625</td><td>0.425</td><td>12.6</td><td>55.3</td><td>O K</td></tr><tr><td>480 min Summer</td><td>9.540</td><td>0.340</td><td>12.3</td><td>44.2</td><td>O K</td></tr><tr><td>600 min Summer</td><td>9.466</td><td>0.266</td><td>12.1</td><td>34.6</td><td>O K</td></tr><tr><td>720 min Summer</td><td>9.404</td><td>0.204</td><td>11.8</td><td>26.5</td><td>O K</td></tr><tr><td>960 min Summer</td><td>9.313</td><td>0.113</td><td>11.5</td><td>14.6</td><td>O K</td></tr><tr><td>1440 min Summer</td><td>9.247</td><td>0.047</td><td>10.6</td><td>6.1</td><td>O K</td></tr><tr><td>2160 min Summer</td><td>9.233</td><td>0.033</td><td>7.5</td><td>4.3</td><td>O K</td></tr><tr><td>2880 min Summer</td><td>9.226</td><td>0.026</td><td>5.8</td><td>3.4</td><td>O K</td></tr><tr><td>4320 min Summer</td><td>9.218</td><td>0.018</td><td>4.1</td><td>2.3</td><td>O K</td></tr><tr><td>5760 min Summer</td><td>9.214</td><td>0.014</td><td>3.2</td><td>1.8</td><td>O K</td></tr><tr><td>7200 min Summer</td><td>9.212</td><td>0.012</td><td>2.8</td><td>1.6</td><td>O K</td></tr><tr><td>8640 min Summer</td><td>9.211</td><td>0.011</td><td>2.4</td><td>1.4</td><td>O K</td></tr></table> <table><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr><tr><td>15 min Summer</td><td>143.930</td><td>0.0</td><td>16</td></tr><tr><td>30 min Summer</td><td>96.151</td><td>0.0</td><td>30</td></tr><tr><td>60 min Summer</td><td>61.531</td><td>0.0</td><td>52</td></tr><tr><td>120 min Summer</td><td>36.920</td><td>0.0</td><td>86</td></tr><tr><td>180 min Summer</td><td>27.160</td><td>0.0</td><td>120</td></tr><tr><td>240 min Summer</td><td>21.763</td><td>0.0</td><td>154</td></tr><tr><td>360 min Summer</td><td>15.835</td><td>0.0</td><td>220</td></tr><tr><td>480 min Summer</td><td>12.539</td><td>0.0</td><td>284</td></tr><tr><td>600 min Summer</td><td>10.433</td><td>0.0</td><td>344</td></tr><tr><td>720 min Summer</td><td>8.964</td><td>0.0</td><td>404</td></tr><tr><td>960 min Summer</td><td>7.046</td><td>0.0</td><td>518</td></tr><tr><td>1440 min Summer</td><td>4.991</td><td>0.0</td><td>734</td></tr><tr><td>2160 min Summer</td><td>3.510</td><td>0.0</td><td>1088</td></tr><tr><td>2880 min Summer</td><td>2.731</td><td>0.0</td><td>1468</td></tr><tr><td>4320 min Summer</td><td>1.912</td><td>0.0</td><td>2196</td></tr><tr><td>5760 min Summer</td><td>1.496</td><td>0.0</td><td>2896</td></tr><tr><td>7200 min Summer</td><td>1.260</td><td>0.0</td><td>3672</td></tr><tr><td>8640 min Summer</td><td>1.110</td><td>0.0</td><td>4400</td></tr></table>						Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	15 min Summer	9.669	0.469	12.8	61.0	O K	30 min Summer	9.775	0.575	13.1	74.8	Flood Risk	60 min Summer	9.830	0.630	13.3	81.8	Flood Risk	120 min Summer	9.801	0.601	13.2	78.2	Flood Risk	180 min Summer	9.759	0.559	13.1	72.7	Flood Risk	240 min Summer	9.714	0.514	12.9	66.9	Flood Risk	360 min Summer	9.625	0.425	12.6	55.3	O K	480 min Summer	9.540	0.340	12.3	44.2	O K	600 min Summer	9.466	0.266	12.1	34.6	O K	720 min Summer	9.404	0.204	11.8	26.5	O K	960 min Summer	9.313	0.113	11.5	14.6	O K	1440 min Summer	9.247	0.047	10.6	6.1	O K	2160 min Summer	9.233	0.033	7.5	4.3	O K	2880 min Summer	9.226	0.026	5.8	3.4	O K	4320 min Summer	9.218	0.018	4.1	2.3	O K	5760 min Summer	9.214	0.014	3.2	1.8	O K	7200 min Summer	9.212	0.012	2.8	1.6	O K	8640 min Summer	9.211	0.011	2.4	1.4	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	15 min Summer	143.930	0.0	16	30 min Summer	96.151	0.0	30	60 min Summer	61.531	0.0	52	120 min Summer	36.920	0.0	86	180 min Summer	27.160	0.0	120	240 min Summer	21.763	0.0	154	360 min Summer	15.835	0.0	220	480 min Summer	12.539	0.0	284	600 min Summer	10.433	0.0	344	720 min Summer	8.964	0.0	404	960 min Summer	7.046	0.0	518	1440 min Summer	4.991	0.0	734	2160 min Summer	3.510	0.0	1088	2880 min Summer	2.731	0.0	1468	4320 min Summer	1.912	0.0	2196	5760 min Summer	1.496	0.0	2896	7200 min Summer	1.260	0.0	3672	8640 min Summer	1.110	0.0	4400
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																														
15 min Summer	9.669	0.469	12.8	61.0	O K																																																																																																																																																																																														
30 min Summer	9.775	0.575	13.1	74.8	Flood Risk																																																																																																																																																																																														
60 min Summer	9.830	0.630	13.3	81.8	Flood Risk																																																																																																																																																																																														
120 min Summer	9.801	0.601	13.2	78.2	Flood Risk																																																																																																																																																																																														
180 min Summer	9.759	0.559	13.1	72.7	Flood Risk																																																																																																																																																																																														
240 min Summer	9.714	0.514	12.9	66.9	Flood Risk																																																																																																																																																																																														
360 min Summer	9.625	0.425	12.6	55.3	O K																																																																																																																																																																																														
480 min Summer	9.540	0.340	12.3	44.2	O K																																																																																																																																																																																														
600 min Summer	9.466	0.266	12.1	34.6	O K																																																																																																																																																																																														
720 min Summer	9.404	0.204	11.8	26.5	O K																																																																																																																																																																																														
960 min Summer	9.313	0.113	11.5	14.6	O K																																																																																																																																																																																														
1440 min Summer	9.247	0.047	10.6	6.1	O K																																																																																																																																																																																														
2160 min Summer	9.233	0.033	7.5	4.3	O K																																																																																																																																																																																														
2880 min Summer	9.226	0.026	5.8	3.4	O K																																																																																																																																																																																														
4320 min Summer	9.218	0.018	4.1	2.3	O K																																																																																																																																																																																														
5760 min Summer	9.214	0.014	3.2	1.8	O K																																																																																																																																																																																														
7200 min Summer	9.212	0.012	2.8	1.6	O K																																																																																																																																																																																														
8640 min Summer	9.211	0.011	2.4	1.4	O K																																																																																																																																																																																														
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																
15 min Summer	143.930	0.0	16																																																																																																																																																																																																
30 min Summer	96.151	0.0	30																																																																																																																																																																																																
60 min Summer	61.531	0.0	52																																																																																																																																																																																																
120 min Summer	36.920	0.0	86																																																																																																																																																																																																
180 min Summer	27.160	0.0	120																																																																																																																																																																																																
240 min Summer	21.763	0.0	154																																																																																																																																																																																																
360 min Summer	15.835	0.0	220																																																																																																																																																																																																
480 min Summer	12.539	0.0	284																																																																																																																																																																																																
600 min Summer	10.433	0.0	344																																																																																																																																																																																																
720 min Summer	8.964	0.0	404																																																																																																																																																																																																
960 min Summer	7.046	0.0	518																																																																																																																																																																																																
1440 min Summer	4.991	0.0	734																																																																																																																																																																																																
2160 min Summer	3.510	0.0	1088																																																																																																																																																																																																
2880 min Summer	2.731	0.0	1468																																																																																																																																																																																																
4320 min Summer	1.912	0.0	2196																																																																																																																																																																																																
5760 min Summer	1.496	0.0	2896																																																																																																																																																																																																
7200 min Summer	1.260	0.0	3672																																																																																																																																																																																																
8640 min Summer	1.110	0.0	4400																																																																																																																																																																																																
©1982-2019 Innovyze																																																																																																																																																																																																			

Waterco Ltd				Page 2																																																																																																																																																																																																									
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ		w10685 - CS5 (Basin) Holt Road, Rossett 1 in 100 plus 30% CC																																																																																																																																																																																																											
Date 05/06/2018 File w10685-CS5 - Infiltrati...		Designed by HW Checked by AW																																																																																																																																																																																																											
XP Solutions		Source Control 2019.1																																																																																																																																																																																																											
<u>Summary of Results for 100 year Return Period (+30%)</u> <table><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (l/s)</th><th>Max Volume (m³)</th><th>Status</th></tr><tr><td>10080 min Summer</td><td>9.210</td><td>0.010</td><td>2.2</td><td>1.3</td><td>O K</td></tr><tr><td>15 min Winter</td><td>9.734</td><td>0.534</td><td>13.0</td><td>69.4</td><td>Flood Risk</td></tr><tr><td>30 min Winter</td><td>9.862</td><td>0.662</td><td>13.4</td><td>86.0</td><td>Flood Risk</td></tr><tr><td>60 min Winter</td><td>9.937</td><td>0.737</td><td>13.7</td><td>95.8</td><td>Flood Risk</td></tr><tr><td>120 min Winter</td><td>9.897</td><td>0.697</td><td>13.5</td><td>90.6</td><td>Flood Risk</td></tr><tr><td>180 min Winter</td><td>9.834</td><td>0.634</td><td>13.3</td><td>82.4</td><td>Flood Risk</td></tr><tr><td>240 min Winter</td><td>9.764</td><td>0.564</td><td>13.1</td><td>73.3</td><td>Flood Risk</td></tr><tr><td>360 min Winter</td><td>9.629</td><td>0.429</td><td>12.6</td><td>55.7</td><td>O K</td></tr><tr><td>480 min Winter</td><td>9.505</td><td>0.305</td><td>12.2</td><td>39.6</td><td>O K</td></tr><tr><td>600 min Winter</td><td>9.401</td><td>0.201</td><td>11.8</td><td>26.2</td><td>O K</td></tr><tr><td>720 min Winter</td><td>9.320</td><td>0.120</td><td>11.6</td><td>15.6</td><td>O K</td></tr><tr><td>960 min Winter</td><td>9.248</td><td>0.048</td><td>10.8</td><td>6.2</td><td>O K</td></tr><tr><td>1440 min Winter</td><td>9.234</td><td>0.034</td><td>7.7</td><td>4.4</td><td>O K</td></tr><tr><td>2160 min Winter</td><td>9.224</td><td>0.024</td><td>5.5</td><td>3.1</td><td>O K</td></tr><tr><td>2880 min Winter</td><td>9.219</td><td>0.019</td><td>4.2</td><td>2.4</td><td>O K</td></tr><tr><td>4320 min Winter</td><td>9.213</td><td>0.013</td><td>3.0</td><td>1.7</td><td>O K</td></tr><tr><td>5760 min Winter</td><td>9.210</td><td>0.010</td><td>2.3</td><td>1.3</td><td>O K</td></tr><tr><td>7200 min Winter</td><td>9.209</td><td>0.009</td><td>2.0</td><td>1.1</td><td>O K</td></tr><tr><td>8640 min Winter</td><td>9.208</td><td>0.008</td><td>1.8</td><td>1.0</td><td>O K</td></tr></table> <table><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Time-Peak (mins)</th></tr><tr><td>10080 min Summer</td><td>1.010</td><td>0.0</td><td>5008</td></tr><tr><td>15 min Winter</td><td>143.930</td><td>0.0</td><td>15</td></tr><tr><td>30 min Winter</td><td>96.151</td><td>0.0</td><td>30</td></tr><tr><td>60 min Winter</td><td>61.531</td><td>0.0</td><td>58</td></tr><tr><td>120 min Winter</td><td>36.920</td><td>0.0</td><td>92</td></tr><tr><td>180 min Winter</td><td>27.160</td><td>0.0</td><td>130</td></tr><tr><td>240 min Winter</td><td>21.763</td><td>0.0</td><td>168</td></tr><tr><td>360 min Winter</td><td>15.835</td><td>0.0</td><td>236</td></tr><tr><td>480 min Winter</td><td>12.539</td><td>0.0</td><td>300</td></tr><tr><td>600 min Winter</td><td>10.433</td><td>0.0</td><td>360</td></tr><tr><td>720 min Winter</td><td>8.964</td><td>0.0</td><td>412</td></tr><tr><td>960 min Winter</td><td>7.046</td><td>0.0</td><td>492</td></tr><tr><td>1440 min Winter</td><td>4.991</td><td>0.0</td><td>728</td></tr><tr><td>2160 min Winter</td><td>3.510</td><td>0.0</td><td>1080</td></tr><tr><td>2880 min Winter</td><td>2.731</td><td>0.0</td><td>1452</td></tr><tr><td>4320 min Winter</td><td>1.912</td><td>0.0</td><td>2132</td></tr><tr><td>5760 min Winter</td><td>1.496</td><td>0.0</td><td>2912</td></tr><tr><td>7200 min Winter</td><td>1.260</td><td>0.0</td><td>3608</td></tr><tr><td>8640 min Winter</td><td>1.110</td><td>0.0</td><td>4400</td></tr></table>						Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status	10080 min Summer	9.210	0.010	2.2	1.3	O K	15 min Winter	9.734	0.534	13.0	69.4	Flood Risk	30 min Winter	9.862	0.662	13.4	86.0	Flood Risk	60 min Winter	9.937	0.737	13.7	95.8	Flood Risk	120 min Winter	9.897	0.697	13.5	90.6	Flood Risk	180 min Winter	9.834	0.634	13.3	82.4	Flood Risk	240 min Winter	9.764	0.564	13.1	73.3	Flood Risk	360 min Winter	9.629	0.429	12.6	55.7	O K	480 min Winter	9.505	0.305	12.2	39.6	O K	600 min Winter	9.401	0.201	11.8	26.2	O K	720 min Winter	9.320	0.120	11.6	15.6	O K	960 min Winter	9.248	0.048	10.8	6.2	O K	1440 min Winter	9.234	0.034	7.7	4.4	O K	2160 min Winter	9.224	0.024	5.5	3.1	O K	2880 min Winter	9.219	0.019	4.2	2.4	O K	4320 min Winter	9.213	0.013	3.0	1.7	O K	5760 min Winter	9.210	0.010	2.3	1.3	O K	7200 min Winter	9.209	0.009	2.0	1.1	O K	8640 min Winter	9.208	0.008	1.8	1.0	O K	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)	10080 min Summer	1.010	0.0	5008	15 min Winter	143.930	0.0	15	30 min Winter	96.151	0.0	30	60 min Winter	61.531	0.0	58	120 min Winter	36.920	0.0	92	180 min Winter	27.160	0.0	130	240 min Winter	21.763	0.0	168	360 min Winter	15.835	0.0	236	480 min Winter	12.539	0.0	300	600 min Winter	10.433	0.0	360	720 min Winter	8.964	0.0	412	960 min Winter	7.046	0.0	492	1440 min Winter	4.991	0.0	728	2160 min Winter	3.510	0.0	1080	2880 min Winter	2.731	0.0	1452	4320 min Winter	1.912	0.0	2132	5760 min Winter	1.496	0.0	2912	7200 min Winter	1.260	0.0	3608	8640 min Winter	1.110	0.0	4400
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status																																																																																																																																																																																																								
10080 min Summer	9.210	0.010	2.2	1.3	O K																																																																																																																																																																																																								
15 min Winter	9.734	0.534	13.0	69.4	Flood Risk																																																																																																																																																																																																								
30 min Winter	9.862	0.662	13.4	86.0	Flood Risk																																																																																																																																																																																																								
60 min Winter	9.937	0.737	13.7	95.8	Flood Risk																																																																																																																																																																																																								
120 min Winter	9.897	0.697	13.5	90.6	Flood Risk																																																																																																																																																																																																								
180 min Winter	9.834	0.634	13.3	82.4	Flood Risk																																																																																																																																																																																																								
240 min Winter	9.764	0.564	13.1	73.3	Flood Risk																																																																																																																																																																																																								
360 min Winter	9.629	0.429	12.6	55.7	O K																																																																																																																																																																																																								
480 min Winter	9.505	0.305	12.2	39.6	O K																																																																																																																																																																																																								
600 min Winter	9.401	0.201	11.8	26.2	O K																																																																																																																																																																																																								
720 min Winter	9.320	0.120	11.6	15.6	O K																																																																																																																																																																																																								
960 min Winter	9.248	0.048	10.8	6.2	O K																																																																																																																																																																																																								
1440 min Winter	9.234	0.034	7.7	4.4	O K																																																																																																																																																																																																								
2160 min Winter	9.224	0.024	5.5	3.1	O K																																																																																																																																																																																																								
2880 min Winter	9.219	0.019	4.2	2.4	O K																																																																																																																																																																																																								
4320 min Winter	9.213	0.013	3.0	1.7	O K																																																																																																																																																																																																								
5760 min Winter	9.210	0.010	2.3	1.3	O K																																																																																																																																																																																																								
7200 min Winter	9.209	0.009	2.0	1.1	O K																																																																																																																																																																																																								
8640 min Winter	9.208	0.008	1.8	1.0	O K																																																																																																																																																																																																								
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																										
10080 min Summer	1.010	0.0	5008																																																																																																																																																																																																										
15 min Winter	143.930	0.0	15																																																																																																																																																																																																										
30 min Winter	96.151	0.0	30																																																																																																																																																																																																										
60 min Winter	61.531	0.0	58																																																																																																																																																																																																										
120 min Winter	36.920	0.0	92																																																																																																																																																																																																										
180 min Winter	27.160	0.0	130																																																																																																																																																																																																										
240 min Winter	21.763	0.0	168																																																																																																																																																																																																										
360 min Winter	15.835	0.0	236																																																																																																																																																																																																										
480 min Winter	12.539	0.0	300																																																																																																																																																																																																										
600 min Winter	10.433	0.0	360																																																																																																																																																																																																										
720 min Winter	8.964	0.0	412																																																																																																																																																																																																										
960 min Winter	7.046	0.0	492																																																																																																																																																																																																										
1440 min Winter	4.991	0.0	728																																																																																																																																																																																																										
2160 min Winter	3.510	0.0	1080																																																																																																																																																																																																										
2880 min Winter	2.731	0.0	1452																																																																																																																																																																																																										
4320 min Winter	1.912	0.0	2132																																																																																																																																																																																																										
5760 min Winter	1.496	0.0	2912																																																																																																																																																																																																										
7200 min Winter	1.260	0.0	3608																																																																																																																																																																																																										
8640 min Winter	1.110	0.0	4400																																																																																																																																																																																																										
©1982-2019 Innovyze																																																																																																																																																																																																													

Waterco Ltd		Page 3			
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS5 (Basin) Holt Road, Rossett 1 in 100 plus 30% CC				
Date 05/06/2018 File w10685-CS5 - Infiltrati...	Designed by HW Checked by AW				
XP Solutions Source Control 2019.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>					
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m³)	Status
10080 min Winter	9.207	0.007	1.6	0.9	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Time-Peak (mins)		
10080 min Winter	1.010	0.0	5048		
©1982-2019 Innovyze					

Waterco Ltd		Page 4
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS5 (Basin) Holt Road, Rossett 1 in 100 plus 30% CC	
Date 05/06/2018 File w10685-CS5 - Infiltrati...	Designed by HW Checked by AW	
XP Solutions Source Control 2019.1		

Rainfall Details

Rainfall Model	FEH	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
FEH Rainfall Version	2013	Cv (Winter)	0.840
Site Location	GB 337309 357277	Shortest Storm (mins)	15
Data Type	Point	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+30

Time Area Diagram


Total Area (ha) 0.262

Time (mins)	Area
From:	To: (ha)
0	1 0.262


©1982-2019 Innovyze

Waterco Ltd		Page 5								
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS5 (Basin) Holt Road, Rossett 1 in 100 plus 30% CC									
Date 05/06/2018 File w10685-CS5 - Infiltrati...	Designed by HW Checked by AW									
XP Solutions										
Source Control 2019.1										
Model Details Storage is Online Cover Level (m) 10.000 Infiltration Basin Structure Invert Level (m) 9.200 Safety Factor 1.2 Infiltration Coefficient Base (m/hr) 0.37008 Porosity 1.00 Infiltration Coefficient Side (m/hr) 0.37008 <table><thead><tr><th>Depth (m)</th><th>Area (m²)</th><th>Depth (m)</th><th>Area (m²)</th></tr></thead><tbody><tr><td>0.000</td><td>130.0</td><td>0.800</td><td>130.0</td></tr></tbody></table>			Depth (m)	Area (m²)	Depth (m)	Area (m²)	0.000	130.0	0.800	130.0
Depth (m)	Area (m²)	Depth (m)	Area (m²)							
0.000	130.0	0.800	130.0							
©1982-2019 Innovyze										


Waterco Ltd		Page 6
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS5 (Basin)	
	Holt Road, Rossett 1 in 100 plus 30% CC	
Date 05/06/2018	Designed by HW	
File w10685-CS5 - Infiltrati...	Checked by AW	
XP Solutions	Source Control 2019.1	

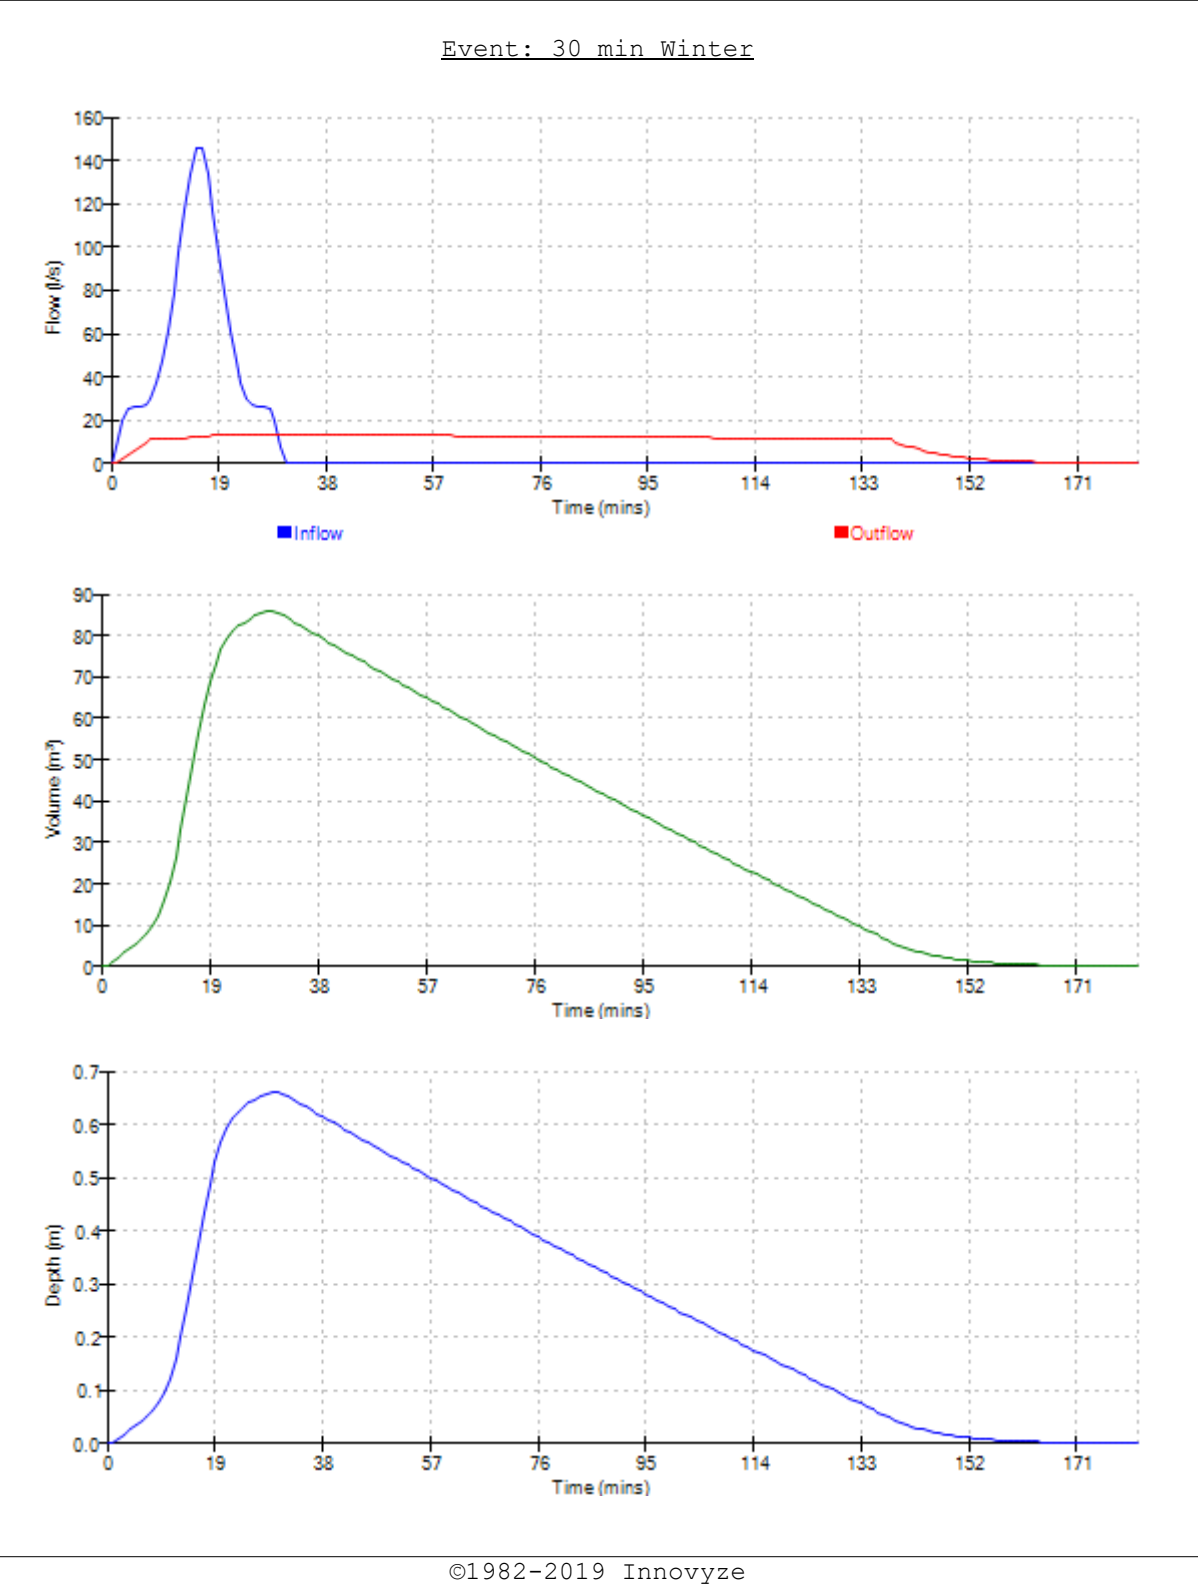


Waterco Ltd		Page 7
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS5 (Basin)	
	Holt Road, Rossett 1 in 100 plus 30% CC	
Date 05/06/2018	Designed by HW	
File w10685-CS5 - Infiltrati...	Checked by AW	
XP Solutions	Source Control 2019.1	

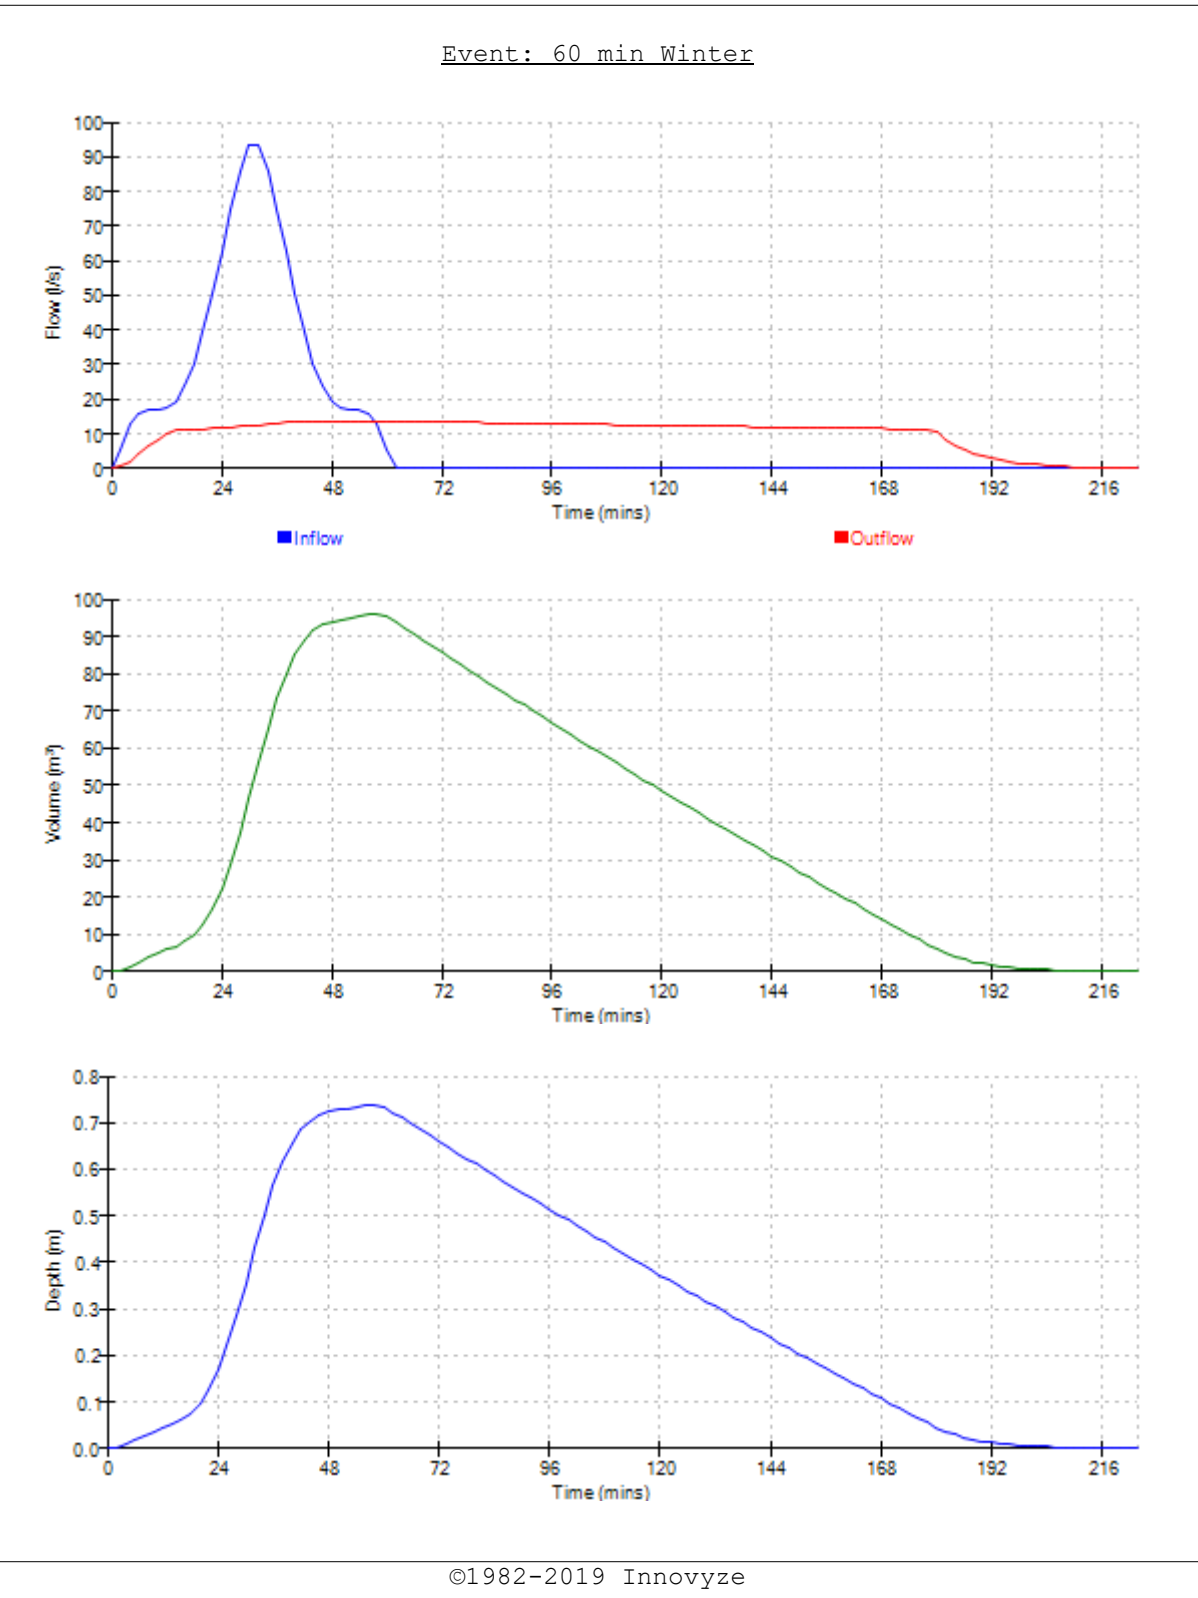

Waterco Ltd		Page 8
Eden Court Lon Parcwr Business Park Denbighshire LL15 1NJ	w10685 - CS5 (Basin)	
	Holt Road, Rossett 1 in 100 plus 30% CC	
Date 05/06/2018	Designed by HW	
File w10685-CS5 - Infiltrati...	Checked by AW	
XP Solutions	Source Control 2019.1	

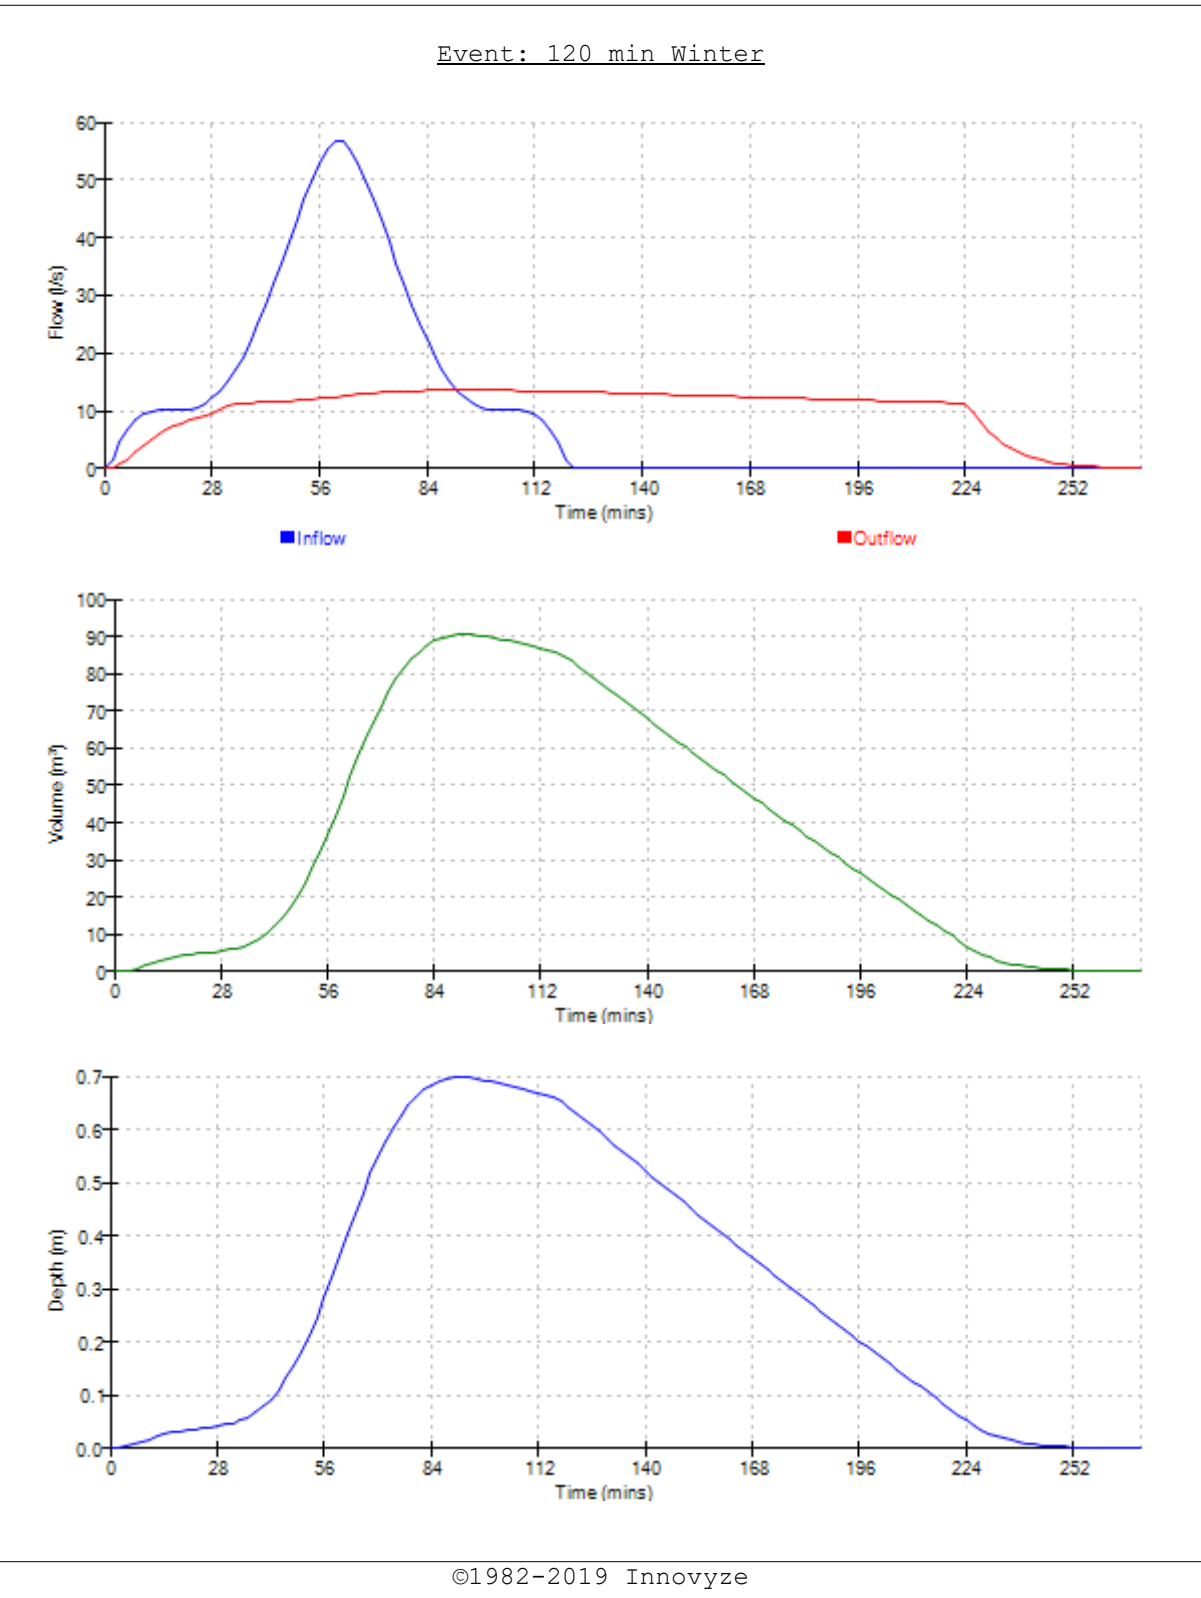

Appendix J Concept Drainage Sketch

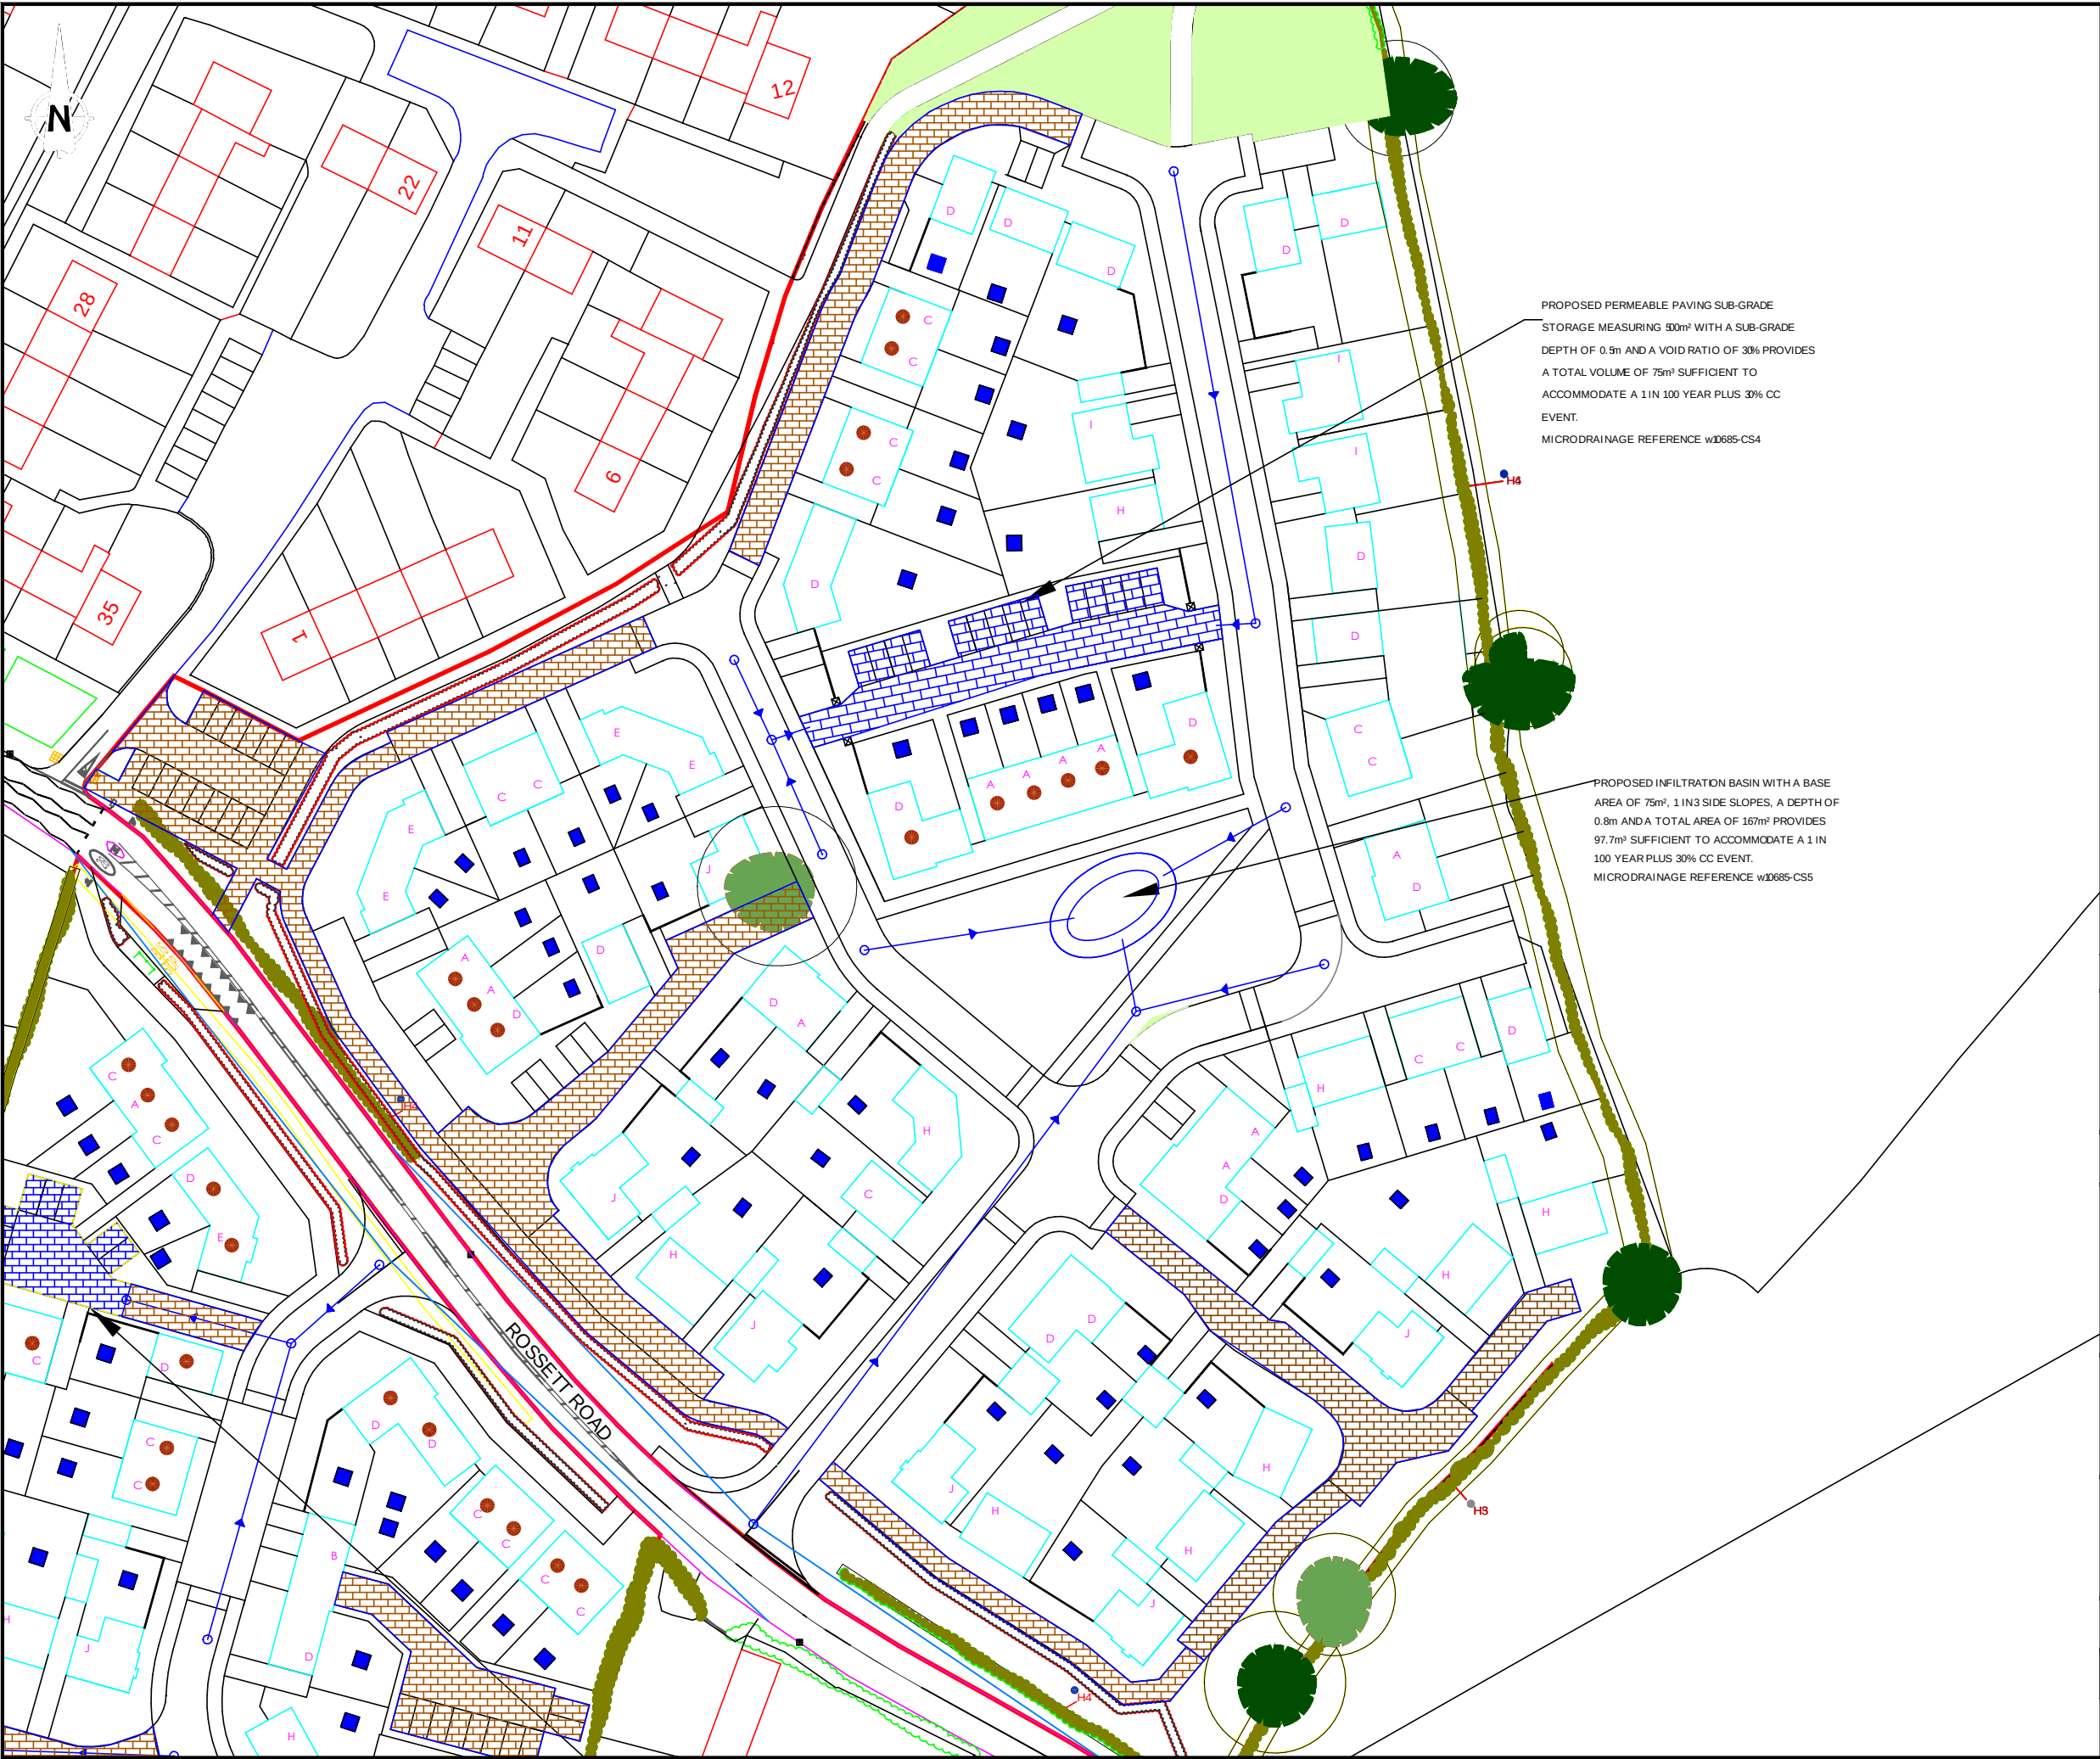

- NOTES
- ALL DIMENSIONS IN MILLIMETRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS SHOWN OTHERWISE.
 - THIS DRAWING PROVIDES A CONCEPT ONLY AND IS NOT INTENDED FOR DETAILED DESIGN.

- KEY
- PROPOSED INSPECTION CHAMBER
 - PROPOSED SURFACE WATER SEWER
 - PROPOSED PRIVATE SOAKAWAY
 - PROPOSED SHARED PERMEABLE ACCESS ROAD

SITE LOCATION
GRID REFERENCE: 337330, 357371
SITE ADDRESS: Holt Road (B5102), Rossett, Wrexham, LL12 0ED.

REV.	DATE	DESCRIPTION	DSGND	CHK'D	APP'D
------	------	-------------	-------	-------	-------

CLIENT
BELLIS BROTHERS LTD

PRINCIPAL DESIGNER



Waterco Ltd., Eden Court,
Lon Parcwr Business Park, Ruthin LL15 1NJ
tel (+44) 1824 702220
www.waterco.co.uk


SCHEME
HOLT ROAD, ROSSETT

TITLE
CONCEPT DRAINAGE SKETCH

STATUS
PRELIMINARY

DESIGNED	CHECKED	APPROVED	SCALE / SHEET SIZE
HW	AW	VG	1: / A3

DRAWING NO.	REV
W10685	1

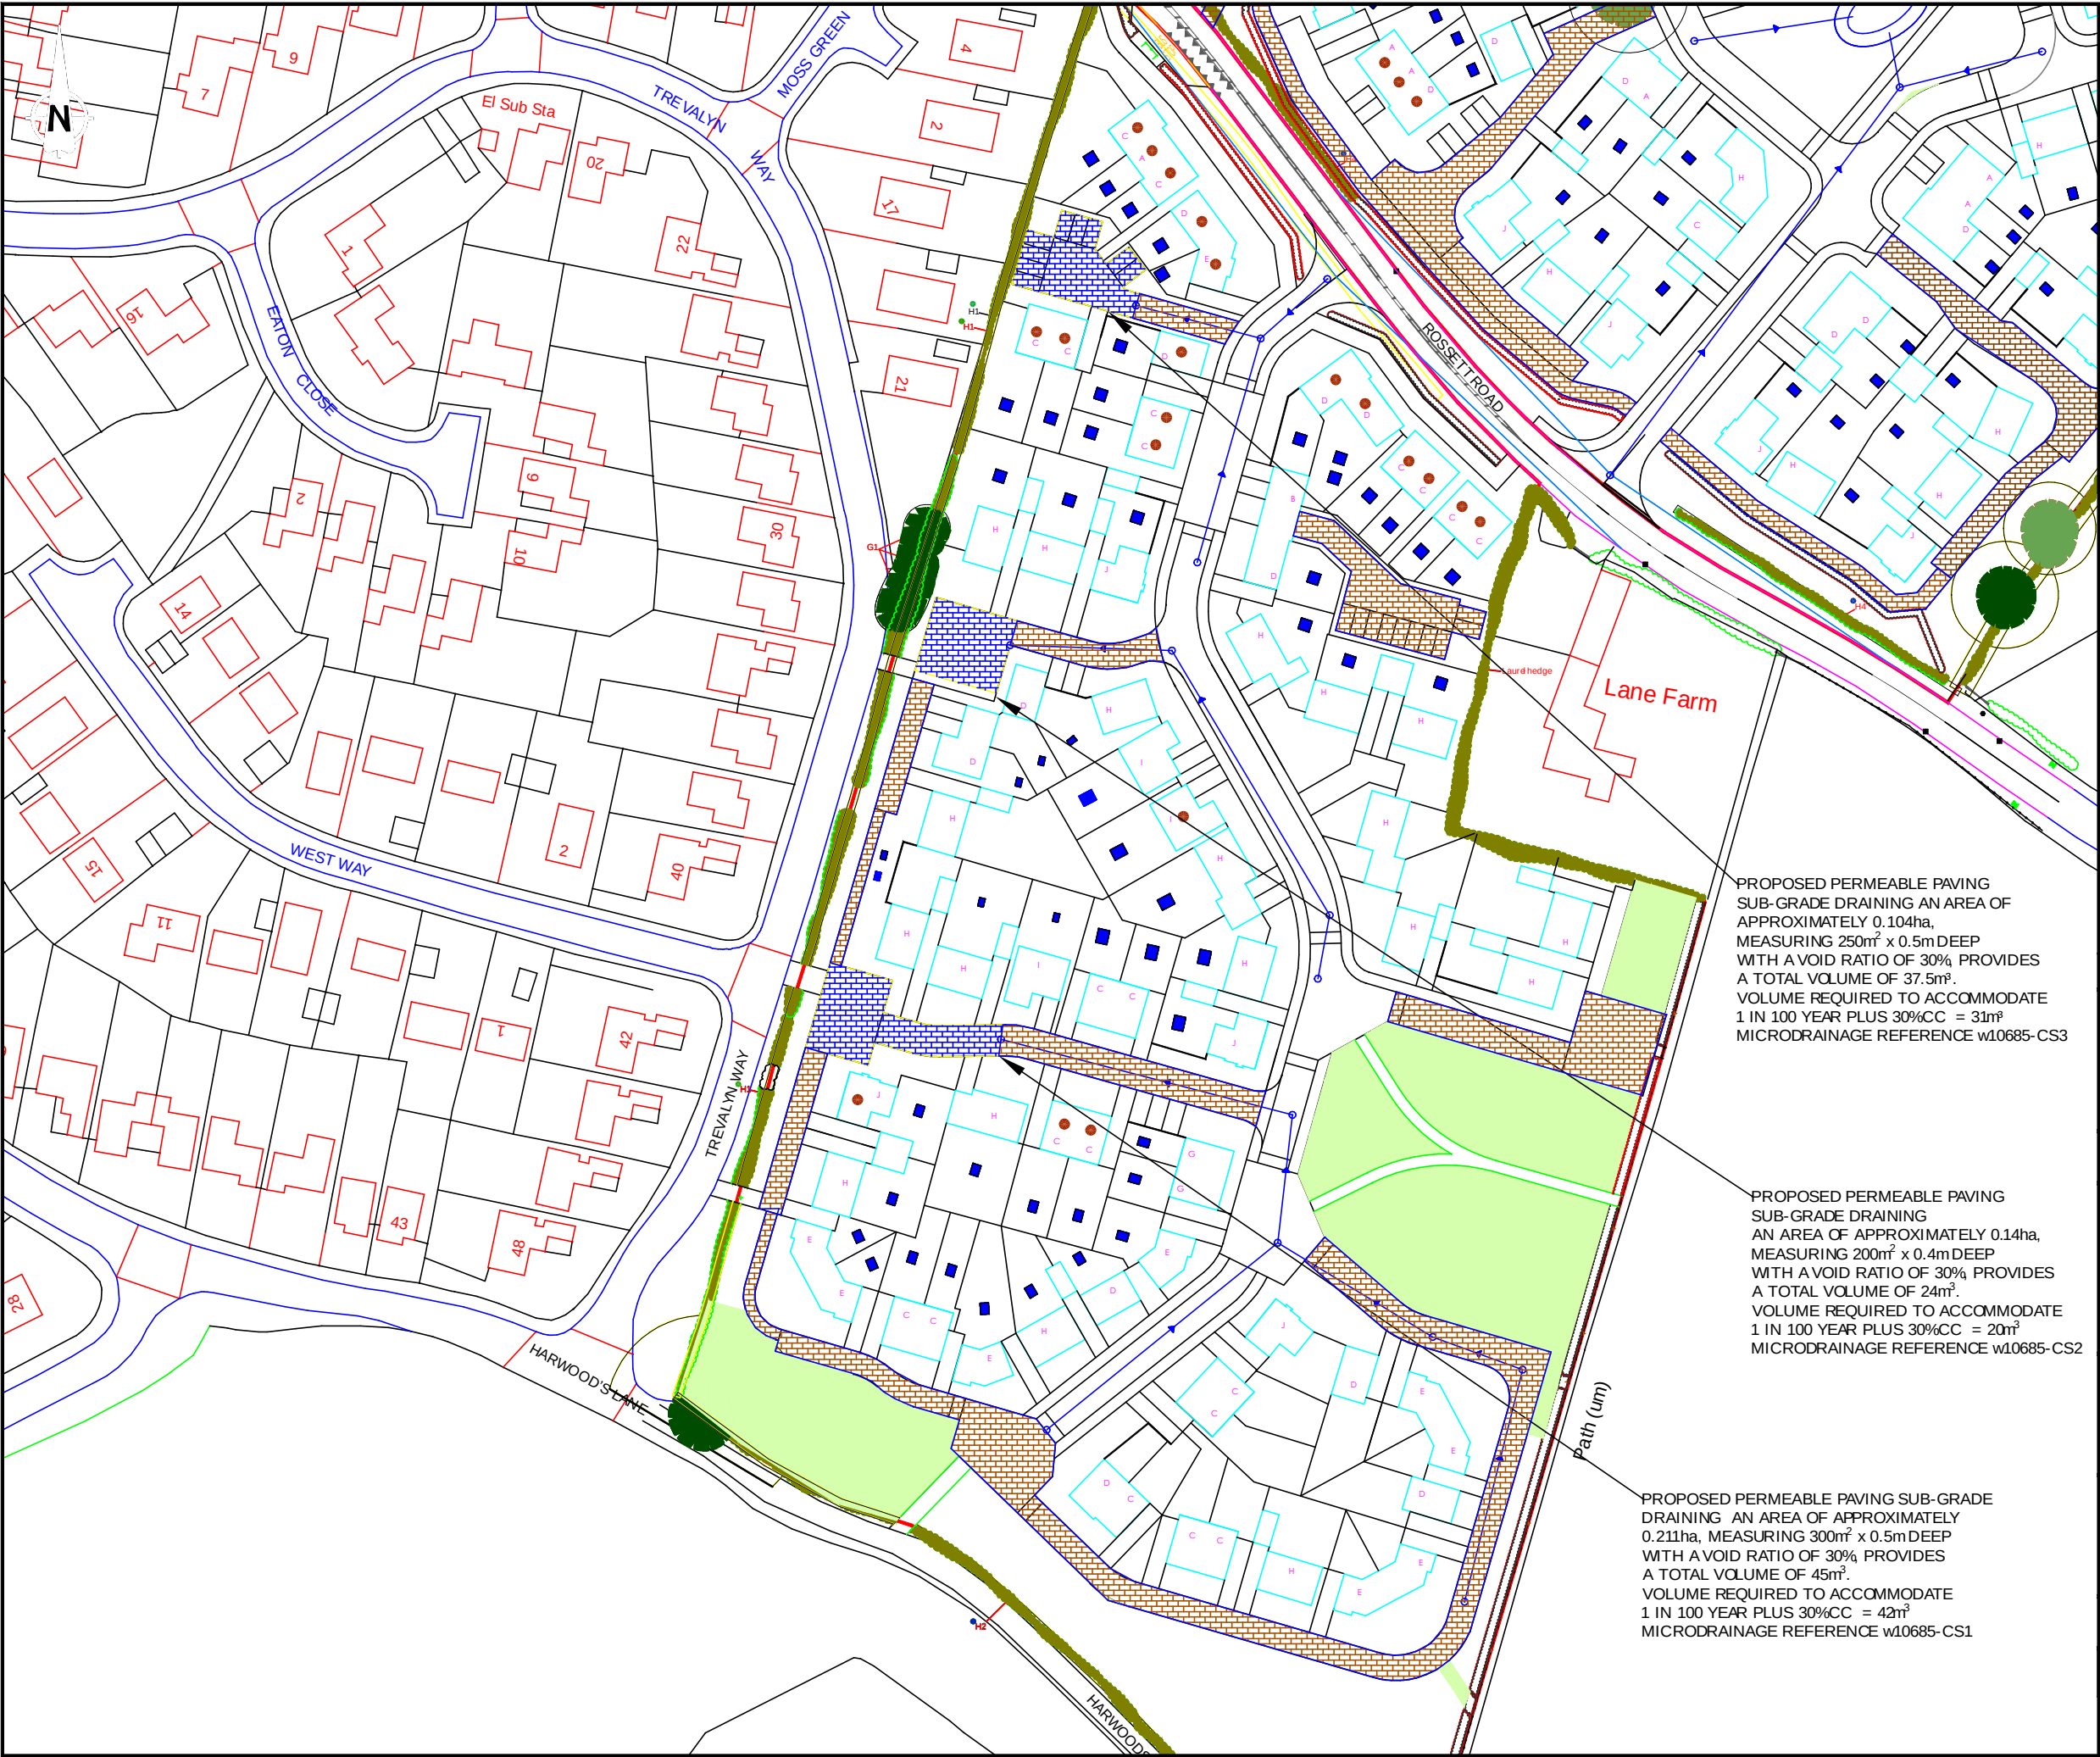

NOTES

- 1. ALL DIMENSIONS IN MILLIMETRES AND ALL LEVELS IN METRES ABOVE ORDNANCE DATUM UNLESS SHOWN OTHERWISE.
- 2. THIS DRAWING PROVIDES A CONCEPT ONLY AND IS NOT INTENDED FOR DETAILED DESIGN

KEY

- PROPOSED PRIVATE SOAKAWAY
- PROPOSED SURFACE WATER SEWER
- PROPOSED INSPECTION CHAMBER
- PROPOSED SHARED PERMEABLE ACCESS ROAD

SITE LOCATION
GRID REFERENCE: 337283, 357183
SITE ADDRESS: Holt Road (B5102), Rossett, Wrexham, LL12 0ED

REV.	DATE	DESCRIPTION	DSGND	CHK'D	APP'D
------	------	-------------	-------	-------	-------

CLIENT

BELLIS BROTHERS LTD

PRINCIPAL DESIGNER

Waterco Ltd., Eden Court,
Lon Parcwr Business Park, Ruthin LL15 1NJ

tel (+44) 1824 702220
www.waterco.co.uk

SCHEME

HOLT ROAD, ROSSETT

TITLE

CONCEPT DRAINAGE SKETCH

STATUS

PRELIMINARY

DESIGNED	CHECKED	APPROVED	SCALE / SHEET SIZE
HW	AW	VG	1: / A3

DRAWING NO.	REV
w10685	1

Appendix K Maintenance Schedules

Operation and Maintenance Requirements for Permeable Paving

Maintenance Schedule	Required Action	Typical Frequency
Regular maintenance	Brushing and vacuuming (standard cosmetic sweep over whole surface)	Once a year, after autumn leaf fall, or reduced frequency as required, based on site-specific observations of clogging or manufacturer's recommendations – pay particular attention to areas where water runs onto pervious surface from adjacent impermeable areas as this area is most likely to collect the most sediment
Occasional maintenance	Stabilise and move contributing and adjacent areas	As required
	Removal of weeds or management using glyphosate applied directly into the weeds by an applicator rather than spraying	As required – once per year on less frequently used pavements
Remedial actions	Remediate any landscaping which, through vegetation maintenance or soil slip, has been raised to within 50mm of the level of the paving	As required
	Rehabilitation of surface and upper substructure by remedial sweeping	Every 10 to 15 years or as required (if infiltration performance is reduced due to significant clogging)
Monitoring	Inspect for evidence of poor operation and / or weed growth – if required, take remedial action	Three-monthly, 48hr after large storms in first six months
	Inspect silt accumulation rates and establish appropriate brushing frequencies	Annually
	Monitor inspection chambers	Annually

Ref. Table 20.15, CIRIA C753 'The SuDS Manual

The maintenance requirements detailed above are to be undertaken by the site owner.

Name:

Position:

Date:

**Signed on behalf
Of the site owner**

Operation and Maintenance Requirements for Soakaways

Maintenance Schedule	Required Action	Typical Frequency
Regular maintenance	Inspect for sediment and debris in pre-treatment components and floor of inspection tube or chamber and inside concrete manhole rings	Annually
	Cleaning of gutters and any filters on downpipes	Annually (or as required based on inspections)
	Trimming any roots that may be causing blockages	Annually (or as required)
Occasional maintenance	Remove sediment and debris from pre-treatment components and floor inspection tube or chamber and inside of concrete manhole rings.	As required, based on inspections
Remedial actions	Reconstruct soakaway and/or replace or clean void fill, if performance deteriorates or failure occurs.	As required
	Replacement of clogged geotextile (will require reconstruction of soakaway)	As required
Monitoring	Inspect silt traps and note rate of sediment accumulation.	Monthly in the first year and then annually
	Check soakaway to ensure emptying is occurring	Annually

Ref. Table 13.1, CIRIA C753 'The SuDS Manual

The maintenance requirements detailed above are to be undertaken by the site owner.


Name:

Position:

Date:

**Signed on behalf
Of site owner**

Appendix L Drainage Survey

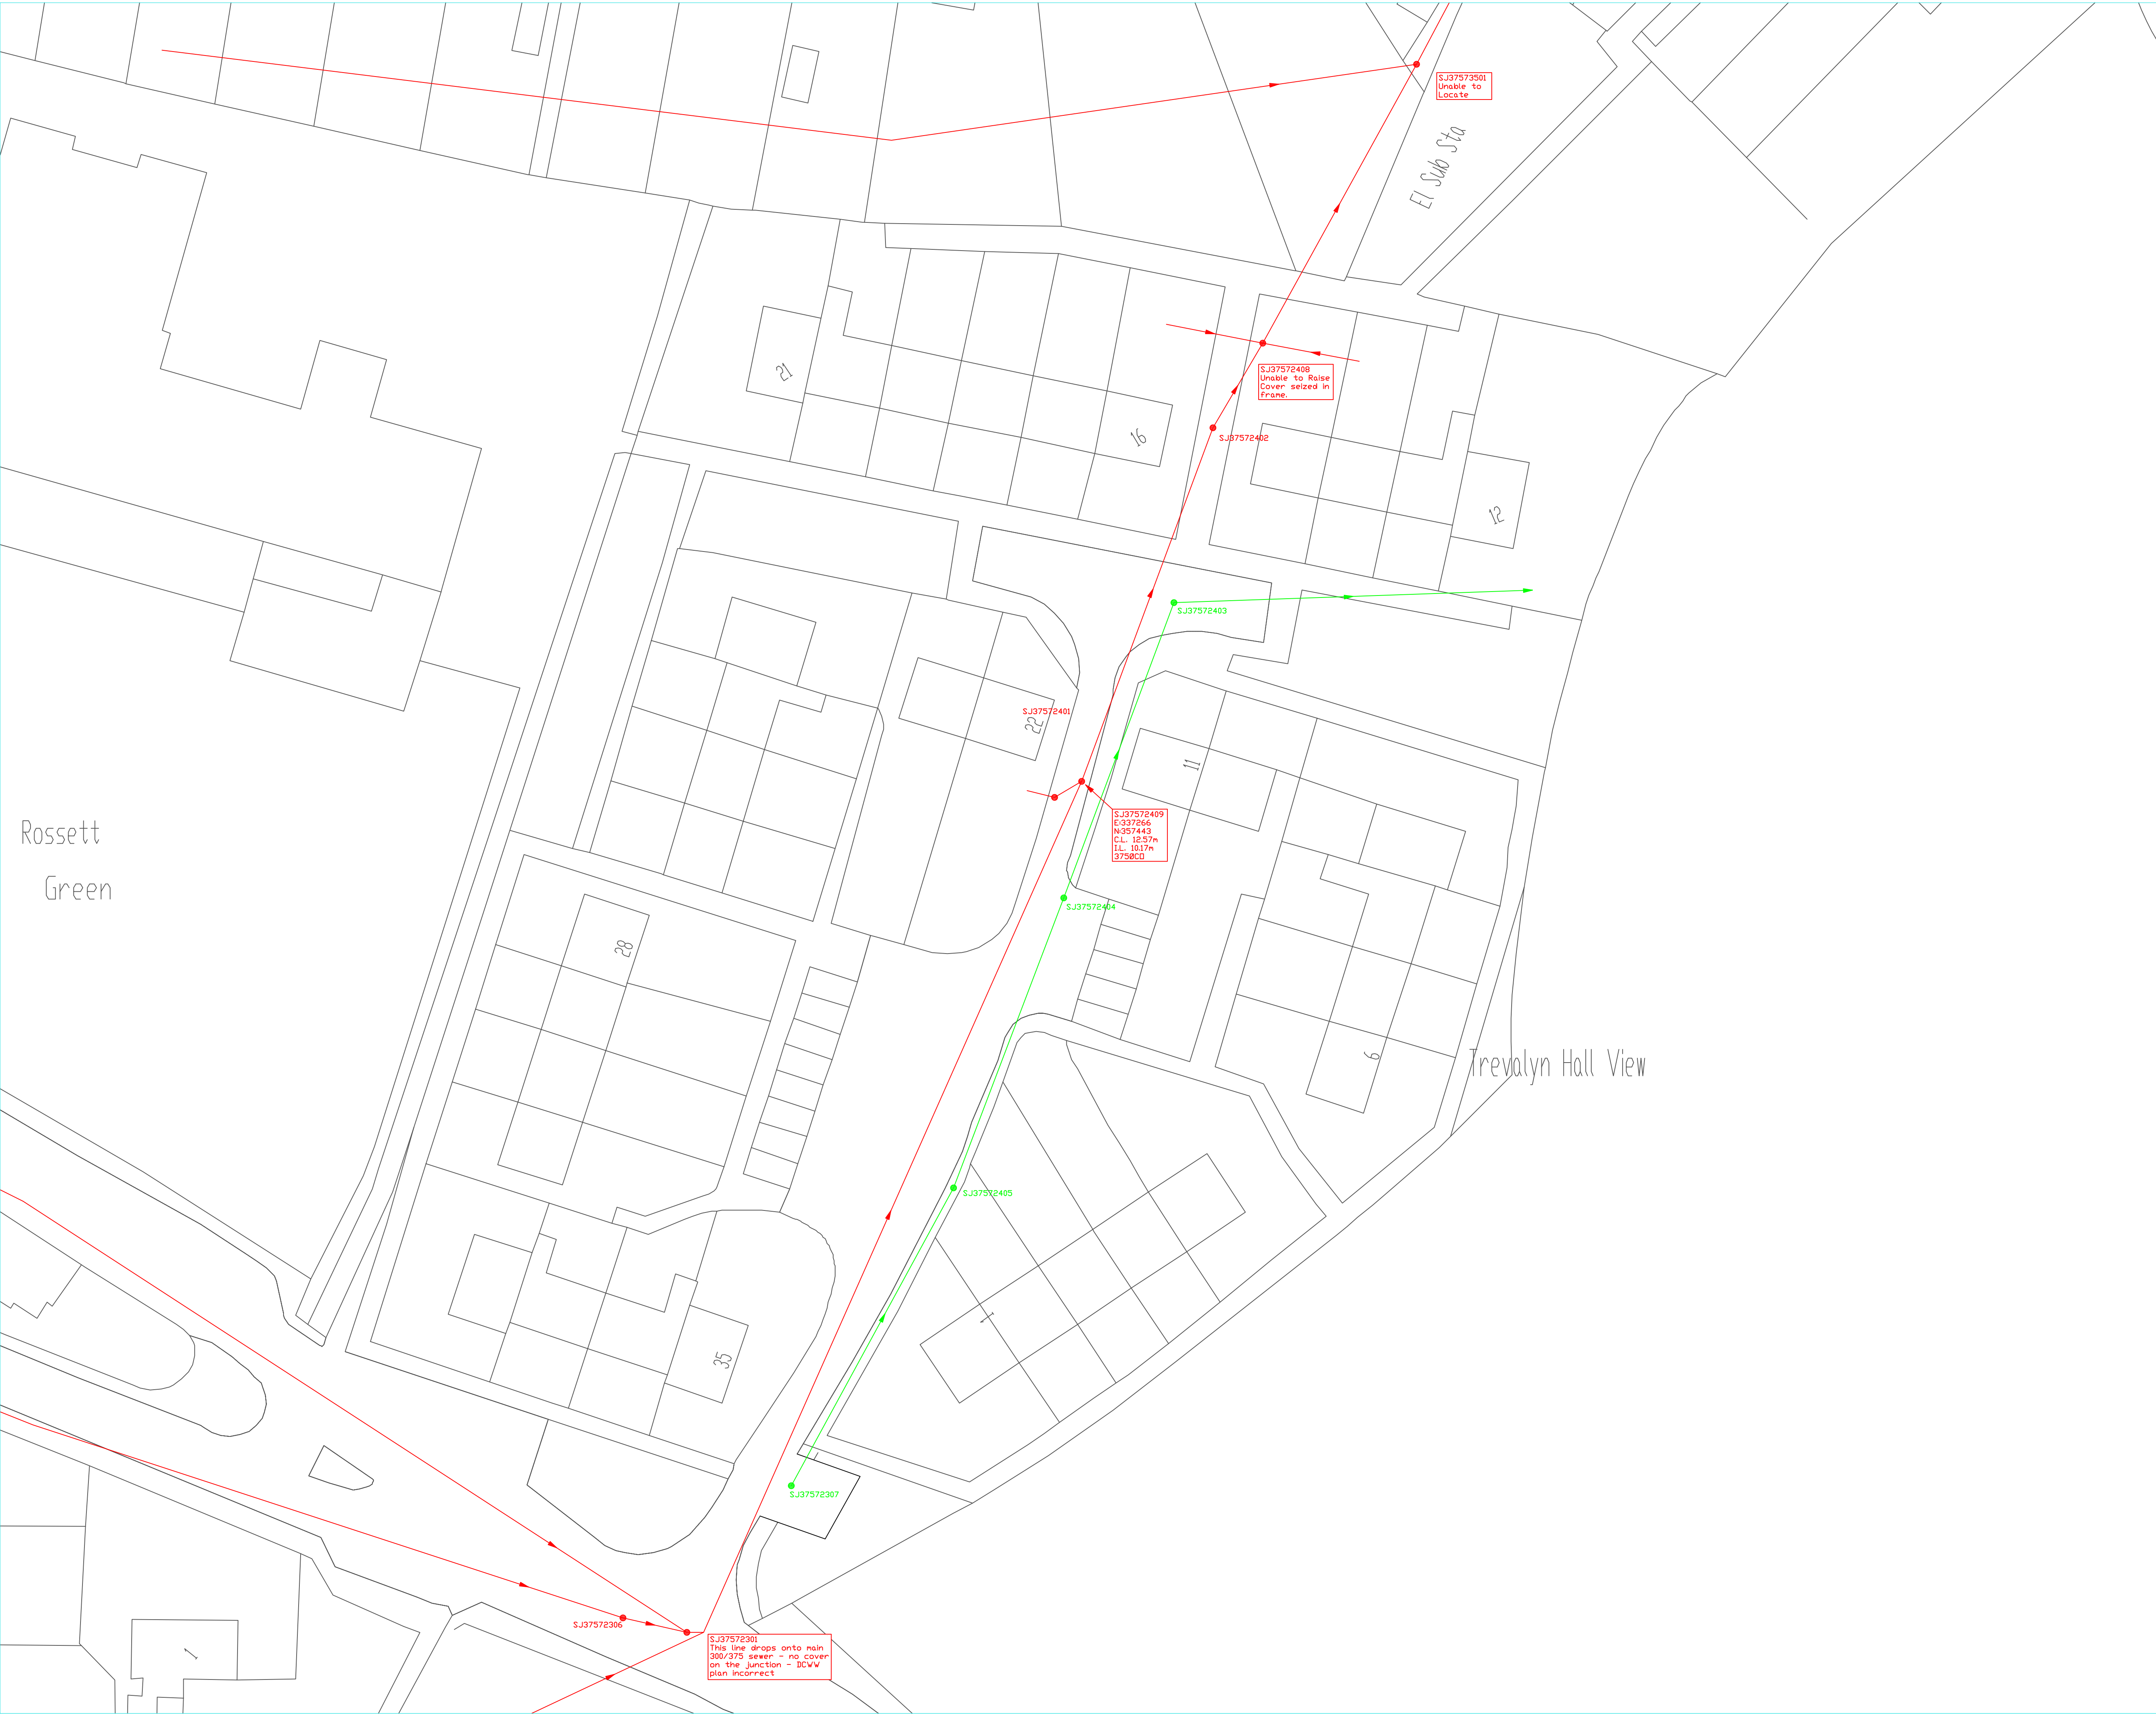

Legend/Notes:

- Combined Sewer
- Foul Sewer
- SW Sewer
- Assumed Sewer (Not Proven)
- Rising Main
- Highway Drainage
- Culvert Sewer
- Open Water Course
- Rain Water Down Pipe
- Foul Down Pipe
- Combined Down Pipe
- Grey Water Down Pipe
- Highway Gully
- Septic Tanks

Rossett
Green

Trevalyn Hall View



Warrington Business Park, Long Lane, Warrington, Cheshire, WA2 8TX
Tel: 01925 244376 Fax: 01925 241517
Email: kevin@invek.com - www.invek.com

Client
Waterco

Drawing Title

Holt Road, Rossett
Drainage Layout

Scale(s)	N.T.S	Drawn	PW
Date	09.07.18	Checked	RD
Job Number	1364	Approved	KN

Sheet Size, Drawing Number & Revision
A1_1364/01_Rev_00

↓

=====

Invek Surveys 6.16 Manhole Details

=====

10/07/18

OS ref SJ3757228360 M/H no SJ37572301

Location HOLT ROAD JUNC TREVALYN HALL VW

Year laid Status PU Function C Type M Survey date 09/07/18

COVER Shape D Hinged N Lockable N Duty H Size 610 x 610 Toxic N

SHAFT Side N Noreg Depth 800 Size 600 x 620 Vermn N

CHAMBER Soffit C Steps 4 Ladders 0 Lndgs 0 Size 1000 x 1000 Const B

Depth flow 30 Depth silt Ht surch Cover level 13.93

-----		Up/dn ref	Shp	-----		Size	-----		Bdrop	Mat	Lng	-----		Depth	Invert
In	A	37572306	C	225	x					VC				2.45	11.48
	B	37571401	C	150	x			150		VC				1.30	12.63
	C				x										
	D				x										
	E				x										
	F				x										

									TV	Crt					
Ou	X	JUNCTION	C	225	x				N	C	VC			2.48	11.45
	Y				x				N	C					

Attention Cover N Step/Lad N Shaft N Chamb N Bch/ch N Other N

Remarks DAC

