



NOTES:

Requirement and spacing of any support piers and movement joints to be to S.E. specification. Joints to be full height of wall and to include any coping. Joints to be situated as inconspicuously as possible, preferably in any returns or piers etc and finished in an approved sealant to match the mortar colour.

S.E. to advise on requirement of any shear ties (debonding type) at any movement joints.

Both leaves of brickwork are to be tied together using suitable s.s. ties at ctrs not exceeding 450mm, both horizontally and vertically. Joint between the two leaves to be fully filled with mortar as the work proceeds.

Contractors chosen brick manufacturer to be consulted as to the necessity for sulphate resisting cement in both the main wall and the coping and capping courses

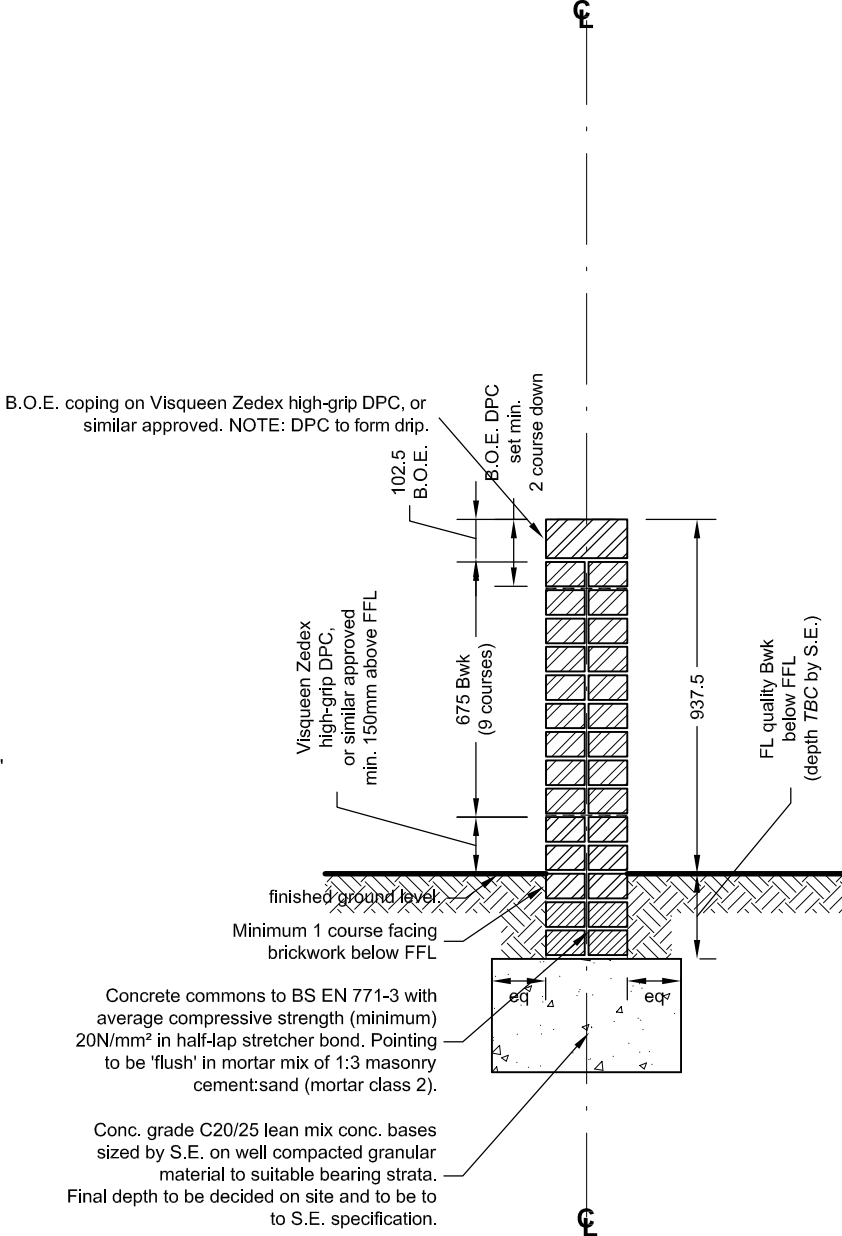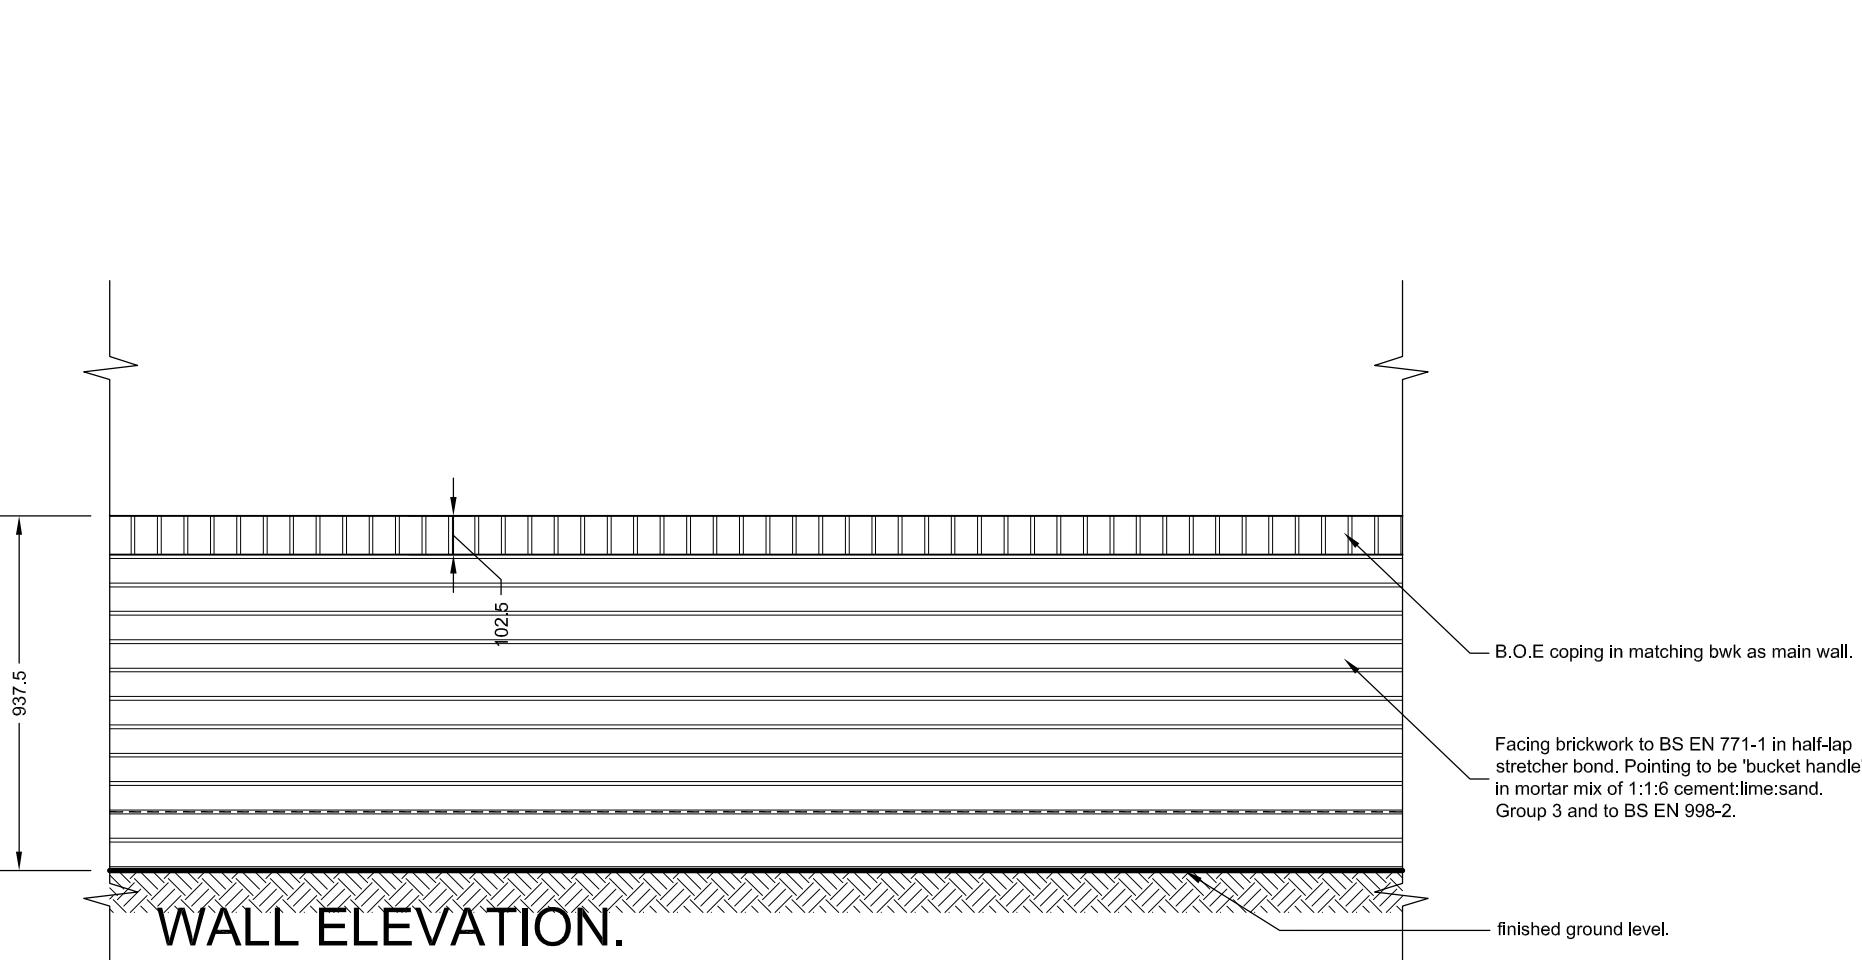

SECTION THROUGH WALL

NOTE:
For extent of boundary walls, fences & gate positions, refer to drwg. no 6955/L(9)01.



Rev.	Date:	Description:	Initial:	Chkd:
Client	GRWYP CYNEFIN	Drawg. Title	TYPICAL BWK WALL 0.9m HIGH	
Project	Redevelopment of site at Parsonage Road, Gresford LL12 8PF	Scale	1:20	Drawn C.B. Chkd. Date 19/11/15
		Drawg. No.	6955/A(9)03	Revision -