
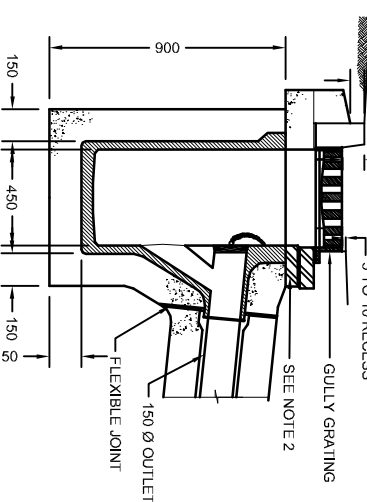
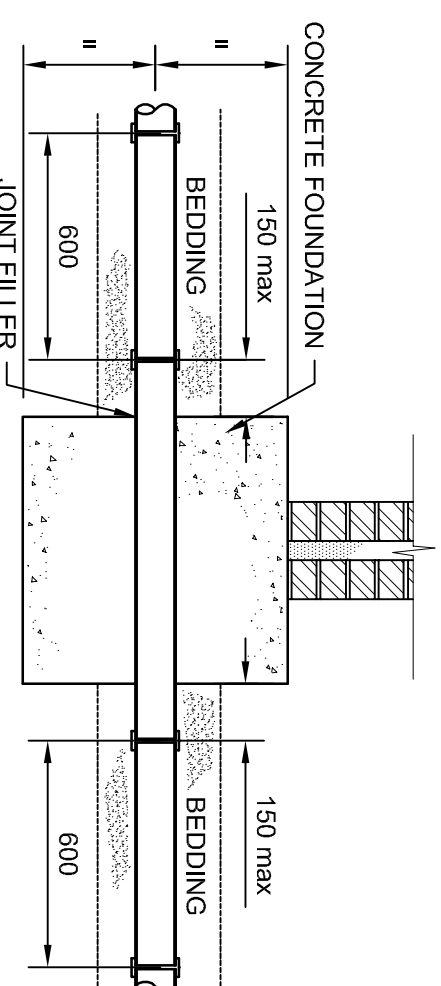
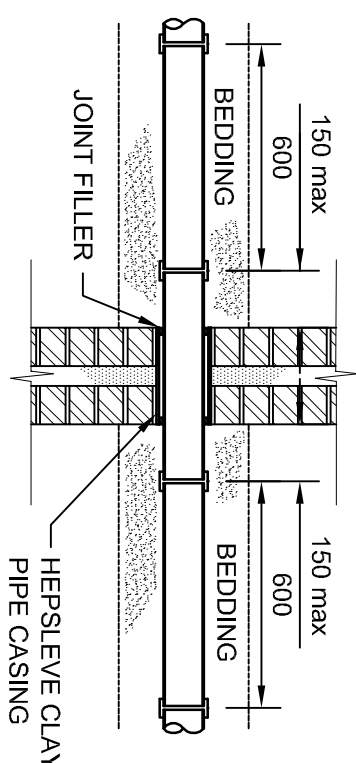
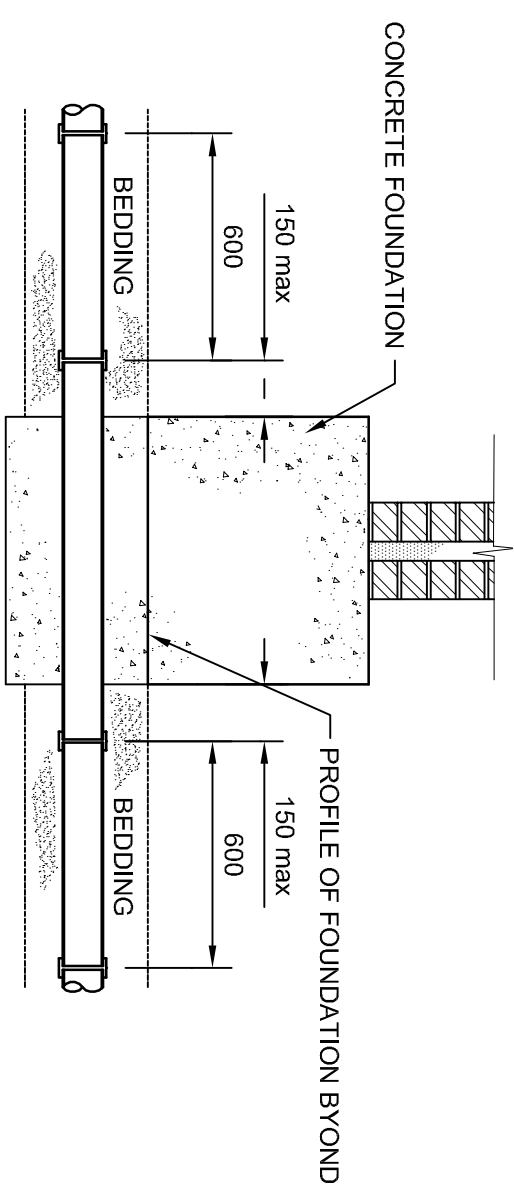
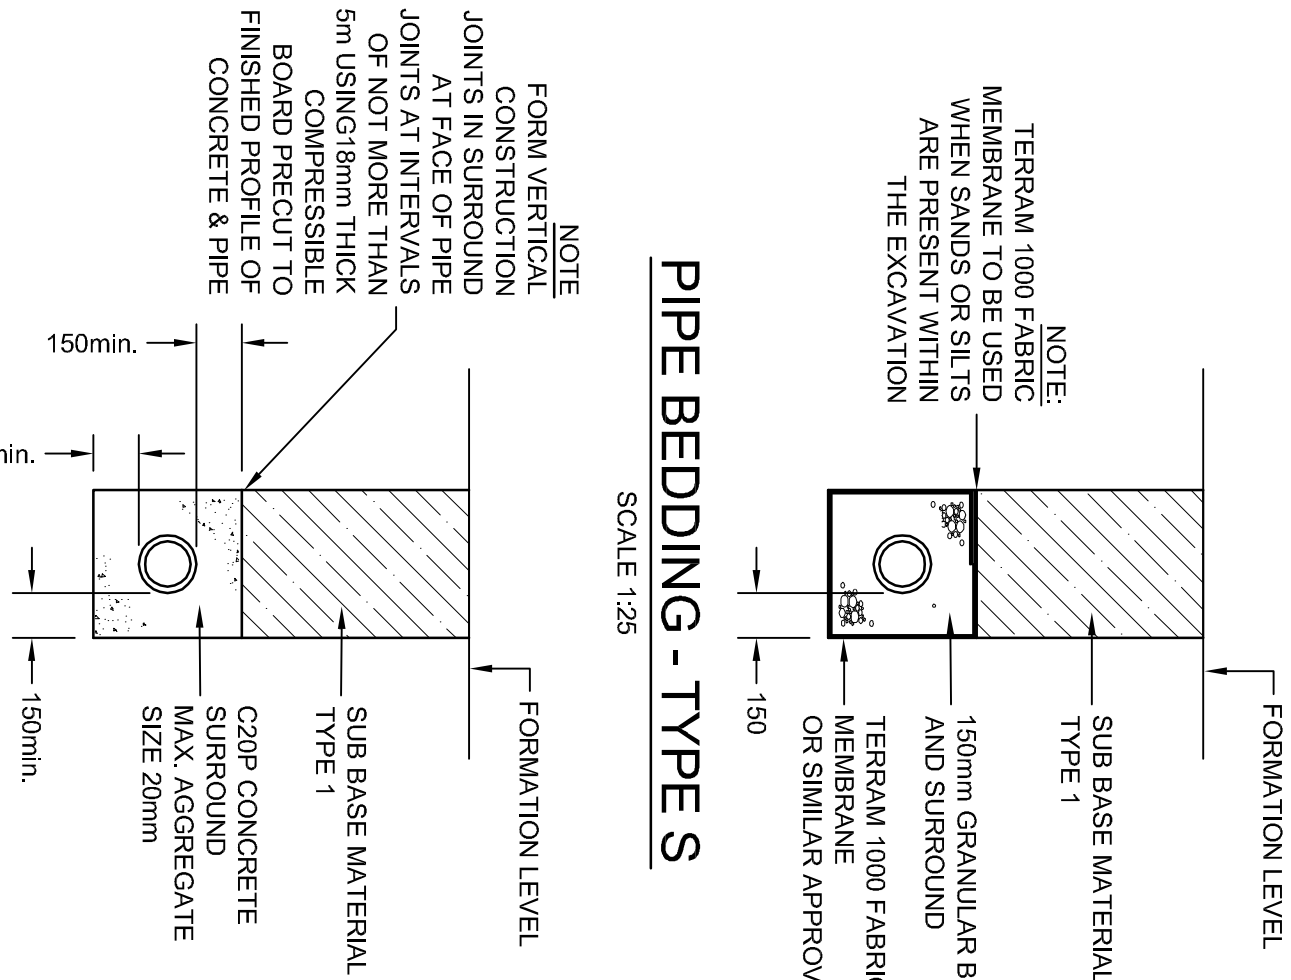
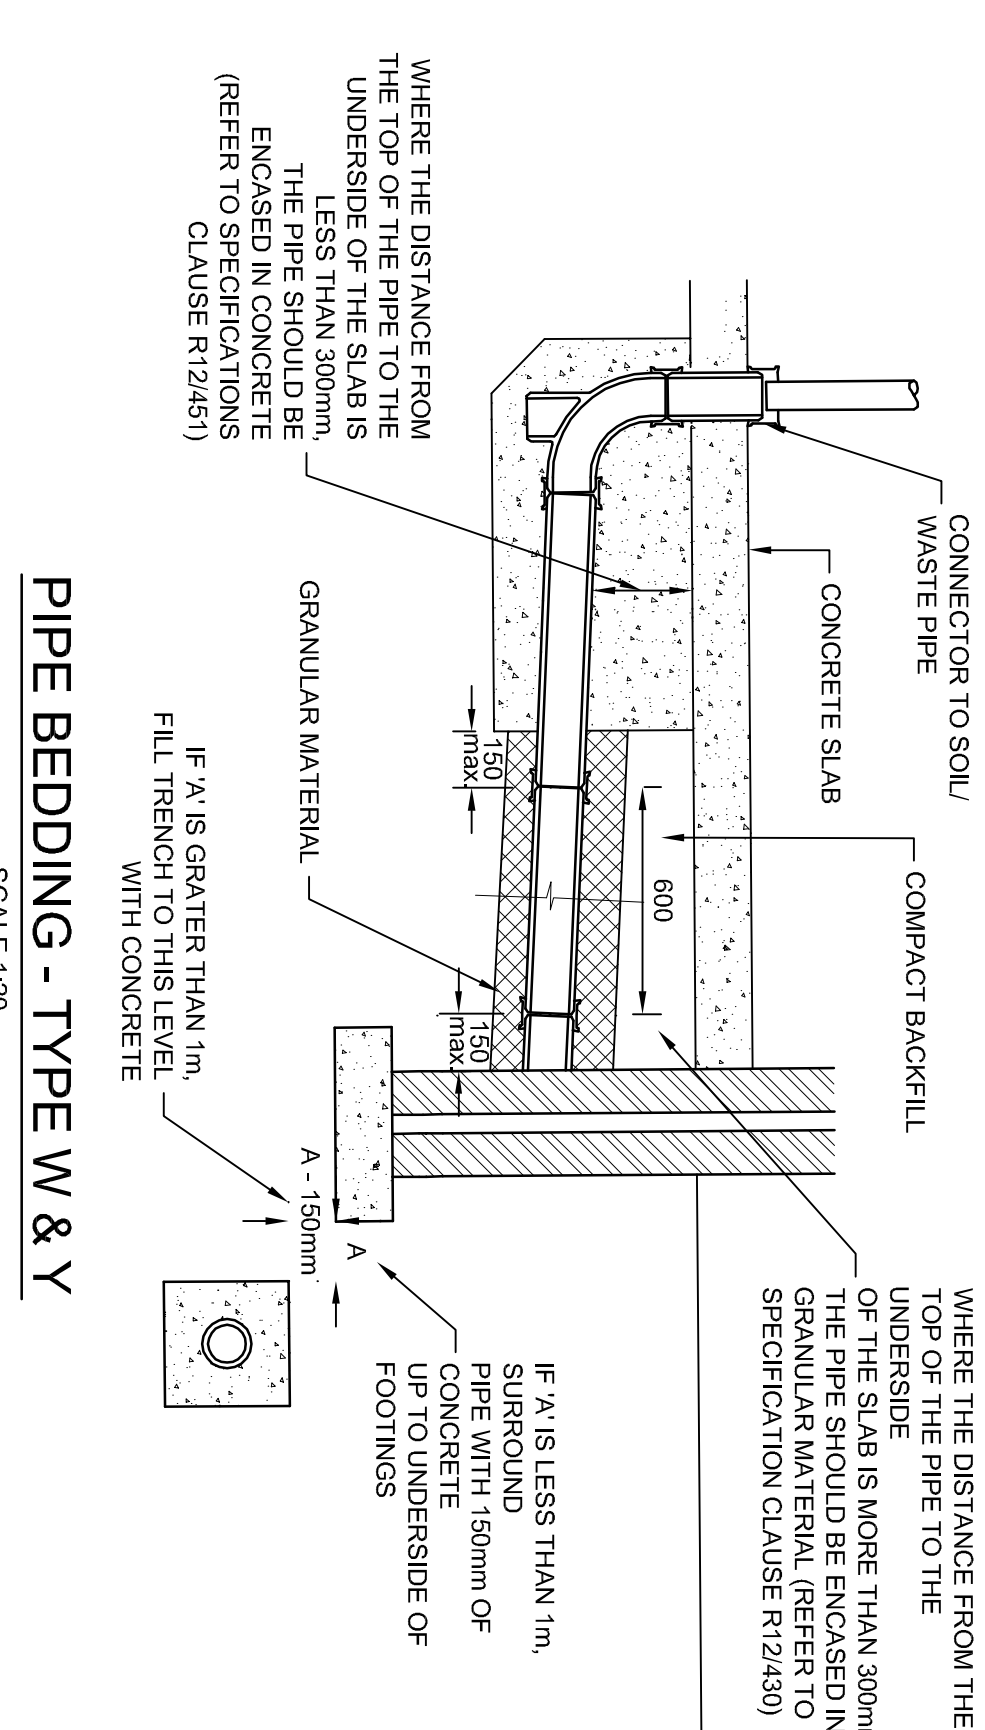
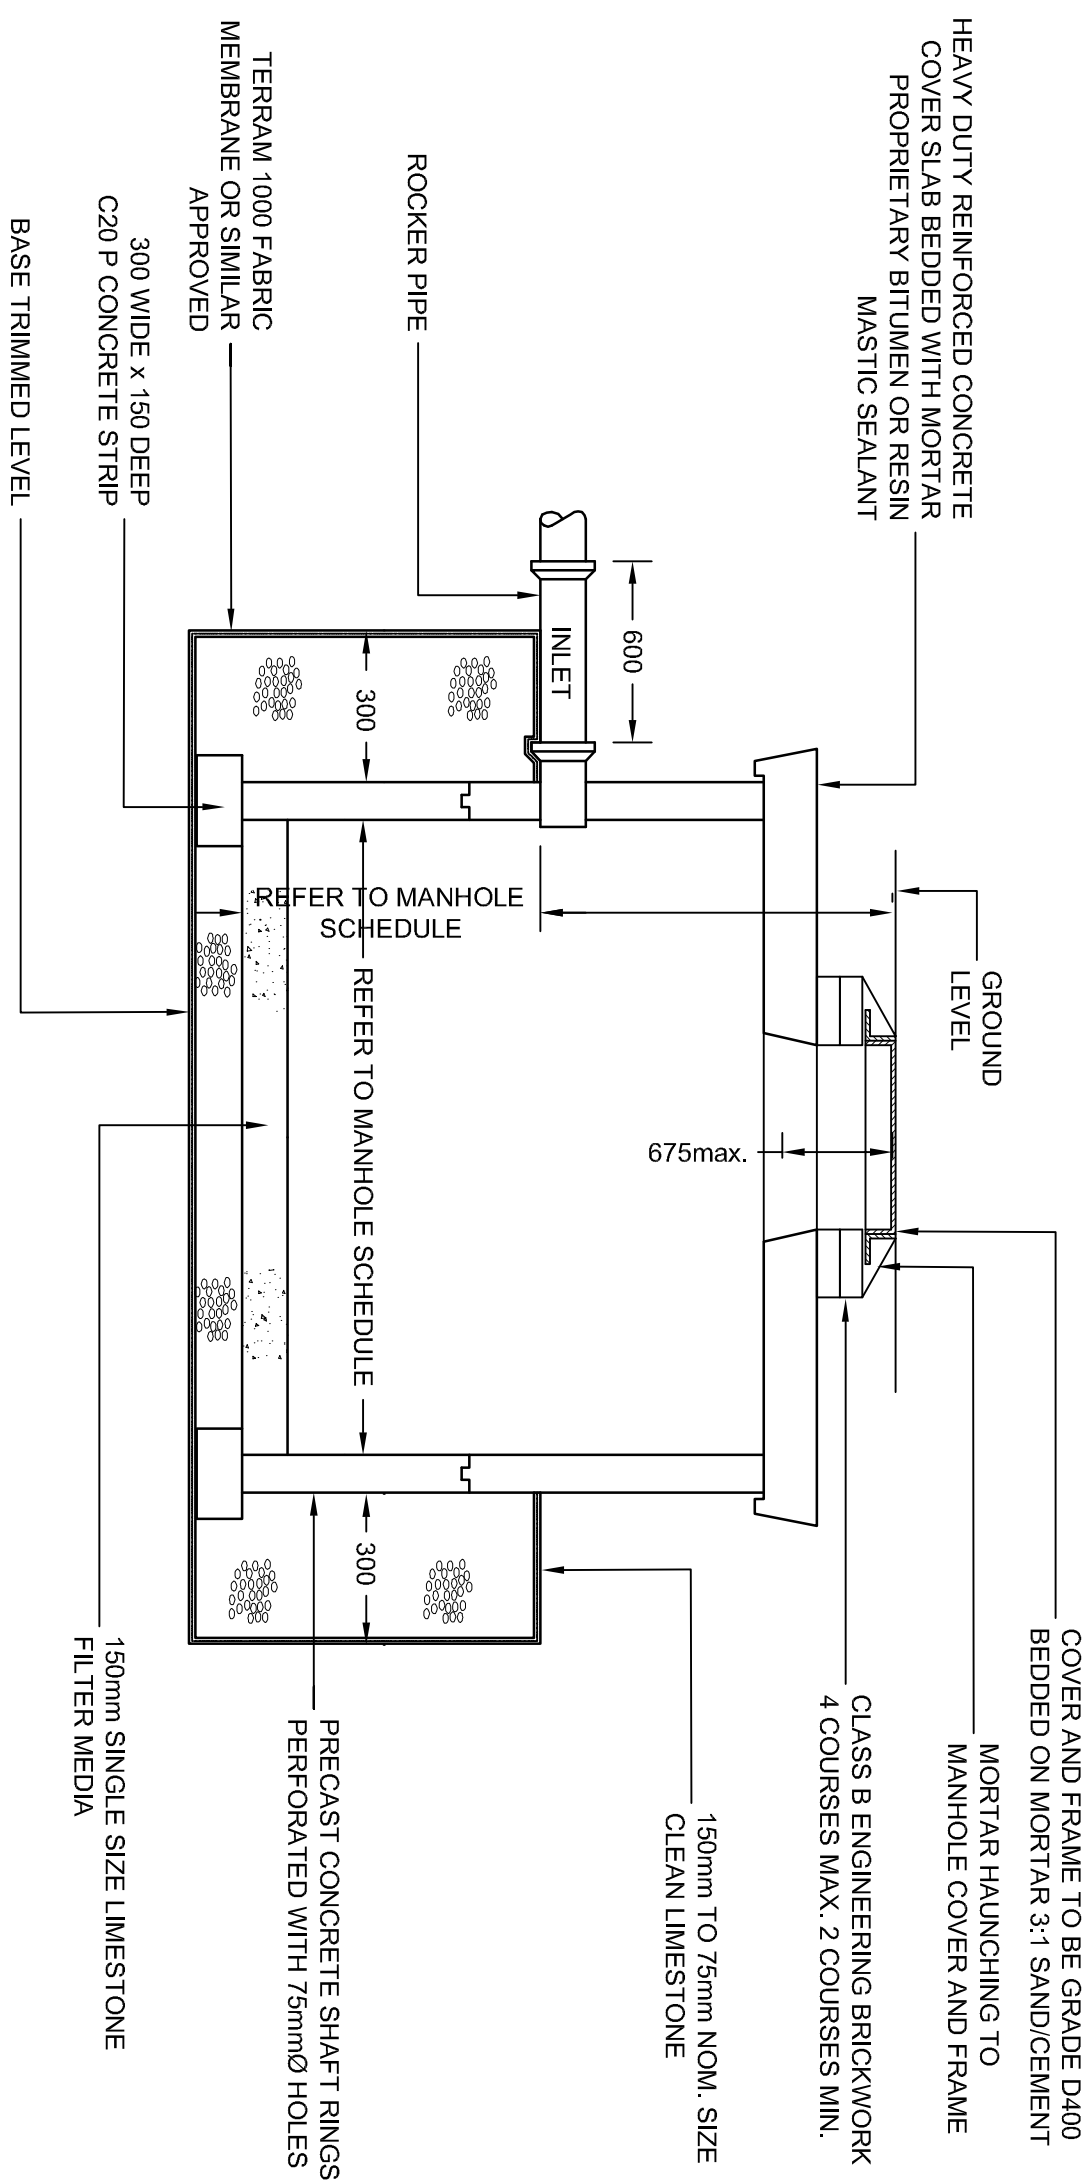
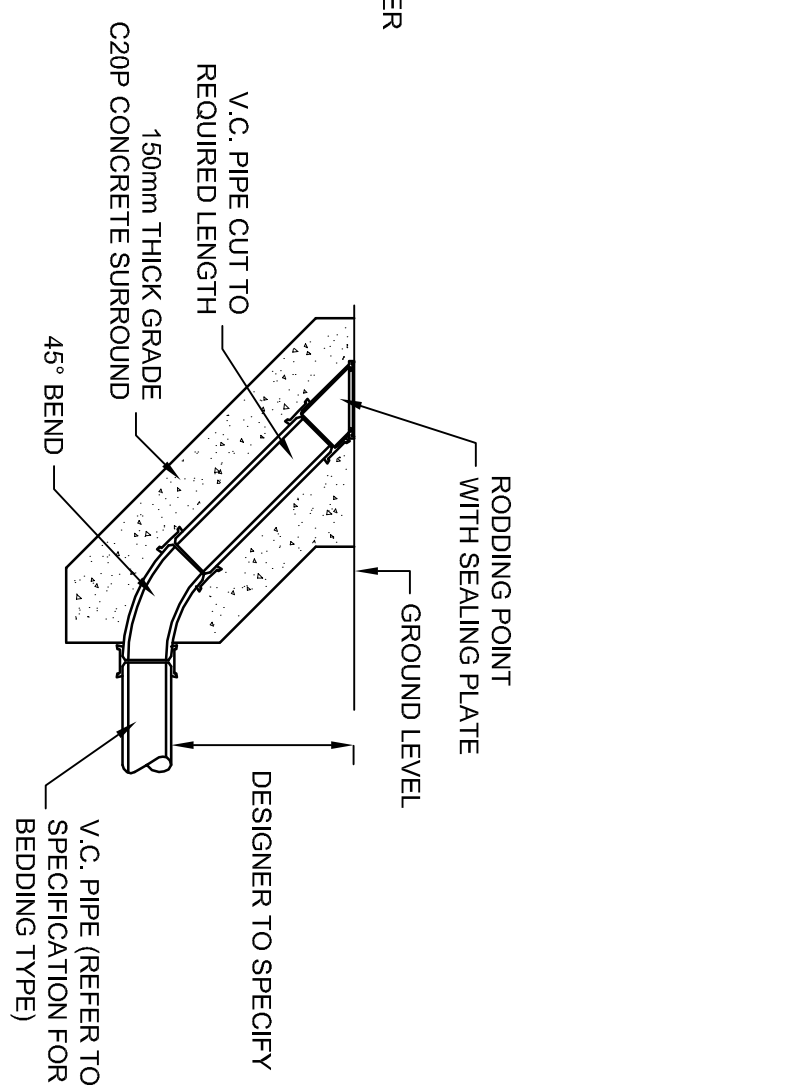
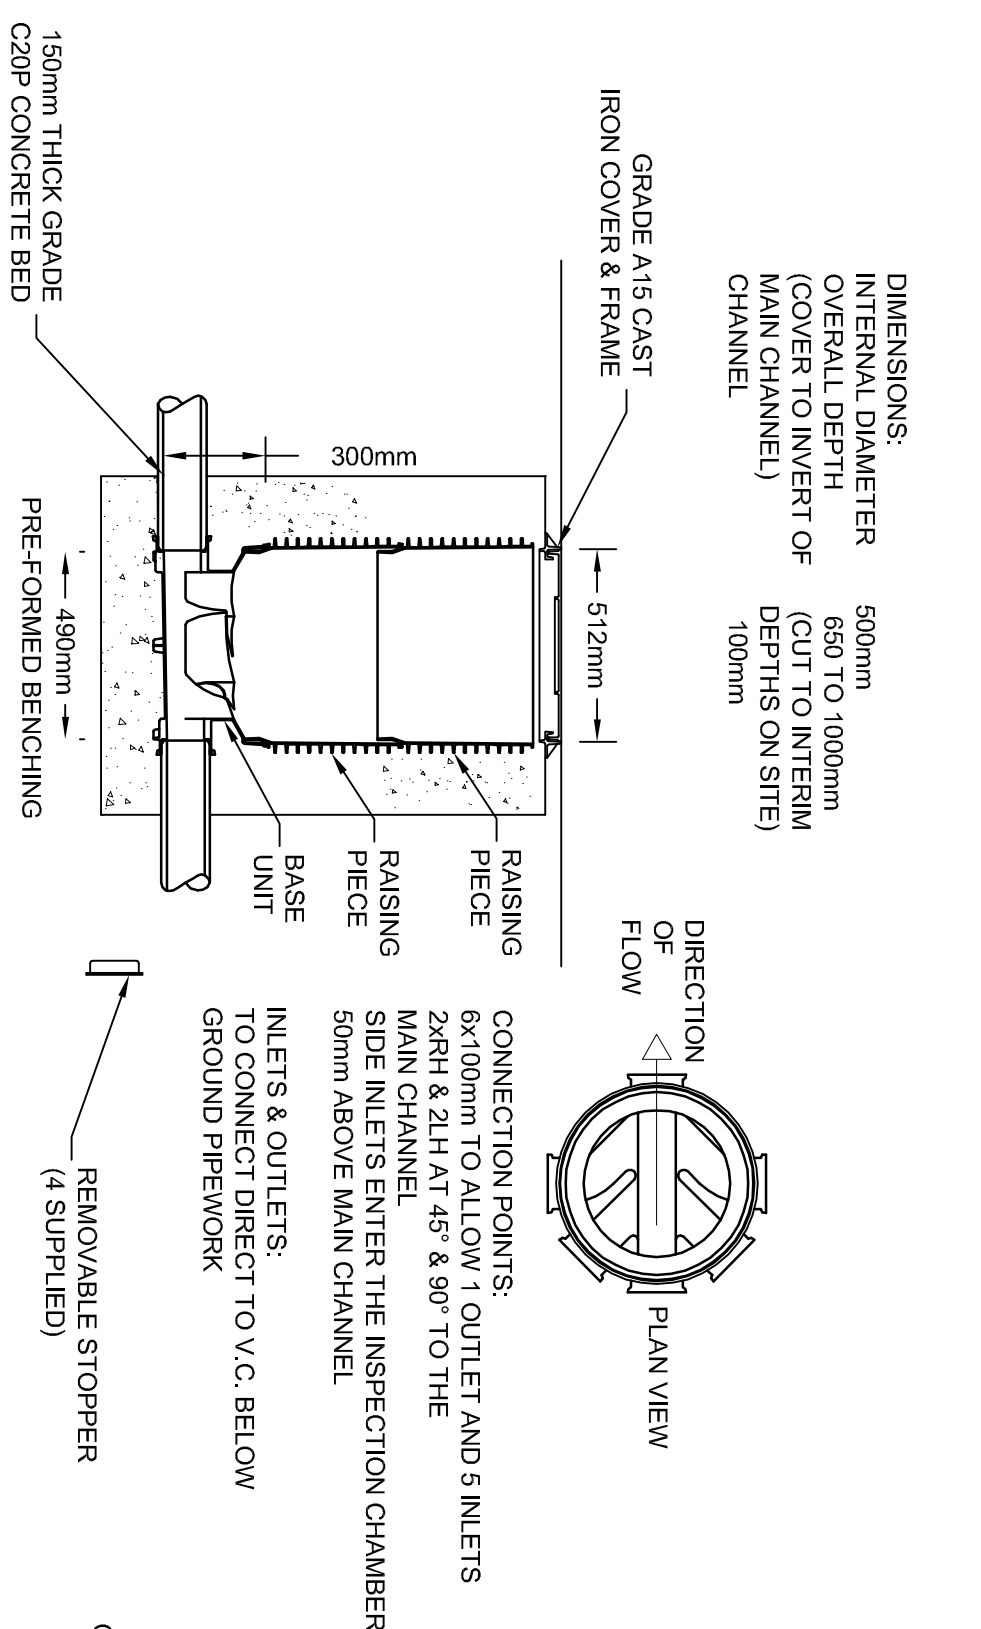
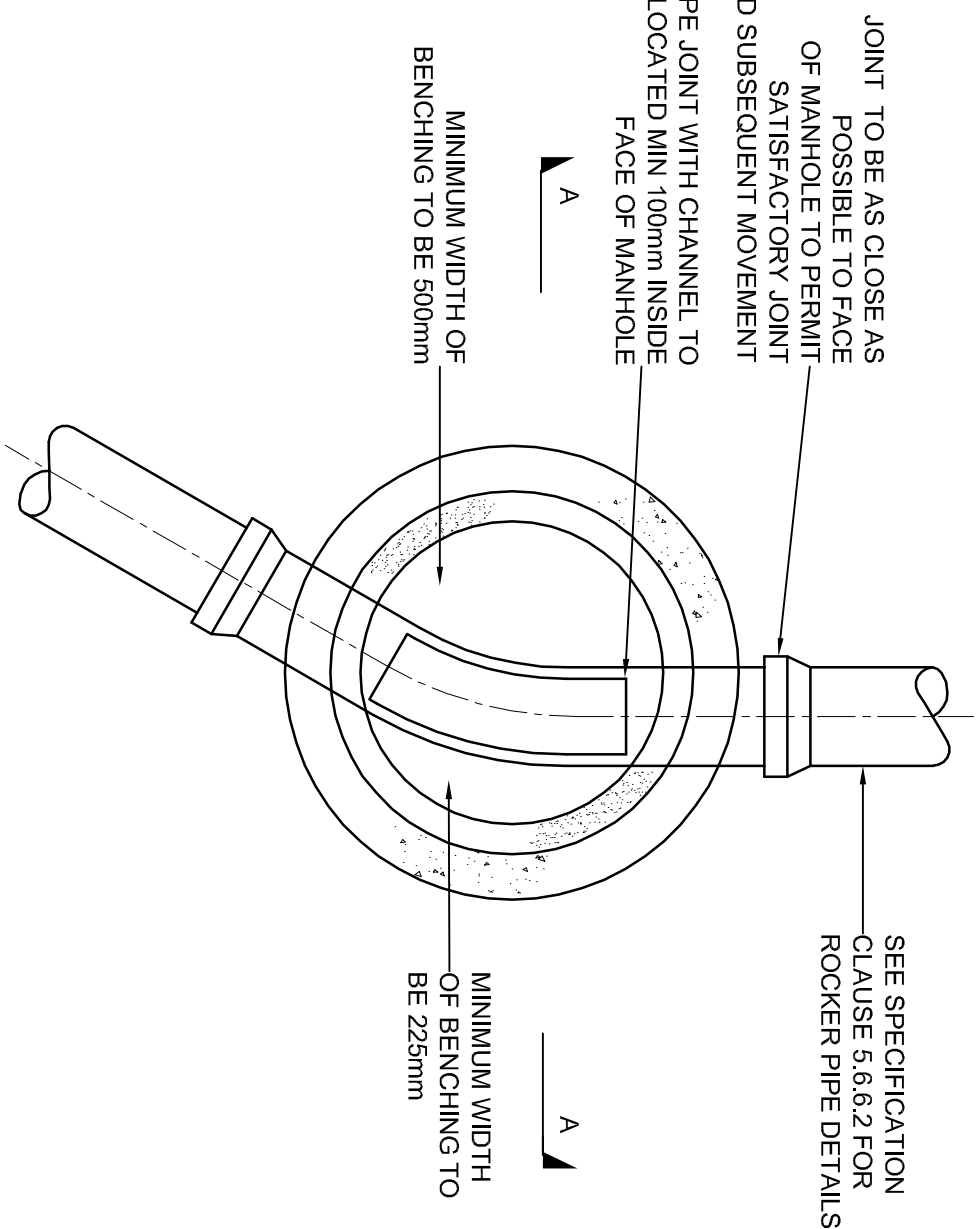


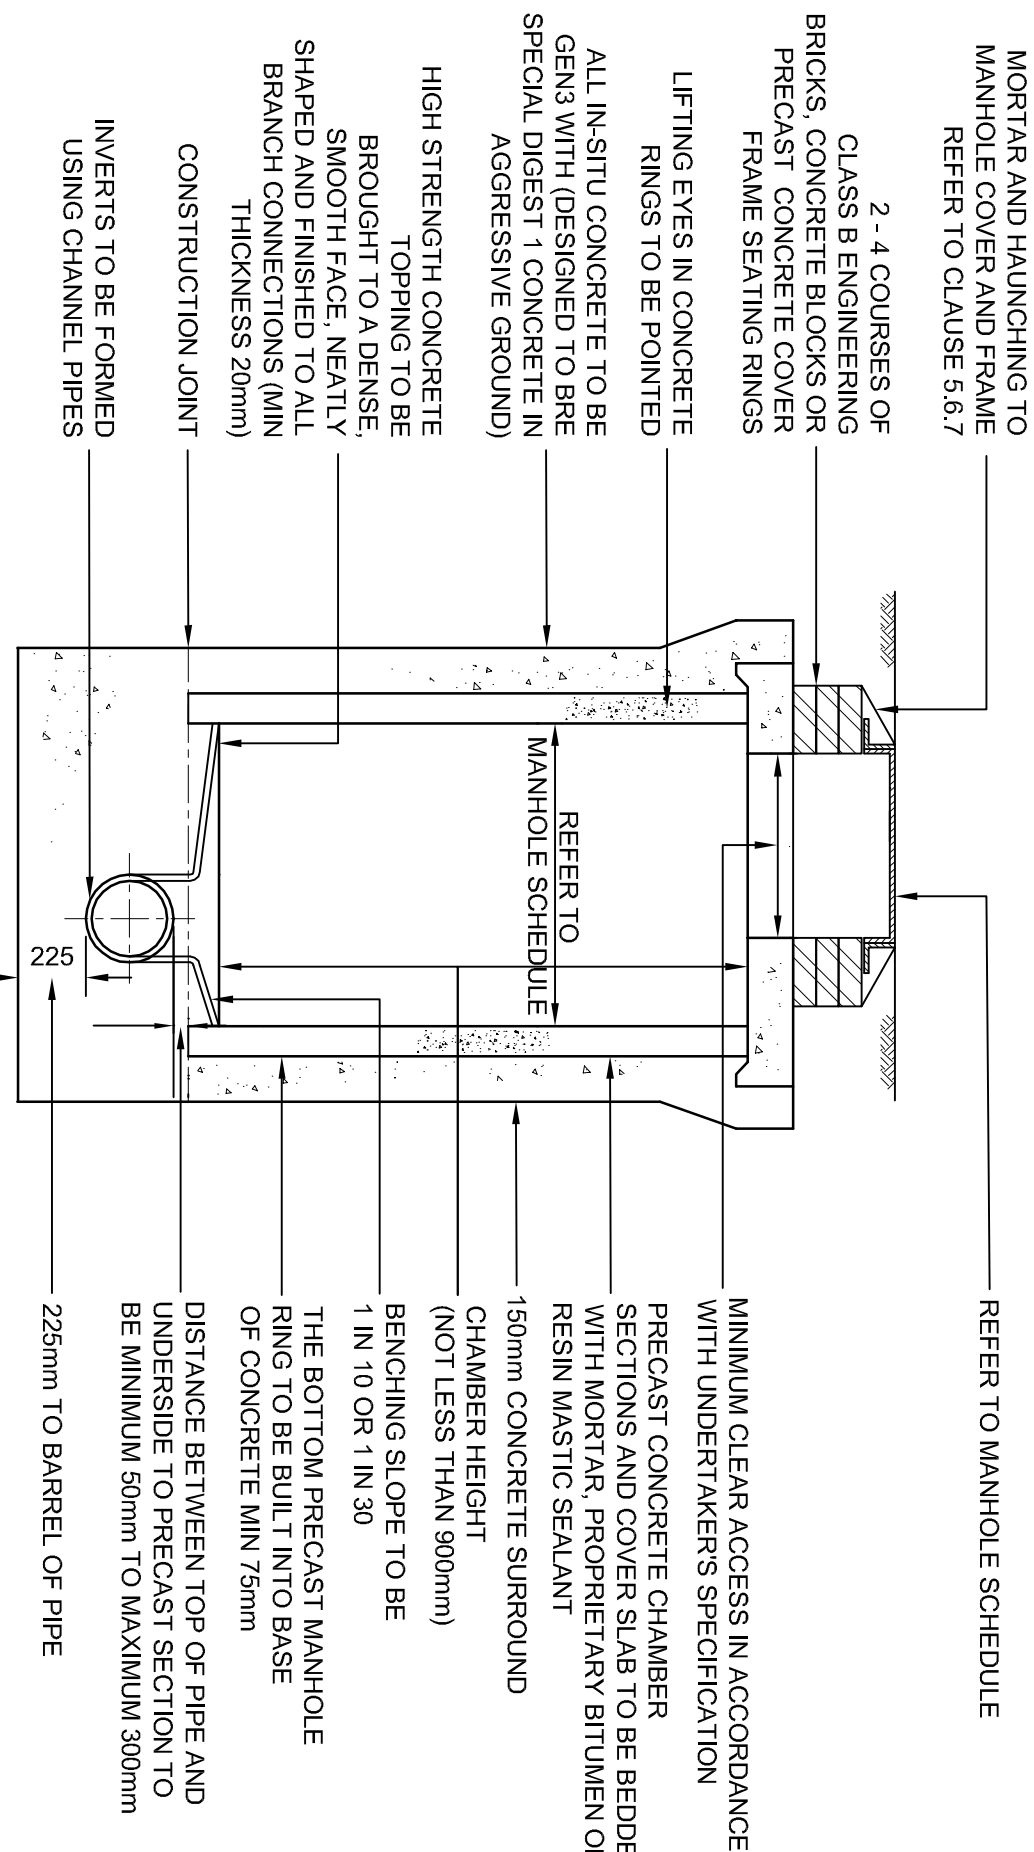

1. When foundation is more than 450mm above drain do not encase in concrete.
2. Joint Filler to be platazole or similarly approved.
3. 12mm diameter chord for 100mm drainage pipes with 150mm diameter casing.
4. 25mm diameter chord filler for 150mm drainage pipes with 225mm diameter casing.
5. Where drainage pipes under buildings have less than 300mm cover they shall have 150mm concrete encasement.

[illegible]