

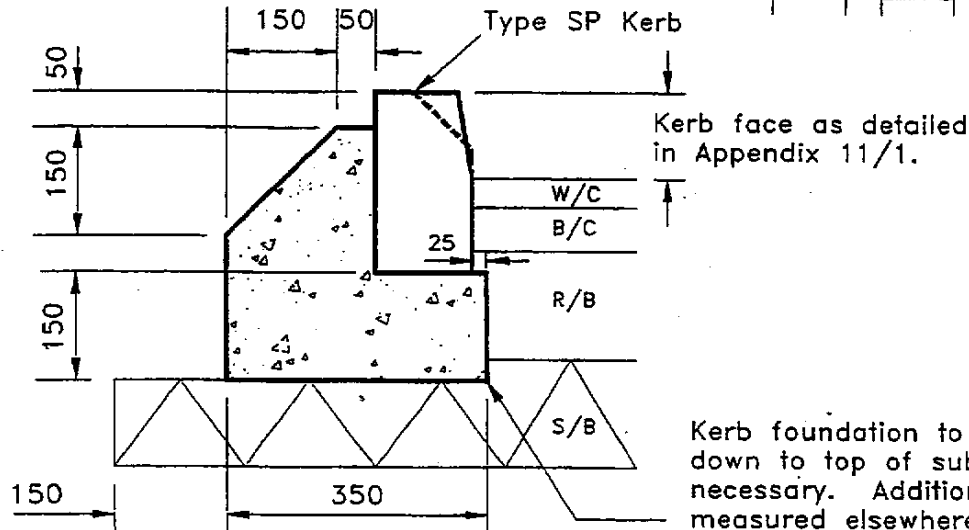
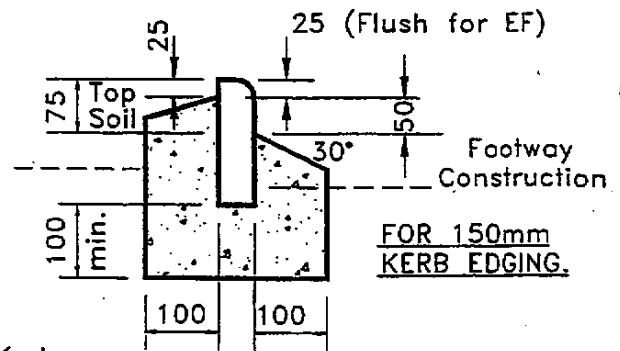


Appendix 11/1

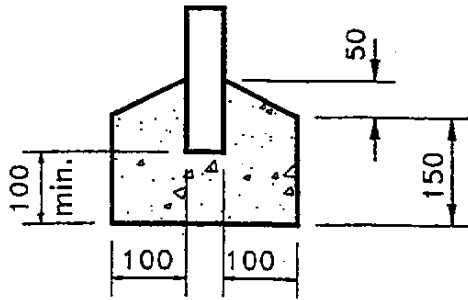

(75 where pavement is flagged.)

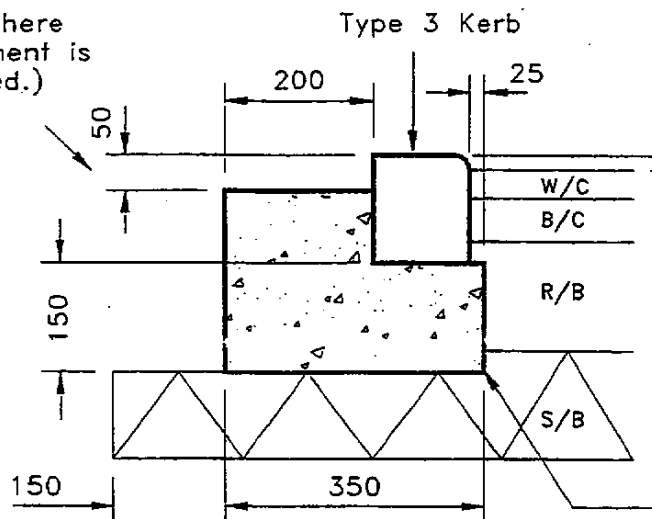

Uprand for vehicular access and pedestrian crossings to be 20. Where necessary for drainage purposes this dimension may be increased to 35. If tactile paving is provided for use by disabled persons then the upstand shall be 0 - 6.

Kerb foundation to be extended down to top of sub-base layer if necessary. Additional concrete measured elsewhere.

General Notes

- 1) Kerbs to be manufactured to standards of BS7263 Part 1.
- 2) Kerbs to be laid on 10mm designation (ii) mortar on prepared foundation. Alternatively lay kerbs on well compacted bed of semidry concrete, max. 35 slump, all in accordance with BS7263 Part 2.
- 3) Concrete to be S.T.1.

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

WREXHAM COUNTY BOROUGH COUNCIL

revisions	title	scale	date
	KERB TYPICAL DETAILS	1:10	8/93
		drawing no 11/01/02	
		sheet 1 of 1	