

Single cable

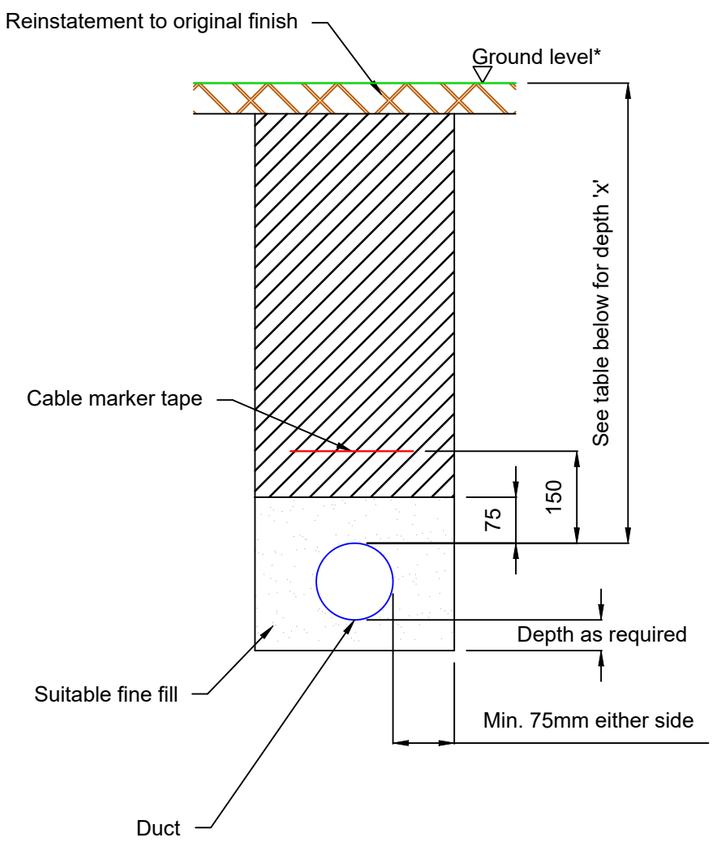

Twin cables

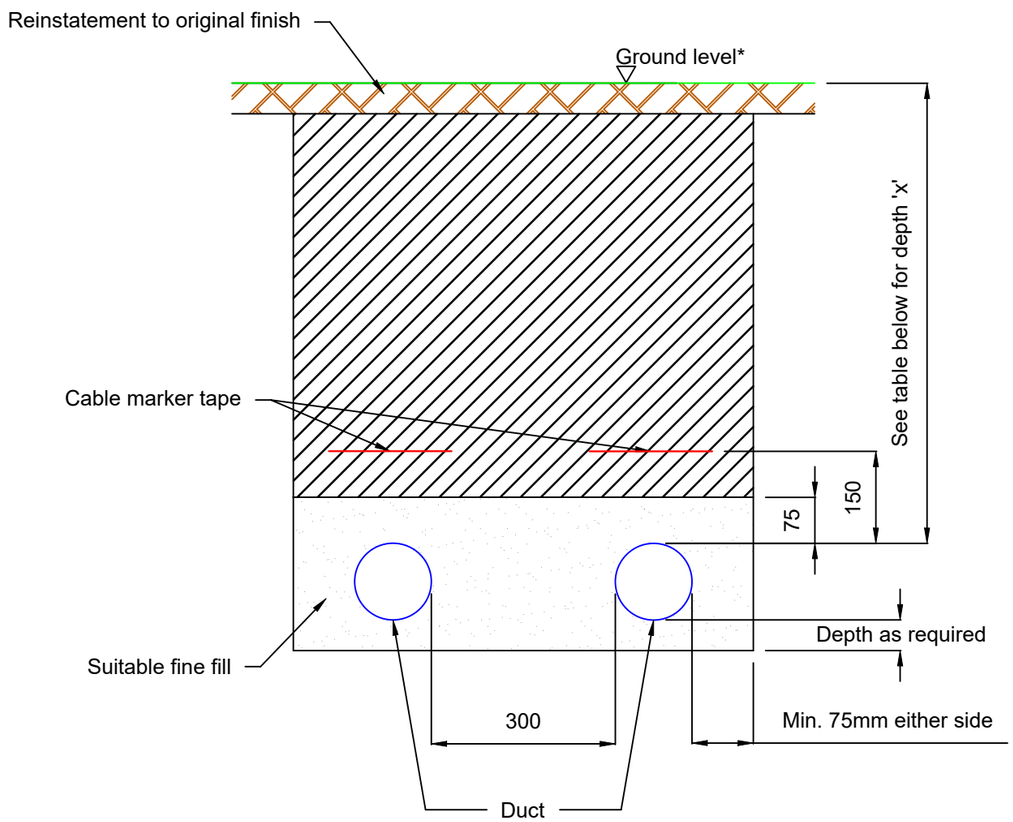

Trench location	Depth 'x'
Footpath / Ground with no vehicle load	600mm
Carriageway	750mm
Agricultural land	1000mm

Notes

Cables will be undergorund between the powerhouse and the point of connection in the site substation.

All dimensions are in mm unless otherwise stated.

Theses drawings are indicative only and should not be used for construction. All details must be reviewd at the time of construction to ensure complicance with the latest standards and modes fo best practice.

*In areas where ground make up prevenets the required minimum depth of fill imported material may be used to create a bund over the cable rout in order to achive this. Confirmation of this must be sought from the ocnstruction works supervisor or designer before any action is taken.

Ducts to be of black polyethylene with the legend "Electric Cable Duct" printed at regular intervals.

Scale (@ A3) As Shown	Date: 26th Febuary 2025

Prepared by: dulas

Client: National Trust

Project: Hafod Road Solar

Figure 7 - Cable Trench Cross Section

Drawn by: MH	Checked by: LR	Version: 0b

Every effort has been made to ensure the accuracy of the information provided on this figure. Dulas Ltd cannot be held responsible for any omissions or errors in the data supplied by third parties and hereby expressly disclaims any responsibility for any losses, disappointment, negligence or damage caused by reliance on the information contained on this figure.