



NOTES:

1. DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS ONLY. IF IN DOUBT - ASK.
2. DIMENSIONS ARE IN MILLIMETRES, UNLESS NOTED OTHERWISE.
3. LEVELS ARE IN METRES RELATIVE TO ORDNANCE DATUM, UNLESS NOTED OTHERWISE.
4. ALL WORK TO BE CARRIED OUT IN ACCORDANCE WITH THE CIVIL ENGINEERING SPECIFICATION FOR THE WATER INDUSTRY (8th EDITION - JUNE 2004), SUPPLEMENTED BY THE DWIR CYMRU CIVIL ENGINEERING SPECIFICATION VERSION 3.0.
5. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH :
 - 2480265_1000_2400 - SITE LOCATION & PLANNING APPLICATION SITE BOUNDARY
 - 2480265_1000_2401 - PROPOSED OVERALL SCHEME LAYOUT
 - 2480265_1000_2402 - PROPOSED SITE LAYOUT
 - 2480265_1000_2403 - PROPOSED SITE ELEVATIONS
 - 2480265_1000_2404 - PROPOSED KUSK DETAILS - SHEET 1 of 2
 - 2480265_1000_2405 - PROPOSED KUSK DETAILS - SHEET 2 of 2
 - 2480265_1000_2406 - PROPOSED KUSK DETAILS - SHEET 3 of 2
 - 2480265_1000_2407 - PROPOSED KUSK DETAILS - SHEET 4 of 2
 - 2480265_1000_2408 - TEMPORARY COMPOUND FOR CONSTRUCTION OF WORKS
 - 2480265_1000_2409 - PROPOSED AREA OF COMPENSATION
 - 2480265_1000_2410 - PROPOSED SCREENING
6. MINOR CHAMBERS AND SOME HANDRAILING HAVE BEEN OMITTED FOR CLARITY OF MAJOR STRUCTURES.
7. MINOR ITEMS OF MECHANICAL PLANT HAVE BEEN OMITTED FOR CLARITY OF MAJOR STRUCTURES.

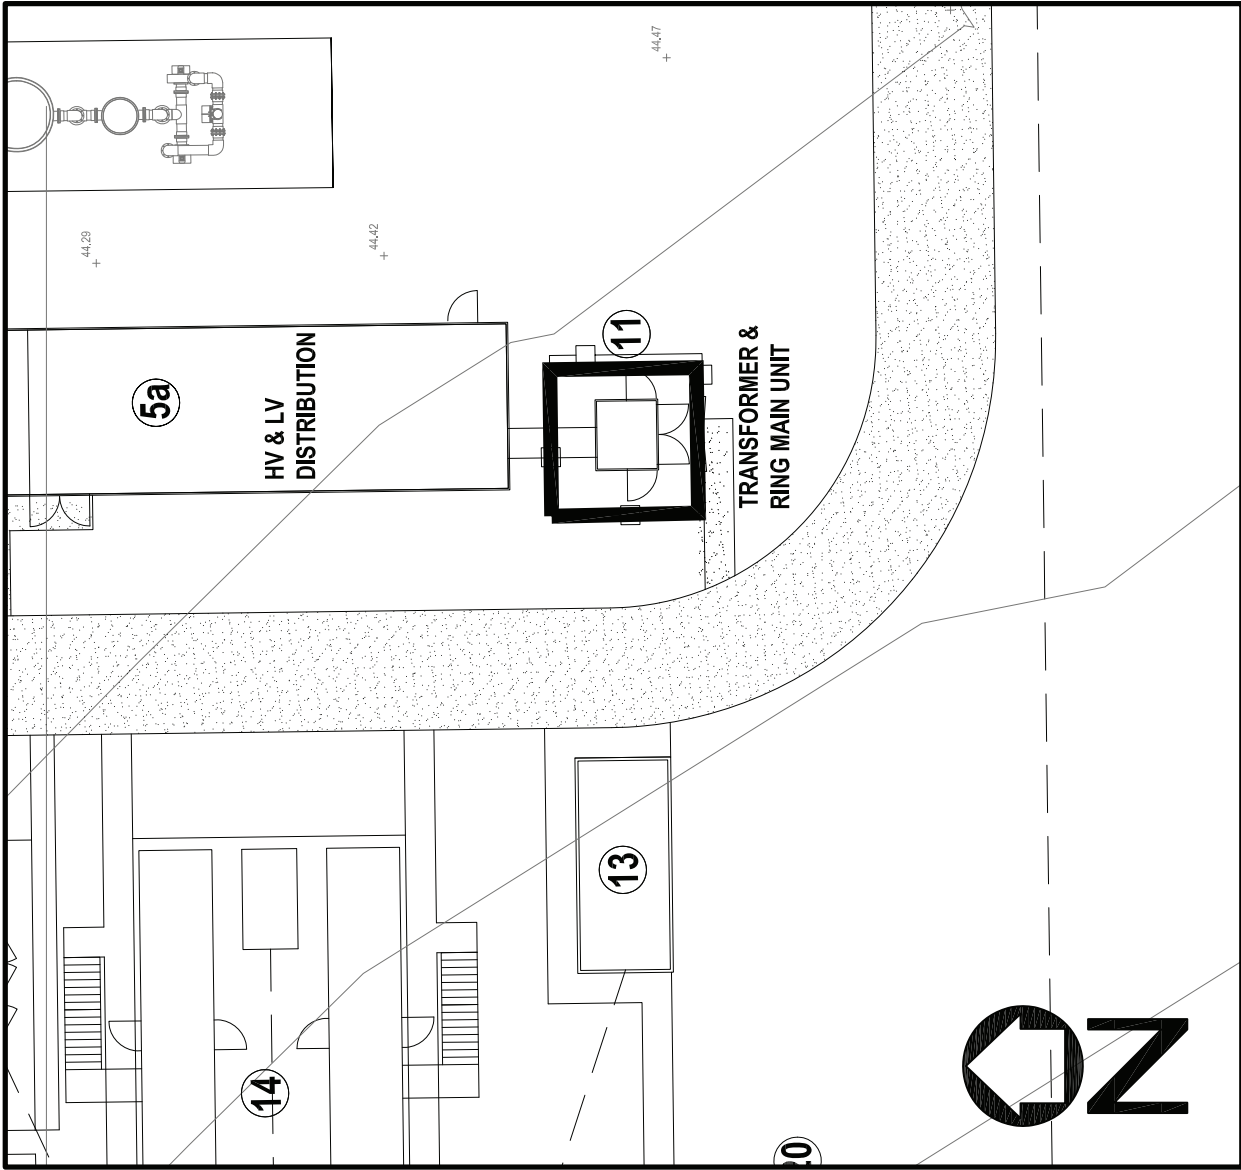


KEY PLAN SCALE 1:250

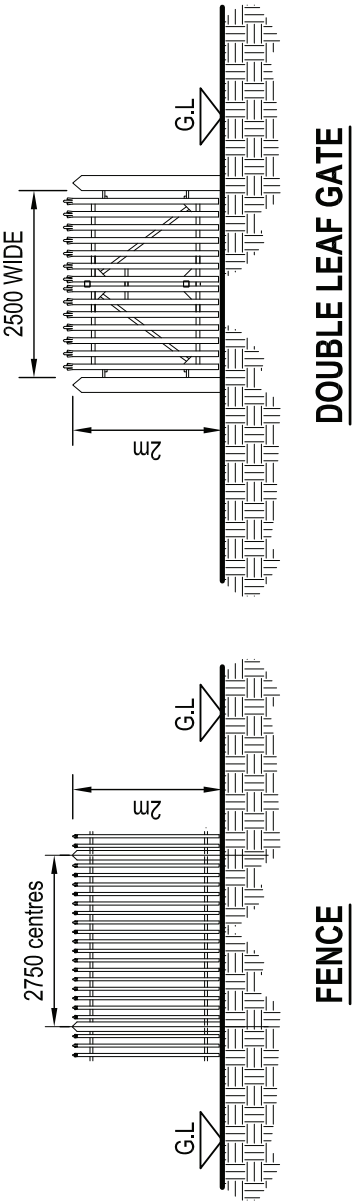

- FENCING & GATE NOTES
1. FENCING TO BE CONSTRUCTED TO BE 40 x 40 x 6mm COIL LB STEEL, ANGLE SECTION D.S. EN 10025 PART 1 TO WHICH PALES ARE FIRED WITH HIGH TENSILE RIVETS.
 2. FENCING POSTS TO BE R.S. JOISTS 102x4mm COMPX'ING WITH B.S.4. HAVING PREPARED LUGS TO FIT TOP AND BOTTOM RAILS.
 3. CORRUGATED PALES TO BE min 4mm THICK TRIPLE HEADED, COLD FORMED AND PLUNGE PUNCHED TO RECEIVE HIGH TENSILE RIVETS.
 4. PALES TO BE AT 152mm NOMINAL CENTRES TO PROVIDE EQUAL SPACING OF RIVETS TO RECEIVE HIGH TENSILE RIVETS.
 5. ALL COMPONENTS TO BE HOT DIPPED GALVANISED IN ACCORDANCE WITH B.S. EN ISO 1461.
 6. FENCE & GATE TO BE CONSTRUCTED AND ERECTED IN ACCORDANCE WITH B.S. 1722 PART 12.

PROPOSED PALISADE FENCING & GATE DETAILS SCALE 1:100

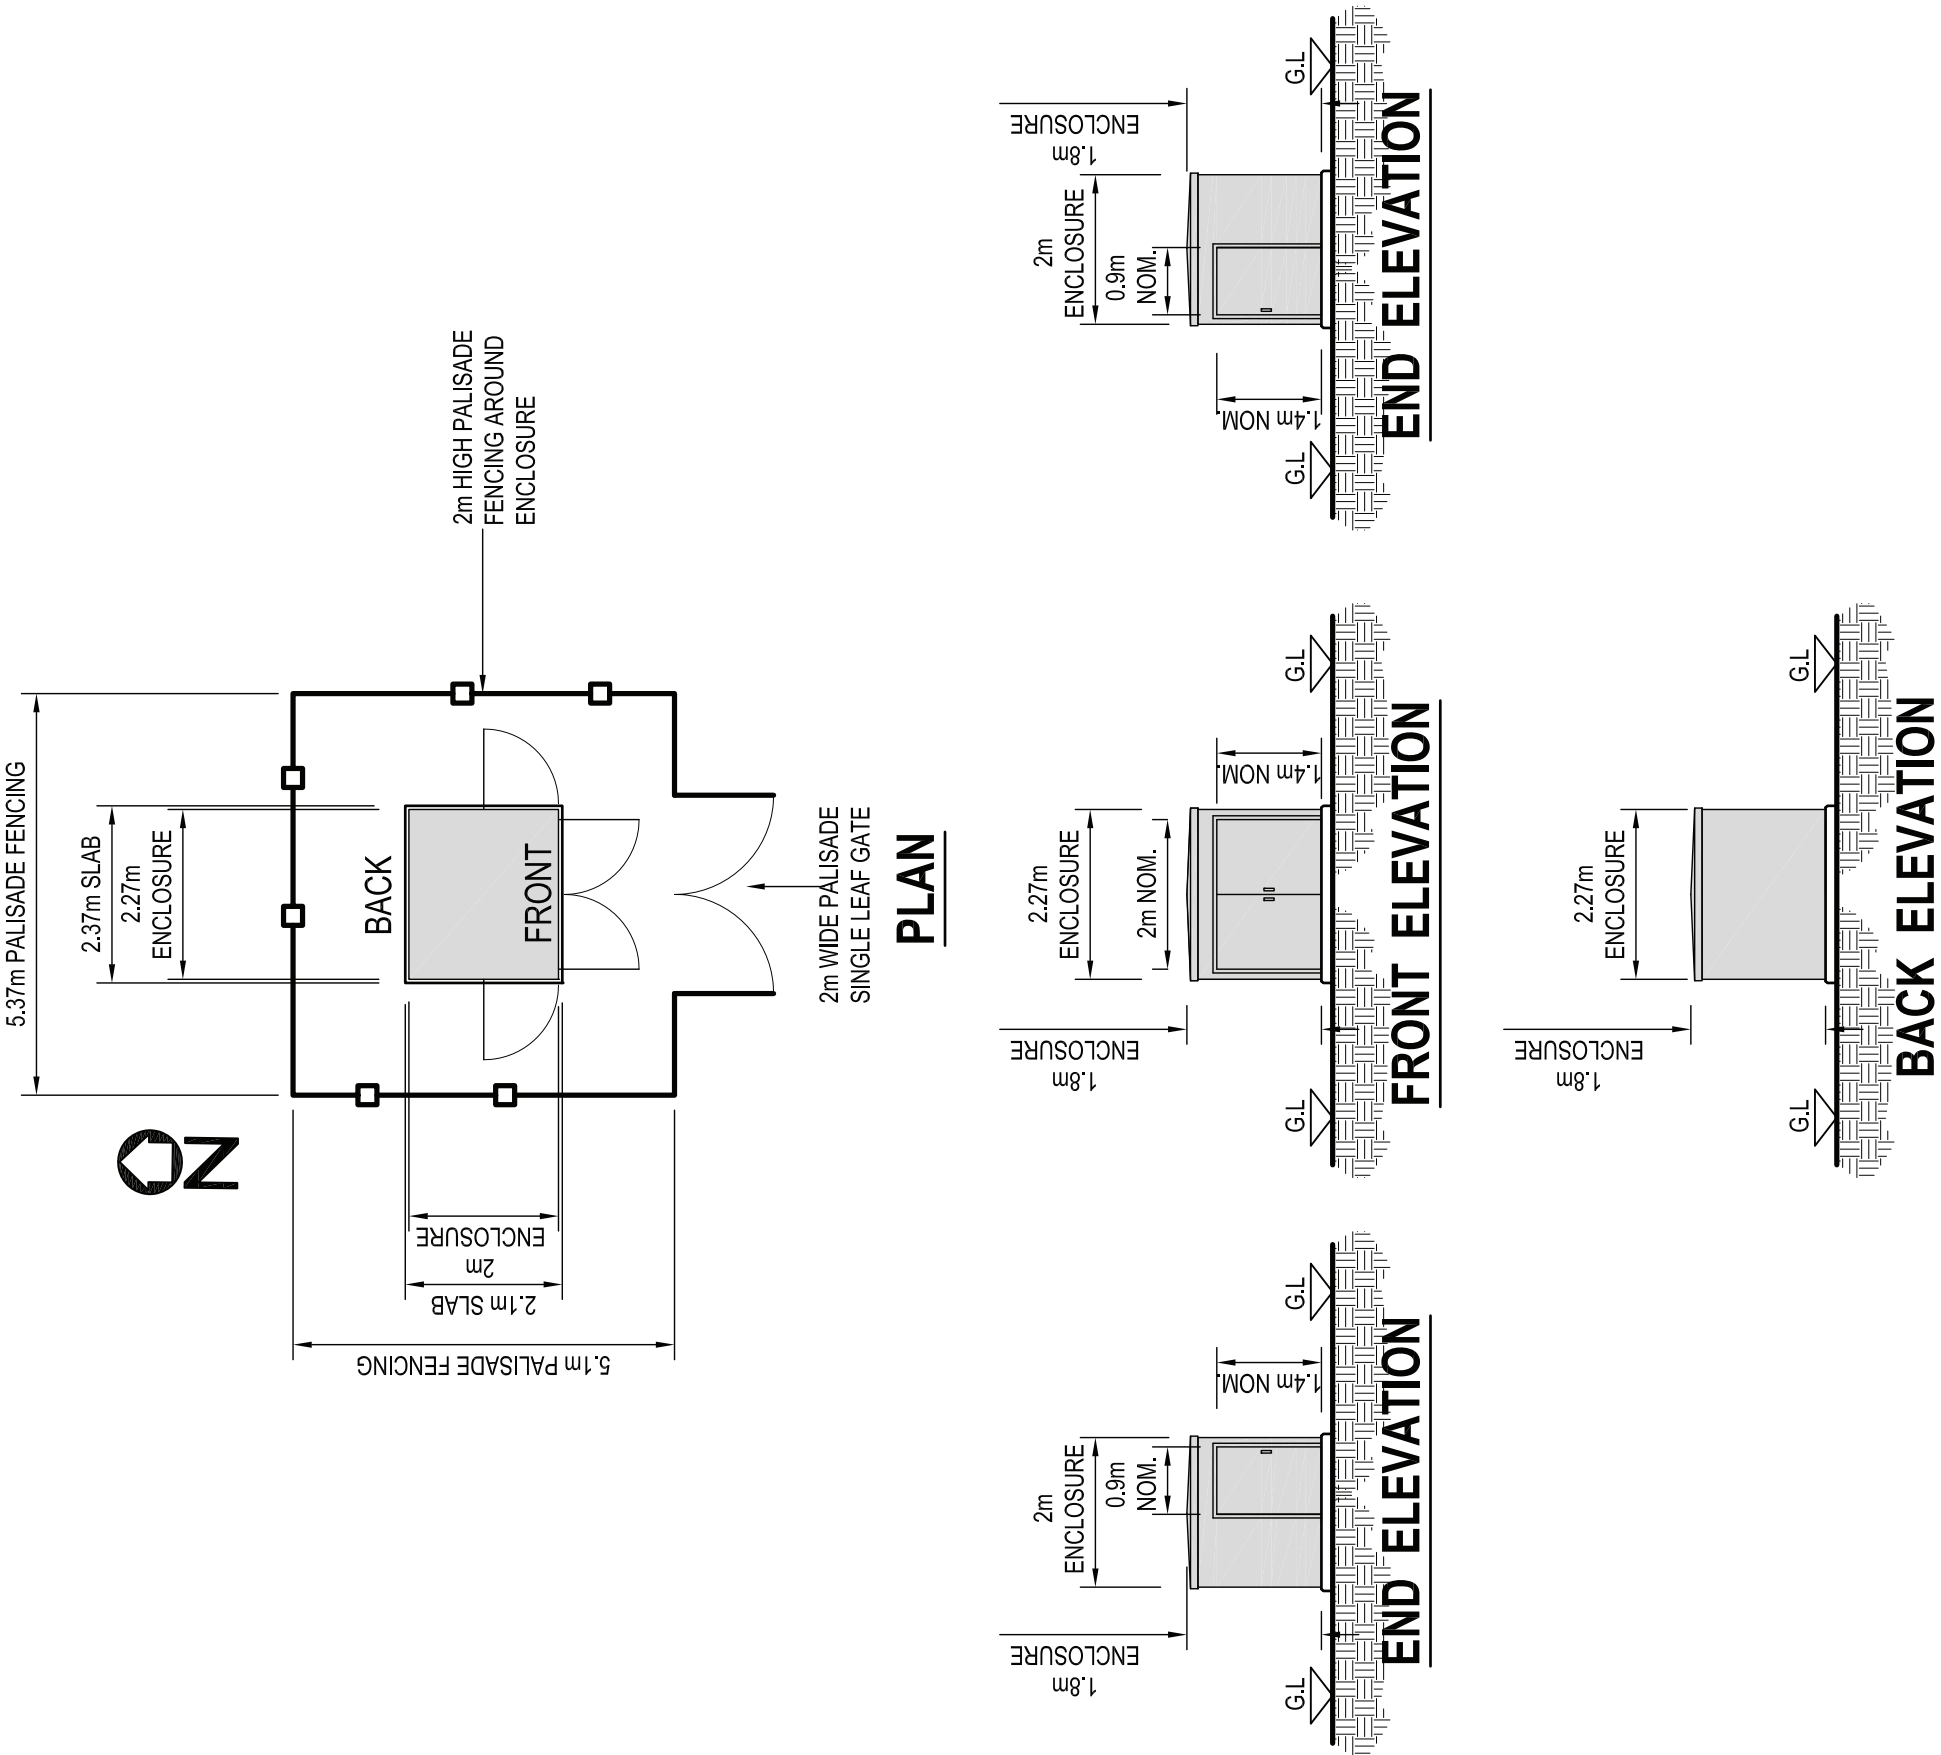

- ENCLOSURE NOTES:
1. ENCLOSURE TO CONSIST OF STEEL.
 2. ENCLOSURE TO BE INSTALLED ON REINFORCED CONCRETE BASE SLAB COLOURED GREY. TOP OF BASE TO BE 150mm ABOVE FINISHED GROUND LEVEL.

PROPOSED TRANSFORMER & RING MAIN UNIT IN STEEL ENCLOSURE DETAILS SCALE 1:100



Rev.	Nature of Revision	Drawn	Chkd.	Appt.	Date

PLANNING

		
DC-WW Unique Ref. A981 SJ040.021	Cosain Ref. 2480265	Intech Ref. P1607
NORTH WALES AMP4 PROGRAMME		
FIVE FORDS SLUDGE TREATMENT & SUSTAINABLE ENERGY		

PROPOSED MISCELLANEOUS DETAILS

   Dŵr Cymru - Welsh Water Versys St Davids Park, Ewloe, FLINTSHIRE, CH6 3DT Tel: 01244 529700 Fax: 01244 529898		
Drawn WJW	Checked LFM	Approved JMo
Date NOV/09	Scale AS SHOWN AT A1	
Designer's Ref. 60098354-10.009	Drawing no. 2480265_1000_2406	Rev A0