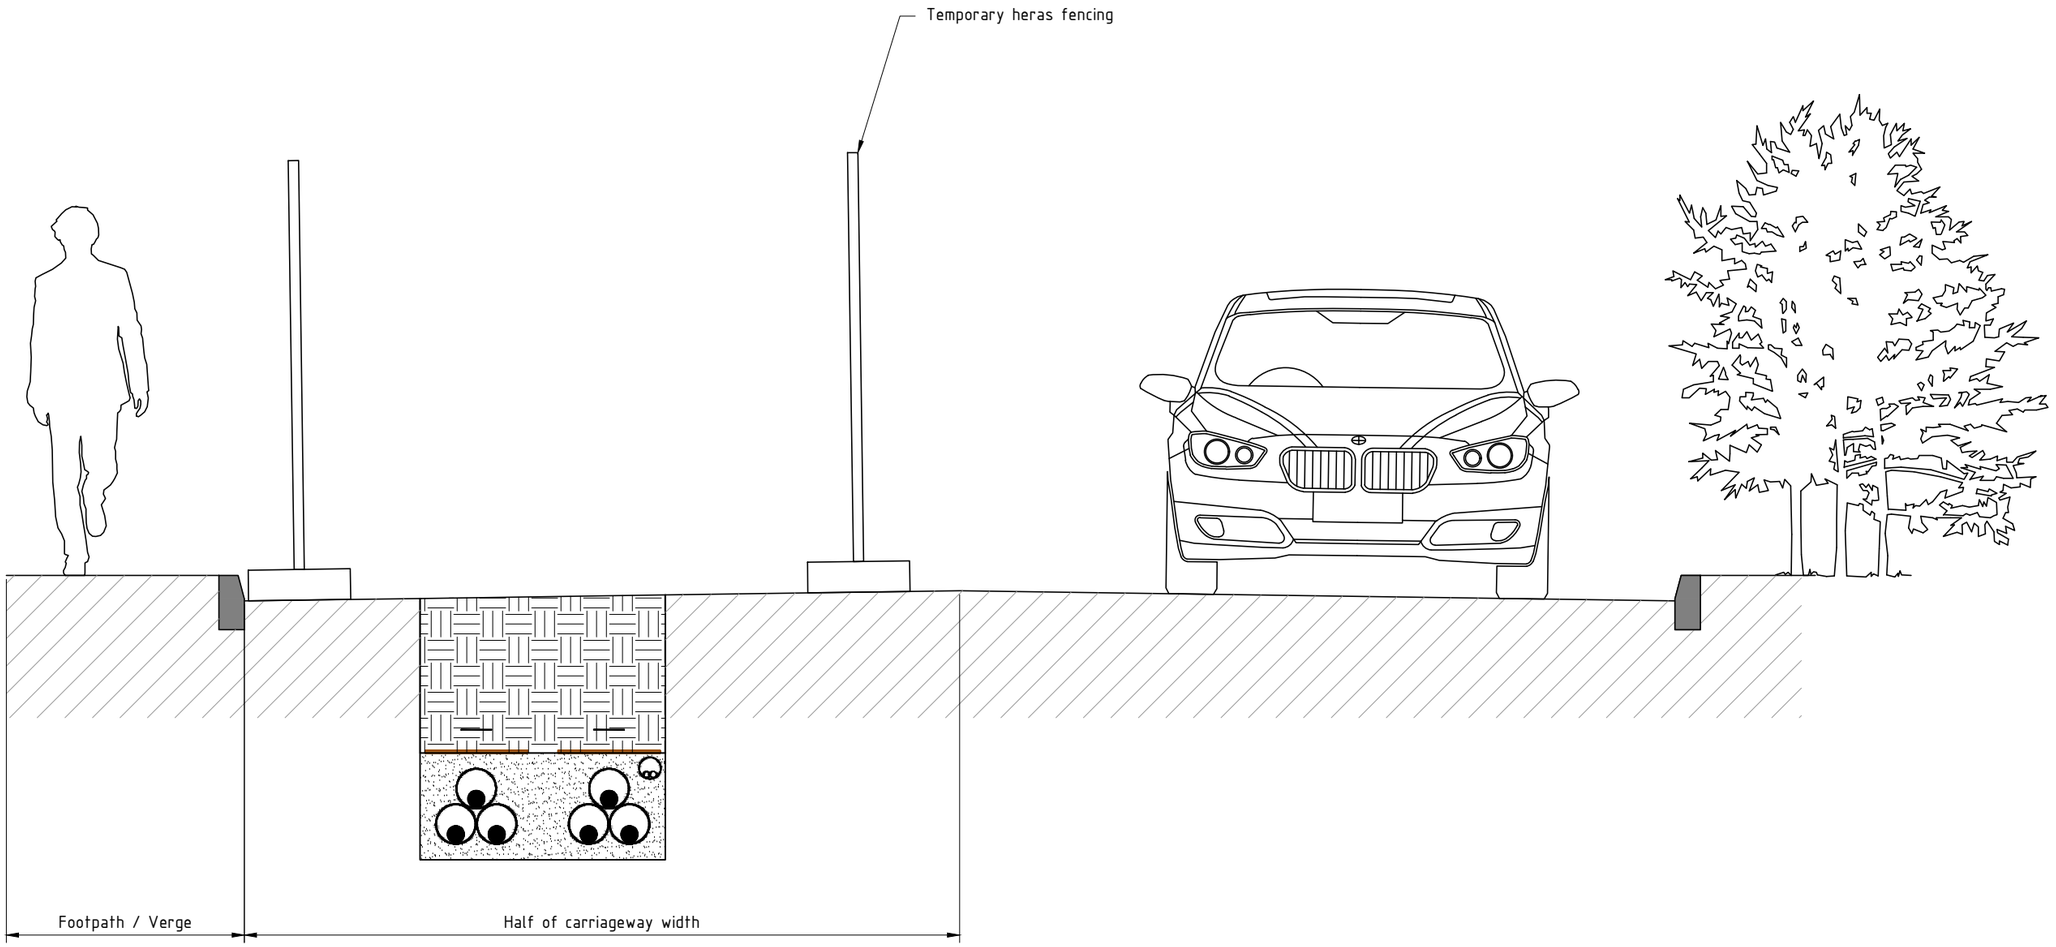


KRONOSPAN STATUS
Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	.....
Cc3		WARNING	
Cc4		Not receiving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full responsibility of the listed commenters and / or approvers.	
Cc5			
Cc6	.....		
CERTIFIED	Date YYYY-MM-DD		

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Index	Modification	Date	Name

Status

xylo TECHNOLOGIES
Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

kronospan

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		


Size: A3
Scale: 1:30
origin
Norm: ISO

Project number
Project name

Description
132kV Cable installation cross sections
Typical double 132kV Circuit and fibre in carriageway

Drawing number: 8000_261
Index:
Sheet/Number: 1/10

Sub Category .
Division .
Process .
Subprocess .

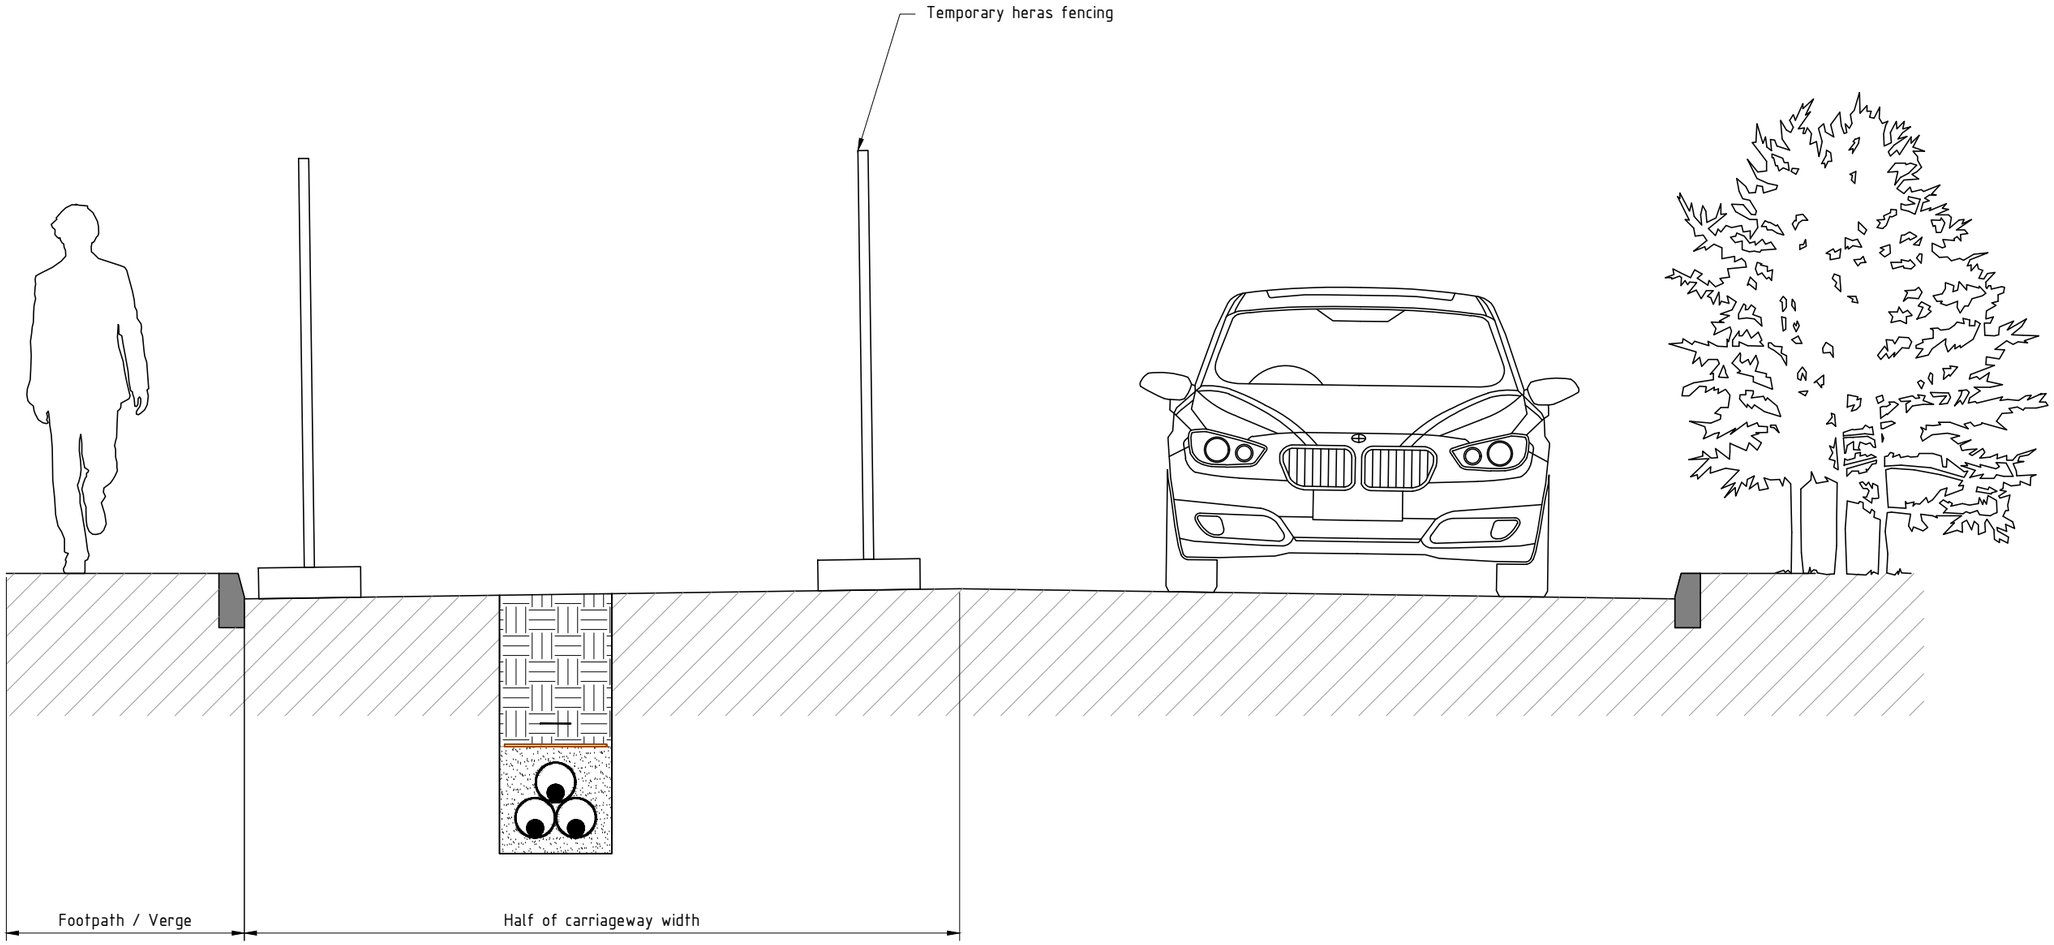

KRONOSPAN STATUS			
Date	16/10/2025		
STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	.....
Cc3		WARNING	
Cc4		Not receving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full responsibility of the listed commenters and / or approvers.	
Cc5			
Cc6	.....		
CERTIFIED	Date YYYY-MM-DD		

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Index	Modification	Date	Name

Status

Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		

Size: A3
Scale: 1:30
origin
Norm: ISO

Project number
Project name


Description

132kV Cable installation cross sections

Typical single 132kV Circuit in carriageway

Drawing number	Index	Sheet/Number
8000_261		2 / 10

Sub Category .
Division .
Process .
Subprocess .

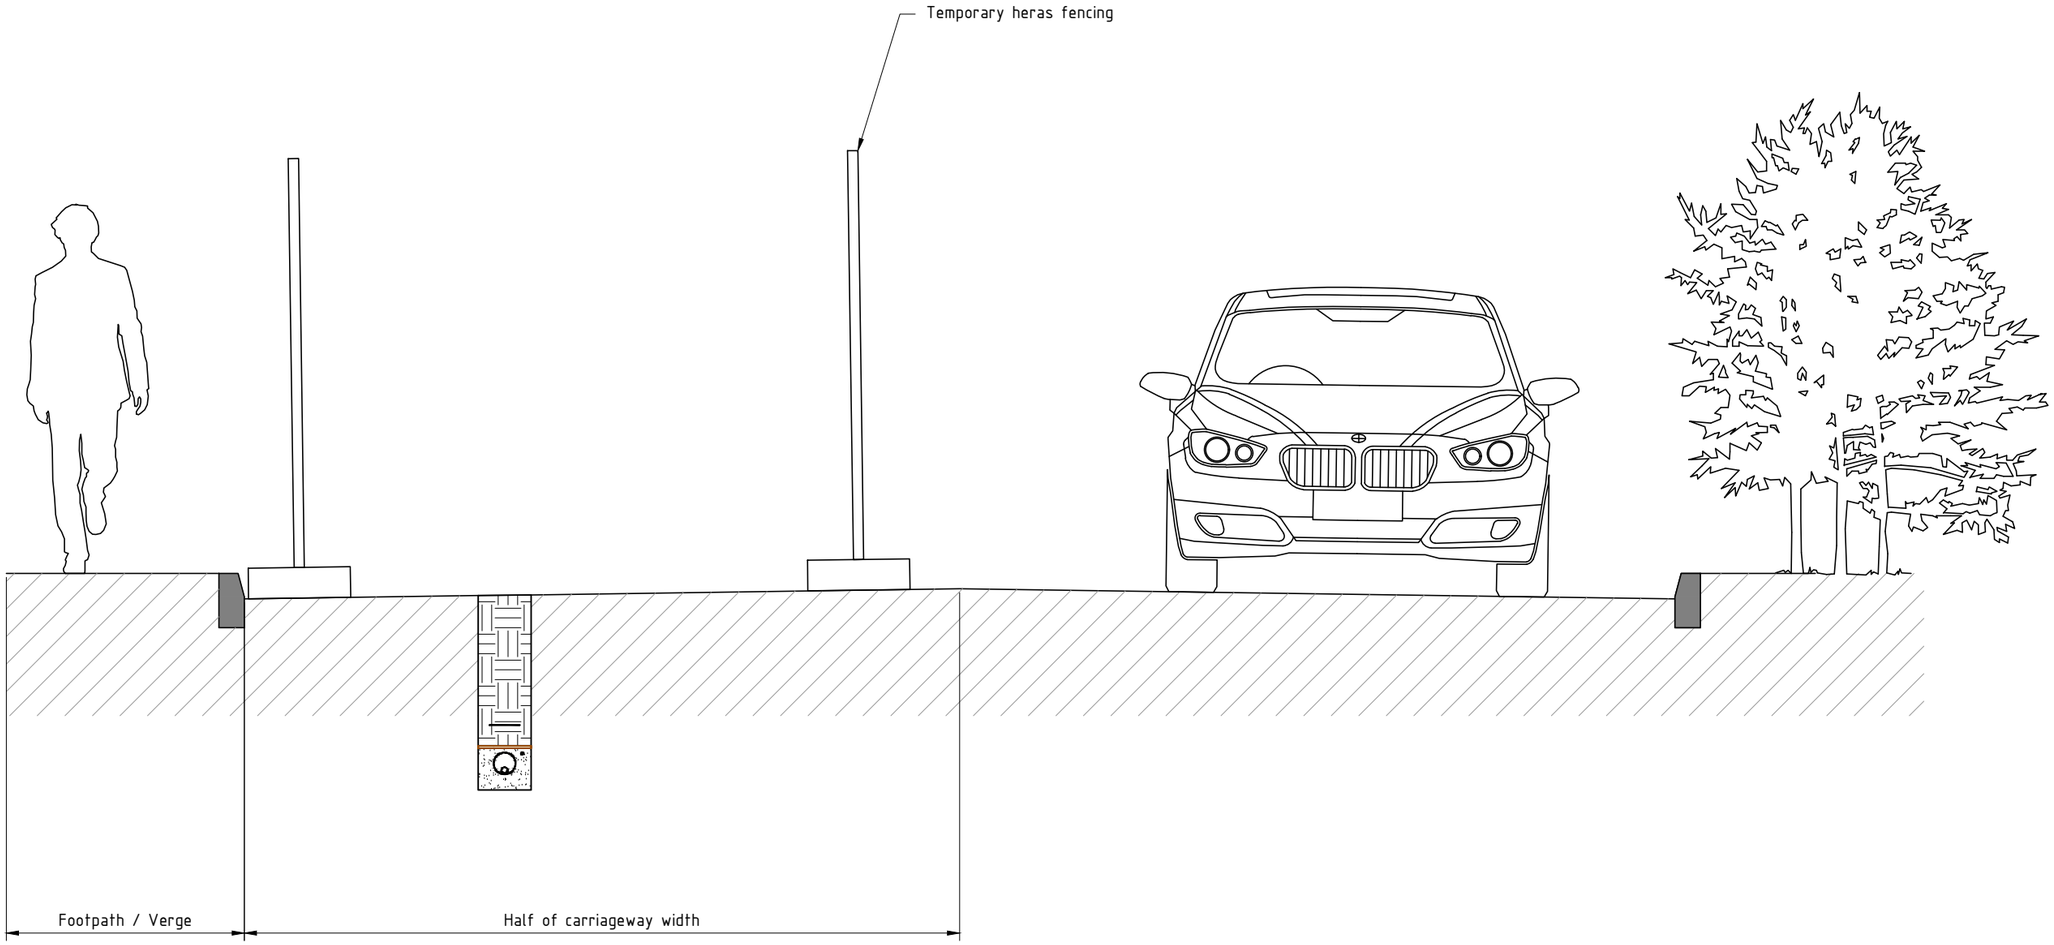

KRONOSPAN STATUS
Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	.....
Cc3		WARNING	
Cc4		Not receiving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full responsibility of the listed commenters and / or approvers.	
Cc5			
Cc6	.....		
CERTIFIED	Date YYYY-MM-DD		

Index	Modification	Date	Name

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Status

Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		


Size: A3
Scale: 1:30
origin
Norm: ISO

Project number
Project name

Description
132kV Cable installation cross sections
Typical fibre trench in carriageway

Drawing number: 8000_261
Index:
Sheet/Number: 3 / 10

Sub Category .
Division .
Process .
Subprocess .

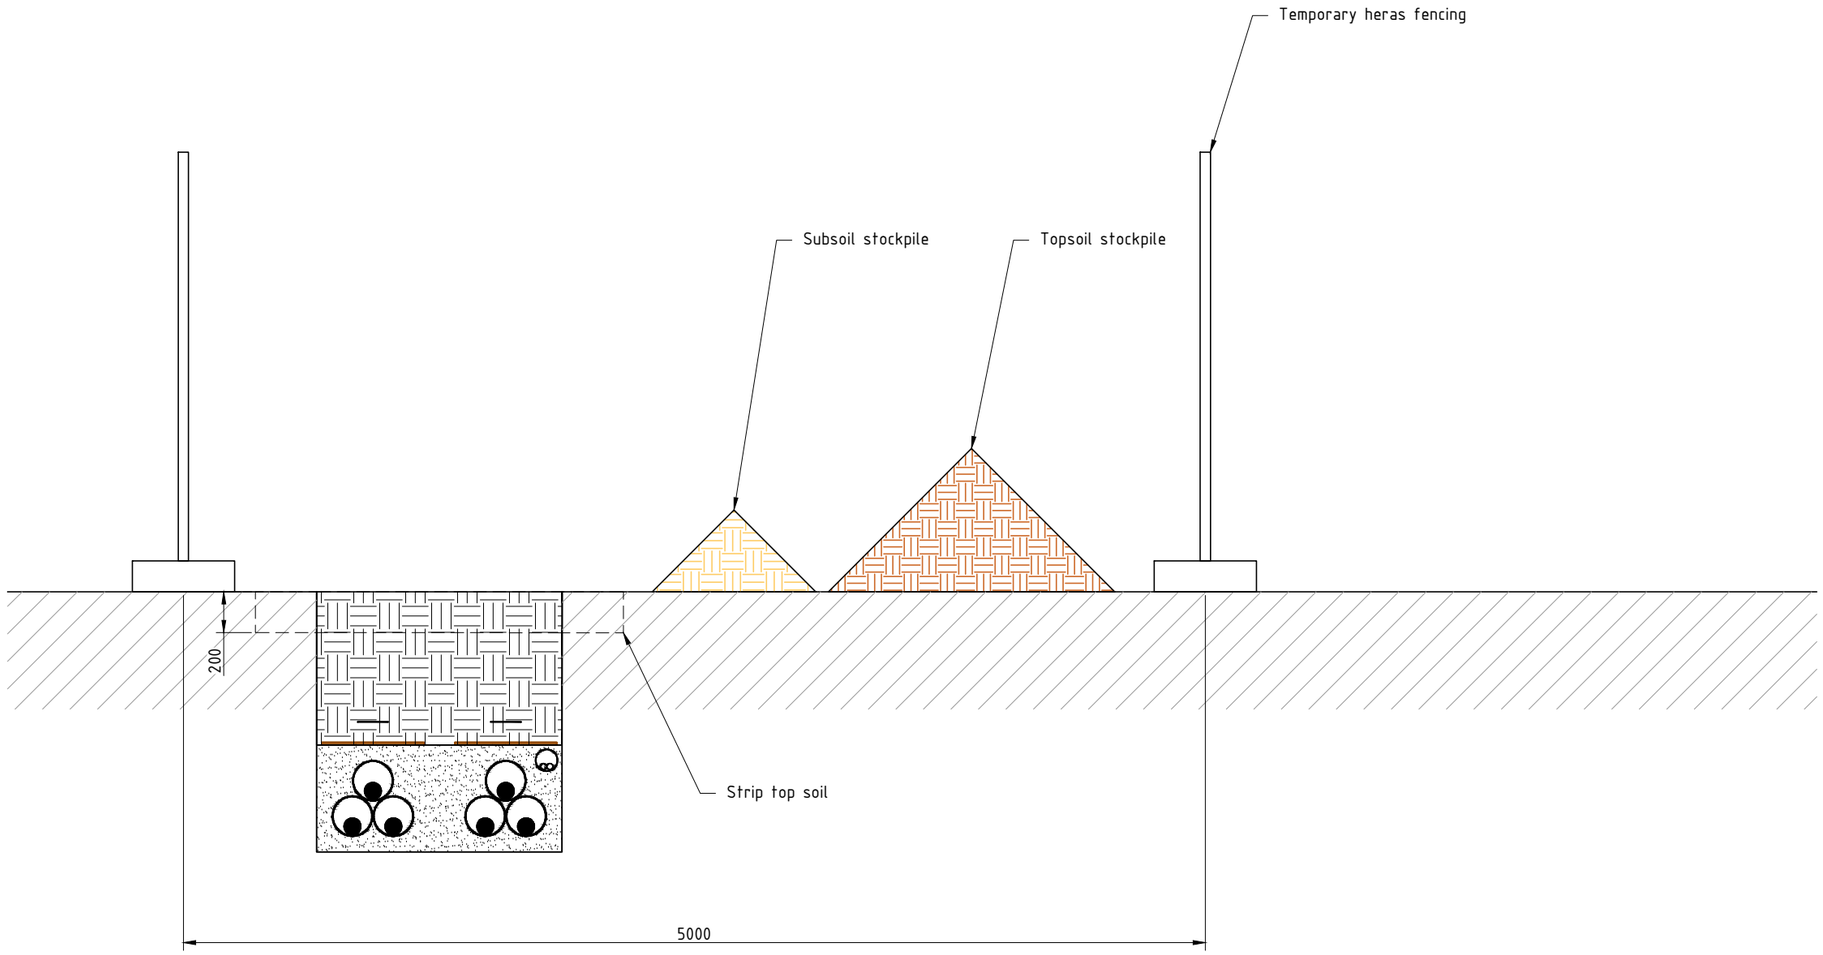

Index	Modification	Date	Name

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Status

Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		

Size: A3
Scale: 1:30
origin
Norm: ISO

Project number
Project name

Description

132kV Cable installation cross sections


Typical double 132kV Circuit and fibre in field

Drawing number: 8000_261
Index:
Sheet/Number: 4 / 10

Sub Category .
Division .
Process .
Subprocess .

KRONOSPAN STATUS
Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	.....
Cc3		WARNING	
Cc4		Not receiving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full responsibility of the listed commenters and / or approvers.	
Cc5			
Cc6	...		
CERTIFIED	Date YYYY-MM-DD		

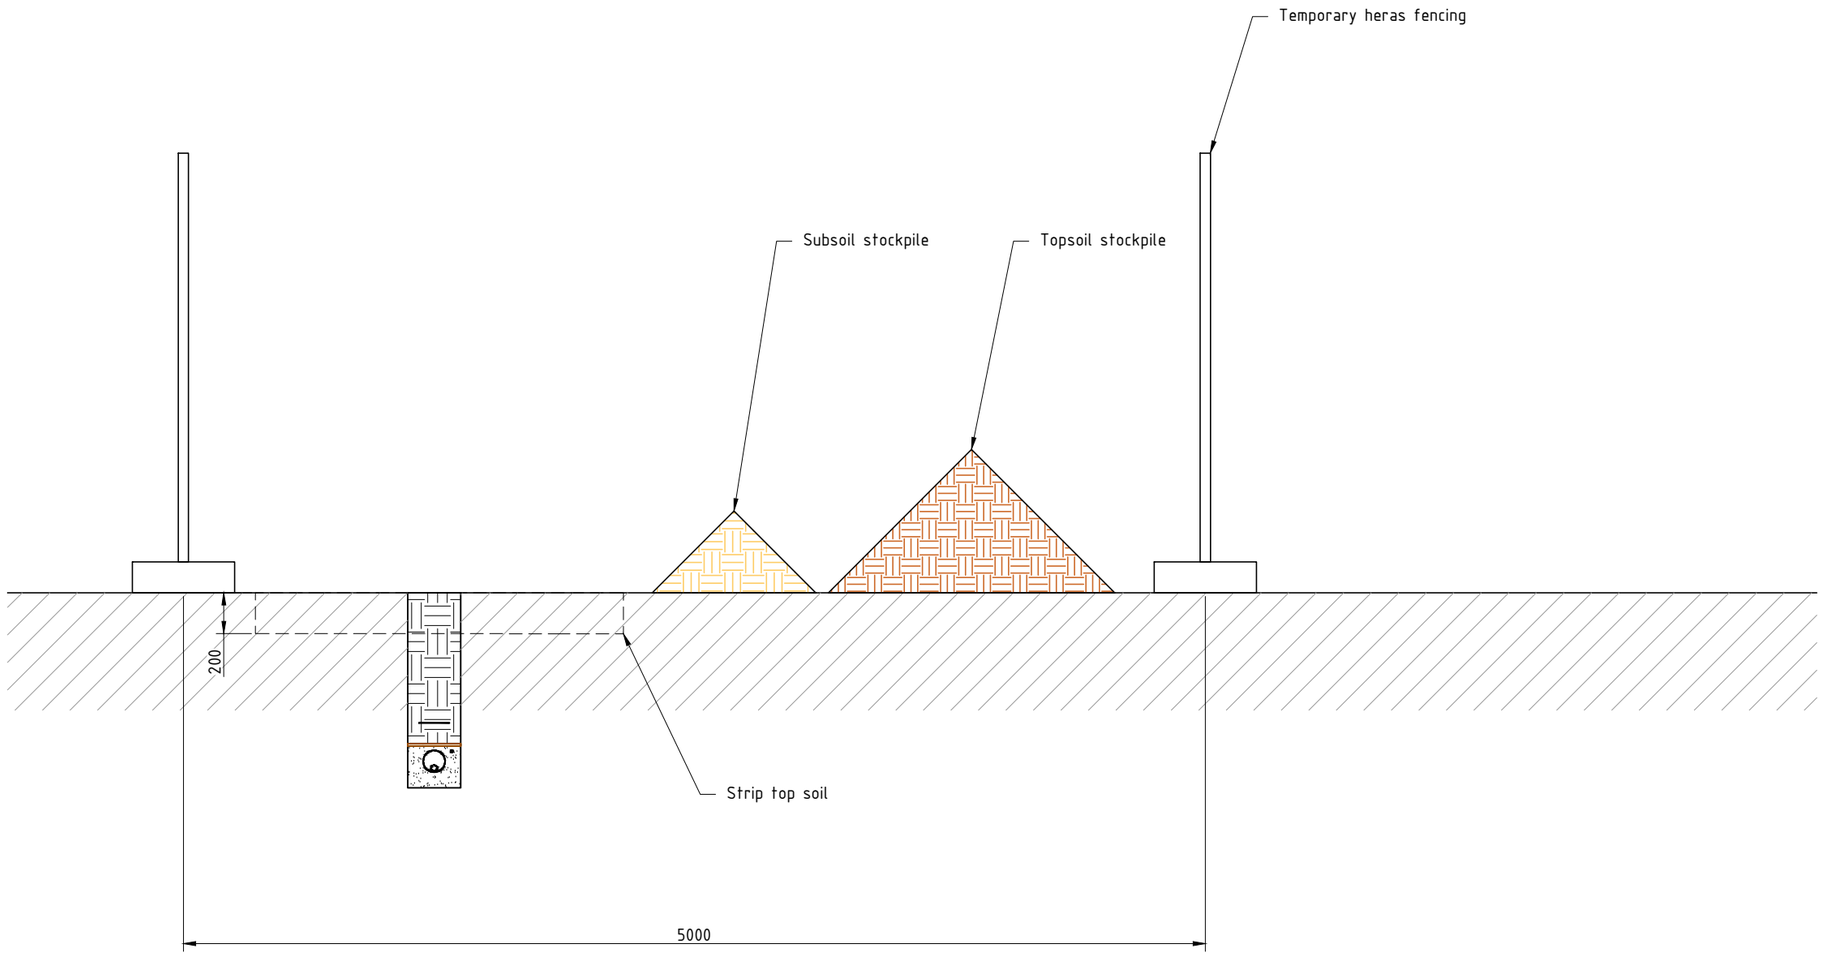

KRONOSPAN STATUS

Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		**WAITED APPROVAL**	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	.....
Cc3		**WARNING**	
Cc4		Not receving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full resposibility of the listed commenters and / or approvers.	
Cc5			
Cc6	.....		
CERTIFIED	Date YYYY-MM-DD		

Index	Modification	Date	Name

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Status

Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		

Size: A3

Scale: 1:30

origin

Norm: ISO

Project number

Project name

Description

132kV Cable installation cross sections

Typical fibre trench in field


Drawing number: 8000_261

Index

Sheet/Number: 5 / 10

Sub Category .
Division .

Process .
Subprocess .

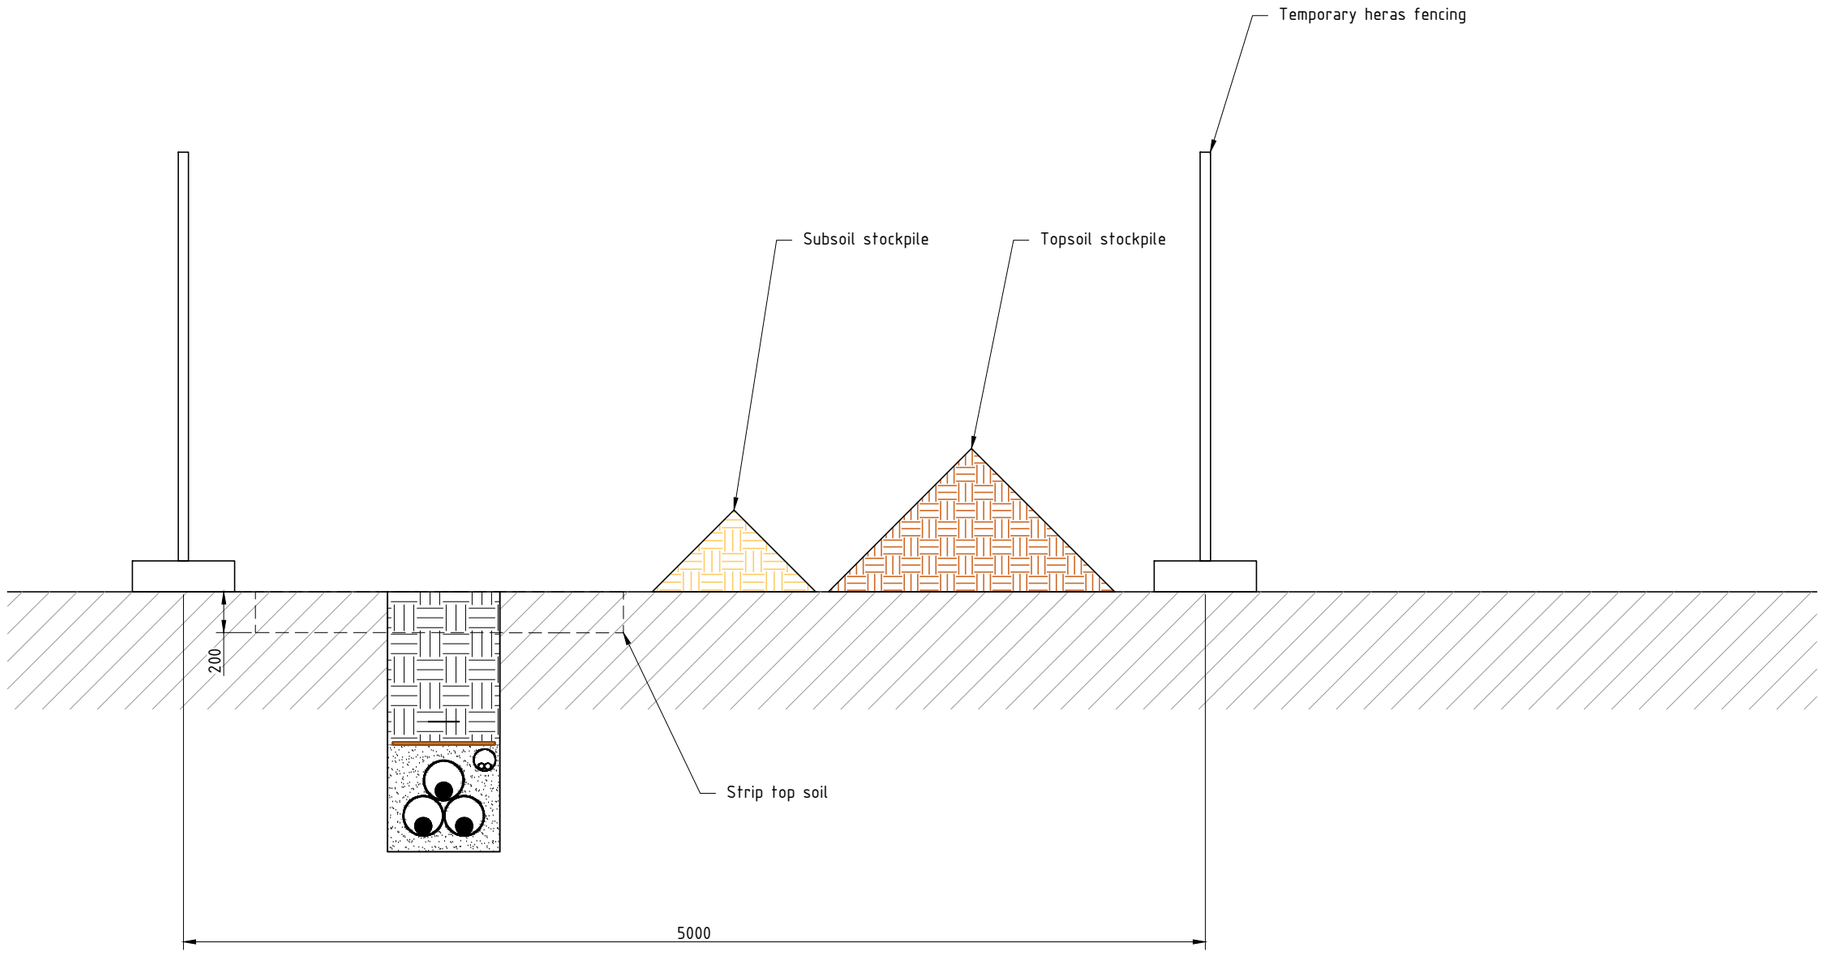

KRONOSPAN STATUS

Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	.....
Cc3		WARNING	
Cc4		Not receiving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full responsibility of the listed commenters and / or approvers.	
Cc5			
Cc6	....		
CERTIFIED	Date YYYY-MM-DD		

Index	Modification	Date	Name

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Status

xylo TECHNOLOGIES
Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

kronospan

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		

Size: A3 | Scale: 1:30 | origin | Norm: ISO

Project number | Project name

Description


132kV Cable installation cross sections

Typical single 132kV Circuit and fibre in field

Drawing number: 8000_261 | Index | Sheet/Number: 6 / 10

Sub Category . | Division .

Process . | Subprocess .

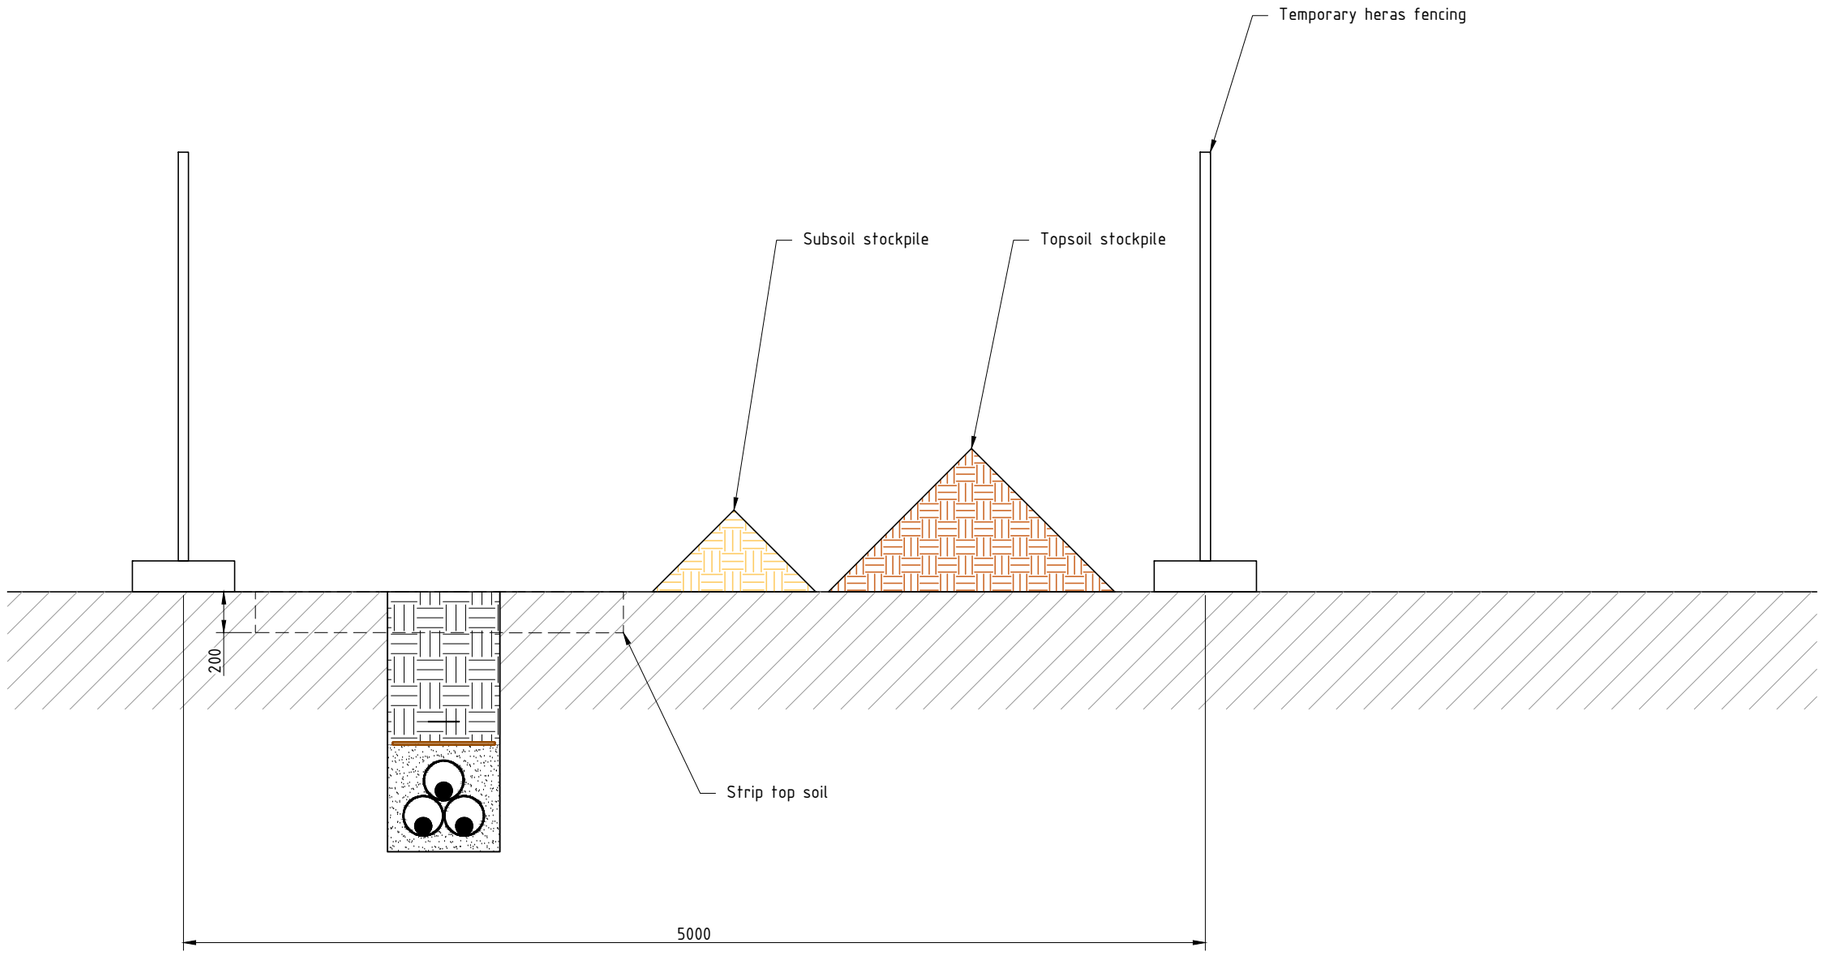

KRONOSPAN STATUS
Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	.....
Cc3		WARNING	
Cc4		Not receving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full responsibility of the listed commenters and / or approvers.	
Cc5			
Cc6	....		
CERTIFIED	Date YYYY-MM-DD		

Index	Modification	Date	Name

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Status

xylo TECHNOLOGIES
Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

kronospan

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		


Size: A3
Scale: 1:30
origin
Norm: ISO

Project number
Project name

Description
132kV Cable installation cross sections
Typical single 132kV Circuit in field

Drawing number: 8000_261
Index:
Sheet/Number: 7 / 10

Sub Category .
Division .
Process .
Subprocess .

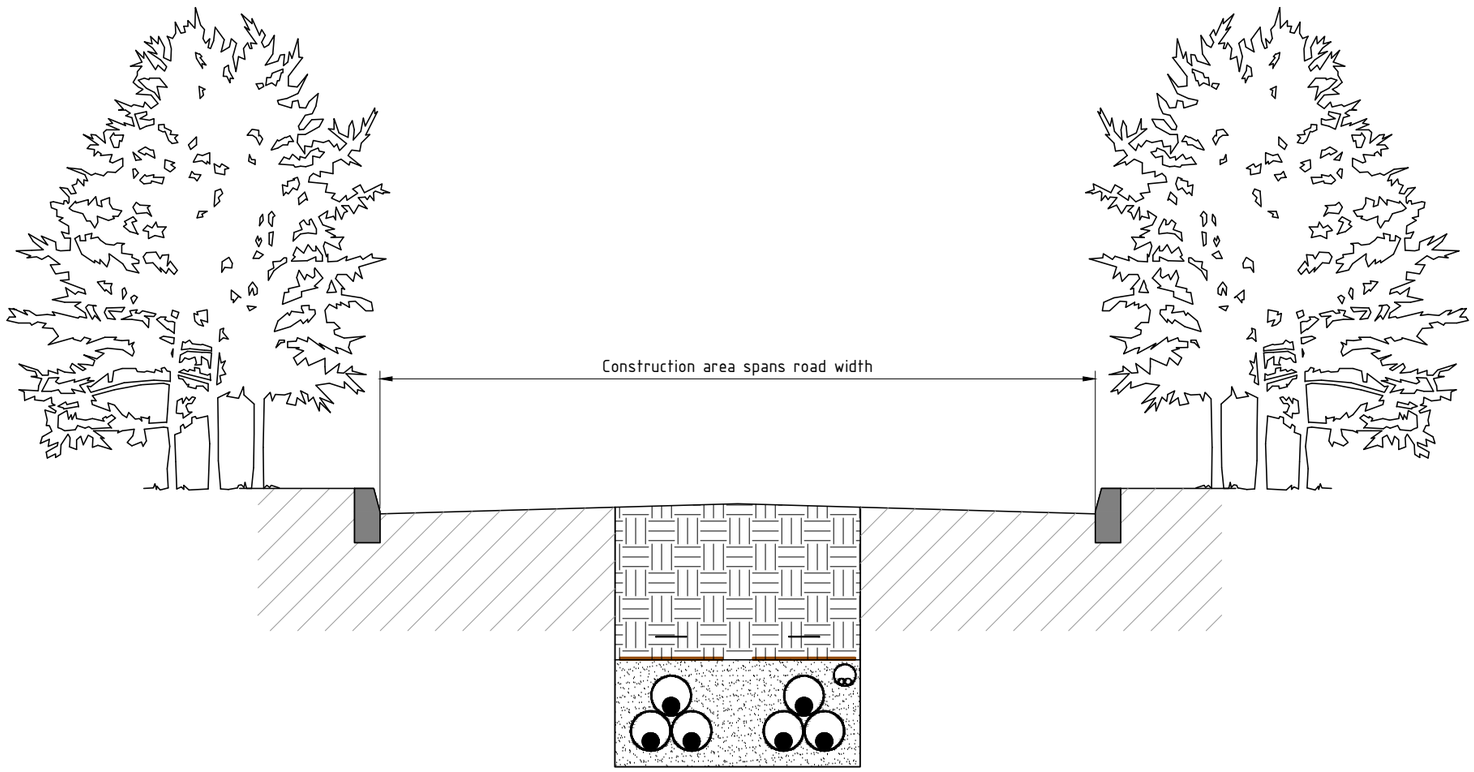

KRONOSPAN STATUS
Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	.....
Cc3		WARNING	
Cc4		Not receiving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full responsibility of the listed commenters and / or approvers.	
Cc5			
Cc6	.....		
CERTIFIED	Date YYYY-MM-DD		

Index	Modification	Date	Name

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Status

xylo TECHNOLOGIES
Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

kronospan

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		

Size: A3
Scale: 1:30
origin
Norm: ISO

Project number
Project name


Description

132kV Cable installation cross sections

Typical double 132kV Circuit and fibre in narrow road

Drawing number: 8000_261
Index:
Sheet/Number: 8 / 10

Sub Category .
Division .
Process .
Subprocess .

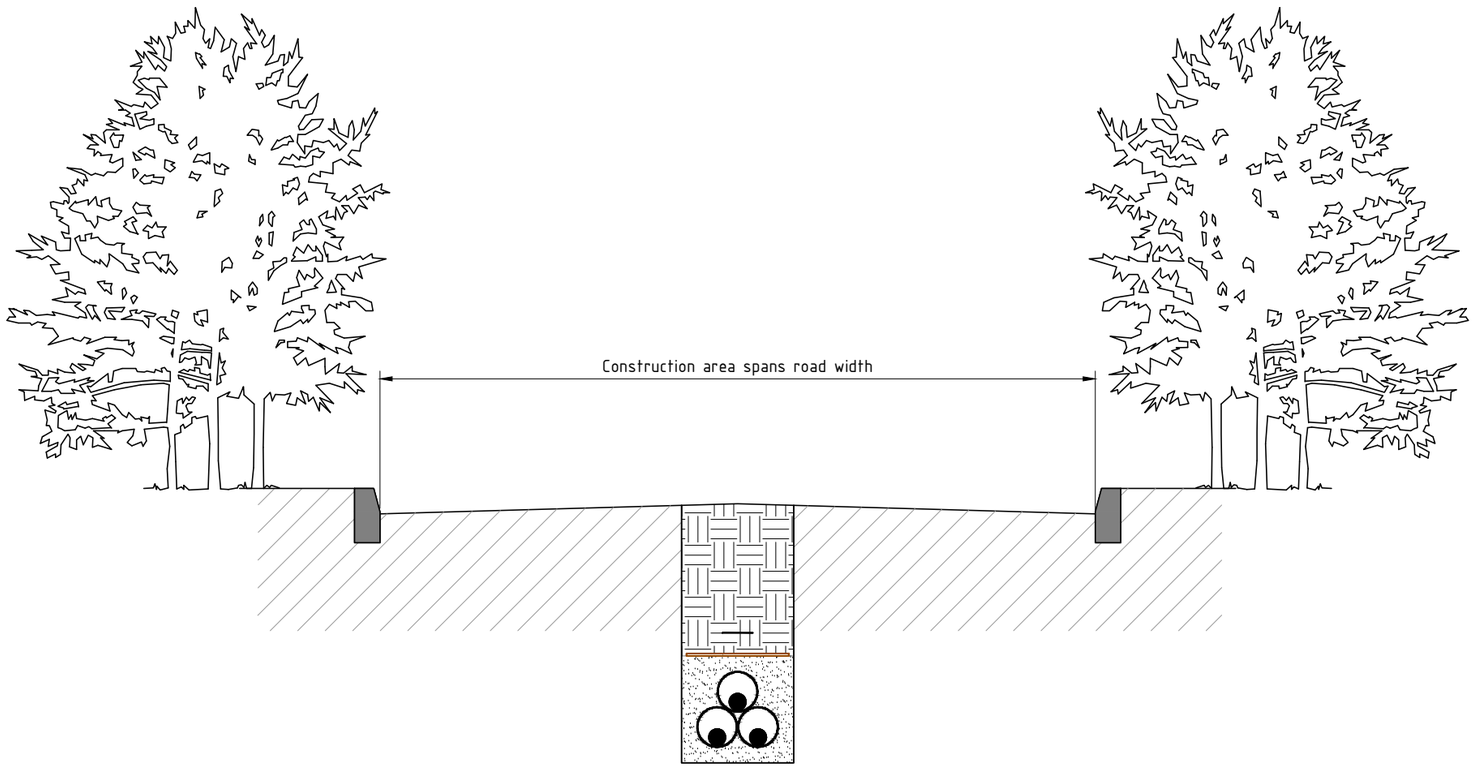

KRONOSPAN STATUS
Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	
Cc3		WARNING	
Cc4		Not receving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full responsibility of the listed commenters and / or approvers.	
Cc5			
Cc6			
CERTIFIED	Date YYYY-MM-DD		

Index	Modification	Date	Name

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Status

Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		

Size: A3
Scale: 1:30
origin
Norm: ISO

Project number
Project name


Description

132kV Cable installation cross sections

Typical single 132kV Circuit in narrow road

Drawing number	Index	Sheet/Number
8000_261		9 / 10

Sub Category	.	Process	.
Division	.	Subprocess	.

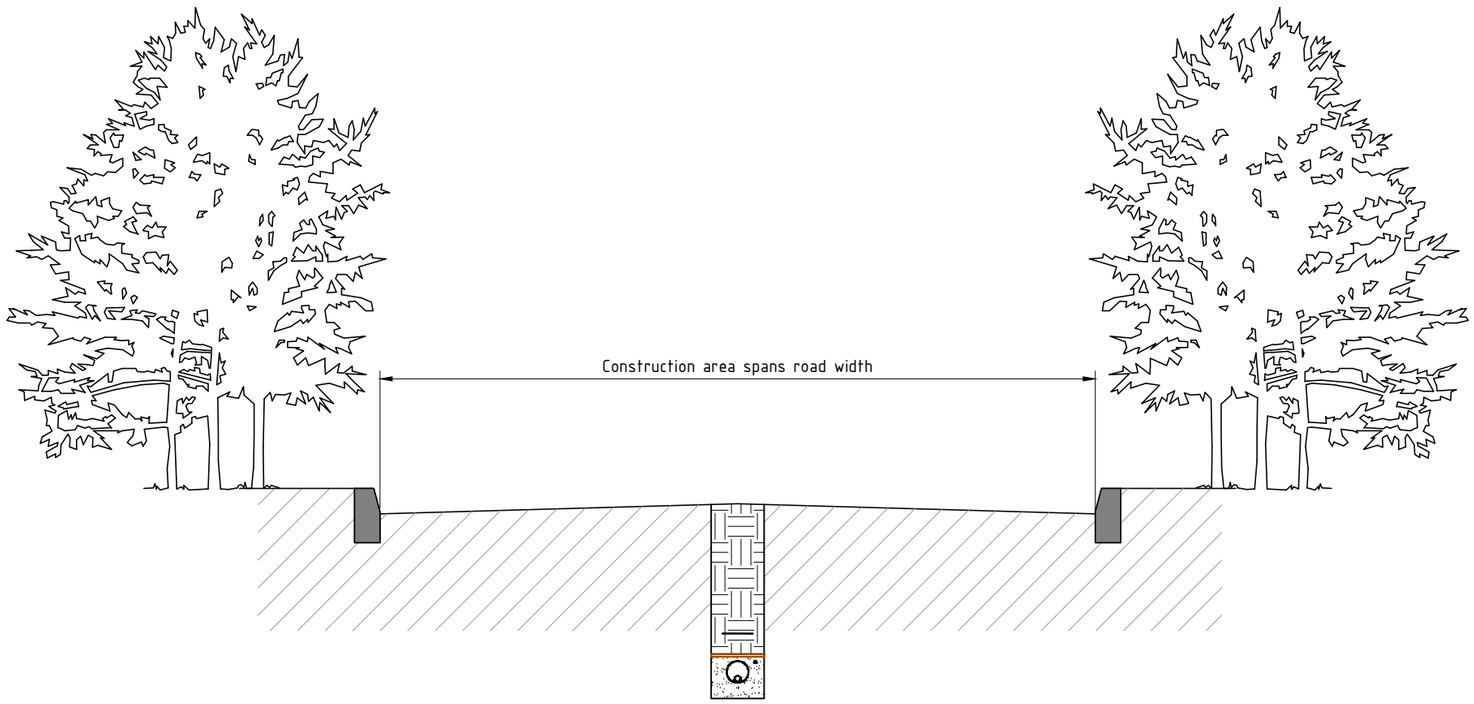

KRONOSPAN STATUS

Date 16/10/2025

STATUS		WAITED COMMENTS	
By	KRONOSPAN	Deadline	YYYY-MM-DD
Date	YYYY-MM-DD	By	.....
By		By	.....
		By	.....
DISTRIBUTION		WAITED APPROVAL	
Date	YYYY-MM-DD	Deadline	YYYY-MM-DD
Attn	#####	By	
Cc1		By	
Cc2		By	...
Cc3		WARNING	
Cc4		Not receving comments and / or approval within above deadlines, the drawing is intended as "APPROVED" under full resposibility of the listed commenters and / or approvers.	
Cc5			
Cc6	....		
CERTIFIED	Date YYYY-MM-DD		

Index	Modification	Date	Name

Confidentiality
This drawing is the property of Kronoplus Technical AG.
Unauthorised distribution or utilisation without prior written authorisation is forbidden and may be unlawful.

Status

Xylo Technologies AG
Rütihofstrasse 1
CH-9052 Niederteufen
Schweiz

Technology

Kronospan Ltd
Maesgwyn Farm
LL14 5NT Chirk, Wrexham
United Kingdom

	Date	Name
Project leader	16/10/2025	M. Titcombe
Drawn	16/10/2025	A. Hilditch
Checked		

Size: A3 | Scale: 1:30 | origin | Norm: ISO

Project number | Project name

Description

132kV Cable installation cross sections

Typical fibre trench in narrow road

Drawing number: 8000_261 | Index | Sheet/Number: 10 / 10

Sub Category . | Process .
Division . | Subprocess .