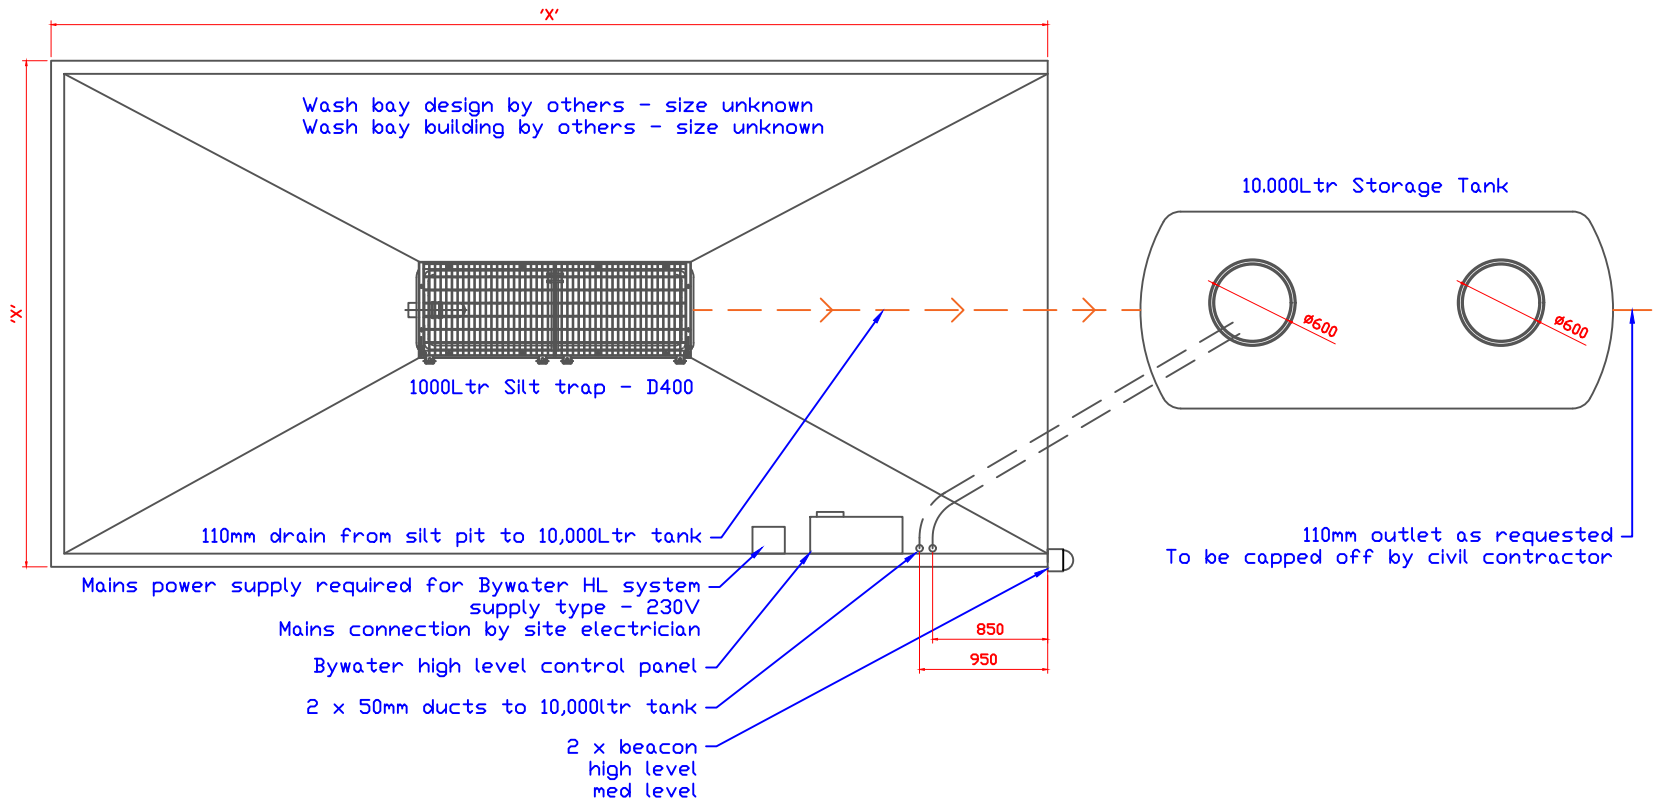


Important Notes

- Incoming power and final connection by others.
- 10,000Ltr Tank, 1,000Ltr silt trap & lids to be supplied by Bywater - to be unloaded by customer
- All ground-work, sub terrain pipes, ducting by others.
- The construction design of the wash slab and plant room base by others.
- All ducts to have draw cord.
- All services and duct routes shown on the drawing for clarity - exact route to be determined on site.
- All underground service pipes (not 110Ø drain) to extend min 350mm past ground level at each end and to be one piece without fittings
- Exact location of 10,000 Litre sump can be to suit site conditions but suction pipe should be less than 20 metres total distance.
- Actual wash pad dimensions and falls to suit equipment being installed and to suit site
- Equipment installation is to a fully prepared site with all services available.
- If in doubt - Ask

ByWater Services Ltd
Unit 7 Telford Way
Stephenson Ind Est
Coalville Leics LE67 3HE
t: 01530 833 469
e: sales@bywaterservices.co.uk

Title: BSL1420 - Prysmian Cables Wrexham
Proposed Layout

Key:

Dimensions in: mm
NOT TO SCALE

This drawing is copyright and must not be reproduced without written permission of ByWater Services Ltd

Drawing No: BY3453
Issue: 1
Revision: 1
Page: 1of1

Rev	Drawn by	Date	Approd	Date	Details
1	AK	05.08.26	Unapproved		First Issue

ByWater Services Ltd reserve the right to change specification without notice