

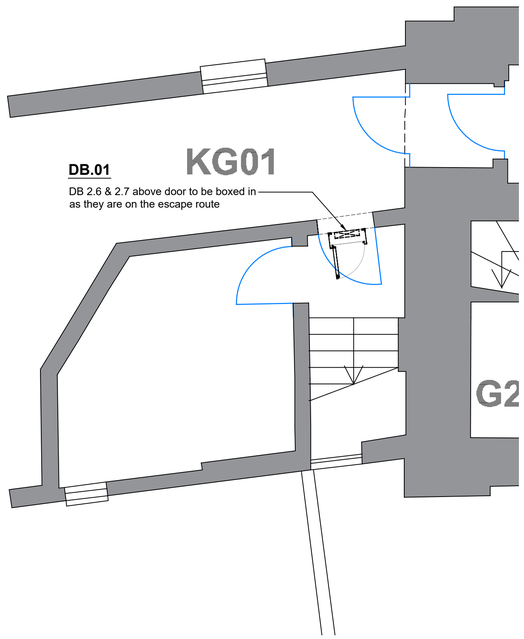



Location Plan for Proposed Distribution Boards
1:50 @ A1

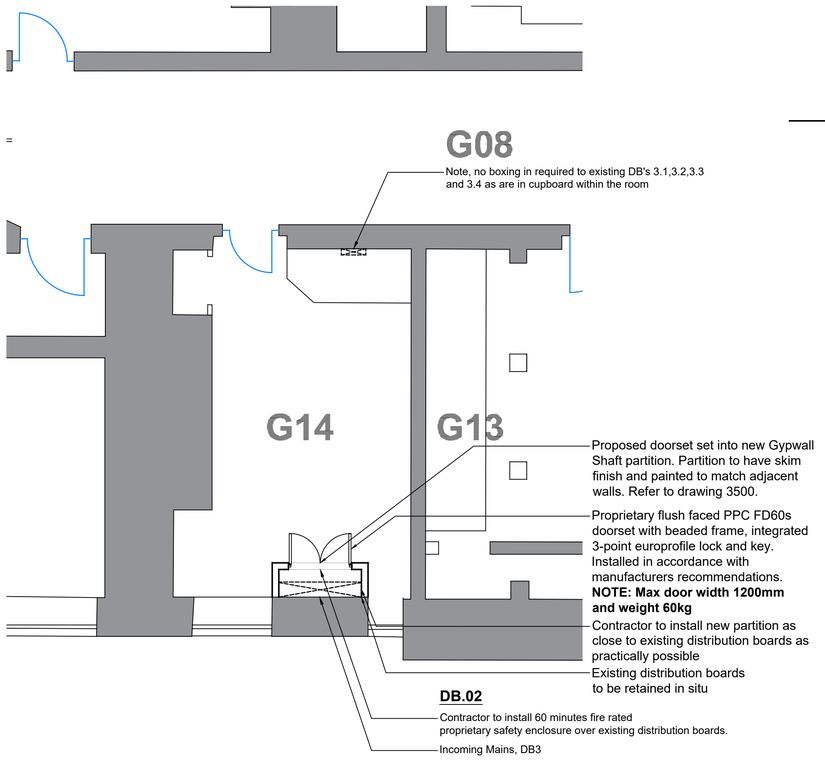

Location Plan for Proposed Distribution Boards
1:50 @ A1

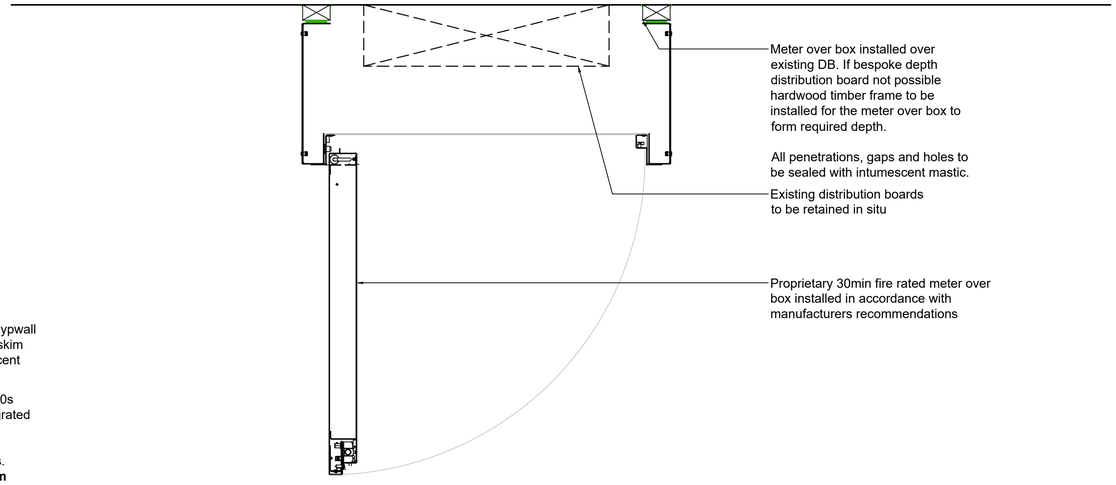

Typical Detail for Proposed Distribution Boards
1:5 @ A1

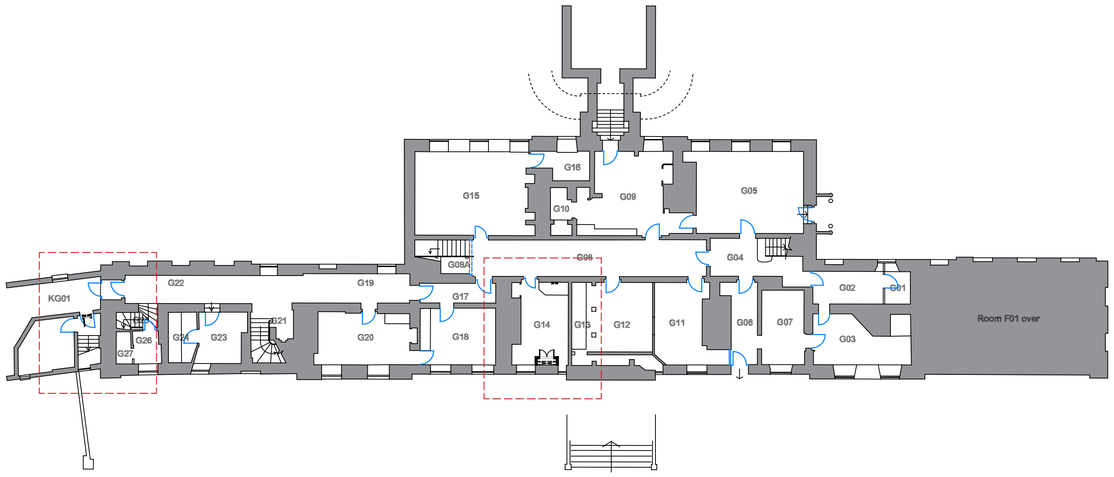

Key Plan for Distribution Boards
NTS @ A1

Seal holes in ceiling with intumescent mastic before boxing in.

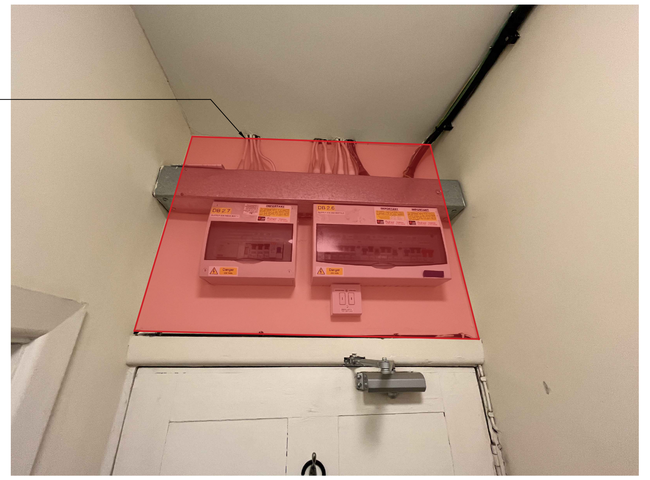


Image 01
Electrical box viewed from inside KG13 to be boxed up as it is above emergency escape route

DB.01

Check ceiling above 2no. small boxes for holes.
If found, seal holes in ceiling with intumescent mastic before boxing in.



Image 02
Electrical box DB3 viewed from inside G14 to be enclosed

DB.02

Notes

1. Any dwg format drawing is to be read in conjunction with and at the scale of the accompanying pdf.
2. Where colours other than black or grey are used, the drawing must be plotted in colour.
3. For status 'C' (Construction) drawings all dimensions are to be checked on site by the contractor, scaling is for Local Authority purposes only.
4. Unless otherwise indicated, all dimensions are in millimeters.
5. All information on this drawing is to be read in conjunction with the relevant Donald Insall Associates specification and trade contractors' drawings and information by specialists.
6. In the event of any discrepancy, please contact us immediately.
7. This drawing may contain survey information by others and is to be used solely for the purposes for which it was issued.
8. These are uncontrolled documents issued for information purposes only. If you have any queries regarding the drawings, please contact DIA immediately.
9. Please note DIA cannot be held responsible for any errors arising from changes made to an uncontrolled dwg file.

© 2019 DONALD INSALL ASSOCIATES LTD

Drawing Status

- **F** Feasibility
- **S** Sketch Design
- **P** Planning
- **B** Building Control
- **D** Developed Design
- **M** Measurement
- **T** Tender
- **C** Construction
- **R** Record

Rev	Date	Dwn	Auth	Revision
3	29-06-2026	CSH	CSH	Enclosure for DB.02 updated
2	16-02-2024	SZA	CSH	RIBA 3 for consents
1	25-01-2024	CSH	MTO	Updated to fire engineer comments
0	17-01-2024	SZA	CSH	Initial Issue

Donald Insall Associates
Chartered Architects and Historic Building Consultants
Y Becws, Pool Lane
Conwy LL32 8PZ
(+44) 01492 592 378
conwy@insall-architects.co.uk

Erddig Hall, Wrexham

Boxing in of Distribution Boards
Mansion Ground Floor

Project	No
NTWFS.02	2306
Scale (A1)	Status / Revision
1:10	P / 03